

APPENDIX K:
HYDROPOWER SYSTEMS TECHNICAL INFORMATION AND ANALYSIS

This page intentionally left blank

APPENDIX K:

HYDROPOWER SYSTEMS TECHNICAL INFORMATION AND ANALYSIS

This appendix provides details on three analyses that are related to hydropower system electricity production, powerplant capacity, costs, and electricity service charge rates and that are conducted for the Glen Canyon Dam Long-Term Experiment and Management Plan (LTEMP) Environmental Impact Statement (EIS). The first analysis (presented in Section K.1) evaluated the impacts of changes in Glen Canyon Dam operations associated with LTEMP alternatives on the economic value of the powerplant's capacity and energy production. The impacts were measured in terms of changes in the value of regional power system capacity (the power system comprised of Western Area Power Administration's (WAPA's) long-term firm (LTF) customers) and overall system-level electricity production costs (the entire Western Interconnection). The second analysis (presented in Section K.2) studied how system resources and operations under LTEMP alternatives affect the wholesale electricity rates paid by LTF customers that receive federal preference power produced by Glen Canyon Dam. The third analysis (presented in Section K.3) studied the effects of alternatives on electricity rates paid by retail customers.

K.1 ECONOMIC VALUE OF GLEN CANYON DAM POWERPLANT CAPACITY AND ENERGY PRODUCTION

This first analysis studied the impacts of changes in Glen Canyon Dam Powerplant operations associated with LTEMP alternatives on the economic value of its capacity and energy production. Power system impacts are measured in terms of increases in capacity expansion expenditures and overall electricity production costs that would result from changing current Glen Canyon Dam operating criteria to different operating criteria as defined under LTEMP alternatives.

K.1.1 Power Systems Background

The Glen Canyon Dam Powerplant generates large amounts of energy that yield economic benefits to the grid. It also provides the grid with firm capacity that contributes to system reliability. Argonne National Laboratory (Argonne) staff conducted a power systems analysis of Glen Canyon Dam's economic benefits under each of the LTEMP alternatives. These alternative-specific operating criteria are summarized in Table 2-1 of the EIS.

The total water release volume from Lake Powell during each water year (WY) is nearly identical under all alternatives (see Section 4.2). However, at varying restriction levels, alternative criteria define the daily and hourly operational flexibility at Glen Canyon Dam, and affect Lake Powell reservoir elevations and monthly water release volumes. LTEMP alternatives also differ in their inclusion of various experimental releases such as high flow experiments (HFEs) and trout management flows (TMFs). The frequencies of these experimental releases differ among the alternatives.

Glen Canyon Dam energy production serves the electricity demands (loads) of a dynamic system that responds to its operations. Therefore, economic impacts of changes in Glen Canyon Dam operations are measured for the system as a whole. Some of the responses to changes in Glen Canyon Dam operating criteria, such as system unit dispatch adjustments, would occur very quickly. System dispatch refers to the amount of generation that each powerplant unit produces over time to match system loads plus system energy losses. In contrast, other system responses are much slower. For example, Glen Canyon Dam operating criteria affect its maximum output at times of peak load, and therefore system-wide capacity expansion pathways; that is, the timing and type of new units that will be built in the future. This methodology measures the spectrum of system economic impacts from hourly time intervals to multi-year processes.

The system modeled consists of 11 hydropower plants (including the Glen Canyon Dam Powerplant) marketed and scheduled by the Colorado River Storage Project (CRSP) Management Center of WAPA, the loads of all LTF power customers, and the resources owned and operated by the eight LTF power customers that have the largest allocations of capacity and energy (see Section K.1.3.2 for more detail). The combined loads and resources of these entities are referred to at the Salt Lake City Area Integrated Projects (SLCA/IP) market system.

The economic impacts of LTEMP alternatives on the value of electricity within the Western Interconnection were determined, but the financial impacts on individual grid participants were not. Impacts on individuals are analyzed in the rate payer and wholesale rate analyses presented in Section K.3. The economic analysis presented here focuses on the total differences in the economic value of SLCA/IP federal hydropower resource among alternatives benchmarked to existing operating criteria (Alternative A). This difference is referred to as the economic cost of an alternative and is quantified as the net present value (NPV) of the cost that would be accrued during the 20-year LTEMP period. System interactions within the broader Western Interconnection are also represented. It should be noted that this is an economic analysis that measures the net cost difference for the system as a whole, not a financial analysis of individual entities (e.g., a utility company) that operate within the system.

Operating criteria impact power economics because they affect the timing and routing of water releases through the dam. From a system dispatch perspective, power produced by Glen Canyon Dam yields the highest economic benefits when the limited amount of water released during a WY is routed through the powerplant's generating turbines to produce power during seasons of the year and times of the day when it displaces either energy generation or demand curtailment from expensive grid resources. For example, Glen Canyon Dam has a high economic value when the energy it produces either reduces or eliminates the operation of a generating unit with a high production cost. On the other hand, it has a much lower value when it displaces lower-cost power generation.

During most HFEs, water release rates from Glen Canyon Dam are greater than the maximum flow rate of the powerplant's turbines. Therefore, some water is released through the dam's hollow jet tubes, bypassing powerplant turbines. Non-power water releases such as these produce no electricity and therefore yield no energy value. Because water is limited, the bypass water reduces the overall economic value of power because this water could have otherwise been

stored in Lake Powell and released to produce energy at another time to displace the dispatch of more costly system resources.

Glen Canyon Dam capacity also has considerable value because the powerplant can generate energy during times of peak demand. Without the Glen Canyon Dam Powerplant, other resources would need to be constructed or acquired in order to ensure that load-serving utilities have adequate generating capabilities available to reliably meet system loads. Operating criteria that affect the Glen Canyon Dam Powerplant's firm capacity may impact WAPA's firm commitment levels to load-serving entities that purchase its capacity. In turn, contractual obligations affect the amount of capacity load-serving utilities can rely upon to meet system peak loads and will impact their long-term integrated resource plans, including the timing and amount of new power plant construction.

The methodology used for power systems analysis mimics decisions that could be made by system entities based on contractual and financial considerations that affect economic outcomes. For example, the borrowing rate for capital may impact both capacity expansion decisions and therefore economic outcomes. Economic costs include the following components: (1) energy production costs for the entire system and (2) capital investment plus fixed O&M costs for constructing and operating units built for system capacity expansion. Energy production costs are comprised of fuel expenditures, variable O&M costs, and unit startup expenses. All costs are estimated over the 20-year LTEMP period starting at the beginning of calendar year (CY) 2015 and extending through the end of CY 2034. To be consistent with the analyses performed for other resource areas, the start of the study period was adjusted to CY 2015. Please refer to Section K.1.9 for a description of how the adjustment was made. Emphasis is placed on accurately estimating the cost of an alternative compared to Alternative A in terms of both economic ranking and the relative magnitude of cost differences. Therefore, costs such as fixed O&M costs are not computed for existing units that remain unchanged across all alternatives.

K.1.2 Glen Canyon Dam, Reservoir, and Powerplant Background

Glen Canyon Dam is a U.S. federal resource that was built by the Bureau of Reclamation (Reclamation) between 1956 and 1964 as part of the CRSP that was authorized by the Colorado River Storage Project Act on April 11, 1956. The Act authorized the Secretary of the Interior to develop the water resources of the Upper Colorado River Basin by constructing, operating, and maintaining the CRSP and other participating reclamation projects. The dam is a 710-foot-high concrete arch structure with a crest length of 1,560 ft, containing 4,901,000 yd³ of concrete. The thickness of the dam at the crest is 25 ft, and its maximum base thickness is 300 ft. The reservoir formed by the dam, Lake Powell, has a total water storage capacity of 27 million acre-feet (maf), with an active capacity of approximately 20.9 maf when full. Under normal water surface elevation levels, the reservoir has a length of 186 mi and a surface area of 161,390 ac. The dam controls a drainage basin approximately 108,355 mi² (Harpman and Rosekrans 1996).

Currently, there are eight generating units at Glen Canyon Powerplant with a total sustained operating capacity of approximately 1,320 megawatts (MW). The first two Glen Canyon units began generating power in September 1964, and the eighth and final unit came

online in February 1966, as recorded in Power Operations and Maintenance Form 59 (Form PO&M-59). When water is released from the reservoir through power plant turbines, the energy generated partially serves the electricity demands of the SLCA/IP wholesale customers.

Lake Powell was filled for the first time in 1980, when it reached a maximum reservoir water elevation of 3,700.6 ft. Displacing power generation and associated air emissions mainly from powerplants that burn fossil fuels such as coal, oil, and natural gas, the average annual gross electricity generation from the Glen Canyon Dam Powerplant between CY 1980 and 2013 was about 4,716.5 GWh. This statistic does not include generation production for years prior to 1980, because a portion of water inflows into Lake Powell were used to fill the reservoir prior to that time. From 1980 through 2013, annual generation has varied by more than a factor of 2.6. Generation was at a low of 3,299 GWh in CY 2005 and at a high of 8,703 GWh in CY 1984. The high level of annual generation variability of the Glen Canyon Dam Powerplant since 1980 is attributable to variations in Lake Powell inflow levels, which are strongly influenced by precipitation. Hydrologic variability and uncertainty reduce generation value. Therefore, other resources need to be made available to serve system loads and reliability requirements.

Operational limitations at Glen Canyon Dam were minimal from 1964 through May 1990. Minimum releases from Lake Powell were 1,000 cfs from Labor Day to Easter and 3,000 cfs during the rest of the year. These minimums are only a small fraction, approximately 3% to 9%, of the physical maximum turbine flow rate of 33,000 cfs at full reservoir. There were no institutional limitations on maximum flow rates, hourly ramping, or daily changes in flow. The relatively low minimum release rate requirement, combined with limits that were only constrained by the physical powerplant and dam characteristics, allowed for flexible operations that maximized the hydropower generation.

Legislation was introduced in Congress in 1990 addressing dam operations after the Glen Canyon Environmental Studies Program published its report in 1987 describing the impacts of dam operation on the national and recreational resources of the Grand Canyon. Reclamation began to restrict operations on June 1, 1990, when it conducted research discharges as part of the Glen Canyon Environmental Studies. Numerous test flows were conducted during a 14-month period that concluded at the end of July 1991. The purpose of these research releases was to collect and analyze data at different flow levels in order to investigate the effects of flow patterns on the riverine environment downstream of Glen Canyon Dam. Interim flow operating constraints were imposed at Glen Canyon Dam on August 1, 1991, and were in effect until February 1997, when the 1996 Glen Canyon Dam Environmental Impact Statement Record of Decision (ROD) was implemented.

The 1996 ROD requires releases from Lake Powell to be at least 8,000 cfs between the hours of 7:00 a.m. and 7:00 p.m., and 5,000 cfs or more during all other hours of the day. The maximum allowable release is limited to 25,000 cfs. In very high release months, the maximum limit can be exceeded, but the release rate must be constant during the entire month. The 1996 ROD operating criteria also limits release fluctuations during all rolling 24-hour periods. The fluctuation level permitted depends on the amount of water that will be released from Glen Canyon Dam during a month. The allowable daily fluctuation is 5,000 cfs/24 hr when the monthly scheduled water release is less than or equal to 600 kaf. Daily fluctuations are restricted

to 6,000 cfs/24 hr for those months in which the scheduled release is equal to or greater than 600 kaf but less than 800 kaf, and at 8,000 cfs/24 hr for months with releases equal to or greater than 800 kaf. Finally, the 1996 ROD operating criteria also limited the rate at which Lake Powell water release are allowed to ramp up and down. The maximum ramp rate is 4,000 cfs/hr when increasing, and 1,500 cfs/hr when decreasing. Operating criteria reduced the flexibility of operations, diminished dispatchers' ability to respond to market price signals, and decreased the economic power benefits of the Glen Canyon Dam. Between 1997 and 2005, this decrease in economic benefit was estimated to range from \$38 million to \$50 million per year (in 2009\$) (Veselka et al. 2010). This range may not be indicative of future economic costs due to a number of factors including changes in power market structures and utility fuel prices. It should be noted that all of the LTEMP alternatives are significantly less flexible than actual operations prior to the 1991 interim operating criteria. Only Alternative B has slightly less operating restrictions than current operations.

The 1996 ROD operating criteria include "emergency exception criteria" that recognize the fact that the Glen Canyon Dam Powerplant is an important grid resource. When emergency exception criteria are invoked, normal operations are suspended until the emergency has ended or WAPA has been cleared of its North American Electric Reliability Corporation (NERC) emergency operation responsibilities. Emergency exception criteria allow Glen Canyon Dam to dispatch up to all of its available capacity at Glen Canyon Powerplant, depending on the severity of the system emergency, by rapidly increasing generation output in response to events such as insufficient system generating capacity, transmission system problems, and system restoration.

In addition, Glen Canyon Dam generators provide system regulation to WAPA as the operator of the Western Area Colorado Missouri (WACM) balancing authority (BA) area. The Glen Canyon Dam Powerplant responds to a regulation signal developed and electronically transmitted to the dam by WAPA for continuous response to power system load and frequency changes. WAPA is required to react to moment-by-moment changes in system frequency, time error, and tie-line loading within the WACM BA via powerplant automatic generation control (AGC) equipment at Glen Canyon Dam and some of the other SLCA/IP federal hydropower plants to adjust the power output of the generators to match variations in system load in accordance with prescribed NERC criteria. The degree to which WAPA responds to these system changes is computed by an area control error (ACE) equation.

The ACE signal that is sent to Glen Canyon Dam adds to or subtracts from the existing scheduled hourly generation set point. Therefore, at any instant in time, the powerplant is typically producing more or less power than the current hourly scheduled set point. Deviations from the set point typically fluctuate from negative to positive values many times during any hour. However, the resulting output from Glen Canyon generators on average approximates the hourly scheduled level. Because post-ROD operating criteria specify release restrictions in terms of hourly average levels, Glen Canyon Dam can provide regulation services while scheduling set point levels at minimum and maximum allowable flow limits. It can also ramp set points within up and down limitations (see <http://www.wapa.gov/crsp/planprojectscrsp/gcopswhite.html>).

The 1996 ROD operating criteria currently restrict Glen Canyon Dam operations in terms of both the operational range of water releases and the rate at which water releases are permitted to change over time. It also provides the operating criteria for Alternative A.

K.1.3 Power Systems Geographic Scope

The Glen Canyon Dam Powerplant is part of a large dynamic power grid that responds to its operations. It is also a component of WAPA's SLCA/IP, which is composed of 11 federal hydropower facilities marketed and scheduled by the CRSP Management Center. WAPA markets these facilities as a bundled resource. Therefore, power economic impact analyses are based on a systems approach that measures the collective responses of system components to changes in Glen Canyon Dam operating rules and experimental releases. The focus area is on SLCA/IP federal hydropower resources, and the utilities operated by WAPA's SLCA/IP LTF power customers. For the purpose of this appendix, this primary impact area is referred to as the SLCA/IP market system (or SLCA/IP system). However, as described in more detail below, the methodology also recognizes that this system does not operate in isolation. Instead, it interacts with the much larger Western Interconnection power grid.

The power systems method uses a three-tiered approach. All simulate the system on an hourly basis over the 20-year LTEMP period. The top tier models the loads and resources of the entire Western Interconnection to gain a broad perspective on the future development of the larger overall system (see Section K.1.3.1). Both Western Interconnection system capacity expansion and economic system dispatch are modeled.

The middle tier models SLCA/IP LTF customer utility loads and resources along with future Western Interconnection interactions via non-firm bilateral energy transaction. It also projects SLCA/IP market system future capacity additions, determines day-ahead unit commitments, and performs economic dispatch. It focuses on SLCA/IP customer resources at a higher level of fidelity than the Western Interconnection tier. The top and middle tiers both rely on projections found in the *Annual Energy Outlook* (EIA 2014) published by the U.S. Energy Information Administration (EIA). The *Annual Energy Outlook* uses an even broader perspective that incorporates overall U.S. and global macroeconomic drivers into the projection of U.S. energy futures.

The bottom tier focuses on SLCA/IP federal hydropower resources. It models the long-term management and routing of water resources within the Colorado River Basin. Future water management is compliant with all applicable laws and water rights. Given this projection of long-term water management, simulation of powerplant dispatch is performed based on market price drivers projected by the Western Interconnection tier and key physical and institutional constraints on reservoir operations and powerplant dispatch. Hourly dispatch is subject to numerous physical and institutional constraints, including those specified under an LTEMP alternative.

The top tier represents a large geographical area, but at a relatively low level of fidelity. Increasing attention to detail and accuracy is paid as the geographical coverage becomes more

focused. By using this approach, power systems comparative analyses are able to determine how changes in Glen Canyon Dam Powerplant operations affect its economic value. This top-down modeling approach is further described below. More details about the selection of the power system's geographical scope and detail are provided in Attachment K.1.

K.1.3.1 Top Tier: General Western Interconnection Perspective Modeling

North America is comprised of two major and three minor alternating-current power grids. The Western Interconnection is the major power grid that stretches from Western Canada south to Baja California in Mexico, and eastward from the Pacific Ocean to the Rockies and the Great Plains. All of the electric utilities in the Western Interconnection are electrically tied together during normal system conditions and operate at a synchronized frequency that averages 60 Hz. The Western Electricity Coordinating Council (WECC) region of NERC facilitates regional transmission expansion planning for the interconnection, and the Western Governors' Association acts as a state/provincial steering committee. These entities work collaboratively to develop long-term electricity supply futures, estimate transmission requirements, and prepare long-term interconnection-wide transmission plans (see <http://energy.gov/oe/services/electricity-policy-coordination-and-implementation/transmission-planning/recovery-act-0>). These plans are voluntarily created and serve to provide a high-level look at possible futures.

Argonne power system analysts modeled the long-term capacity expansion, unit commitments, and hourly unit dispatch of Western Interconnection resources using the AURORA_{xmp} model (referred to as AURORA). The Western Interconnection topology and supporting model inputs were provided by EPIS, Inc., the AURORA model developers. A depiction of this topology is shown in Figure K.1-1. Each "bubble" in the diagram roughly represents groups of utilities, single BAs, or combinations of BAs. Bidirectional limits on the links that connect bubbles restrict network energy transfers. User-defined limits can vary hourly. The location of SLCA/IP federal hydropower resources in the AURORA Western Interconnection topology is indicated in the figure. The Glen Canyon Dam Powerplant is labeled "GC," and the Flaming Gorge and Fontenelle Powerplants are labeled "FG" and "FN," respectively. The location of powerplants in the Wayne D. Aspinall Cascade and all other SLCA/IP hydropower plants is labeled "Aspinall & Others."

The primary driver of many variables that define Western Interconnection future developments were based on projections published in EIA's 2014 *Annual Energy Outlook* (hereafter 2014 AEO; EIA 2014) for the reference scenario that was released in April 2014. Model results are consistent with state integrated resource plans (IRPs). A more detailed description of AURORA is provided in Section K.1.5.9.

In addition to estimating the capacity expansion pathways and system production costs, AURORA also projects future locational marginal prices (LMPs) throughout the Western Interconnection. The LMPs measure the incremental cost to serve an additional 1 MW of load at a specific point in the grid; that is, the cost to change the dispatch of system resources to serve a slightly higher load. This typically involves increasing the power generation at one of more units or reducing loads via a demand response management (DSM) agreement.

AspinallEIS/Vol2-Appdx-D.pdf). As discussed in Attachment K.1 (Geographic Scope of the Analysis), alternative operations at Glen Canyon Dam are expected to have a negligible impact on prices within the Western Interconnection and patterns outside of the SLCA/IP market system, and are therefore assumed to be static (i.e., given values) and identical under all alternatives.

LTEMP alternatives will have a relatively small impact on bilateral market interactions between the SLCA/IP market system and the rest of the Western Interconnection; that is, a maximum decrease of about 4.3% for power sales and decrease of 1.4% for power purchases. The use of LMPs to measure the economic impact of changes in Western Interconnection transactions yields a very good approximation because the LMP represents the system resource cost to serve the marginal load at a specific point. Therefore, a SLCA/IP market system sale to the Western Interconnection displaces higher cost generation in the interconnection. Likewise, a power purchase by the SLCA/IP market system displaces higher cost generation in the SLCA/IP system by increasing production in the interconnection at a cost that approximately equals the LMP at the Palo Verde hub minus transmission costs.

K.1.3.2 Middle Tier: LTF Customer Utility Systems

The primary focus of the power systems analysis is the SLCA/IP federal hydropower resources and the utilities operated by its LTF power customers. The SLCA/IP federal hydropower resources that the CRSP Management Office markets and the Montrose EMMO schedules are described in more detail in Section K.1.3.3. This section describes the approximately 138 customer entities that have SLCA/IP LTF contractual agreements with WAPA.

WAPA sells power to wholesale power customers on both a firm and non-firm basis, including cities and towns, rural electric cooperatives, public utility and irrigation districts, federal and state agencies, investor-owned utilities, power marketers, and American Indian Tribes (Tribes). In total, these entities provide retail electric service to millions of consumers in the Western Interconnection. However, others are end-use customers, including federal and state agencies, and irrigation districts that use power directly for their own purposes. Various laws, including the Reclamation Project Act of 1939 and the Federal Power Act, require WAPA to give preference to certain types of nonprofit organizations seeking to purchase federal power. Those entitled to preference status include cities and towns, state and federal agencies, irrigation districts, public utility districts, rural electric cooperatives, and Tribes (see <https://www.wapa.gov/About/Pages/customers.aspx>).

For economic analysis purposes, the system modeled in the middle tier includes LTF customers that are categorized as either large or small. Accounting for about 75% of WAPA's LTF energy and capacity sales, the eight largest customers, in terms of capacity and energy allocation, are Deseret Generation and Transmission Cooperative (Deseret), the Navajo Tribal Utility Authority (NTUA), Salt River Project (SRP), Utah Associated Municipal Power Systems (UAMPS), Utah Municipal Power Agency (UMPA), Platte River Power Authority (PRPA), Tri-State Generation and Transmission Association (Tri-State), and Colorado Springs Utilities

(CSU). Except for NTUA, all large LTF customers own and operate generating resources. About 130 remaining customers were aggregated for the analysis into two “small customer” entities accounting for the remaining 25% of LTF sales. Individually, each small customer receives less than 2.5% of WAPA’s total SLCA/IP LTF capacity and energy sales. Lastly, WAPA has LTF contracts to serve project use loads such as pumping for irrigation. Serving these loads has the highest priority for delivery.

In CY 2013, the eight large SLCA/IP LTF power customers owned and contracted for the use of specific physical resources. Based on data contained in EIA Form-860 and information obtained from both IRPs and the EPIS AURORA database, the total firm capacity of these resources was approximately 12,670 MW. As discussed in more detail in Section K.1.7.5, firm capacity in this power systems study is based on the maximum output level that a resource is expected to reliably produce during the time of peak demand. For some generating units, the firm capacity is significantly different from the nameplate capacity.

As shown in Figure K.1-2, over 50% of this capacity is owned by SRP and another 19% is owned by Tri-State. The remaining six large customers account for the remainder. In addition to these supply resources and the aforementioned SLCA/IP LTF contracts, additional firm capacity for is secured through other federal power purchases from WAPA’s Loveland Area Projects and the Desert Southwest Offices and through non-federal power contracts. In addition, DSM measures are credited as firm capacity resources. Based on data contained in Federal Energy Regulatory Commission (FERC) Form-714 and utility IRPs, these resources and non-firm energy transactions were used to serve combined service territory loads of almost 61 TWh in CY 2013.

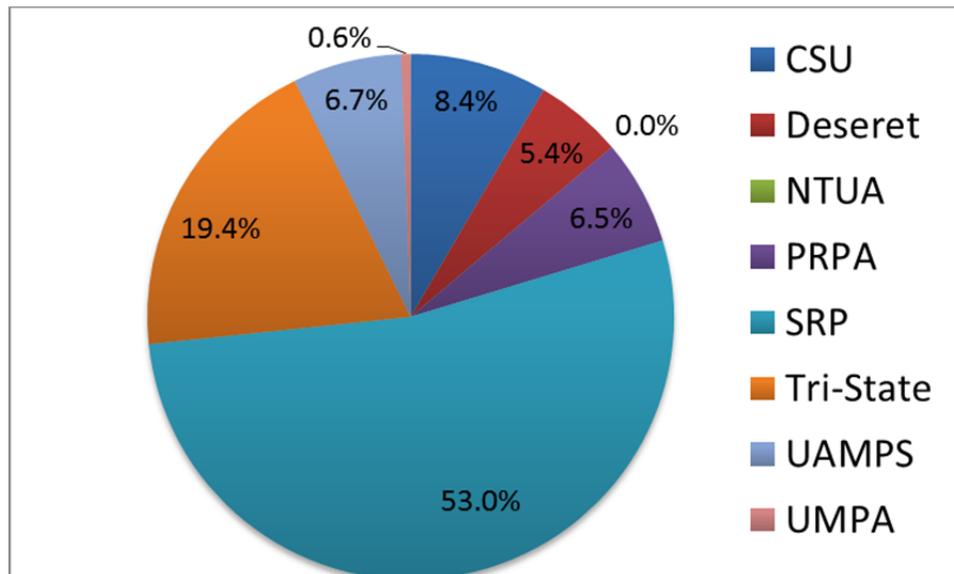


FIGURE K.1-2 Percentage of Total Generation Resources Owned by Individual Customers

Figure K.1-3 shows a simplified topology for the SLCA/IP market systems that was used by the AURORA model. It contains both large and small LTF customers. Where applicable, bubbles for large customers (shown as Pool A in Figure K.1-3) contain both loads and resources. Depending on the customer's location, loads and resources are designated as east or west regional entities. In the figure, small customer and project use bubbles only contain loads that have been aggregated by location. Energy flows among entities via system linkages. Some links have limitations and/or associated costs. More details about the SLCA/IP market system topology are described in Section K.1.6.

It should be noted that the Glen Canyon Dam Powerplant and all other federal hydropower plants are modeled as resources that are directly available to WAPA's customers. In reality, energy and capacity from these resources are sold by the CRSP Management Center to customers through LTF contracts. Argonne staff, in consultation with WAPA, Reclamation, and the NPS, decided not to include a representation of these contracts in the modeling process because the vast majority of the SLCA/IP federal resource is under contract to ultimately serve LTF customer loads and capacity needs. Financial complications associated with covering short-term and hourly long and short energy positions would have made the modeling process significantly more expensive and time consuming. It was also judged to have little impact on the assessment of the relative impacts of LTEMP alternatives. Given the time and budget

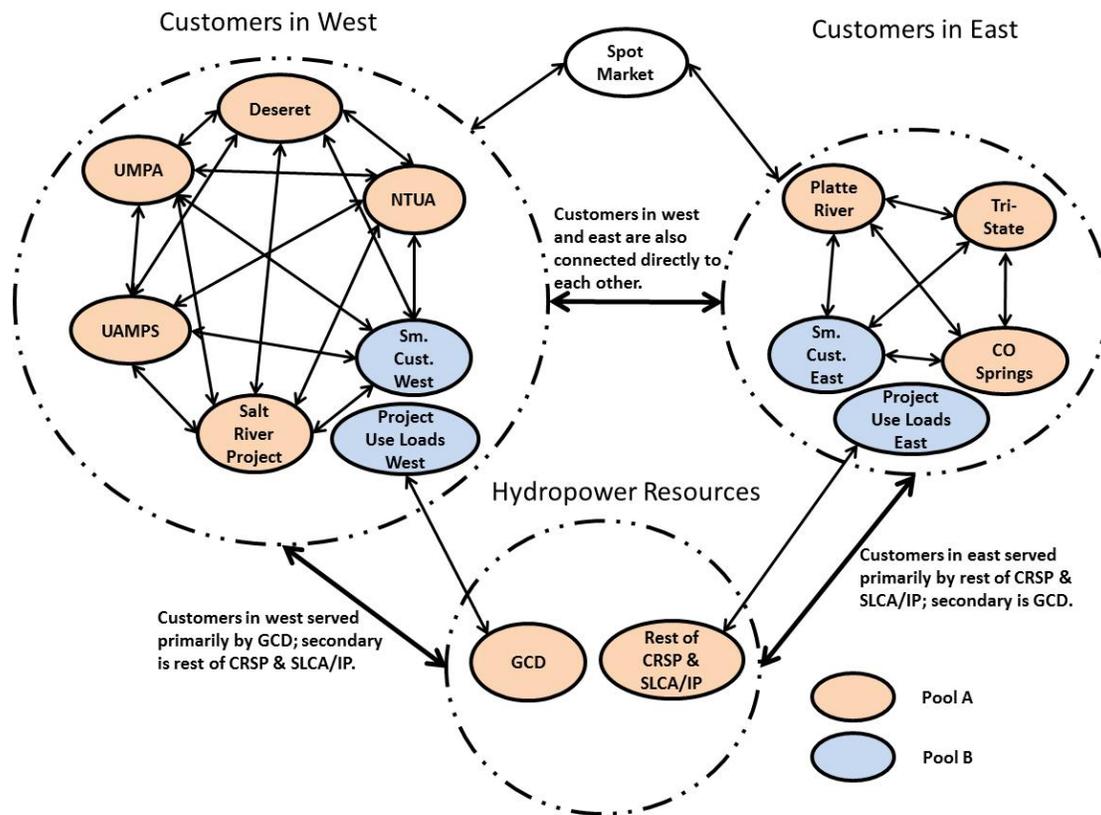


FIGURE K.1-3 Simplified Network Topology of the SLCA/IP Market System

constraints, it was decided that the more direct approach of modeling hydropower resources was sufficient.

Power systems modeling of the SLCA/IP market system assumes a very high level of cooperation and coordination among WAPA and its LTF power customers. Capacity expansion planning, unit commitment schedules, and least-cost hourly dispatch for the entire system were based on a “single operator/decision maker” model. This is a higher level of cooperation and coordination than what actually occurs. However, WAPA and its customers do cooperate on a number of different levels. For example, several large LTF customers jointly own capacity of some of the same facilities. They also buy and sell energy through long-term, day-ahead, and hour-ahead bilateral agreements using various market signals. The SLCA/IP market system topology also includes energy transfer costs that dampen power transfers relative to a “single-decision maker” model that does not incur these costs.

The AURORA topology of the SLCA/IP market system does not model physical transmission constraints. It does, however, limit flows on some links between bubbles. Energy flows on links connecting SLCA/IP federal hydropower resources to LTF customer loads are limited by contract rate of delivery (CROD) allocations (WAPA 2015). CROD is the firm capacity the CRSP Management Center agrees to have available for delivery. It may or may not be accompanied by energy supplied by WAPA (see <https://www.wapa.gov/crsp/opsmaintcrsp/dictionary.htm#c>). When not all of the CROD is being utilized for WAPA power deliveries, a customer can use the remainder to schedule the delivery of other energy transactions. In addition, 5% of the energy that flows on these links is lost between the point of injection and the delivery point. This represents EMMO current transmission losses for SLCA/IP federal hydropower deliveries. Under wet hydrological conditions in which SLCA/IP total federal hydropower generation exceeds the total CROD, the excess energy flows on links that represent shorter term WAPA energy transactions with its LTF customers.

Regardless of the amount of firm capacity that is available from SLCA/IP federal hydropower resources, WAPA’s CROD is assumed to be identical under all alternatives. Currently, some customers voluntarily use the difference between the CROD and sustainable hydropower (SHP) on WAPA’s transmission system for customer displacement power (CDP). The SHP is the minimum amount of power and energy the EMMO must deliver to its LTF customers regardless of SLCA/IP federal hydropower conditions. The CDP replacement option is specified under an amendment to the SLCA/IP firm electric service contract to accommodate replacement power decisions. Therefore, it is assumed that any loss in firm capacity under an alternative will free up transmission capacity for CDP transactions (Loftin et al. 1998).

Transfers of energy among LTF customers are virtually unconstrained, which may lead to an overestimation of the amount of energy transfers and underestimation of cost impacts among LTF customer utilities. However, there are significant on- and off-peak costs for energy flows on lines that connect customers to each other. These costs tend to dampen bulk power transactions among the bubbles. Information from WAPA regarding hourly transmission rates for five of WAPA’s large customers and six other investor-owned utilities in the surrounding area (Wicks 2014) was used to set transfer costs on links between any two firm electric service customers to \$6.5/MWh and \$3.5/MWh for peak and off-peak, respectively.

Lastly, it is assumed that additional capacity built by customers as a result of any losses at Glen Canyon Dam will be located to help alleviate transmission congestion. Note that Glen Canyon Dam is remotely located from major load centers. This may also result in a somewhat lower energy loss on the transmission lines since more heavily loaded lines during peak hours have higher losses than during cooler off-peak periods. For example, replacement capacity for SRP would likely be built closer to the Phoenix load center than the Glen Canyon Dam. Because the LTEMP analysis was an economic analysis and not a financial one, it did not address the impacts of siting each potential replacement power plant. See the discussion in the section “Capacity Expansion Candidate Unit Characteristics” in Section K.1.6.3.

Assumptions and simplifications associated with the topology and representation of the SLCA/IP market system will affect modeling results. However, the intent of the power systems analysis is to perform a comparative economic study to identify the relative ranking and magnitude of alternative impacts using Alternative A as a benchmark. Because any inconsistencies in results will be present in the evaluation of all alternatives, the relative differences among alternatives are expected to be robust. Despite the simplifying assumptions and potential effects on modeling results, the AURORA dispatch model does provide reasonable results for LTEMP power systems analyses. As discussed in more detail in Section K.1.6.2, a 2013 benchmark analysis of utility-level generation by fuel type for the eight large customers modeled by AURORA were very similar to values reported by each utility in EIA Form-923. This result assured Argonne modelers that, from a production cost standpoint, the modeling approach and the results obtained were reasonable.

K.1.3.3 Bottom Tier: WAPA SLCA/IP Hydropower Resources

Of the three analysis tiers, the bottom tier is modeled at the finest level of granularity. It simulates the hourly operation of WAPA’s 11 SLCA/IP powerplants that are marketed and scheduled by the CRSP Management Center. For this study, six of these facilities are classified as large plants. The largest is at Glen Canyon Dam. Its powerplant consists of eight generating units with a combined capacity of about 1,320 MW. As shown in Figure K.1-4, Glen Canyon Dam accounts for about 72% of WAPA’s total SLCA/IP federal hydropower nameplate capacity. Other SLCA/IP federal hydropower plants in the system that are classified as large SLCA/IP federal hydropower facilities include powerplants contained in the CRSP and the Seedskaadee Project. All large plants except Fontenelle are in the CRSP. The Blue Mesa Powerplant has two generators, the total capacity of which is 86.4 MW. Located 12 mi downstream from Blue Mesa on the Gunnison River, the Morrow Point Power Plant has two units with a combined capacity of 165 MW; another 6 mi farther downstream, the Crystal Powerplant has an installed capacity of approximately 32 MW from one unit. Blue Mesa, Morrow Point, and Crystal are part of the Wayne D. Aspinall Cascade (also referred to as the Aspinall Cascade). The Fontenelle Powerplant has a nameplate capacity of 10 MW and it is the only powerplant associated with the Seedskaadee Project. Flaming Gorge Dam is located on the Green River downstream of Fontenelle Dam. The Flaming Gorge Powerplant has three generating units. Each unit has a nameplate capacity of 50.65 MW for a total of approximately 152 MW. However, because of turbine limitations, the operable capability of the powerplant is approximately 141 MW.

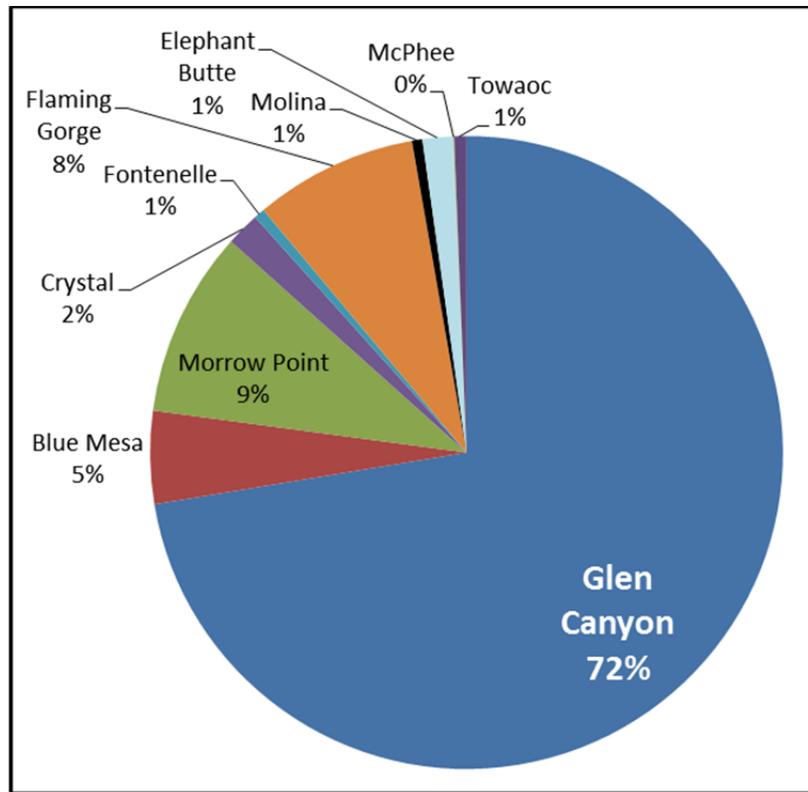


FIGURE K.1-4 Percentage of SLCA/IP Federal Hydropower Nameplate Capacity by Facility

The SLCA/IP hydropower facilities that are classified as small include the Upper and Lower Molina complex in the Collbran Project with a combined nameplate capacity of 13.5 MW, the Elephant Butte Powerplant in the Rio Grande Project with 28 MW, and in the Dolores Project, the McPhee and Towaoc Powerplants with total of 11.5 MW. Combined, these small facilities account for less than 3% of WAPA’s SLCA/IP hydropower resources.

Modeled hourly energy production from federal hydropower resources are input into the SLCA/IP market system as a time series of power injections and from bubbles indicated in Figure K.1-3 as “Hydropower Resources.” As discussed in more detail in Section K.1.5, both the middle and bottom tier models use a consistent set of LMP projected by the Western Interconnection model (top tier).

K.1.4 Overview of Power Systems Methods

The Argonne team of power system analysts and modelers developed a collection of tools that are linked together to evaluate the economic costs of LTEMP EIS alternatives. The processes by which these tools were used and information flows among them are summarized in this section. The next section describes each tool in more detail, and the ones that follow provide more information on model input data and applications.

Incorporating all aspects of the three tiers discussed earlier, Figure K.1-5 shows the modeling sequence and data flows for the power systems analysis. Using Western Interconnection topology depicted in Figure K.1-1, the AURORA model models the top tier. Palo Verde market hub LMPs produced for CY 2013 are calibrated to closely match observed levels. LMP calibration factors are discussed in more detail in Attachment K.2 and are applied to future years through the end of the study period.

The bottom tier, which represents WAPA's SLCA/IP federal hydropower plants, is modeled next. Due to the complexities of SLCA/IP hydropower operating criteria and mandates unrelated to power production, AURORA could not directly model either the firm capacity or the hourly operations of the larger and more complex SLCA/IP federal hydropower resources. Therefore, the Colorado River Simulation System (CRSS) model, the Sand Budget Model (SBM), a simplified version of the Generation and Transmission Maximization (referred to as GTMax-Lite) model, and spreadsheet tools were used to project powerplant-specific hourly production levels over the study period at a level of detail sufficient for estimating power economic impacts that would potentially occur from alternative Glen Canyon Dam operations.

The CRSS model developed by Reclamation models the future operations of water-related resources on the Colorado River. Power systems analysis utilized 21 CRSS projected monthly hydrological futures for large WAPA SLCA/IP federal hydropower plants including Glen Canyon Dam. Separate CRSS model runs are made for each alternative, resulting in unique projections of monthly reservoir elevation and water volume releases for Glen Canyon Dam. The monthly operations of all other SLCA/IP dams are unaffected by an alternative.

A simplified version of the Generation and Transmission Maximization model (called GTMax-Lite) developed by Argonne optimizes the economic value of hourly energy produced by both Glen Canyon Dam and all other large SLCA/IP federal hydropower facilities. The dispatch depends on unit availability as simulated by an outage model, LTEMP EIS operating criteria, SBM monthly water releases, and a time series of energy market prices.

For each alternative, the GTMax-Lite configuration that represents Glen Canyon Dam was run for all traces under two different conditions. The first condition assumes that no distinctive release events such as HFEs will occur in the future; that is, CRSS monthly results and Western Interconnection calibrated LMPs drive hourly SLCA/IP operations. No TMFs or HFE are conducted in this first set of model runs. Using these initial results from CRSS and GTMax-Lite, the Reclamation SBM schedules various HFEs that differ in terms of peak water release rate, duration, and timing. The SBM also reallocates CRSS monthly water release volumes among the months of a single WY in order to enable higher water releases during months with experiments. Due to the reallocation of monthly water releases and the scheduled TMFs and HFEs, the GTMax-Lite model that represents Glen Canyon Dam must be run a second time using the SBM results. It is this second GTMax-Lite run that is used for Glen Canyon Dam for all power systems economic analyses.

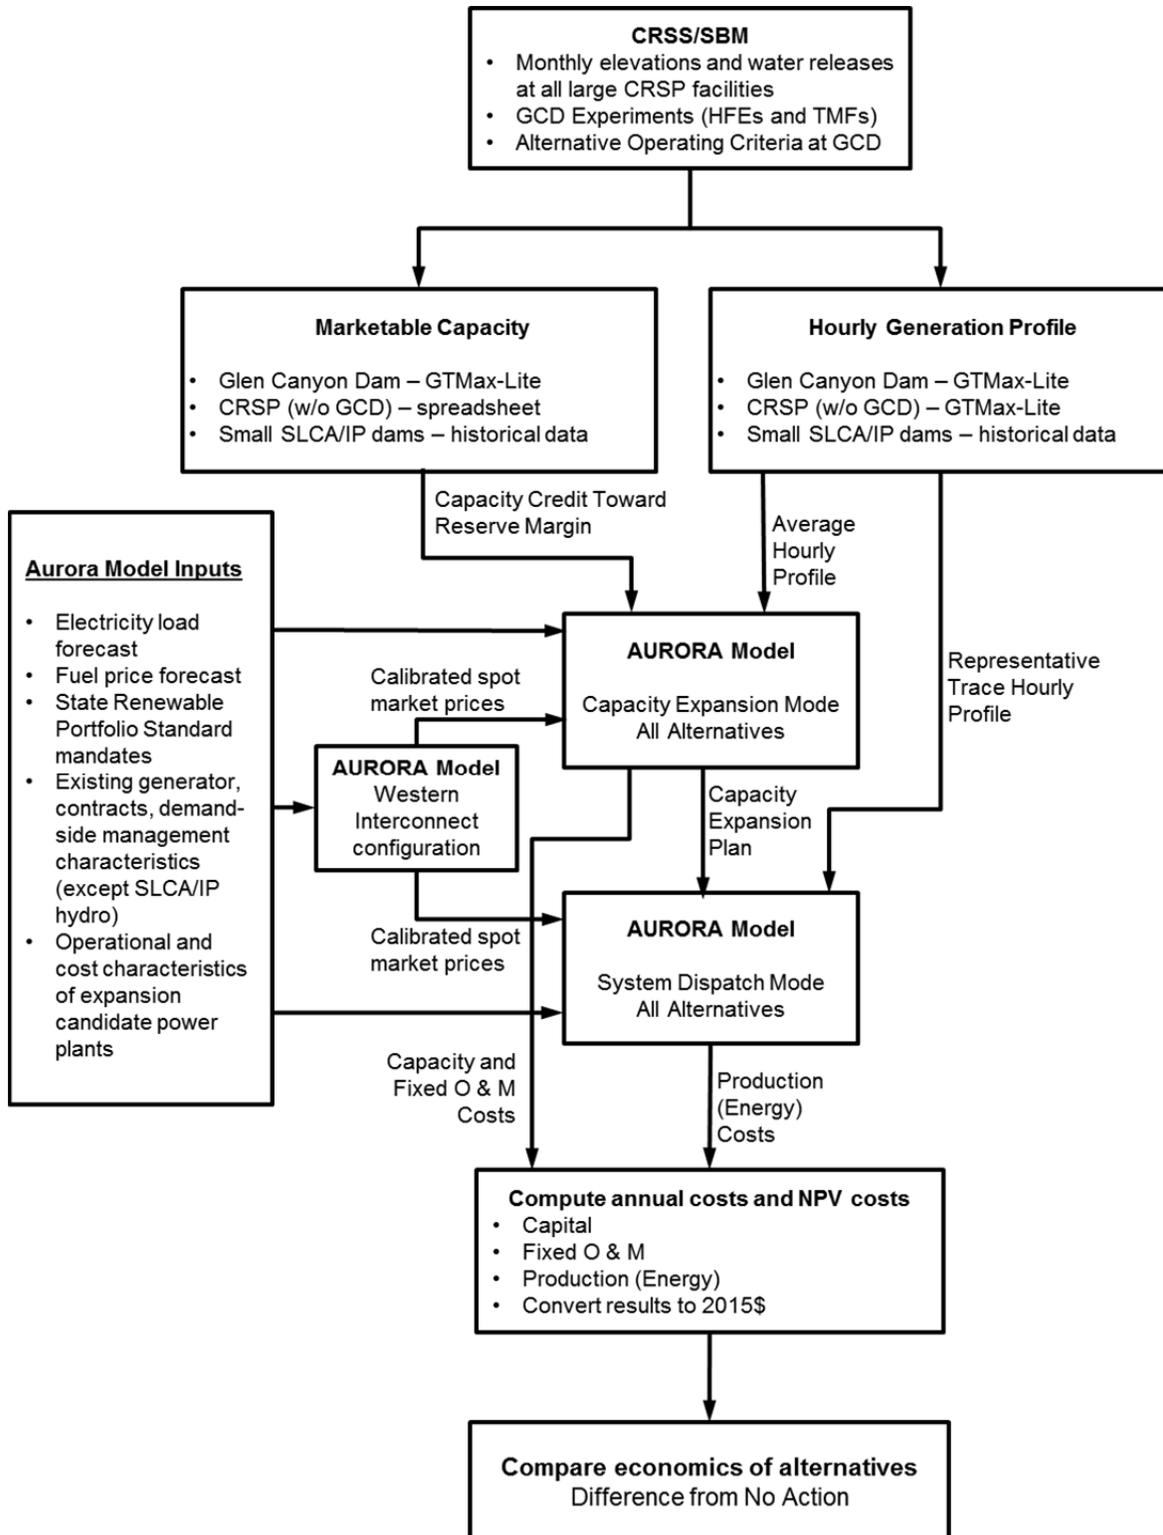


FIGURE K.1-5 Flow Diagram of the Power Systems Methodology Used in the LTEMP EIS

A second configuration of GTMax-Lite configuration simulates the operation of other large SLCA/IP powerplants. It also uses input data from the CRSS model and calibrated Western Interconnection LMPs. The Glen Canyon Dam LTEMP EIS alternative operating criteria and experimental releases conducted at Glen Canyon Dam do not impact the operations of these upstream resources; therefore, the SBM does not consider these resources in the determination of when HFE events will occur. GTMax-Lite optimization for these plants was performed for a condition that represents an average hydrological condition as projected by CRSS and for the CRSS projection, also known as a trace, which was judged by Argonne staff to be “representative” of the 21 projections. The selection of this representative trace is described in Attachment K.3.

The firm capacity of WAPA’s SLCA/IP federal hydropower resources is computed by spreadsheet tools that estimate the maximum potential output of these resources during the time of peak system load. Depending on an alternative’s operating criteria, the maximum output level at the Glen Canyon Dam Powerplant is suppressed. For example, flat flow alternatives are associated with relatively low firm capacity levels, while higher firm capacity levels are attained under less stringent operating criteria such as under Alternative B. As described in more detail in Sections K.1.5 and K.1.7, determination of Glen Canyon Dam Powerplant capacity is based on GTMax-Lite hourly results for all 21 projected futures. Other large SLCA/IP hydropower plant firm capacities are based on CRSS projected futures and power equations that estimate maximum output levels.

The middle tier is modeled by the SLCA/IP market system configuration of AURORA. This configuration contains all of the loads and resources that are in the utilities operated by SLCA/IP LTF wholesale customers and a point that represents a connection to the rest of the Western Interconnection. At this interconnection point, energy is bought and sold at the calibrated Palo Verde market hub price. Hour-by-hour energy injections into the system from WAPA’s hydropower resources are prescribed as determined by GTMax-Lite.

For each alternative, AURORA was used for two major purposes: (1) to determine the cost of capacity expansion pathway over time during the study period for the SLCA/IP market system; and (2) to compute production costs associated with a least-cost unit commitment and system dispatch for a given expansion pathway and a single representative hydrology future or trace. Therefore, AURORA is run in two modes. The first, or “expansion,” mode is used to determine the type of technologies that will be built in the SLCA/IP market system and the time when system capabilities will be expanded. It also considers scheduling the retirement of existing generating units. The second, or “dispatch,” mode determines unit commitments and performs a system dispatch of a static set of both existing and new resources. This static resource set was determined by previous AURORA capacity expansion runs.

As shown in Figure K.1-5, calibrated market prices are used by both the capacity expansion and system dispatch modes for all alternatives. However, the AURORA capacity expansion model runs use the hourly energy production from WAPA’s SLCA/IP hydropower resources, based on an average hydropower condition, while AURORA dispatch runs use generation level projected by the representative trace.

Results of the AURORA dispatch model consist of costs to produce the electrical energy to meet the system load demand. Production costs are the sum of powerplant fuel costs, variable O&M costs, unit startup costs, and the cost of power purchased from the spot market minus spot market sales revenues. Results from the AURORA expansion and dispatch models (namely capital, fixed O&M, and production or energy costs) were combined to determine the total annual costs for each alternative. The NPV stream of costs was also calculated to facilitate comparisons among alternatives. This single lump-sum value was based on a discount rate of 3.375%, a rate that is used by Reclamation for cost-benefit studies of projects. The use of this discount rate was in part based on information contained in Attachment K.4, which was provided by Reclamation staff. At the recommendation of WAPA staff, a second discount rate of 1.4% was used in a sensitivity study.

K.1.5 Description of Individual Power System Models

As described in the previous section, Argonne used several tools and models of varying levels of detail and complexity to estimate the economics of LTEMP EIS alternatives. Additional information on each of these tools and models, along with a description of other supporting algorithms, is provided below.

K.1.5.1 Colorado River Simulation System Model (Bottom Tier)

The CRSS model was developed by Reclamation to model future operations of water-related resources on the Colorado River, including both the upper and lower portions of the basin. The Glen Canyon Dam is the lowest reservoir in the upper basin. For the LTEMP EIS, CRSS projected 105 monthly hydrological futures over a 48-year time period from 2013 through 2060, inclusive. Each future or trace is based on a historical time series of hydrological conditions. Power system analyses utilize the first 21 years of CRSS projections of reservoir elevations and water release volumes for CRSP and the Seedskaadee Project; that is, the set of large plants. Of the 105 traces projected by CRSS, a common set of 21 was used by all EIS research areas including power systems analyses.

For the initial structured decision-making exercises, all of the simulation cases included three separate options for sediment conditions (high, moderate, and low), effectively multiplying the number of simulations required by a factor of three. Once the detailed results were generated, the three sets of findings were assigned relative weightings in order to combine and condense the findings into weighted averages. For expediency in the power systems analysis, all of the simulation runs will be based on a single sediment option (the moderate case, also designated “s2” in previous treatments), which was weighted by 63.1% for combining the detailed results. This greatly reduces the number of cases to be examined, and based on previous findings it does not affect comparisons or conclusions regarding impacts of the alternatives.

Separate CRSS model runs are made for each alternative, resulting in a unique projection of monthly reservoir elevation and water volume releases for Glen Canyon Dam. However, monthly operations of all other SLCA/IP dams are identical under all alternatives. Therefore,

operations for all large SLCA/IP federal hydropower plant model runs of GTMax-Lite used CRSS results for Alternative A.

K.1.5.2 Representative Trace Tool (Bottom Tier)

The Representative Trace Tool contains supplemental software written by Argonne specifically for the LTEMP EIS. It assists in the selection of a single hydrological trace for the detailed hourly dispatch of WAPA's large SLCA/IP hydropower plants. The trace chosen best meets a set of criteria for being "representative." The representative trace must have annual variations in hydrological conditions at Glen Canyon Dam that are similar to the hydrological distribution of the entire population of the 21 common trace set for sediment condition 2. The mean Glen Canyon Dam annual water release of the representative trace must also be approximately equal to the mean of all 21 traces. For consistency, the selected trace is also applied to the other five large SLCA/IP federal hydropower plants.

K.1.5.3 Hydropower Outage Model (Bottom Tier)

The Hydropower Outage model and supporting spreadsheets are used to simulate unit outages at all six large SLCA/IP federal hydropower powerplants. This includes both scheduled outages and forced outages that are caused by random mechanical and electrical events. Designed and written by Argonne, a methodology was developed to incorporate the number, cause, and duration of forced outages that may potentially occur during the 20-year study period. The model uses a random number generator to simulate the timing and cause of forced outages using data contained in the NERC Generating Availability Data System (GADS). Several instances of the model were run. The time series of random outage selected for LTEMP analyzes was the one that closely matched GADS statistical averages. The outage methodology is discussed in more detail later in Section K.1.7.3 and in Attachment K.5. The same time sequence of representative outages was used under all alternatives.

Reclamation provided Argonne with maintenance schedules over the study period for large SLCA/IP facilities. The timing and length of outages at large SLCA/IP powerplants is in general the same under all EIS alternatives. However, during HFEs and TMFs, it was assumed that a scheduled maintenance outage would not be conducted.

K.1.5.4 Generation and Transmission Maximization-Lite (Bottom Tier)

GTMax-Lite is a simplified version of the full GTMax model. Both were developed by Argonne. GTMax-Lite has limited scope and data requirements compared to the full version of GTMax. The two versions of GTMax-Lite used for the LTEMP EIS represent only the physical characteristics of hydropower plants, downstream flow requirements, and both water release and reservoir operating criteria. The primary modeling objective of the lite version is to maximize the economic value of hydropower resources. This differs from the full GTMax model, in which the full model represents other factors such as customer power delivery requests sent to the EMMO,

short-term purchase and sale commitments, and non-economic EMMO dispatch goals and guidelines. Although full GTMax and GTMax-Lite differ, they share many of the same features and in general produce similar generation patterns and estimates of hydropower economic value.

The GTMax-Lite model configuration used for LTEMP power systems analyses optimizes the economic value of hourly energy produced at both Glen Canyon Dam and all other large SLCA/IP federal hydropower facilities. Operations depend on both unit availability as simulated by the outage model and a set of operating criteria. For the LTEMP EIS, two configurations of the model were constructed. One represents the operation of only Glen Canyon Dam, and the other optimizes the operation of the remaining large hydropower facilities.

GTMax-Lite was used because many thousands of weekly runs with hourly time steps need to be performed rapidly. It was customized to address a specific problem by tailoring the objective function, the input and output routines, and the model constraints to be consistent with LTEMP modeling needs; that is, it models federal hydropower resources without LTF contractual obligations. Multiple model runs and data handling are controlled by a Microsoft Excel® spreadsheet, and the objective function is optimized using the Lingo software, which simultaneously identifies the best pattern of hourly energy production over time that satisfies all operational constraints. The Lingo optimization software was developed by LINDO Systems and is widely used by educational institutions and large corporations.

Glen Canyon Dam Configuration

The Glen Canyon Dam GTMax-Lite model was run thousands of times in support of the structured decision analysis (SDA) process (Appendix C). This includes nearly 1,000 LTEMP scenario optimizations (combinations of 19 long-term strategies based on the 7 alternatives [see Section 4.1], 21 hydrology traces [based on 105 years of historical data], and three sediment traces [based on 50 years of historical data]) that optimize water releases (each run consisting of 180,000 hr of Glen Canyon Dam flows). The GTMax-Lite hourly water release results were used by analysts in each resource area, such as sediment, fish, recreation, and riparian vegetation. Analyses of power systems economics leverages the outputs produced by this process.

Initial SDA exercises used all of the simulation cases, including the three separate sediment input traces (high, moderate, and low input). The power systems simulation runs used a single sediment trace (the moderate case). This reduced the number of cases to be examined by two-thirds, and, based on previous findings, does not affect comparisons or conclusions regarding impacts of the alternatives.

GTMax-Lite simulated operations at Glen Canyon Dam were made for all 21 projected hydrological futures over the entire study period. As described below, all runs were performed twice. The Glen Canyon Dam configuration uses hourly AURORA calibrated prices projected by the Western Interconnection configuration to maximize the economic power value of operations during representative 1-week periods for each month during the study period. Hourly prices input into the model are average values based on weekday, Saturday, and Sunday/holiday Palo Verde hub LMP projections. Model results for hourly Glen Canyon Dam generation are greatly

influenced by the hourly LMP profile, a weekly water release requirement, Lake Powell Reservoir elevation, and LTEMP alternative operating criteria.

To achieve more accurate/realistic results, both GTMax-Lite configurations explicitly model scheduled and forced outages. Reclamation provided a maintenance schedule for all six CRSP facilities over the study period (Clayton 2013). A methodology was developed to incorporate the number, cause, and duration of forced outages that would be expected during the study period. Data on forced outages for hydroelectric turbines were obtained from GADS, which is a database of operating data on electric generating equipment maintained by the NERC. This information was input into an algorithm that produced a plausible series of random outages for units at the Glen Canyon Dam Powerplant. For large SLCA/IP federal hydropower facilities, based on the cause of forced outages and associated average down times using data contained in the NERC GADS for hydropower plants that had capacities greater than 30 MW.

Market prices input to LTEMP power system models represent the economic value of hydropower generation at hourly intervals. These prices directly influence the generation schedule produced by the models when optimizing SLCA/IP hydropower resources. To the extent possible, the GTMax-Lite model uses its limited-energy/water resource stored in a reservoir (i.e., Lake Powell at the Glen Canyon Dam) to first generate electricity during on-peak hours when it has the highest economic value. Any remaining energy is scheduled during lower-priced hours.

Model-generated operations comply with any operating constraints and downstream flow targets placed upon the hydropower system for environmental or institutional reasons. Operating constraints include limits on water release up- and down-ramp rates, limits on reservoir water release rate changes over a rolling 24-hour period, ancillary service requirements, and others.

Figure K.1-6 illustrates a typical Glen Canyon Dam GTMax-Lite result for a 24-hour period. The green bars represent hourly Glen Canyon Dam Powerplant production, the total of which is highly influenced by the mandated monthly water release volume. The light green line shows hourly market prices. In general, energy production is the highest when it has the most value. Note that the production levels are such that the total of hourly generation multiplied by the market price (i.e., energy production value) over the day is as large as possible. The production pattern adheres to all operating criteria such that the power output pattern complies with minimum and maximum flow rate constraints, ramp-rate limits, and daily change restrictions. Also note in this example that some of the constraints are binding. In this case, the minimum and maximum generations do not bind the solution; that is, generation levels do not operate at either of these levels. Generation pattern is bound or limited by daily change and both up and down hourly ramp rate constraints. However, when more water is released for power generation, the maximum limit becomes binding because peak generation levels are possible within the daily change constraint. On the other hand, when hydropower generation is low, the minimum constraint becomes binding. Therefore, hydropower conditions often dictate when a constraint is either binding or not binding.

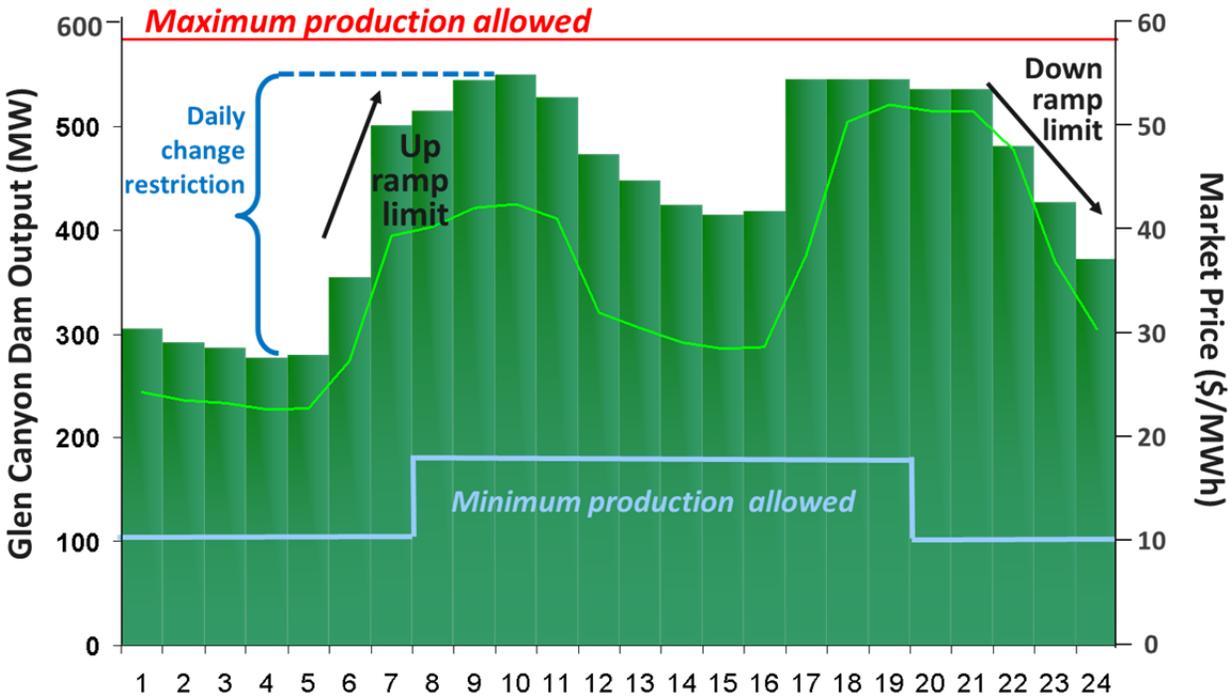


FIGURE K.1-6 Illustration of a Typical GTMax-Lite Result for a 24-Hour Period

More operational flexibility at Glen Canyon Dam always translates into higher or equal economic value. For example, if there was no daily change constraint, powerplant output in Figure K.1-6 would have been at the minimum during the nighttime, when prices are lower, and ramped up over a few more hours to reach the maximum output level when prices are the highest. A further relaxation of operating criteria by removing hourly ramping constraints, lowering the minimum, and increasing the maximum would have resulted in a higher concentration of Glen Canyon Dam generation in the hours with the highest demand. The daily maximum generation level would have also been higher. Therefore, limits not only constrain the economic value of energy, but also impact the maximum output that Glen Canyon Dam produces during system peak loads and therefore reduce its firm capacity.

The Glen Canyon Dam version of GTMax-Lite compresses the full 8760 hr per year into 12 “typical week” periods of 168 hr for each month. Outputs include hourly turbine and non-turbine water release and power generation schedules for a series of representative 1-week time periods (i.e., sequence of 168-hour time periods) that maximize the economic value of hydropower energy resources. The Glen Canyon Dam GTMax-Lite configuration utilizes a “wrap” technique that significantly reduces model end-effects associated with running typical weeks. The technique essentially connects the modeled beginning hours to those at the end of the optimized week. Because the model mathematically repeats the same weekly pattern infinitely, ending model solutions are positioned such that it is starting in a good position for operations during the following week.

Because the GTMax-Lite model only simulates operations for one representative week in each month, the results are repeated to reflect full months of hourly operations for each year of the study. This is accomplished by assigning the typical water and generation release pattern estimate by GTMax-Lite for specific day types to each day of the month. For example, the Sunday optimized pattern is assigned to all Sundays and holidays that occur in a month. It should also be noted that GTMax-Lite is provided with the number of day types that occur in each simulated month. Using this information, GTMax-Lite produces a weekly result such that the repeated daily results over a month release the exact amount of specified monthly water release.

The GTMax-Lite configuration that represents Glen Canyon Dam was run under two different of assumptions. The first assumes that no distinctive release events such as HFEs will occur in the future, in which case CRSS data are used to drive operations. This information was input into the SBM in order for the model to schedule HFEs and adjust CRSS monthly water release volumes and Glen Canyon Dam reservoir elevations. This intermediate solution was only used by the SBM.

For a second run of the Glen Canyon Dam GTMax-Lite model, it is assumed that HFEs will occur as scheduled by the SBM. The LTEMP EIS defines several different types of HFE, each with a unique specified hourly water release pattern. GTMax-Lite models operations when an HFE is *not* scheduled. A separate routine is used to compute Glen Canyon Dam Powerplant generation based on the prescribed HFE water release pattern. This pattern depends on the type of HFE that would be conducted. Under most HFEs, there are time periods when water release requirements exceed the combined maximum flow rate of Glen Canyon Dam Powerplant turbines. Therefore, the routine tracks both turbine water and non-turbine water releases. It also computes power production levels based on Lake Powell's water elevation. During days in a month in which an HFE is not scheduled, Glen Canyon Dam hourly generation simulated by GTMax-Lite accounts for the SBM monthly water release volume, the amount of water that was released during the HFE, and the number of normal operating days (i.e., day without the HFE) in the month.

Other Large Federal SLCA/IP Hydropower Resources Configuration

Because WAPA markets power from combined SLCA/IP facilities, of which Glen Canyon Dam is the single largest component, a second GTMax-Lite configuration was developed. It represents the remaining CRSP hydropower powerplants, including Blue Mesa, Morrow Point, Crystal, and Flaming Gorge, and the Fontenelle Powerplant of the Seedskadee Project. Although Fontenelle is not technically part of CRSP, it is included in this configuration because it is operated as a cascade with Flaming Gorge and the CRSS model projects both monthly reservoir elevations and releases for these facilities. This GTMax-Lite configuration and its key operating constraints, shown in Figure K.1-7 below, were developed specifically for the LTEMP EIS.

GTMax-Lite is a scaled-down version of the full GTMax model. Both represent all the physical CRSP and Seedskadee powerplants and downstream flows at gages in the Green River. However, the lite version omits the representation of SLCA/IP firm contracts. Instead, large

SLCA/IP hydropower plant operations are driven directly by electricity market price signals—not contracts. This streamlined process involves far fewer model operator steps and solves the problem considerably faster than the full GTMax model. The omission of SLCA/IP firm contractual loads has a very minor impact on the dispatch of the Glen Canyon Dam Powerplant because price patterns are highly correlated with loads, and operating constraints under all alternatives restrict the flexibility of Glen Canyon’s response to hourly changes in prices and load patterns. Instead, operations follow a general on-peak and off-peak pattern that is restricted by the daily change criterion.

The GTMax-Lite configuration that represents these five large SLCA/IP powerplants was run once for an average hydrological condition to support AURORA capacity expansion model runs, and a second time using the representative trace to support SLCA/IP detailed system dispatch runs. It optimizes operations during all hours of the study period, based on input data from the CRSS model and AURORA Western Interconnection calibrated market prices for the Palo Verde market hub. LTEMP EIS alternative and experimental releases conducted at Glen Canyon Dam, such as HFEs and TMFs, do not affect the operations of these five upstream resources. Therefore, this configuration uses CRSS results for Alternative A. Therefore, the SBM did not adjust CRSS results.

As shown in Figure K.1-7, GTMax-Lite contains two water cascades. The first consists of the Fontenelle and Flaming Gorge Reservoirs and the second consists of the Aspinall Cascade, which includes the Blue Mesa, Morrow Point, and Crystal reservoirs. Operationally, reservoirs in

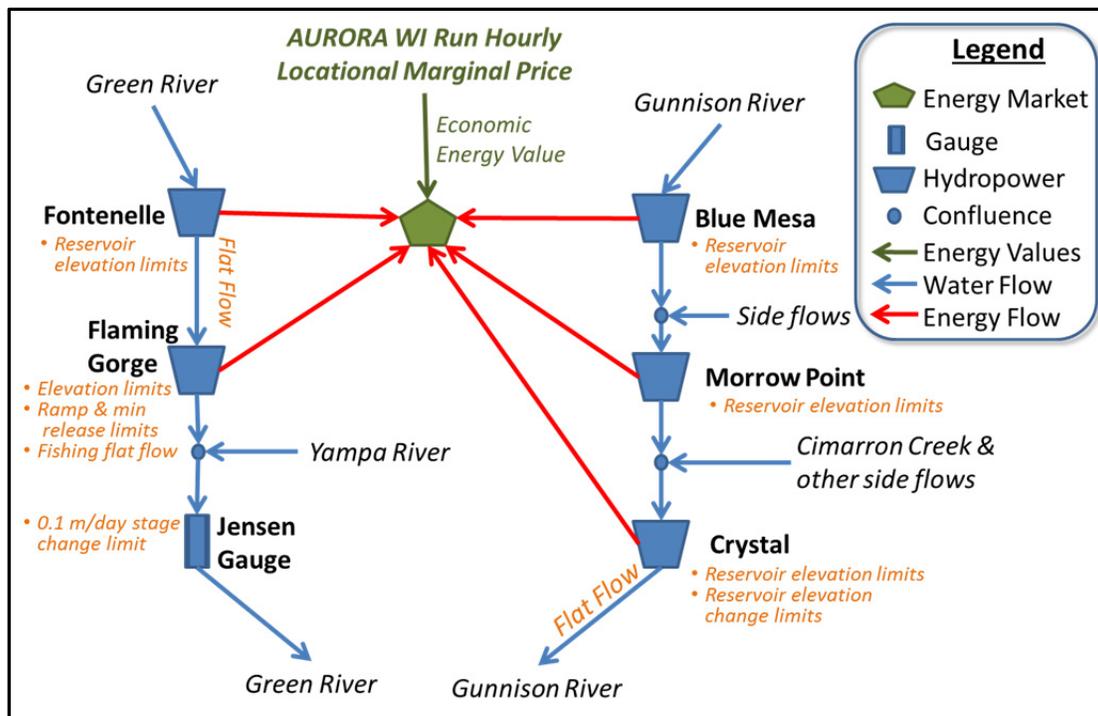


FIGURE K.1-7 GTMax-Lite Network Topology for the Large SLCA/IP Hydropower Resources Other Than Glen Canyon Dam

the first cascade are very loosely connected, but reservoirs in the Aspinall Cascade are very tightly coupled.

Monthly releases and reservoir elevations were obtained from CRSS model results for Alternative A. CRSS also provides information about water inflows into reservoirs, side flows that occur between connected reservoirs, and reservoir evaporation. Other inputs included operating constraints placed on the facilities, such as restrictions on water release ramp rates and flow requirements at the Jensen Gage downstream of Flaming Gorge. The objective function simultaneously maximizes the economic value of the hydropower resource at these five large facilities. The output is an hourly schedule of water releases and electric generation that maximizes the economic value of hydropower resources within the bounds of all operating constraints.

Operating constraints include maximum and minimum limits imposed on all reservoirs and a complex set of restrictions at the Crystal Reservoir that bound the rate of elevation changes over time. In order to ensure that water releases do not violate reservoir operating constraints, the GTMax-Lite model computes hourly water mass balances and reservoir elevations using reservoir elevation-volume functions. Water balancing equations account for water inflows, side flows, evaporation, upstream reservoir water releases, and all releases from the reservoir of interest.

Flows at the Jensen Gage are restricted to daily stage changes of 0.1 meters/day. Because gage flows are directly affected by upstream water releases from the Flaming Gorge Reservoir, GTMax-Lite models gage flows that comply with the daily gage constraint. To optimize Flaming Gorge operations, water travel time distribution (WTTD) functions are used to estimate the time it takes water to flow through Green River reaches, and the attenuation of releases as water travels downstream. For this study, two reaches are defined. The first is from the Flaming Gorge Dam to the confluence of the Green and Yampa Rivers and the second is from this confluence down to the gage. Although WTTD can vary by hydrological condition, for this study a typical WTTD function was derived from Streamflow Synthesis and Reservoir Regulation (SSARR) model outputs. SSARR was written by the Army Corps of Engineers. In general, it takes about 24 hr for the first fractional amount (less than 1%) of a Flaming Gorge release to reach the gage. Typically, all of the water passes the gage 48 hr after the release. Gage readings are computed using a function that relates the flow rate at the gage to the gage stage. Yampa River water flows into the Green River are based on historical monthly data. Based on historical records, for this study a monthly 50% flow exceedance was input into GTMax-Lite.

The temporal modeling methods used by GTMax-Lite for the five large hydropower plants differ from the Glen Canyon Dam configuration because it simulates operations for all hours during every study period day. It was structured and configured differently from Glen Canyon Dam GTMax-Lite because the operating constraints at powerplants and reservoirs in the Aspinall Cascade are fundamentally different from those at Glen Canyon Dam. The imposition of gage constraints at Jensen is also unique. The five-plant configuration of GTMax-Lite needs to be run far fewer times than the Glen Canyon Dam configuration, and therefore it is computationally efficient to model all days.

As shown in Figure K.1-8, time in the five large plant configuration of GTMax-Lite is separated into three periods that include history, primary optimization, and extension. The historical period is required because operations in the past affect future operation. These include operations in the Aspinall Cascade that constrain Crystal Reservoir elevation changes over 1-day and 3-day periods. In addition, operations at the Flaming Gorge Dam need to comply with gage flow constraints. Note that the water travel time from the Dam to the gage is about 2 days. For the first model run, actual historical operations are input into the model. However, for all subsequent optimizations, “history” is obtained from the previous model run. For this study, hourly results for the last 3 days of the primary optimization period are used.

To reduce model end effects and place operations at the end of the simulated period in a good position for the following days, a 1-week extension period is included in each model run. This differs from Glen Canyon Dam GTMax-Lite model runs that apply the previously described wrap technique to reduce model end effects. Results for the extension period are not used by AURORA or in any economic calculations. Instead, results for the extension period are erased and replaced with primary optimization period results from a subsequent model run.

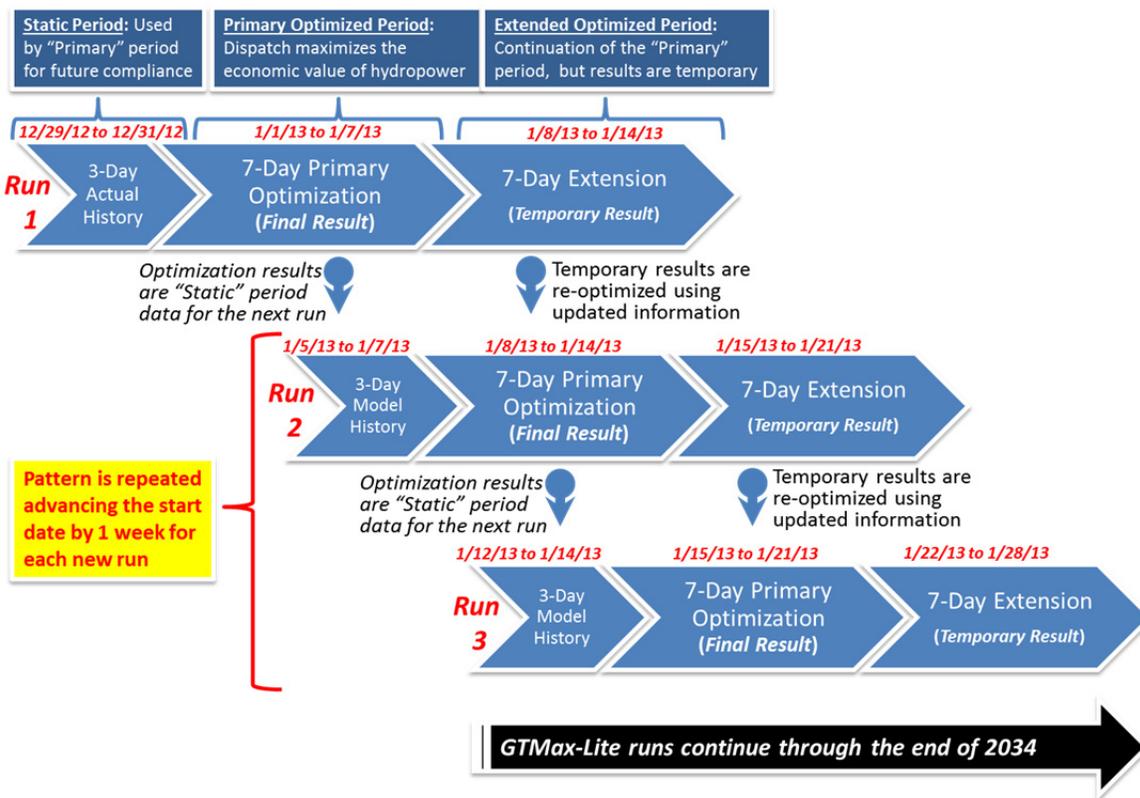


FIGURE K.1-8 Illustration of Temporal Modeling Method Used in the GTMax-Lite Five Large SLCA/IP Plant Configuration

K.1.5.5 Sand Budget Model (Bottom Tier)

The Reclamation SBM schedules various HFEs that differ in terms of peak water release rate, duration, and timing. It uses results from the CRSS model and the intermediate Glen Canyon Dam GTMax-Lite solution. The model is run for each alternative using alternative specific triggers to schedule future HFEs under all 21 hydrological futures and three sediment futures.

SBM maintains the annual WY release volumes specified by CRSS, but reallocates monthly volumes in order to enable higher water releases during months with experiments. Due to the reallocation of water releases, the Glen Canyon Dam GTMax-Lite model is run a second time using the SBM results. It is this second GTMax-Lite run that is used for all economic analyses.

K.1.5.6 Large SLCA/IP Powerplant Spreadsheets (Bridges Bottom and Middle Tiers)

Several spreadsheets were developed by Argonne and reviewed by WAPA for the LTEMP EIS power system analyses. These large SLCA/IP powerplant spreadsheets perform the following functions:

- Create alternative-specific hourly Glen Canyon Dam generation input data for the SLCA/IP market system configuration of AURORA. One set of generation data contains average hourly values computed from GTMax-Lite results for the 21 SBM traces. These values are used for SLCA/IP capacity expansion simulations. The second set of Glen Canyon Dam generation is based on GTMax-Lite results for the representative trace and used for AURORA dispatch model runs.
- Determine the amount of Glen Canyon Dam capacity that will be reserved and available for ancillary services for each day of the simulation period. If these services cannot be entirely fulfilled by the Glen Canyon Dam Powerplant, the amount that needs to be supplied by Aspinall powerplants is computed. Although monthly water release volumes as projected by CRSS are constant among alternatives, the hourly dispatch may be altered at WAPA's discretion during a few hours of the LTEMP period. Therefore computations for Glen Canyon Dam and Aspinall are performed for each alternative.
- Find and store the maximum daily generation level contained in Glen Canyon Dam GTMax-Lite outputs for all alternatives and traces. These data are used by the Firm Capacity Spreadsheet that computes aggregate firm capacity level for SLCA/IP federal hydropower resources.
- Create alternative-specific hourly generation input data for AURORA that represents the five large SLCA/IP powerplants. One set of generation data is

based on GTMax-Lite that models these five large plants based on average monthly releases and reservoir information that is derived from CRSS trace results. These values are used for SLCA/IP capacity expansion simulations. The second set of large SLCA/IP hydropower generation values is based on GTMax-Lite results for the representative trace and used for AURORA dispatch model runs.

- Determine the maximum potential output level from the five large SLCA/IP powerplants. Maximum output levels are computed for all combinations of unit outages at each powerplant based on operating criteria, turbine capacities, forebay elevation, tailwater elevation calculations, and water-to-power conversion factors as a function of head. Except for minor adjustments that account for Aspinall spinning reserve and regulation service duties, maximum output levels are identical across all alternatives. Based on user-defined risk level, spreadsheet results are also used by the Firm Capacity Spreadsheet to set the aggregate firm capacity level for WAPA's SLCA/IP federal hydropower resources.

K.1.5.7 Small SLCA/IP Powerplant Spreadsheet (Bridges Bottom and Middle Tiers)

The capacity and dispatch of relatively small SLCA/IP federal hydropower resources including Deer Creek, Elephant Butte, Towaoc, McPhee, and Molina are estimated using the Small SLCA/IP Powerplant spreadsheet. Estimates of future hourly plant-level generation are on based on historical Form PO&M-59 data and powerplant duty cycle (i.e., baseload or peaking). This spreadsheet is also used to estimate maximum output levels for use in computations of WAPA's SLCA/IP hydropower firm capacity. The same hourly generation and maximum output values are used for all alternatives for both AURORA capacity expansion and dispatch model runs.

K.1.5.8 Loads Shaping Algorithm (Middle Tier)

In order to project hourly customer loads for LTF large and small customers, Argonne analyzed several years of historical load data for the eight large customers that was contained in the FERC Form-714. Normalized loads for CY 2006 were selected to serve as a representative profile and used as the basis for projecting future chronological hourly loads for all LTF customers. The basis for selecting this year is described in more detail in Section K.1.6.3. Normalized profiles cannot simply be multiplied by a constant value (e.g., monthly peak load) to scale loads for a future year, because load factors are projected to change over time as reflected in utility IRPs. The Loads Shaping Algorithm is used to compute hourly scaling factors that, when applied to the normalized profile, produce a time series of chronological hourly loads that simultaneously match both a projected monthly peak load and monthly total load.

The Loads Shaping Algorithm uses a quadratic programming technique that minimizes differences between a normalized load duration curve (LDC) constructed from historical data and a reshaped LDC generated by the model. Figure K.1-9 shows the original LDC, constructed from historical loads for one of the large customers and the reshaped LDC. The reshaped curve is consistent with a projected monthly load factor. Upper and lower load constraints may be specified by the user to bind the model’s solution. For each point in the LDC, a scaling factor, shown on the secondary y-axis, is then computed as the ratio of the reshaped load to the original load. Finally, the algorithm constructs a scaled chronological hourly profile based on the load scaling factors and an associated original hourly load. The end product, as shown in Figure K.1-10, is a chronological load time series that exactly matches the monthly projected peak and total load.

K.1.5.9 AURORA (Top and Middle Tiers)

The AURORA model is at the core of the methodology used to identify SLCA/IP federal hydropower interactions with the power grid. It was developed by EPIS, Inc., and it is used by utilities throughout the United States to model capacity expansion pathways, simulate unit commitments, and perform hourly unit dispatch. Based on information contained in the EPIS,

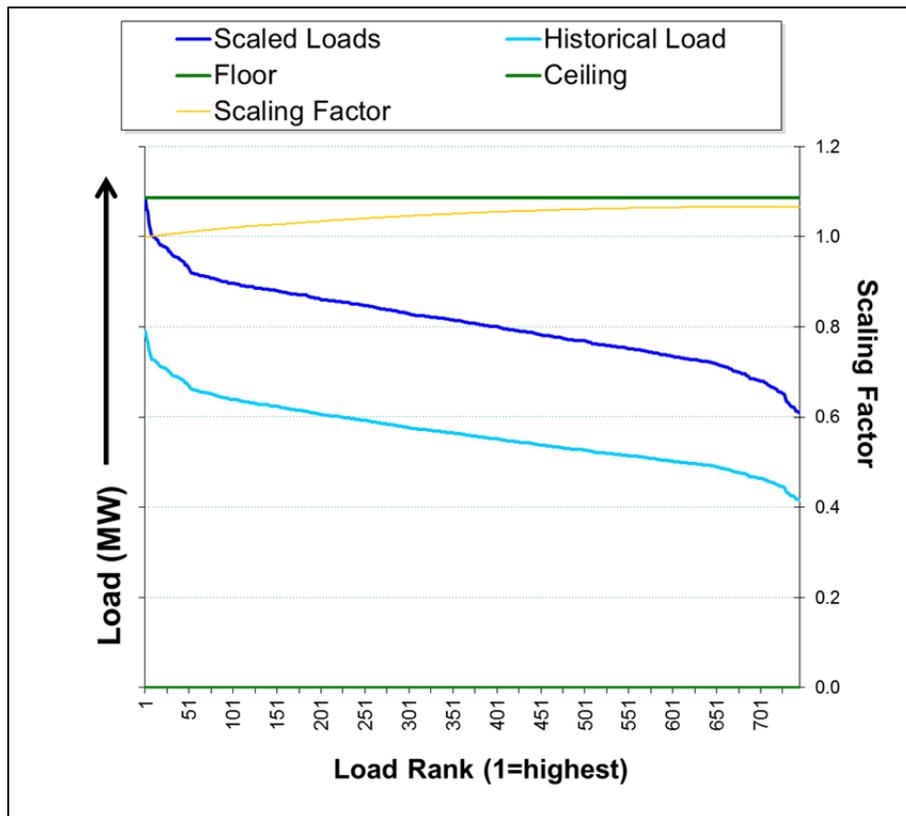


FIGURE K.1-9 Example of the Load Scaling Algorithm LDC

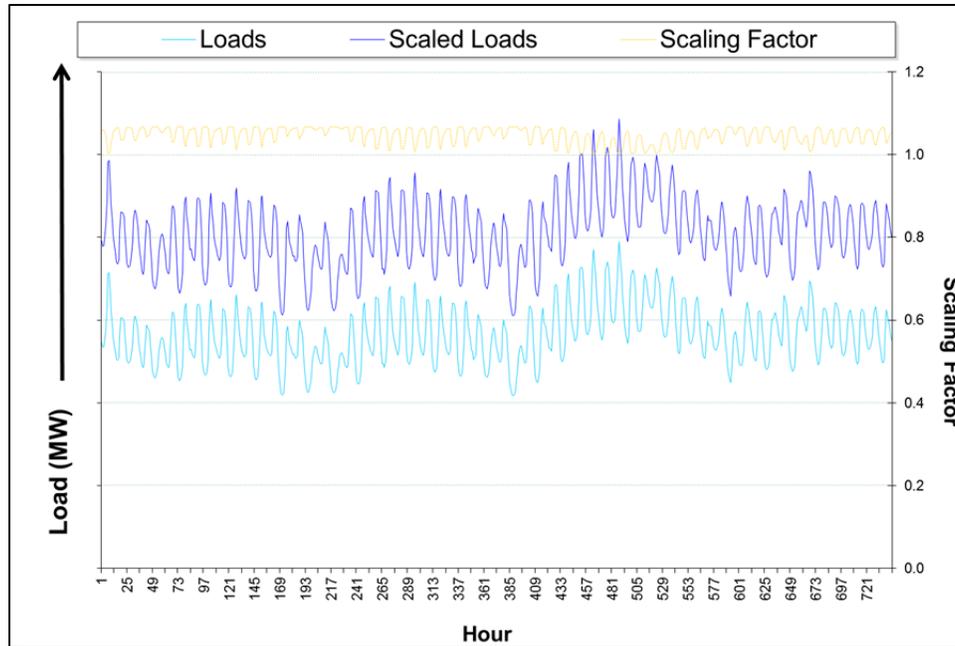


FIGURE K.1-10 Example of the Load Scaling Algorithm Chronological Hourly Loads

Inc., Web page (http://epis.com/AURORA_xmp/long_term_expansion.php), one of the primary uses of AURORA is for lifecycle analysis and resource capacity expansion optimization studies.

AURORA uses hourly demands and individual resource-operating characteristics in a transmission-constrained, chronological dispatch algorithm. This algorithm also models the deployment of curtailments at market price trigger points. LMPs projections are made in user-defined market bubbles over long-term planning horizons. For the LTEMP EIS, it computes LMPS at each of the bubble shown in Figure K.1-1.

A recursive modeling process identifies the set of resources among existing and potential future resources with the highest and lowest market values to produce economically consistent capacity expansion and retirement schedules. Based on the NPV of hourly market prices, it chooses to build one or more technologies contained in a user-defined list of new resource candidates. AURORA compares those values to existing resources in an iterative process to create a capacity expansion path of new units over time. The end result is a coordinated forecast of capacity expansion schedules for multiple market areas that meet planning reserve margin targets. Information from both state renewable portfolio standards (RPSs) and utility-specific IRPs regarding renewable resource development goals were input into the AURORA model to estimate the future expansion of wind and solar resources in the system.

Capital investment decisions made in AURORA use levelized capital investment costs that spread the cost of building a new unit into payments that are made at set time intervals (i.e., weekly, monthly, annually) over the book life of the project, similar to home mortgage payments. In this study, these payments are made and accounted for from the time a new unit

comes online through the end of the LTEMP study period. This reduces modeling end-effects because new units contained in the AURORA expansion path will operate long beyond the end of the LTEMP period. For example, if a new unit is brought online during the last year in the study, only 1 year of capital payments are included in the economic cost calculations, not the entire cost of the project. This reduces issues associated with evaluating technologies that have disparate capital costs and operational characteristics on timelines that do not cover the entire life of the candidate resources.

This leveled cost methodology is equivalent to incurring all capital cost expenditures when the unit comes online and later receiving a salvage value payment at the end of the study period. The salvage value represents the economic value of the resource at the end the study. This approach is used in the Wien Automatic System Planning (WASP) Package. Developed in 1972 by the Tennessee Valley Authority and the Oak Ridge National Laboratory, it has long been in continuous use by many utilities around the world for power generation expansion planning. When using the WASP sinking fund depreciation accounting method, WASP mathematics are equivalent to NPV results used by Argonne in this study (IAEA 1980).

For the LTEMP EIS, AURORA is used in the order listed below for the following purposes:

1. Project Palo Verde market hub prices/LMPs (top tier),
2. Determine construction schedules for new units in the SLCA/IP market system (middle tier), and
3. Simulate unit commitments and perform SLCA/IP market system dispatch (middle tier).

Modeling for the top tier is performed once—the results are used across all LTEMP EIS alternatives. The middle tier of AURORA is run for each alternative.

AURORA is first used to project future hourly energy market prices throughout the Western Interconnection during the study period; that is, for top tier modeling. Without alteration, it uses a Western Interconnection topology and dataset that were provided by EPIS. It should be noted that EPIS derived model input data for load growth, utility fuel price projections, and the cost and performance for new candidate units for system capacity expansion based primarily on information contained in EIA's 2014 AEO (EIA 2014).

For the LTEMP EIS, LMPs at the Palo Verde marketing hub were selected as a representative hourly time series. These market prices are the primary economic driver that shape SLCA/IP hydropower operations in both versions of the GTMax-Lite model and the Small SLCA/IP Power Plant Spreadsheet. The same price set was used for all alternatives. As discussed in Attachment K.1, Argonne assumes that alternative operations at Glen Canyon Dam will have an effect of less than a few cents/kWh on Western Interconnection LMPs outside of the SLCA/IP market system.

The second purpose of the AURORA model was to project system capacity expansion paths and unit retirement schedules for utilities in the SLCA/IP market system based on the assumption that customers will engage in cooperative agreements that are mutually beneficial; that is, middle tier modeling. It uses detailed unit-level information about existing powerplant units owned and operated by WAPA and its LTF customers. The model also includes information about candidate units that could be built in the future. Projected power demands consist of WAPA project use loads (which are described later) and loads for SLCA/IP LTF customers as described above. Capacity is constructed such that the reserve margin of the aggregate eight large customers never drops below 15%.

The firm capacity credit assigned to SLCA/IP federal hydropower resources in AURORA is estimated by the WAPA Firm Capacity Spreadsheet. The firm capacity logic used in this tool is in part based on a risk level consistent with a dry (i.e., low) hydropower condition such that the CRSP Management Center and the EMMO will be able to meet its LTF contractual capacity obligations with SLCA/IP federal hydropower resources 90% of the time. This is consistent with the level of risk to which WAPA has been exposed in the past.

SLCA/IP utility system energy transactions with the rest of the Western Interconnection are assumed to be priced at levels projected by the AURORA Western Interconnection model run. For the purpose of determining capacity expansion paths, it was assumed that the SLCA/IP market system would only make power purchases. This assumption was made to ensure that the SLCA/IP market system would not construct capacity on a speculative basis for the purpose of selling energy to the Western Interconnection; that is, it constructs capacity primarily for internal purposes. Because the Western Interconnection prices tend to be more expensive than production costs in the SLCA/IP market system, purchases from the Western Interconnection tend to be small. However, the Western Interconnection energy was made available for purchase in situations where internal SLCA/IP production costs became expensive. In addition, reserve margin requirements were configured to exclude WAPA LTF purchases because Western's contracts are considered extremely reliable (i.e., non-contingent) from the buyer's perspective.

The third purpose of the AURORA model was to perform a detailed dispatch analysis of the SLCA/IP market system which consists of the SLCA/IP hydropower facilities and WAPA's SLCA/IP LTF customers. Resources available for hourly dispatch are based on a previous capacity expansion run made by AURORA.

K.1.5.10 LMP Calibration Spreadsheet (Top Tier)

Spot market prices were modeled for CY 2013 through CY 2033 by the Western Interconnection AURORA model. Prices from the first year of this run, 2013, were compared against actual day-ahead market (DAM) prices published by the Intercontinental Exchange (ICE) and the California Independent System Operator to determine model accuracy. The Palo Verde market hub was chosen for the LTEMP analysis to represent prices for the spot market in the AURORA network topology because it is a major hub relatively close to Glen Canyon Dam and is often used as the benchmark price for WAPA energy transactions.

In general, AURORA prices differed significantly from both ICE and California independent system operator day-ahead market (CAISO DAM) historical prices for 2013. Therefore, the LMP Calibration Spreadsheet was written to scale AURORA hourly LMPs to more closely match actual nominal values in terms of 2013 dollars. The ICE publishes day-ahead weighted average peak, off-peak, and Sunday off-peak electricity prices for each day. Sunday off-peak hours are the 16 daytime hours that have the highest loads; they correspond to the 16 hr classified as peak in the other 6 days of the week. Hourly prices generated by the AURORA model were subdivided into seven categories: holiday, Sunday daytime, Sunday nighttime, Saturday peak, Saturday off-peak, weekday peak, and weekday off-peak. AURORA 2013 monthly averages were computed for each category and compared against the monthly average ICE prices in these categories.

A scalar (ratio of the ICE to AURORA prices) was generated for each month and each category. Prices generated by the AURORA model were generally lower than the ICE prices. Prices in off-peak hours were lower by about 5 to 15%, and prices in peak hours were lower by as much as 20 to 50%. To adjust prices, both AURORA 2013 and projected LMPs for Palo Verde were multiplied by the aforementioned scalar.

LMPs at the Palo Verde hub were projected by applying AURORA model price growth rates to the calibrated 2013 price (Figure K.1-11). Future spot market prices are difficult to accurately forecast because they are dependent on many factors, each of which cannot be projected with certainty. Therefore, many future scenarios are possible. For the power systems analysis, the 2014 AEO (EIA 2014) reference case was used to supply AURORA with variable inputs that drive future prices. One of the most important of these is natural gas prices. Figure K.1-12 shows a very strong correlation between historical on and off-peak prices at the Palo Verde hub and natural gas prices. This correlation is due the fact that the resources that are on the margin (i.e., last ones dispatch and determine the LMP) frequently burn natural gas. This strong correlation is expected to continue in the future. AURORA model results support this expectation. Figure K.1-13 shows that the 2014 AEO (EIA 2014) forecasted annual average delivered natural gas price to increase in the future. By 2033, natural gas prices are expected to be about 83% more expensive than prices in 2013. Calibrated LMPs follow this same basic trend. By 2033, Palo Verde price projections, which are based on the aforementioned methodology, are expected to increase by 78%. Factors that lead to a slightly slower growth in LMPs include the emergence of more-efficient gas-fired electricity generating technologies that burn less fuel per MWh of fuel consumed and a projected increase in the penetration of variable energy resources (VERs).

K.1.5.11 Firm Capacity Spreadsheet (Bridges Bottom and Middle Tiers)

The Firm Capacity Spreadsheet uses maximum daily output levels from the Large and Small SLCA/IP Powerplant spreadsheets and an assumed risk preference to estimate the amount of firm capacity that is available to the SLCA/IP market system for credit toward the system reserve margin. It also applies outage results produced by the Hydropower Outage model the five large SLCA/IP federal hydropower plants. GTMax-Lite runs of Glen Canyon Dam incorporate outages into estimated daily peak powerplant operations under all 21 hydrological traces.

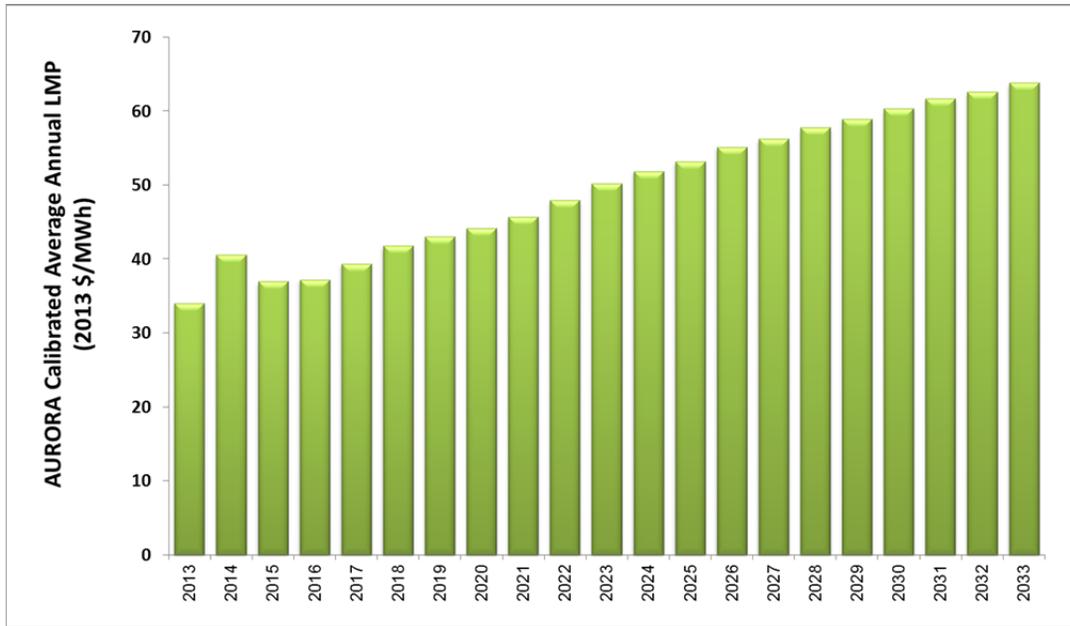


FIGURE K.1-11 Projected Annual Average Calibrated AURORA LMPs at the Palo Verde Market Hub

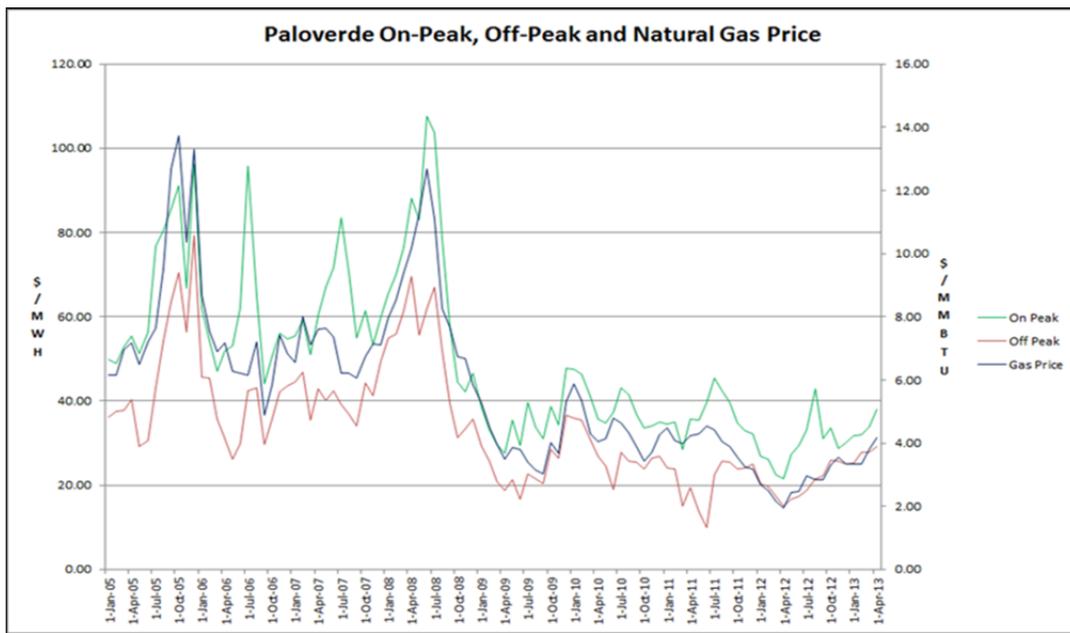


FIGURE K.1-12 Historical Palo Verde On- and Off-Peak Electricity Prices Compared to Natural Gas Prices

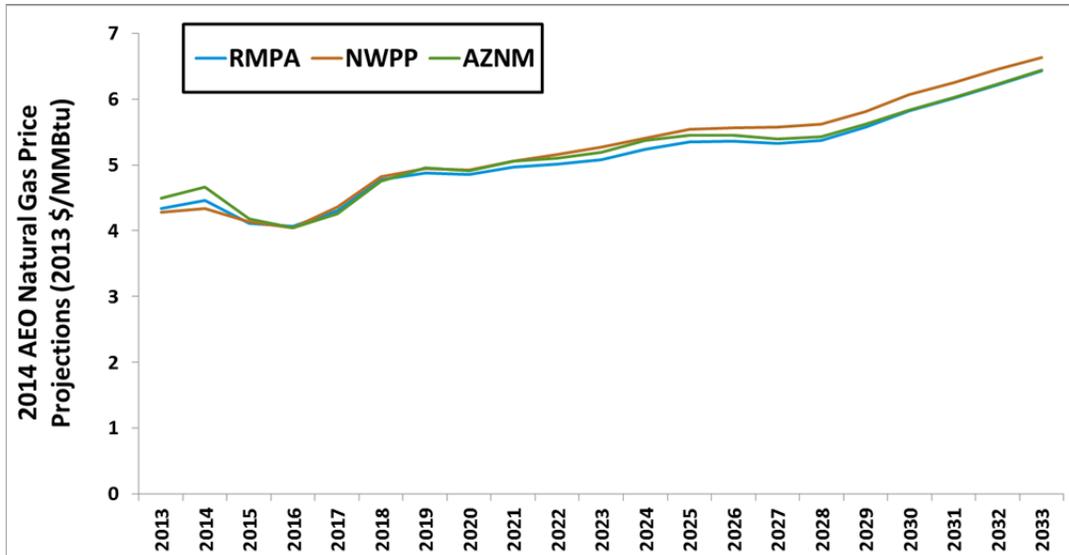


FIGURE K.1-13 2014 AEO (EIA 2014) Projected Delivered Utility Natural Gas Prices

In addition to outages, the spreadsheet incorporates a large number of factors in the determination of firm capacity. As explained in more detail in Section K.1.7, these factors include the following:

- The time of the year the system peak load is projected to occur;
- The probability distribution of the coincidental hydropower peak output potential from SLCA/IP hydropower facilities that consist of all SLCA/IP large and small federal hydropower plants as computed by Glen Canyon Dam GTMax-Lite and the Large SLCA/IP Powerplant Spreadsheet tools;
- Projected ancillary service obligations;
- Projected capacity levels that will be reserved to for project use obligations;
- Expected future system transmission losses; and
- The risk tolerance level associated with SLCA/IP federal hydropower having a lower production capability than the declared firm capacity level during the time of the system peak load.

Firm capacity results vary significantly by alternative and are sensitive to both assumptions regarding the selected risk tolerance level and the month in which the peak load is projected to occur in the future. For the LTEMP EIS, the capacity that is available to the SLCA/IP market system is a fixed amount over the entire study period. Spreadsheet firm

capacity results are input into the AURORA SLCA/IP market system runs that simulate capacity expansion.

K.1.6 SLCA/IP Market System, Data Sources, and Model

The power systems methodology assesses the economic impacts of changes in Glen Canyon Dam Powerplant operations at the systems level using the three-tiered approach briefly described in the Power Systems Geographic Scope section. The middle tier represents SLCA/IP federal hydropower resources marketed and scheduled the CRSP Management Center and all of the utility systems that receive LTF SLCA/IP energy and capacity.

Previous sections described federal hydropower resources and hourly prescribed energy injections into the SLCA/IP market system based on GTMax-Lite model results. This section provides additional information about modeling the loads and resources of CRSP Management Center LTF power customers. There are approximately 129 LTF SLCA/IP wholesale customer entities that are categorized as either large or small. Accounting for about 75% of WAPA's LTF energy and capacity sales, the eight largest customers are Deseret, NTUA, SRP, UAMPS, UMPA, PRPA, Tri-State, and CSU. Except for NTUA, all large LTF customers own and operate generating resources. There are about 130 remaining customers, which are aggregated into east and west "small customer" entities, accounting for the remaining 25% LTF sales. Energy received by a few customers under WAPA LTF contracts are used to serve project use loads such as pumping for irrigation. Figure K.1-3 shows a simplified topology for the SLCA/IP systems that was used by the AURORA model to simulate the capacity expansion pathways and dispatch under each alternative. The following sections describe key model input and modeling assumptions for the SLCA/IP system.

The AURORA model is used to simulate unit commitment scheduling, for resources dispatch, and for capacity expansion in the SLCA/IP market system. Details on model inputs for initial historical conditions and for simulating future operations are provided below.

K.1.6.1 Historical Data Sources

The first year simulated by AURORA is CY 2013. It set initial model conditions based on historical information and serves as a starting point for modeling the future. A considerable amount of data is needed for AURORA to model SLCA/IP market system operations including hourly load data, characteristics of existing powerplants, and firm hydropower contracts that WAPA's customers have with offices other than the CRSP Management Center. Primary data sources for this information include the following:

- EPIS—AURORA database containing general/default power systems data;
- EIA—existing powerplant ownership, capacity, technology type, primary mover, historical delivered fuel prices, plant fuel consumption, historical annual generation;

- ICE and CAISO Web sites—sources of historical day-ahead peak and off-peak electricity prices;
- NERC—power plant maintenance and forced outage characteristics from GADS;
- FERC—historical hourly load data for utilities and BAs;
- Large customer IRPs—a report filed by each of WAPA’s customers and contains characteristics of existing power plants, utility system loads, and DSM programs; and
- WAPA—data and information on LTF contracts from the CRSP Management Center and other regional offices from which WAPA customers receive federal hydropower and detailed information on federal hydropower plant and WACM BA operations, including factors related to ancillary services and the transmission system.

The AURORA model uses a database constructed by EPIS that contains Western Interconnection-wide powerplant characteristics, fuel price projections, and hourly load profiles. These data were compared to the aforementioned data sources to verify their accuracy and consistency. Because the methodology calls for WAPA’s eight large customers to be modeled in detail, Argonne staff constructed hourly load profiles for SLCA/IP system entities and carefully examined power plant characteristics data contained in the AURORA inventory and benchmark them against data on powerplant characteristics compiled by EIA.

Historical 2013 Loads

SLCA/IP market system loads were generated for three types of LTF customers: large, small, and project use. Project use loads are based on information provided by CRSP Management Center staff. These loads are aggregated into east and west groups and are assumed to be constant over each month. Project use loads are projected to increase over the study period, but are relatively small, ranging from a total project use monthly peak load of 4.15 to 51.42 MW. Project use loads are higher in the summer and lower in the winter.

The power systems modeling effort began at a time when historical FERC Form-714 load data for CY 2013 were not yet available. Argonne staff therefore constructed a time series of CY 2013 hourly loads for each of the eight large customers and for each of the two small customers groups classified as east and west.

Loads for 2013 were constructed by the Loads Shaping Algorithm. For the eight large customers, the algorithm scaled representative nominal hourly shapes to CY 2013 levels such that hourly loads were consistent with projected monthly peak and total load targets. As described previously, CY 2006 hourly load profiles were used as the basis for constructing these

nominalized shapes. CY 2013 load targets were based primarily on information contained in large customer IRPs.

Aggregate small customer loads in the west were based on the UAMPS load profile that was scaled to match 2013 small customer energy data used for retail rate analyses. UAMPS projected growth rates were also applied to the west small customer group. An identical method was used for the small customer group in the east, except in this case load profiles and growth rates for CSU were scaled to match small customer energy targets.

Although Western almost exclusively sells LTF capacity and energy to utilities in its service territory, special arrangements were made to enable Tribal entities to receive SLCA/IP federal hydropower capacity and energy. For 48 Tribes that do not operate their own electric utilities, WAPA made an administrative change to allow them to directly receive an allocation of power through a benefit crediting arrangement. In this benefit crediting arrangement, WAPA delivers the Tribe's allocation to its electric service supplier. Because the SLCA/IP rate is lower than the supplier's production cost, the supplier provides the Tribe with a payment that is equal to the Tribe's electric allocation from WAPA multiplied by the difference in rates. The payment received by the Tribe is the financial equivalent of a direct delivery of electricity. Through this arrangement, Tribes ultimately receive the same services, pay the same rates for both capacity and energy, and abide by the same terms as all other customers. For power systems economic modeling, these financial transactions are not explicitly simulated because the effects on overall system-level economics did not appreciably differ among alternatives.

2013 Powerplant Characteristics and Fuel Prices

Recent data (from 2012 and 2013) on thermal power plant characteristics were obtained from EIA Form-860. This information was coupled with monthly cost and quality fuel deliveries from EIA Form-923 to estimate delivered 2013 fuel prices for each of the thermal powerplants in the unit inventory of WAPA's large customers. Fuel prices for 2013 are typically used. However, when this information is not available, 2012 prices are used as a surrogate. AURORA model generating unit capacity levels vary by month, with generally higher capacities in the winter than in summer months.

In AURORA, delivered fuel prices are not directly assigned to each powerplant in its database. Instead, AURORA applies unit-specific fuel price multipliers to a common price. Henry Hub is used as a price reference point for natural gas, and state-level coal prices are used as coal reference points. The EPIS-supplied representation of the Western Interconnection uses actual and projected monthly natural gas prices at Henry Hub for the year 2010 in terms of nominal 2010 dollars. For power systems analysis, AURORA unit-level delivered natural gas prices are converted to 2013 dollars. Prices at points of delivery are typically higher than the Henry Hub price. Therefore, prices are adjusted to account for delivery costs by applying unit-specific price multipliers in the model. Natural gas prices for 2013 are based on plant delivery costs reported in FERC Form-923. Similarly, 2013 coal prices in 2013 nominal dollars are computed in AURORA by applying unit-level multipliers to state-level prices.

Natural gas prices in AURORA differ by month; generally, prices are higher in the winter as compared to the spring and autumn. These same seasonal trends were used for the LTEMP power systems study. No seasonal changes in coal or distillate fuel prices were assumed; that is, coal and distillate fuel prices are constant throughout 2013.

Only one small oil-fired unit is owned by WAPA's large customers. It is rarely dispatched. No adjustments were made to the EPIS default nuclear fuel price. Only one nuclear plant is partially owned by SRP. It is dispatched as a base load unit, and production levels do not vary significantly among alternatives. Therefore, production cost differences for this plant do not have a significant bearing on economic cost differences among alternatives.

O&M Costs for Existing and Committed Units

Real variable O&M costs for existing units and ones that are committed to be constructed are held static at 2013 levels throughout the study period. Note that real costs exclude inflation; therefore it is assumed that the economic cost of O&M for power production in the future will change at the same rate as inflation. Also, federal Principles and Guidelines (P&Gs) for economic and environmental evaluation of water-related resources precludes the use of speculative projections concerning capital and O&M cost.

Fixed O&M costs only factor into LTEMP EIS economic calculations for capacity expansion units because the retirement schedule of existing units and online dates for committed units do not change among alternatives; therefore the economic difference of these "fixed" costs between Alternative A, which serves as a reference point, and other alternatives is equal to zero. However O&M costs for newly constructed powerplants in the future differ by alternative and are therefore tracked and accounted for in the power systems analysis.

2013 Unit-Level Heat Rates

Documentation in the AURORA model acknowledges shortcomings in the default heat rate data in the EPIS-provided database. It recommends that EIA sources of historical generation data, like Form-923, be consulted to confirm plant-specific heat rates. This information was coupled with monthly powerplant generation and the cost and quality fuel deliveries from EIA Form-923 to generate heat rates and delivered fuel prices for each of the thermal powerplants in the unit inventory of WAPA's large customers. AURORA default heat rates differed by as much as 60% from levels calculated from current EIA data. Therefore, in this analysis heat rates calculated from EIA data replaced AURORA default values. However, EIA data was not reported for some thermal powerplants; in those cases, default AURORA values or surrogate values based on similar type plants were used. Some differences were also found when comparing AURORA default delivered fuel prices with those calculated from recent EIA data. When discrepancies were found, calculated fuel prices were used in this analysis. However, AURORA defaults were used for plants that either had no EIA data or where fuel prices were outside of a reasonable range.

2013 Firm Power Contracts

As described previously, contracts between the CRSP Management Center and its LTF customers are not directly modeled. Instead, power systems economic analyses assume that federal SLCA/IP hydropower plants are supply resources for meeting SLCA/IP system (i.e., large and small customer utility) loads. In addition to SLCA/IP capacity and energy, some customers also receive federal hydropower from other regional offices within the WAPA organization. Information on these non-SLCA/IP contracts was supplied by WAPA. These contracts are modeled in AURORA as virtual hydropower plants, the operation of which is constrained by contract monthly minimum and maximum hourly contract limits and total monthly energy bounds.

In addition to federal contracts, customers have contracts with entities that are either within the modeled SLCA/IP system and/or other Western Interconnection entities that are outside of the SLCA/IP market system. Information on these contracts was ascertained from customer IRPs. Details on these other contracts were typically not available. Therefore, Argonne power system modelers created simple representations of these contracts in AURORA using the information that was available in the IRPs. Contracts are modeled in AURORA as virtual thermal power plants with operating limits.

2013 Renewable Energy Resources (Water, Wind, and Solar)

The AURORA model also includes a representation of existing renewable energy resources. These resources include SLCA/IP system non-federal hydropower and wind and solar Variable Energy Resources (VERs) that produce power and serve system loads. Non-federal hydropower plant resources were modeled as AURORA hydropower plants based on the operating characteristics of the resource (i.e., run-of-river or peaking). For 2013 operations, monthly generation levels were benchmarked to actual levels recorded in EIA Form-923. Power production from VERs is represented as a fixed time series of hourly power injections into the grid using locational profiles provided by EPIS in the AURORA Western Interconnection database.

K.1.6.2 AURORA Model Dispatch Results for 2013

Initial model AURORA model runs of CY 2013 produced results that significantly differed from historical monthly generation levels. Model runs were mainly driven by EPIS input data that was supplied with the model. However, after system representation and input data refinements were made, the model results more closely mimicked historical production patterns. Figure K.1-14 shows that the 2013 AURORA generation profile by fuel type for WAPA's eight large LTF customers is similar to actual 2013 levels as found in EIA Form-923. Generation for hydropower plants by LTF customer utilities exactly match prescribed historical levels.

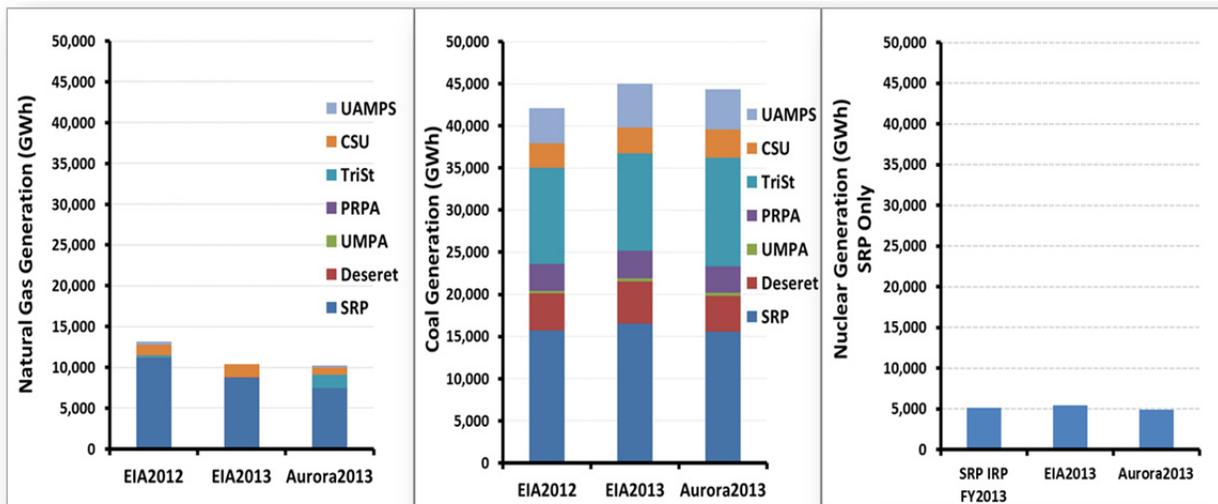


FIGURE K.1-14 Comparison of Modeled and Actual Annual Aggregated Generation Levels (from the EIA) for Natural Gas, Coal, and Nuclear Powerplants under the No Action Alternative

K.1.6.3 SLCA/IP Market System Projections

SLCA/IP market system supply and demand attributes, time value of money assumptions, and projections driving variables such as load growth, delivered utility fuel prices, and new unit technology characteristics play a major role in the development of the system and LTEMP EIS power system results. Projected future developments in the SLCA/IP market system rely on several information sources that include the following:

- Large customer IRPs—future fossil-fuel powerplant additions, VER powerplant planned additions and future expansion goals, and DSM initiatives;
- EIA announced (or committed) new unit additions, 2014 AEO (EIA 2014) candidate technology characteristics, utility fuel price, and load projections as driven by broader forces such as overall U.S. and global macroeconomic developments; and
- WAPA—changes in project use loads and outlooks for future ancillary service requirements.

WAPA LTF customers are required to submit IRPs in order to receive federal hydropower capacity and energy. Information contained in these IRPs was used as a principal source of model inputs for future developments in terms of load growth and resource capacity expansion. However, not all IRPs cover the entire timeframe of the LTEMP EIS study period. Therefore, projections found in the 2014 AEO (EIA 2014) were used to supplement LTF customer IRPs and provide projections that were based on a common and consistent basis.

Load Growth Projections

This section will describe in detail how the hourly loads for the eight large customers and the two groups of aggregate small customers were developed for the years in the LTEMP study period. As noted earlier, small customers were aggregated into an east group or bubble and a west group or bubble.

Developing hourly loads was a three-step process. First, historical hourly load data was gathered for each utility to be modeled. Second, a historical year was selected that best represented the load profiles of all years for which data was collected. The year selected had the best matches to both the average weekly load factor and the average annual load factor across all years. Third, the Hourly Load Forecast Algorithm was used to generate hourly load profiles for all future years for each utility. The model scaled hourly loads so they followed the profile of the representative year and at the same time also match forecasted monthly peak and total monthly energy for each utility modeled.

To find the representative historical year, hourly loads were collected from each large customer for the years 2006 to 2009. The data were compiled by FERC in Form-714 and are publicly available via software downloaded from the FERC Web site (available at <http://www.ferc.gov/docs-filing/forms/form-714/view-soft.asp>). These years were chosen because they were the only recent set of years for which complete annual datasets were available for all eight customers. For more details on load data collection, see Attachment K.7.

Small Customer Loads. As noted earlier, small customers were aggregated into an east bubble and a west bubble. Staff from WAPA assisted Argonne in classifying whether small customers should be placed into the east or west bubble. In general, small customers in Colorado, New Mexico, and Wyoming were put into the east bubble, while small customers in Arizona, Nevada, and Utah were put into the west bubble. Small customer load shapes were based on the representative year from one of the eight large customers. For small customers in the east bubble, the profile from CSU was used; for small customers in the west bubble, UAMPS was used. UAMPS is in the western part of the CRSP Management Center customer territory and is comprised of many cooperating small customers. Therefore, it was judged that UAMPS load shape was representative of small customers in the west bubble. CSU is a municipal utility in the eastern part of WAPA's service territory; therefore, its load shape was used to represent small customers in the east bubble. These load shapes were scaled to match their estimated historical total load based on information that was collected for the retail rate payer analysis described in Section K.3.

Representative Load Shape. After collecting the historical data, total hourly coincidental loads were computed for the eight large utilities for the 2006 through 2009 time period. A weekly load factor (WLF) was calculated for each week in each year for which FERC Form-714 data were available. An average weekly load factor (AWLF) across all years was also calculated. Then the sum of the squared differences (SSD) between the WLF and the AWLF was calculated using the equation $SSD(WLF) = \sum (WLF - AWLF)^2$.² A similar calculation was

performed to find the SSD between the annual load factor (ALF) for each year and average annual load factor (AALF) across all years or $SSD(ALF) = \sum (ALF - AALF)^2$. The sum of the squared differences (squared errors) for both the WLF and ALF were then summed. CY 2006 had the smallest errors and therefore was selected as the representative year for all customer loads because it had the smallest sum, which indicated that, among all years, its relative shape was the closest to the average. Using a common year for all utilities correctly captures load diversity among the utilities, including those resulting from large-scale weather patterns.

After selecting the representative year, the Hourly Load Forecast Algorithm was used to generate hourly load profiles for future years for each of the eight large LTF utilities and for each small customer bubble. Inputs into the algorithm were the utility's hourly load profile for the representative year and the forecasted monthly peak load and energy for each future year. Based on the data that were available, a load forecast was generated using a customized method for each utility. The following describes the method used to generate each load forecast.

Salt River Project

1. Historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Total annual energy for 2012 was specified in the 2013 IRP (SRP et al. 2012). From 2013 to 2033, the annual energy was assumed to grow at the same annual rate as the total electricity sales forecast for the Southwest region of the Western Electricity Coordinating Council in the 2014 AEO (namely, Table 91 in EIA 2014).
3. Annual peak loads for 2012 to 2016 were specified in the 2013 IRP (SRP et al. 2012). From 2017 to 2033, the peak load was assumed to grow at the same annual rate as used for the total annual energy shown above (namely, the data from Table 91 of the early release of EIA 2014).

Navajo Tribal Utility Authority

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Annual peak loads and energy for 2012 to 2030 were obtained from the October 2012 IRP (NTUA 2012).
3. Annual peak loads and energy for 2031 to 2033 were calculated using the same growth rate as 2030.

UMPA

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Annual peak loads and energy for 2012 to 2033 were obtained from the IRP 5-year plan (UMPA 2013).

UAMPS

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. UAMPS staff provided historical monthly energy and peak demand data for 2011 to 2013 (Anderson 2014).
3. There were no growth forecasts in the UAMPS IRP (UAMPS 2013), so the same growth rates were assumed for annual peak and energy as those provided in the UMPA IRP for 2014 to 2033. Members of UAMPS were assumed to have similar energy demand profiles as members of UMPA.

Deseret

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Annual peak loads and energy for 2012 to 2018 were obtained from the IRP update (Deseret 2012).
3. From 2019 to 2033, the annual peak load and energy were assumed to grow at the same rate as the total electricity sales forecast for the Rocky Mountain region of the Western Electricity Coordinating Council in the 2014 AEO (namely, Table 94, in EIA 2014).

Tri-State Generation and Transmission Association

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.

2. Annual peak loads and energy for 2012 to 2029 were obtained from the IRP (Tri-State 2010).
3. Annual peak loads and energy for 2030 to 2033 were assumed to grow at the same rate as 2029.

Colorado Springs Utility

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Annual peak loads and energy for 2012 to 2031 were obtained from the IRP (CSU 2012).
3. Annual peak loads and energy for 2032 to 2033 were assumed to grow at the same rate as 2031.

Platte River Power Authority

1. The historical hourly load profile for 2006 was used. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from 2006.
2. Annual peak loads and energy for 2012 to 2020 were obtained from the IRP (PRPA undated).
3. Annual peak loads and energy for 2021 to 2033 were assumed to grow at the 5-year average growth rate from 2016 to 2020.

Small Customer—West

1. The historical 2006 hourly load profile for UAMPS selected as representing small customers in this bubble.
2. Data was collected for 2012 on retail energy sales from EIA Form-861 and summed for all small customers in this bubble.
3. The annual load factor for UAMPS was assumed to be representative of this small customer group. The annual peak load for 2012 was computed from the retail energy sales in 2012 and the UAMPS load factor.

4. Annual peak loads and energy for 2013 to 2033 were assumed to grow at the same rate as for UAMPS.
5. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from the 2006 UAMPS load profile.

Small Customer—East

1. The historical 2006 hourly load profile for CSU selected as representing small customers in this bubble.
2. Data for 2012 was collected on retail energy sales from EIA Form-861 and summed for all small customers in this bubble.
3. The annual load factor for CSU was assumed to be representative of this small customer group. The annual peak load for 2012 was computed from the retail energy sales in 2012 and the CSU load factor.
4. Annual peak loads and energy for 2013 to 2033 were assumed to grow at the same rate as for CSU.
5. The monthly peak loads and energy were based on the ratios of monthly peak to annual peak and monthly energy to total annual energy from the 2006 CSU load profile.

Peak and total load growth rates may be different, resulting in future load profiles that are either more or less “peaky” in the future relative to historical levels. Also, both peak and total load growth rates differ among individual large utilities and for small customer aggregates. Using this method allows the model to grow loads and transform load shapes uniquely for each profile as reflected in IRPs’ long-term trends.

Figures K.1-15 and K.1-16 show stacked bar charts of customer non-coincidental monthly peak load and total monthly load projections, respectively. As described in sections that follow, projections of the eight large customer system summer peak load is particularly significant. Any reduction in Glen Canyon Dam Powerplant capacity as a result of more stringent operating criteria does not incur an economic cost until all of the excess capacity in the system is fully depleted. The year in which this occurs is heavily dependent on large customer utility system load growth. Attachment K.6 contains more detailed results for individual large customers and for the two aggregate small customer bubbles.

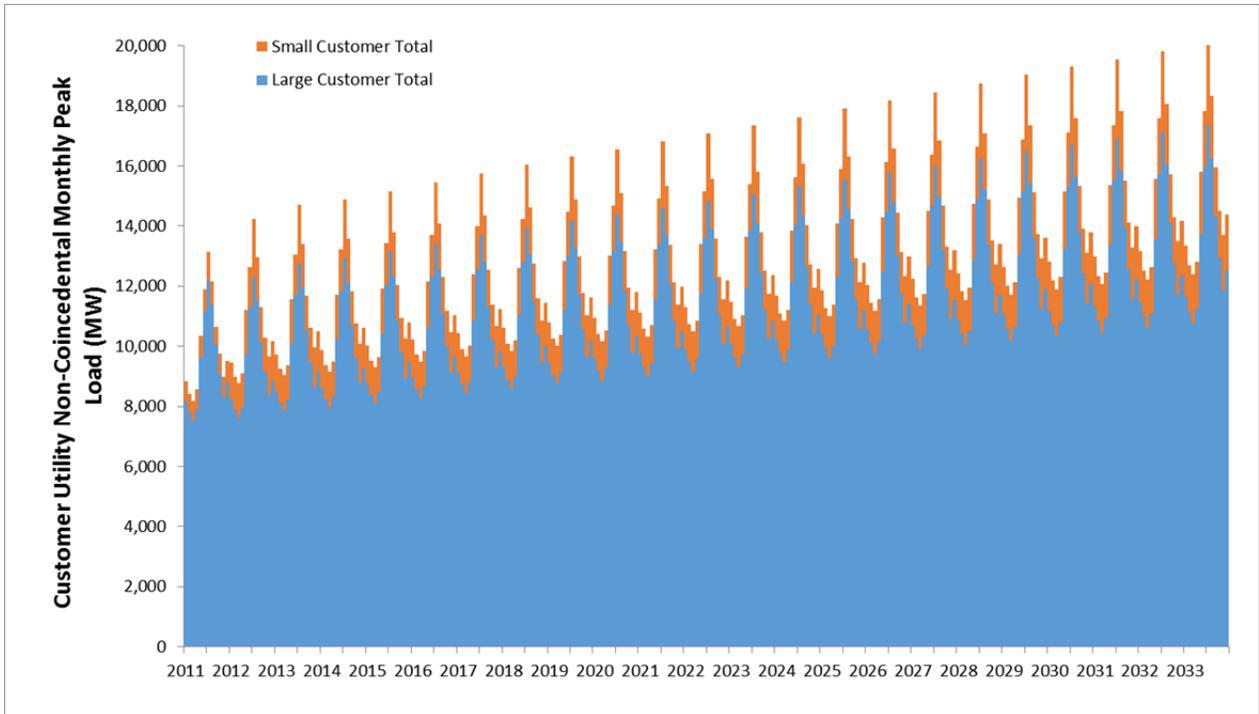


FIGURE K.1-15 Total Non-coincident Peak Loads for the SLCA/IP Market System

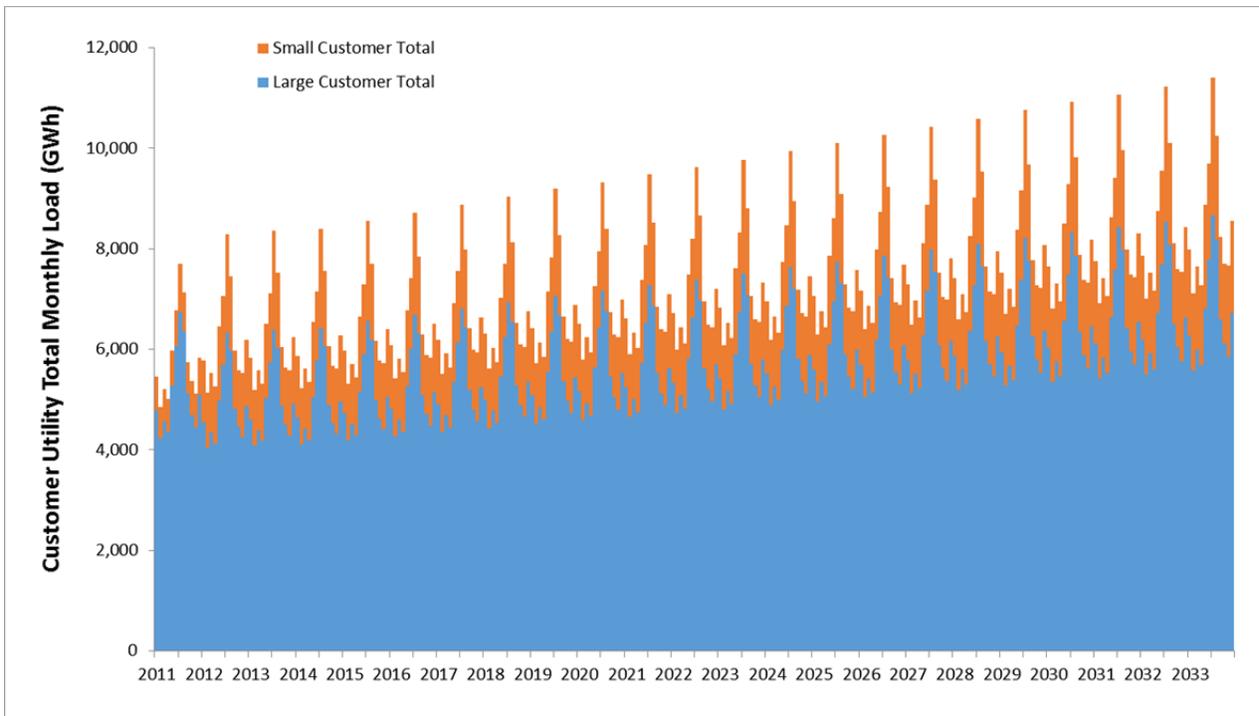


FIGURE K.1-16 Total Monthly Loads for the SLCA/IP Market System

Capacity Expansion Candidate Unit Characteristics

To reliably meet the forecasted increases in electricity demand and to replace powerplants that will be retired during the study period, new powerplants will be constructed in the SLCA/IP market system.

Argonne staff used the AURORA model to create system capacity expansion paths and unit retirement schedules for utilities in the SLCA/IP system for each of the EIS alternatives. As described previously, AURORA uses detailed unit-level information about existing and committed generating units owned and operated by WAPA's LTF customers. The model also includes information about candidate units that could be built in the future. The type and number of new technologies added over time was determined by Argonne staff by tunneling AURORA model capacity expansion runs. In this context, "tunneling" refers to restricting the number of possible model solutions to a smaller set of capacity expansion possibilities (e.g., restricting the number of possible new gas-turbines built in a specific year and location [i.e., bubble], to one to three units instead of the model default of zero to unlimited new units). This technique is often used in capacity expansion planning when the number of combination of expansion technologies is otherwise enormous. It often requires multiple iterative model runs as the user explores different tunnel boundaries such that the solution is not bounded by the user-defined limits. Capacity is constructed such that the capacity reserve margin of the aggregate eight large customers never drops below 15%. Table K.1-1 shows the cost, in terms of 2013 dollars, and performance characteristics of a suite of candidate plants from which the AURORA model could choose to expand capacity of the power system.

Note that the list of candidate technologies input into the AURORA model includes a range of types and sizes. The model "builds" units taking into account load growth, costs, and technology attributes, including the size of each candidate. AURORA makes a trade-off between building large units with economies of scale (lower \$/MW cost for large units) that often leads to excess capacity that may persist for a few years, versus building several small ones that better follow capacity needs (smaller excesses) but are more expensive to build in terms of \$/MW.

Expanding capacity for the aggregate customer group leads to a lower cost as opposed to building capacity for each individual utility. By doing so, customers take advantage of economies of scale and lower amounts of new capacity. The sharing of new capacity can be accomplished via joint unit ownerships and long-term firm capacity agreements among customer utilities.

Expansion candidates were selected from the suite of new central station electricity generating technologies in the 2014 AEO (EIA 2014). The suite includes conventional and advanced thermal units and renewables. Performance characteristics in the table include unit capacity, heat rate, and fuel type, and cost characteristics include capital costs, fixed and variable O&M costs, book life of the unit, and number of years it takes to construct. Costs are shown as a range because WAPA's customers are located in three different geographic regions identified by the EIA 2014 AEO (EIA 2014) electricity market module; each has powerplant-specific labor multipliers. Different labor multipliers were factored into the powerplant costs from EIA depending upon where the plant would be located. Labor costs vary by region where the plant is

TABLE K.1-1 Cost and Performance Characteristics of Capacity Expansion Candidates

Expansion Candidate Technology	Capacity (MW)	Heat Rate (Btu/kWh)	Fuel Type	Unit Book Life (yr)	Construction Lead Time (yr)	AFUDC (% of overnight cost)	Levelized Capital Cost (2013\$/MW/yr)		Fixed O&M Cost (2013\$/MW/yr)		Variable O&M Cost (2013\$/MWh)	
							Min	Max	Min	Max	Min	Max
Scrubbed Pulverized Coal	600	8,800	Coal	30	4	9.83	194,080	197,146	31,491	31,982	4.51	4.59
Integrated Gasification Combined Cycle	550	8,700	Coal	30	4	9.83	250,755	253,980	52,015	52,684	7.31	7.40
Conventional Combined Cycle	300	7,050	Natural Gas	30	3	7.26	59,953	60,429	13,456	13,563	3.68	3.71
Advanced Combined Cycle	400	6,430	Natural Gas	30	3	7.26	66,931	67,407	15,708	15,825	3.34	3.37
Conventional Combustion Turbine	120	10,850	Natural Gas	30	2	4.76	62,438	62,755	7,544	7,578	15.87	15.95
Advanced Combustion Turbine	230	9,750	Natural Gas	30	2	4.76	43,722	44,304	7,297	7,392	10.75	10.89
Advanced Nuclear	2,236	10,452	Uranium	30	6	15.19	385,516	386,997	94,873	95,243	2.18	2.19
Wind	50	0	Wind	30	3	7.26	105,631	106,900	40,996	41,350	0.00	0.00
Solar Thermal	50	0	Solar	30	3	7.26	240,921	253,715	65,452	68,112	0.00	0.00
Photovoltaic	50	0	Solar	30	2	4.76	217,553	225,801	24,055	24,966	0.00	0.00

Source: EIA (2014).

constructed; a regional multipliers table is located on the EIA Website (<http://www.eia.gov/forecasts/capitalcost>).

Overnight capital expenses and fixed O&M costs are based on 2014 AEO (EIA 2014) data and expressed in 2012 dollars. AEO documentation indicates that these costs are applicable to new units built in 2014 and later. It is assumed that these costs will not change in real terms; therefore, capital costs for a specific technology in real terms do not change as a function of online date. The AEO costs do not include expenses paid by plant owners that are plant specific and can vary significantly between two virtually identical plants in the same geographic region. Therefore, financing-related costs are excluded from AEO capital costs, and items like insurance, property taxes, asset management fees, and energy marketing fees are excluded from AEO fixed O&M costs (EIA 2013). The AEO cost values were converted to 2013 dollars using the “Powerplants” index contained in the “Bureau of Reclamation Construction Cost Trends” table (Reclamation undated). The values for January were used because it was assumed that new plants came online at the beginning of the year. Fixed O&M costs were converted to 2013 nominal dollars using this same table, except in this case the “Powerplant Accessory elect. & misc. equip” index was used. Variable O&M costs for new construction are converted to 2013 nominal dollars based on the producer price index (PPI) for “Electric power transmission, control, and distribution energy production” (series ID code pcu22112-22112-) (BLS undated).

In the AEO, capital costs are shown as an “overnight” cost, which is an estimate of the cost at which a powerplant could be constructed assuming that the entire process from planning through completion could be accomplished in a single day. However, in reality a plant takes several years to construct. Money borrowed or committed to a project during its construction must be repaid with interest. The term for this expenditure is allowance for funds during construction (AFUDC). Because capital costs from the 2014 AEO (EIA 2014) for expansion candidates were overnight costs, they did not include AFUDC. Therefore, these additional expenditures were added to the overnight capital cost before the capital costs are leveled. Calculation of AFUDC assumes that a certain percent of the total overnight cost is borrowed at regular intervals during construction. The time series of expenditures is often referred to as an “S curve” of capital spending. The time series of expenditures from the S curve coupled with the interest rate of the borrowed money and the time period over which it is borrowed yields the amount of interest paid per dollar or as the amount of AFUDC as a percent of the overnight cost.

AFUDC is estimated for each technology using a spreadsheet model. For this study, a Weibull distribution was used to represent the S curve of capital spending and the interest rate assumed was 4.28%. Table K.1-1 shows the amount of AFUDC as a percent of the overnight cost. It estimates interest payments monthly using a blended average of long-term taxable and municipal bond rates, which are estimated using information from several sources including the following:

1. WM Financial Strategies (undated)
2. Bloomberg Business (undated)
3. BondsOnline (undated)

Assumed construction times used for the study period were also obtained from the 2014 AEO (EIA 2014). The average projected bond rate in real terms (i.e., actual quoted levels less projected inflation) is expected to vary slightly over time. As a simplification, an annual average bond rate of 4.28% was used regardless of when construction begins. This is the average rate over the 2017 through 2033 time period. It should be noted that during this time period the weighted average annual bond rate fluctuates between 4.16% in 2033 and 4.39% in 2019; that is, a range of only 0.23%.

It should be noted that in order for the power systems analysis to be consistent with other LTEMP resource study areas, the analysis period and assumed implementation date of all alternatives is assumed to occur retroactively. Therefore, in order to best capture the economic impacts of an alternative, capacity replacement for lost Glen Canyon Dam Powerplant capacity may be brought online in the model sooner than what may be physically possible.

Capital costs used for this analysis are similar to those recommended by Energy and Environmental Economics, Inc. (E3), for WECC 10- and 20-year planning studies (E3 2014). Similar to this study, E3 used AEO new powerplant construction cost information as the basis for its recommendations to WECC. However, E3 used data from the 2013 AEO, while this analysis used more recent data contained in the 2014 AEO (EIA 2014). The costs between the two sources were slightly different. Overnight capital costs for the two key technologies selected by AURORA for SLCA/IP market system expansion are somewhat lower in the 2014 AEO (EIA 2014) compared to the 2013 AEO; costs are 5.2% less for advanced combustion turbines and 7.6% less for advanced natural gas combined cycle plants.

E3 also used a method similar to that used in this study by adjusting overnight capital costs to account for additional expenditures like AFUDC. The AFUDC multipliers applied by Argonne are slightly greater than those used by E3. For example, Argonne used an IDC multiplier of 1.0476 for advanced combustion turbines, while E3 used a multiplier of 1.035. For advanced natural gas combined cycle technologies, Argonne used a multiplier of 1.0983 while E3 used a multiplier of 1.068.

Finally, the levelized cost of capital plus fixed O&M cost used in Reclamation's (2007a) *Colorado River Interim Guidelines for Lower Basin Shortages and Coordinated Operations for Lake Powell and Lake Mead* (Interim Guidelines EIS) is consistent with levels used in this study. For a natural gas combined cycle plant, the total cost presented in that EIS was \$75,800/MW-yr (in 2007\$; i.e., approximately \$83,400/MW-yr in 2013\$). In comparison, this study uses a levelized capital cost of capital plus fixed O&M that, depending on location, ranges between \$82,639/MW-yr and \$83,232/MW-yr. No other technologies were considered in the Interim Guidelines EIS; therefore, a comparison cannot be made for the combustion turbine technology.

In an email response (James 2014) sent to LTEMP co-lead agencies following the March/April 2014 Stakeholder Workshop, the Colorado River Energy Distributors Association (CREDA) suggested using capital cost data from a document published by the Electric Power Research Institute (EPRI 2013). In this document, the overnight capital cost of a natural gas-fired combined cycle plant was shown to have a range of 900 to 1,150 \$/kW (in 2011\$); the lower cost unit used wet cooling and the higher cost dry cooling. The wet cooling value was

similar to the value from the 2014 AEO (EIA 2014), which also assumed wet cooling. When AFUDC was added, the cost range became 1,025 to 1,325 \$/kW, which equates to an AFUDC multiplier of about 15% above the overnight cost. This multiplier is substantially more than AFUDC multipliers used by either Argonne or the E3 report. The EPRI report did not provide a rationale for using such a high multiplier. The discount rate assumed by the EPRI study was also greater than the one used by Argonne (i.e., 5% vs. 4.28%, respectively).

CREDA supplied its own capital cost estimate for a natural gas-fired combined cycle plant because it believed that the EPRI data did not fully account for higher elevations and harsher ambient conditions that exist in CREDA member service regions. The capital cost given by CREDA ranged from 1,130 to 1,426 \$/kW. It was assumed that AFUDC was included in these capital costs, but assumptions about calculating the AFUDC were not given. Therefore, we were unable to compare Argonne's and E3's assumptions to CREDA's.

CREDA also supplied an estimate of levelized cost for the natural gas-fired combined cycle plant; the cost range was 108,000 to 132,000 \$/MW-yr. This cost was based on actual Southwest utility experience. Although CREDA did not state the exact discount rate used to determine the levelized cost, it did acknowledge it was greater than 5%. However, based on the capital cost range in units of \$/kW that CREDA supplied, its discount rate would be approximately 6.25%, which is substantially higher than the discount rate used by Argonne.

The economic cost to build a new generating unit and the financial outlays that a utility incurs to build a new generating unit are fundamentally different. For example, utility outlays for taxes and insurance are excluded from an economic analysis because these are transfer payments that are not part of the cost of construction. These costs, however, are important for a utility and therefore are key financial elements in utilities' cost calculation. Also, the EIA costs used in this study are typical values that are adjusted for broad regional construction costs such as material and labor. These data are not utility- or site-specific, which would take into account other factors such as the availability of cooling water. Although these considerations are important for a specific site, more generic/typical values are applied for this analysis. For example, it is assumed that a natural gas combined-cycle (NGCC) unit would be constructed at a site where there is sufficient cooling water to operate the facility, thereby eliminating the need to build expensive dry cooling technologies.

Generating Unit Operating Cost and Fuel Price Projections

This section will describe how fixed O&M costs of expansion candidates generating plants were projected into the future and will also describe how fuel prices for both existing and new generating plants were projected.

Variable O&M Costs for Existing and Committed Units. The AURORA model default database currently contains unit-level estimates of variable O&M costs for the year 2010 in terms of nominal 2010 dollars. These costs are converted to 2013 nominal dollars based on the PPI for “Electric power transmission, control, and distribution energy production” (series ID code pcu22112-22112-) (BLS undated). This equates to an increase in nominal cost of approximately 6.9%, which is reflected in AURORA inputs, thereby affecting unit-level total power production cost.

Future Natural Gas Prices for Existing Units. Unit delivery multipliers are adjusted for future time periods to be consistent with anticipated real price projection changes forecasted regionally by the 2014 AEO (EIA 2014). The cumulative percent increase in natural gas prices are provided in Table K.1-2. Note that all multipliers in the table are relative to the 2013 price.

Future Natural Gas Prices for New Expansion Units. Future natural gas prices for new units constructed by AURORA model expansion plans are specified by bubble and duty cycle. These prices are linked to the absolute real 2013 price levels and price changes over time that are consistent with the 2014 AEO (EIA 2014) prices shown in Figure K.1-17. Prices can also vary by technology type. The 2014 AEO (EIA 2014) price projections are specified in terms of 2012 dollars. These were converted to 2013 dollars using the GNP IPD based on the GNP IPD for January 2013 relative to January 2012 GNP IPD (see <http://research.stlouisfed.org/fred2/data/GDPDEF.txt>).

Natural gas prices in AURORA differ by month; generally, prices are higher in the winter as compared to the summer. In the AURORA EPIS default database, this monthly price pattern is most distinct (i.e., relatively large price range during the year) in early forecast years and gradually diminishes over time. These same seasonal trends were used for the LTEMP power systems study.

Future Coal Prices for Existing Units. AURORA base coal prices are entered at the state level and change annually. Unit delivery coal price multipliers are adjusted for future time

TABLE K.1-2 Cumulative Annual Percentage Increase in Natural Gas Prices at the Henry Hub^a

Year	Percentage Increase
2014	3.7
2015	3.9
2016	14.9
2017	22.2
2018	33.2
2019	29.3
2020	21.5
2021	29.5
2022	33.9
2023	37.6
2024	42.1
2025	45.3
2026	48.8
2027	52.3
2028	55.3
2029	60.4
2030	67.5
2031	71.3
2032	76.5
2033	82.8

^a Natural gas prices are highly volatile, and prices may have changed by the time the EIS was published.

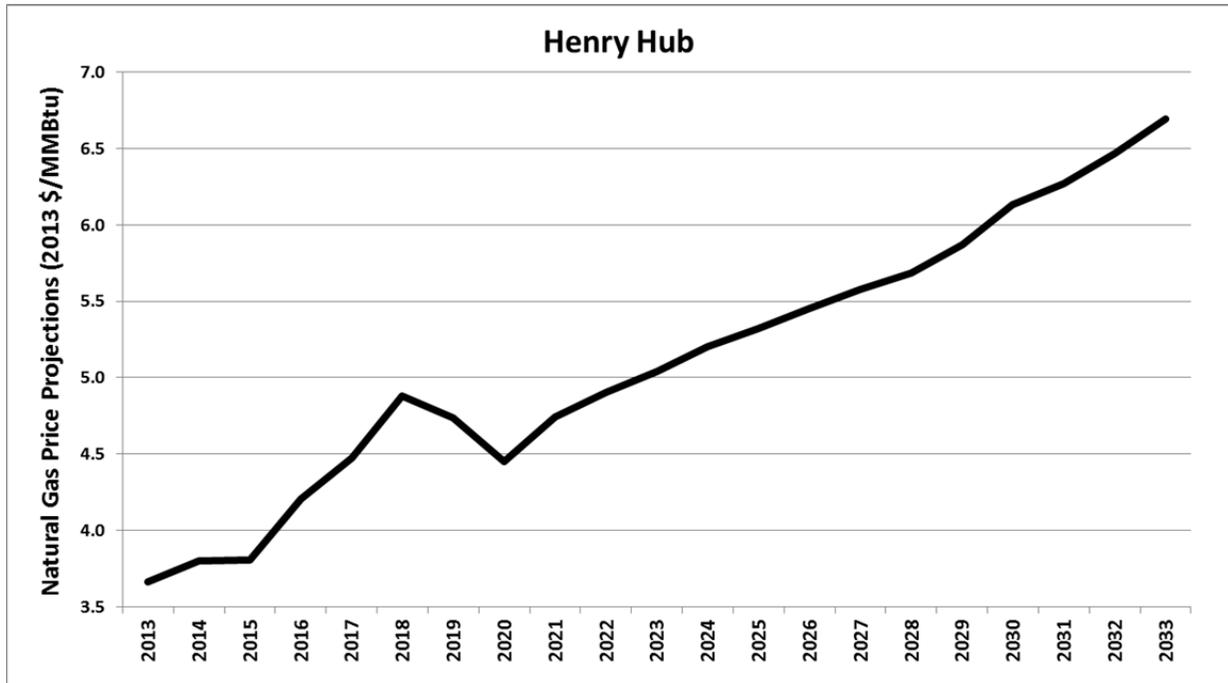


FIGURE K.1-17 Projected 2014 AEO (EIA 2014) Natural Gas Prices at the Henry Hub (Note that natural gas prices are highly volatile, and prices may have changed by the time the EIS was published)

periods to be consistent with anticipated real price projection changes forecasted regionally by the 2014 AEO (EIA 2014) electricity market module shown in Figure K.1-18. Regional multipliers are shown in Table K.1-3.

Multipliers are applied at the unit level, depending on the state in which it resides. Therefore, as shown in Figure K.1-18, states were paired with the AEO regions. Because Wyoming is split between two regions, an average of the two was used.

Future Coal Prices for New Expansion Units. Future coal prices for new units constructed by the AURORA model expansion plan are specified by bubble (i.e., large customer) and duty cycle. These are consistent with absolute real-price levels and changes over time projected by 2014 AEO (EIA 2014), as shown in Figure K.1-19. The 2014 AEO (EIA 2014) price projections are specified in terms of 2012 dollars which are converted to 2013 dollars using the GNP IPD.

Future Distillate Fuel Oil for Existing Units. Future delivered price multipliers are adjusted for future time periods to be consistent with anticipated real price projection changes forecasted regionally by the 2014 AEO (EIA 2014). Regional multipliers are shown in Table K.1-4.

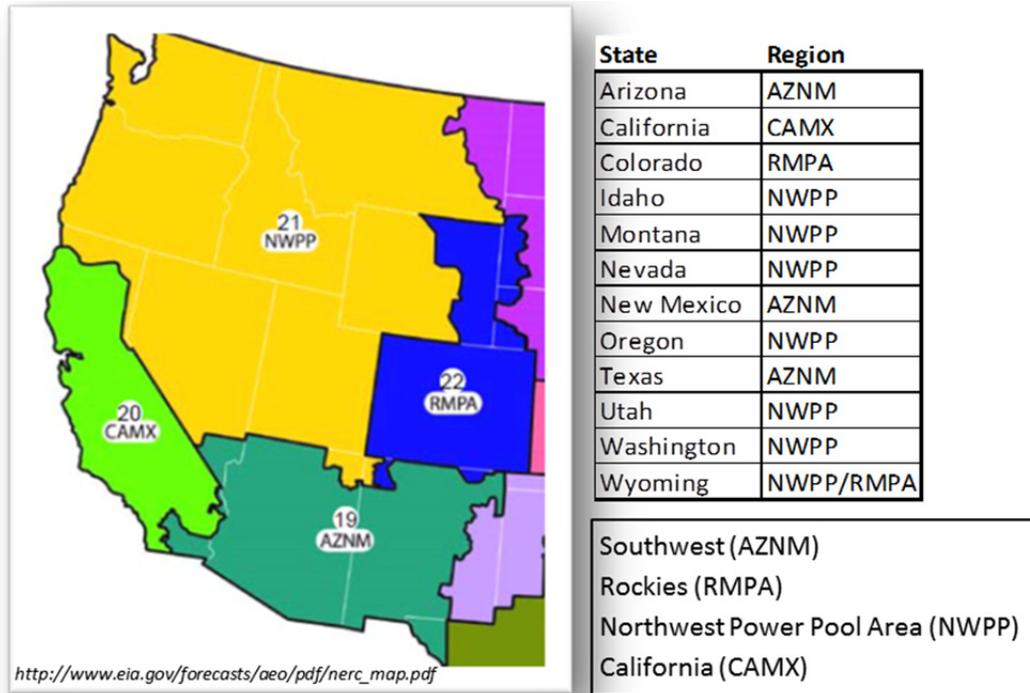


FIGURE K.1-18 2014 AEO (EIA 2014) Electricity Market Module Regions and the Mapping of States to Regions

Future Nuclear Fuel Price for Existing Units. EPIS-supplied nuclear fuel prices and projections were used for power systems modeling. As previously noted, there is only one nuclear plant in the SLCA/IP market system whose production levels do not vary significantly among alternatives.

Renewable Resource Projections

Future renewable resource additions are built by the model such that each utility complies with information included in its IRP. One simplification is that a utility employs a single type of renewable generation to serve future load in each state (namely, solar for Arizona and New Mexico and wind for Utah and Colorado).

TABLE K.1-3 Cumulative Annual Percent Increase in Regional Coal Prices

Region	Year																			
	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
RMPA	-1.6	2.7	6.5	8.8	11.6	13.7	15.8	17.7	20.0	22.1	24.4	26.8	28.7	30.3	29.3	30.0	30.1	30.9	31.7	33.8
NWPP	0.6	4.5	10.0	11.9	14.7	17.1	19.4	20.5	23.0	26.4	28.7	31.2	33.2	35.1	32.6	32.3	31.2	31.5	30.6	34.4
AZNM	-1.7	5.1	8.6	11.6	8.9	9.2	9.6	10.8	12.2	13.7	14.7	15.9	16.8	17.6	18.1	19.2	20.2	21.3	22.3	23.3
CAMX	-4.0	2.7	4.3	5.8	7.8	9.6	11.6	13.1	15.1	17.0	19.1	21.2	22.7	23.9	24.9	26.9	28.7	30.5	31.8	33.1

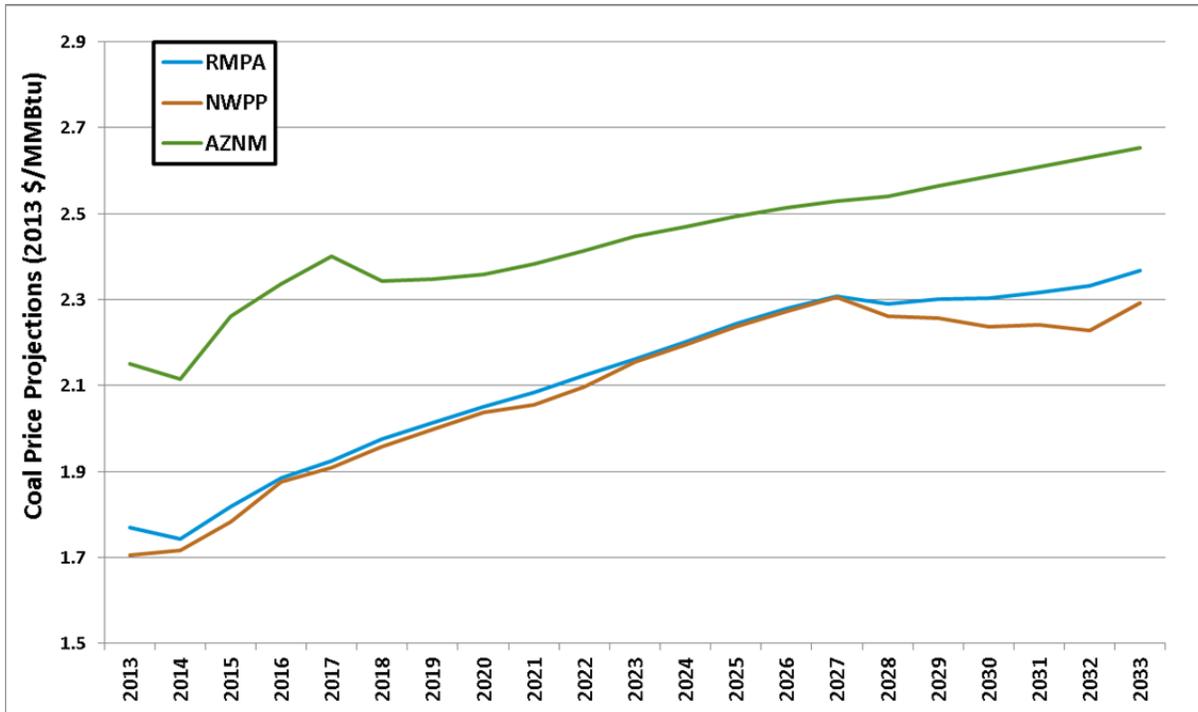


FIGURE K.1-19 Projected AEO 2014 (EIA 2014) Coal Prices by Electricity Market Module Region

K.1.7 Glen Canyon Dam Powerplant Capacity Cost and Benefit Methodology

The difference between the firm capacity level of Alternative A and the firm capacity level under a specific alternative is the amount of additional capacity that will eventually need to be built. It is referred to as lost Glen Canyon Dam capacity and will be replaced at some point in the future by one or more entities in the SLCA/IP market system, which consists of WAPA and its LTF customers. The economic costs of this lost firm capacity is based on the capital and fixed O&M costs that would be expended to construct and operate new units that replace it. The amount of replacement capacity that would need to be built is dependent on several factors, including the level of current and committed system resources, future annual system peak loads, and system reliability criteria. Economic impacts are measured for the system as a whole, where system-wide capacity expansion pathways are simulated and associated costs are computed for each alternative. A time series of costs differences relative to Alternative A is then computed and expressed as a single NPV for each alternative. Capacity replacement costs include capital investment for new capacity plus fixed O&M costs for operating the newly constructed units.

TABLE K.1-4 Cumulative Annual Percentage Increase in Regional Distillate Fuel Prices

Region	Year																			
	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
RMPA	-5.6	-10.2	-13.0	-13.9	-13.0	-11.1	-9.3	-7.3	-5.2	-3.3	-1.5	0.3	1.7	3.5	4.9	6.4	7.6	9.0	10.6	12.2
NWPP	-5.6	-10.4	-13.3	-14.2	-13.2	-11.3	-9.5	-7.5	-5.3	-3.5	-1.5	0.3	1.8	3.4	4.8	6.4	7.6	9.0	10.6	12.2
AZNM	-5.6	-10.2	-13.0	-13.9	-13.0	-11.1	-9.3	-7.3	-5.2	-3.3	-1.5	0.3	1.7	3.5	4.9	6.4	7.6	9.0	10.6	12.2
CAMX	-5.6	-10.4	-13.1	-14.0	-13.1	-11.2	-9.4	-7.4	-5.3	-3.4	-1.5	0.3	1.8	3.5	4.8	6.4	7.6	9.0	10.6	12.2
NWPP/RM	-5.6	-10.3	-13.1	-14.0	-13.1	-11.2	-9.4	-7.4	-5.3	-3.4	-1.5	0.3	1.7	3.4	4.8	6.4	7.6	9.0	10.6	12.2

K.1.7.1 Treatment of Glen Canyon Dam Capital and Fixed O&M Costs

The Glen Canyon Dam and Powerplant were constructed between June 1960 and September 1966. Preceding the construction of the dam, diversion tunnels were dug and a coffer dam was built upstream to divert water from the main dam construction site (see <http://www.usbr.gov/uc/rm/crsp/gc/history.html>). All of the capital costs to build the dam and powerplant were incurred in past. Therefore, the economic costs of these past expenditures are treated as sunk investments under all alternatives; that is, economic costs for building the dam and powerplant are set equal to zero because past expenditures cannot be altered. Furthermore, it is assumed that any additional capital investment in the dam and powerplant that will be incurred in the future is unaffected by an alternative. It therefore follows that capital investment differences among alternatives is also zero. Similarly, Glen Canyon Dam fixed O&M costs are assumed to be unaffected by all of the alternatives. It is also assumed that the total physical 1,320 MW of nameplate capacity at Glen Canyon Dam is identical under all LTEMP EIS alternatives and that the capacity of all powerplant units will not change over the study period.

Past Glen Canyon Dam construction costs and interest expenses are paid by WAPA SLCA/IP LTF customers through WAPA's firm energy and capacity rates. Revenues from the sale of CRSP power are deposited in the U.S. Treasury. These power revenues also pay for irrigation assistance, O&M costs, salinity control, and environmental programs. CRSP power revenues have funded more than \$287 million of costs associated with environmental programs in the Grand Canyon. Of this amount, Glen Canyon Dam environmental experiments recommended through the Glen Canyon Dam Adaptive Management Program have cost \$63.3 million since 1992.

K.1.7.2 WAPA's SLCA/IP LTF Obligations and Glen Canyon Dam Replacement Capacity

Currently, Glen Canyon Dam capacity primarily benefits SLCA/IP LTF customers. Through its marketing program, WAPA currently sells customers bundled SLCA/IP federal hydropower resources, not individual plants. For power systems analysis, firm capacity is therefore determined for the entire system, based on the coincidental sum of maximum daily energy outputs from all SLCA/IP federal hydropower facilities and other factors such as those described in the Firm Capacity Spreadsheet section (Section K.1.5.11). For the LTEMP EIS, Argonne conducted a study of WAPA's SHP commitment levels over the last 10 years; the study is described later in this appendix, in the Firm Capacity Risk Level section. The study found that capacity has historically been marketed such that 90% of the time WAPA's 11 SLCA/IP federal hydropower plants had sufficient maximum operating capabilities to meet customers' total peak requests for energy within the bounds specified by SLCA/IP LTF contracts. This same 90% level is used to determine the firm capacity under all of the alternatives. However, in the future WAPA may choose to market capacity at either a higher or a lower risk level.

Operating criteria differ by alternative in terms of the distribution of monthly water release volumes during a WY and the level of operating flexibility that is allowed at Glen Canyon Dam. Both affect the maximum output level that the Glen Canyon Dam Powerplant is

allowed to deliver during times of SLCA/IP market system peak load. The difference between the Alternative A capacity and the capacity under another specific alternative is the amount of additional capacity that will eventually need to be built above the Alternative A capacity expansion plan. This lost capacity will be replaced at some point in the future by one or more large SLCA/IP LTF customer utilities. For the purposes of economic impacts, it is assumed that the identification of the entities that replaces this lost capacity is inconsequential. As stated previously, this is an economic analysis that measures the net cost difference for the system as a whole, not a financial analysis of individual entities (e.g., a utility company) that operate within the system.

The wholesale rate and retail rate studies that are presented in Sections K.2 and K.3, respectively, discuss potential impacts on individual entities within the SLCA/IP market system. The wholesale rate study also discusses rates under a scenario in which WAPA replaces lost capacity, as well as another scenario in which WAPA makes capacity and energy obligations based on the chronological capabilities of SLCA/IP federal hydropower resources. The latter scenario requires that SLCA/IP LTF customers replace the lost capacity.

K.1.7.3 WAPA SLCA/IP Firm Hydropower Capacity

Argonne used several tools and models of varying levels of detail and complexity to estimate SLCA/IP federal hydropower plant firm capacity levels; that is, the maximum power output that system operators can usually, but not always, rely upon to meet peak loads. Argonne also developed capacity expansion paths for each alternative and associated costs for the SLCA/IP market system. An expansion path describes the timing and type of new units that will be built in the future. It is based on a host of factors such as SLCA/IP firm capacity, the system capacity reserve margin goal, projected fuel prices, the characteristics of existing powerplants, and peak load growth.

Firm capacity is based on the coincidental sum of maximum daily energy outputs for all SLCA/IP federal hydropower facilities. The method used varies by powerplant size and operating criteria. Figure K.1-20 lists SLCA/IP federal hydropower facilities grouped by size. The figure also provides information on the models, parameters, and data used for estimating firm capacity.

The entire physical capacity of SLCA/IP federal hydropower resources is not available to meet LTF customer loads. Instead capacity is reserved for other purposes. As shown in Figure K.1-21, some of these purposes include capacity set aside to serve project use loads such as pumping for irrigation, replacing transmission losses, providing spinning reserves, and performing regulation services. A more detailed description of these components is provided next.

From an operational standpoint, the capacity that is reserved for these purposes is known with a relatively high degree of certainty. However, at any single point in the future, the impacts of unit outages, reservoir elevation, and environmental operating criteria on hydropower resource capacity are highly variable and cannot be predicted without forecast error. Therefore, SLCA/IP

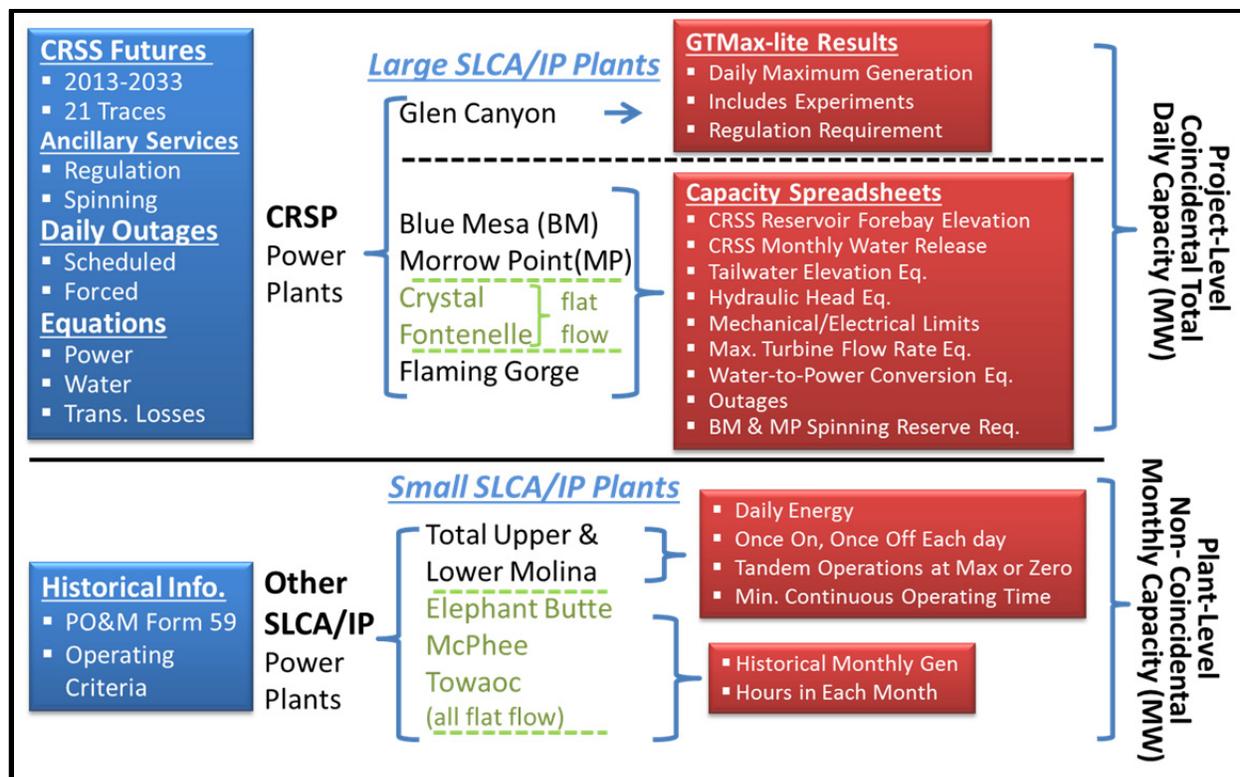


FIGURE K.1-20 WAPA SLCA/IP Hydropower Powerplants

federal hydropower resources are exposed to risks because the future of both reservoir conditions and the operating state of generating units are not known with certainty. This risk level is directly related the amount of firm capacity that is assumed (that is, the lower the amount of firm capacity, the lower the risk). The power systems methodology uses a probabilistic approach to quantify this risk.

Project Use Loads

WAPA has an obligation to serve project use loads such as pumping for irrigation. These loads are also given a high priority in LTEMP power system models; that is, these loads must be satisfied before other SLCA/IP market system loads are served. Summary data that describes project use obligations was obtained from the CRSP Management Center. These obligations were transformed into hourly “flat” load vectors. During the study period, one new project use load will come online: the Navajo-Gallup Water Supply Project. From discussions with CRSP Management Center staff, it was determined that there would be additional project use loads from this project of 5 MW load in 2018, 2023, 2024, and 2029, for a total increase of 20 MW. Loads are assumed to be identical for both capacity and energy economic analyses. In addition, these loads are assumed to be unaffected by alternative.

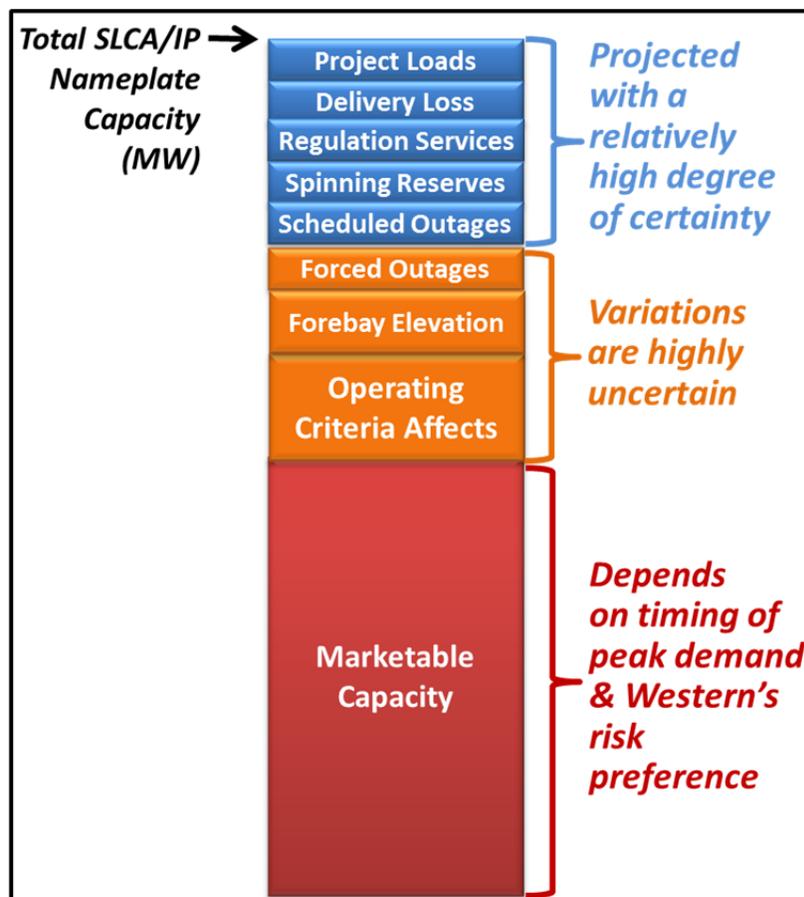


FIGURE K.1-21 SLCA/IP Federal Hydropower Capacity Uses and Variability Factors

Delivery Losses

Energy is lost in the process of transporting energy from SLCA/IP federal hydropower generation points to points of energy delivery. Under current accounting practices, which were established after system consolidation measures were implemented, transmission system losses are set to 5% (Scheid 2015). Therefore, it is assumed that marketable capacity that is delivered to customers is reduced by this same percentage. For example, when the Fontenelle Powerplant produces its maximum output of 10 MW, it is assumed that only 9.5 MW is delivered to demand points; that is, for accounting purposes, 0.5 MW is lost during the transmission process. As described in section K.1.3.2, 5% losses for SLCA/IP energy deliveries are also accounted for in AURORA model capacity expansion and dispatch simulations.

Ancillary Services

As part of its power pool agreements, WAPA has an obligation to provide ancillary services. SLCA/IP resources provide regulation reserves and fast spinning reserves. As shown in

Table K.1-5, both of these ancillary services are projected to increase by up to 80 MW. The maximum requirement is reached in 2025 for regulation reserves and in 2030 for fast spinning reserves. A total of 160 MW of ancillary will then be maintained from 2030 into the foreseeable future. Estimates of future ancillary service levels were provided by Reclamation based on a discussion with WAPA staff in May 2013.

Figure K.1-22 shows how the methodology used for this study explicitly reduces the operating range of plants that provide one or more ancillary services. A plant’s hourly maximum output is reduced by the level of regulation service and spinning reserve provided. In addition, when providing regulation services, the minimum generation level is also increased by the level of regulation service provided. Note that under current power pooling agreements, a powerplant simultaneously provides identical levels of up and down regulation. Based on discussions with power system operators, the priority for ancillary services provided by SLCA/IP federal hydropower resources is as follows. The first priority is to serve both regulation services and spinning reserves at Glen Canyon Dam. However, if the Glen Canyon Dam Powerplant has insufficient capacity to serve both or doing so would increase Glen Canyon Dam non-power water releases, spinning reserves will be off-loaded to powerplants located in the Aspinall Cascade and, if absolutely necessary, followed by regulation services.

When Glen Canyon Dam serves regulation services, it instantaneously fluctuates above and below a fixed generation set point. For example, when the hourly set point is 500 MW and regulation services is 60 MW, generation will go to a minimum of 440 MW when regulating down and go up to a maximum of 560 MW when regulating up. Based on conversations with EMMO staff, the net energy generated to provide regulation over a 1-hour time period is very close to zero; that is, instantaneous fluctuations in generation above and below the generation set point sum to zero. In the example above, 500 MWh of generation would be generated during the hour.

Because water release restrictions at Glen Canyon Dam are specified in terms of average hourly flow rates, and not instantaneous limits, regulation services can continue to be provided when releases are at an environmental flow rate limit. For example, a powerplant’s generation can be set for an hour to a level that exactly releases the minimum water flow rate requirement. When providing regulation services during this hour, instantaneous flow rate will sometimes be lower than the environmental “hourly rate” minimum (regulating down), but these low flows will be offset by instances when it is higher than the minimum flow (regulating up).

TABLE K.1-5 Assumed Ancillary Services Provided by SLCA/IP Hydropower Facilities from 2013 to 2030

Year	Ancillary Services (MW)		
	Fast Spinning Reserves	Regulation Reserves	Total
2013	43	60	103
2014	45	62	107
2015	47	63	111
2016	50	65	115
2017	52	67	118
2018	54	68	122
2019	56	70	126
2020	58	72	130
2021	60	73	134
2022	63	75	138
2023	65	77	141
2024	67	78	145
2025	69	80	149
2026	71	80	151
2027	73	80	153
2028	76	80	156
2029	78	80	158
2030+	80	80	160

Regulation services will affect the operating range at Glen Canyon Dam. The sum of the regulation service plus the operational set point cannot exceed the physical maximum MW output of the *entire* powerplant. The maximum physical output of the plant is dependent on the number of units that are operational and Lake Powell's water elevation. At the other extreme, the set point operation minus regulation service cannot be less the minimum operating limit of a *single* Glen Canyon Dam unit.

Spinning reserves only affect the maximum set point at Glen Canyon Dam. Under normal operating conditions, this spare or reserved capacity is not utilized. However, events such as a unit forced outage or downed power lines may result in a sudden grid energy imbalance; that is, there is not enough energy production to serve load. To overcome this deficiency, spinning reserves are deployed and one or more powerplants increase output to return the system to a balanced state as quickly as possible.

When spinning reserves are deployed at Glen Canyon Dam, the powerplant very quickly ramps up production by a maximum of 60 MW. Under these conditions, the water release up-ramp is allowed to exceed environmental operating limits. Glen Canyon Dam "emergency exception criteria," which are stipulated under all alternatives, allows Glen Canyon Dam to operate outside of minimum and maximum flow limits, daily changes constraints, and both maximum hourly up- and down-ramp rates in the event of a power system emergency (e.g., grid energy imbalance events). However, similar to regulation services, the set point generation level plus the spinning reserve service cannot exceed the physical maximum MW output of the *entire* plant. As shown in Figure K.1-22, when both ancillary services are being served, the sum of set point, regulation, and spinning reserves cannot exceed then maximum output capability of the plant.

The economic cost of providing ancillary services at Glen Canyon Dam varies by alternative, such that the greater the operational flexibility is, the higher the cost of serving regulation and spinning reserves will be. Under flat flow alternatives, ancillary services do not typically affect the operating range because there is no flexibility in the system. On the other hand, ancillary services at times bind (i.e., lower) the maximum output level at Glen Canyon Dam. These binding events occur when the monthly water release volume allows for a relatively large daily operating range and a higher base flow. Glen Canyon Dam unit outages and lower reservoir elevations exacerbate the economic impacts of this constraint by essentially lowering the maximum physical output of the plant.

The time series of ancillary service projections shown in Table K.1-5 was used in GTMax-Lite model runs that determine differences in capacity and energy value among LTEMP EIS alternatives. Glen Canyon Dam currently supplies a total of 67 MW of ancillary services,

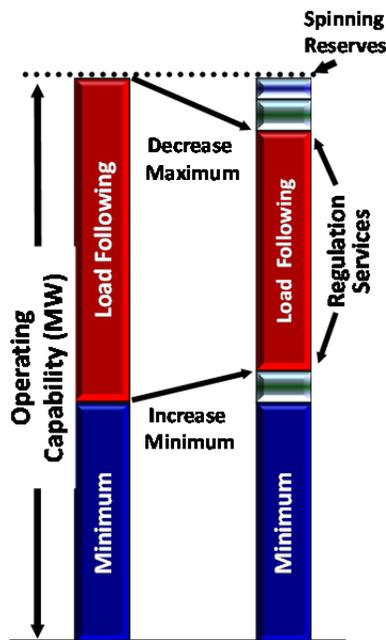


FIGURE K.1-22 Reductions in Operating Range when Providing Ancillary Services

and this is not expected to increase during the LTEMP study period. Therefore, a sensitivity study was performed to determine how firm capacity levels will change if a different ancillary services schedule is used. The sensitivity study and results are reported in Section K.1.10.8.

Outage

All of the SLCA/IP hydropower resources undergo both scheduled and forced unit outages, during which times a unit either produces no output or produces at a level that is lower than its full capability; that is, the capacity is temporarily de-rated. Maintenance is normally performed during a scheduled outage, while forced outages typically occur at random, and are precipitated by the failure of one or more unit/plant components.

For the LTEMP study, the Reclamation provided Argonne with unit-level maintenance schedules for the six largest SLCA/IP facilities over the study period. When a unit is taken out of service for maintenance, the maximum output of that unit is set to zero in all pertinent modeling processes, including both versions of GTMax-Lite and spreadsheet tools that estimate maximum physical output levels at large SLCA/IP hydropower resources other than Glen Canyon Dam.

To represent unit forced outages at large SLCA/IP powerplants, a methodology was developed to incorporate the number, cause, and duration of forced outages that may potentially occur during the study period. Data on forced outages for hydroelectric turbines were obtained from the GADS. This database is maintained by NERC and contains operating information on electric generating equipment. GADS data were input into an algorithm that produces a plausible series of random outages for units at the Glen Canyon Dam Powerplant. Using a different set of random draws for each run, the forced outage model performed numerous simulations. The run that produced the most representative time series of outages in terms of matching overall GADS statistical averages was selected. It should be noted that the forced outage model only represents full unit outages. It therefore does not directly represent partial outages. However, the model uses equivalent outage statistics that implicitly account for these types of outages. For example, if a unit is de-rated by 25% over a 6-month time period, the equivalent outage rate would be 12.5%. Details of the forced outage algorithm and methodology are described in Attachment K.5.

Scheduled and forced outages are not explicitly modeled for small SLCA/IP federal hydropower resources. However, outages are reflected in the model to the extent that unit down time is reflected in Form PO&M-59 data, which is ultimately used to model small federal hydropower facilities. For example, if the McPhee unit was down for an entire month, a zero generation level would be reported by Form PO&M-59 for that month, which would affect the results produced by the Small SLCA/IP Powerplant Spreadsheet model. Although this methodology is not the most accurate modeling approach, it should be noted that the total small facilities capacity is less than 3% of the entire SLCA/IP federal hydropower capacity. Therefore, modeling errors were judged by Argonne staff to be negligible.

Maximum Power Plant Output, Forebay Elevations, and Monthly Releases

The surface water elevation in a reservoir affects both hydropower maximum possible output level and the amount of water that needs to be released through a turbine to produce a unit (MWh) of energy. For the large SLCA/IP hydropower resources, end of the month reservoir elevations, also referred to as forebay elevations, were projected using Reclamation's CRSS and the SBM models.

Because EIS alternative operating criteria affect monthly Glen Canyon Dam water releases, and therefore Lake Powell water elevations, CRSS and SBM make separate projections for each alternative. Future hydrology conditions are not known with certainty; therefore, the CRSS model projected 105 possible outcomes at the end of each month throughout a 2013 through 2060 time period, inclusive. Although 48 years of monthly outcomes were projected, only the first 21 calendar years (20 water years) were used for analysis in the EIS. Each outcome, also known as a "trace," is based on a unique historical series of hydrological conditions. Therefore, hydrological conditions are deterministic and it is extremely unlikely that any one trace will ever be repeated. Of these 105 traces, a common set of 21 was used by all EIS research areas.

Using this information, the GTMax-Lite model is used to optimize the hourly operations of the Glen Canyon Dam such that it maximizes the economic value of energy. As described previously, GDC GTMax-Lite runs were performed twice. The first provides input to the SBM and the second run accommodates experimental releases using altered SBM monthly water release volumes and reservoir elevations. Hourly operations are projected over the entire time period for all 21 traces for each alternative. Daily maximum daily generation levels from Glen Canyon Dam GTMax-Lite output for all alternatives and traces are stored for use by the Firm Capacity Spreadsheet.

The maximum monthly physical output levels for the other five large SLCA/IP hydropower resources were computed over the entire study period for all 21 CRSS traces. Each powerplant's maximum possible output level is based on the following set of conditions, limits, and equations;

1. Mechanical/electrical turbine capacity limit;
2. Unit operating status (either operating or out of service);
3. Reservoir elevation as a function of water storage;
4. Maximum turbine water release as a function of head (forebay minus tailwater elevations);
5. Tail-water elevation as a function of maximum flow rate; and
6. The water-to-power conversion factor that is a function of reservoir forebay elevation.

In order to solve for the above set of relationships, an iterative process is used to converge all interdependent relationships to a consistent set of values. Interdependencies occur because the tailwater elevation is a function of the turbine flow and the turbine flow is a function of the system head, which is the difference between the tailwater and reservoir forebay elevations. In addition, the total turbine flow rate, and therefore tailwater and head, depend on the number of units that are operating. End-of-month reservoir forebay elevation levels that are used in the dispatch process for the other five large SLCA/IP hydropower plants are obtained from the CRSS model.

The physical maximum output level for the small SLCA/IP federal hydropower plants was set to the nameplate capacity. However, for small run-of-river hydropower plants, historical maximum output levels are based on the MWh of energy that a plant produced during a month divided by the number of hours that occurred during the month. The maximum output is typically achieved only at the Molina units.

Operating Criteria Effects on the Maximum Output Level

In addition to physical limitations, operations at all SLCA/IP hydropower plants are required to remain within a set of institutional and environmental limitations. For power systems analysis, SLCA/IP modeled operations are restricted by three types of limitations. These include (1) reservoir operating restrictions, (2) reservoir water release constraints, and (3) downstream gage stage and water flow limitations. Each of these affects the maximum daily output level. Depending on the situation, operating criteria do not allow a powerplant to reach its maximum physical output potential.

Glen Canyon Dam. The impact of operating criteria on Glen Canyon Dam maximum output levels is both complex and situational, involving not only the criteria, but also other factors such as the ancillary service requirements, monthly water release volumes, Lake Powell Reservoir elevation, and the number of operational units. End-of-month Lake Powell Reservoirs were obtained from the SBM.

To provide accurate estimates of the operating criteria on Glen Canyon Dam maximum output levels, Argonne optimized its hourly dispatch using a configuration of the GTMax-Lite model that only models Glen Canyon Dam. The GTMax-Lite model incorporates all environmental constraints imposed on Glen Canyon Dam from the current operating regime, such as restrictions on reservoir water release up/down ramp rates, minimum and maximum hourly release rates, and flow rate changes over a rolling 24-hour period. It also includes a projected maintenance schedule provided by Reclamation and a set of random unit forced outages. When physically possible and economically advantageous, the Glen Canyon Dam Powerplant also has ancillary service requirements, which, as discussed above, can impact Glen Canyon Dam's operational range.

For Glen Canyon Dam, the daily capacity level is set to the maximum output level that was modeled each day by GTMax-Lite. Although all operating criteria at Glen Canyon Dam

potentially affect the maximum output potential, the daily change constraints in combination with water availability typically are the most binding. In addition to the aforementioned operating criteria, HFEs also affect capacity.

Aspinall Cascade: Blue Mesa, Morrow Point, and Crystal Dams. The Aspinall Cascade is operated as a tightly coupled, multipurpose system with a total nameplate capacity of approximately 283.4 MW. Plants in the cascade include Blue Mesa, Morrow Point, and Crystal. At the top of the cascade (i.e., highest elevation), the Blue Mesa Powerplant operates in a peaking mode. Located 12 mi downstream from Blue Mesa, the Morrow Point Power Dam is in the middle of the cascade. When four boats operate in the Morrow Point Reservoir, there is a minimum reservoir elevation requirement of 7,151 ft. In addition, the Morrow Point Reservoir cannot be drawn down by more than 3 ft per rolling 24-hour period if the surface elevation is below an elevation of 7,144 ft. When four boats are not operating, the minimum reservoir elevation is 7,125 ft.

The Crystal Powerplant is at the bottom of the cascade. In addition to functioning as a power generation unit, its operations stabilize the flow of water through Gunnison National Park. The flat flow requirement precludes it from rapidly changing its power output from one hour to the next. Operating criteria for the Crystal Reservoir are season specific. During the wet season (March 1 to June 30), the operating criteria limit reservoir drawdown to no more than 4 ft in a 24-hour rolling period, 5 ft over a 48-hour rolling period, or 6 ft over a 72-hour rolling period, and so on. In addition, once an elevation of 6,748 ft is reached, the reservoir level may not drop by more than 0.5 ft per 24-hour rolling period. During the remainder of the year, there is a 10-ft-per-24-hr-period fluctuation limit, with a maximum 3-day drawdown of 15 ft. If the reservoir elevation is below 6,733 ft, there is a 5-ft-per-24-hr-period drawdown limit, with a maximum drawdown of 20 ft per 7-day period.

Cascade reservoir restrictions can at times affect the hourly dispatch of powerplant units. However, for the LTEMP EIS, it is assumed that these operating criteria do not affect the maximum output level that can be achieved at the Blue Mesa and Morrow Point. Generation at both of these powerplants can be ramped up or down from a zero output level to maximum capability in a matter of minutes without adverse effects on the power equipment. In addition, the plants are scheduled in advance, so reservoirs can usually accommodate water releases associated peak powerplant output levels without violating reservoir operating criteria. Therefore, it is assumed that Blue Mesa and Morrow Point maximum output levels are limited only by the reservoir level and the number of units that are in service as described in the Forebay Elevation section above.

The Crystal Dam however has a flat flow requirement that precludes it from rapidly changing its power output from one hour to the next. Therefore, the maximum output level from this plant is assumed to equal the monthly generation at the plant divided by the number of hours in the month.

Green River: Fontenelle Dam and Flaming Gorge Dam. The Fontenelle Powerplant also releases water at a constant rate (or flat flow), and output levels are nearly constant during daily operations. Therefore, maximum output level from this plant is assumed to equal the monthly generation at the plant divided by the number of hours in the month.


Operations at Flaming Gorge Dam are subject to set of complex limitations that affect maximum daily capacities. These include a minimum flow rate of 800 cfs, a maximum up-ramp rate of 800 cfs/hr, and a down-ramp rate limit of 1,000 cfs/hr. Water releases are further constrained to a constant rate (i.e., flat flow) in the summertime during the hours of the day when people are likely to be fishing below the dam. In keeping with current practices, the computation of Flaming Gorge capacity assumes the following:

1. The daily water release volume is the same for all days of a month;
2. The hourly water release pattern is identical each day of the week;
3. There is a one-hump release pattern during the summer; and
4. There is flat flow in summer between the hours of 6:00 AM and 7:00 PM (i.e., a duration of 13 hr every day).

The trapezoidal methodology utilized in the Large Plant Capacity Spreadsheet is illustrated in Figure K.1-23. It applies simple geometric equations to estimate Flaming Gorge base and peaking capacities using daily water release volumes and reservoir elevations derived from CRSS model results. The base capacity is computed by multiplying the 800 cfs minimum flow requirement by a water-to-power conversion factor that is a function of hydraulic head. It requires a significant volume of base load water to be released each day (i.e., constant 800 cfs release over a 24-hour period).

The water volume that remains after sustaining the daily base release is used to estimate peaking capacity as the height of a trapezoid. The length of the top of the trapezoid is 13 hr (i.e., fishing duration) and length of its bottom/base is equal to 13 hr plus the up and down ramping times. As shown in Figure K.1-24, these ramping times increase as a function of peaking water volume and subjected to a total time limit of 11 hr (i.e., 24 hr less the 13 hr flat flow period).

Furthermore, the sum of the base load and peaking capacities cannot exceed the total physical turbine flow limit multiplied by the water-to-power conversion factor, as described in more detail in the Forebay Elevation section; both the maximum turbine flow limit and the power conversion factor are a function of the hydraulic head. The total turbine water release, and therefore the maximum output level, is reduced when turbines are taken offline due to a scheduled or forced unit outage at Flaming Gorge. The results of performing trapezoidal computations over a large range of daily water volumes are shown in Figure K.1-25. This relationship between daily water volume and maximum turbine flow rate is fairly accurately described by a sixth order polynomial. Multiplying the maximum flow rate by the water to power conversion factor yields a capacity estimate.

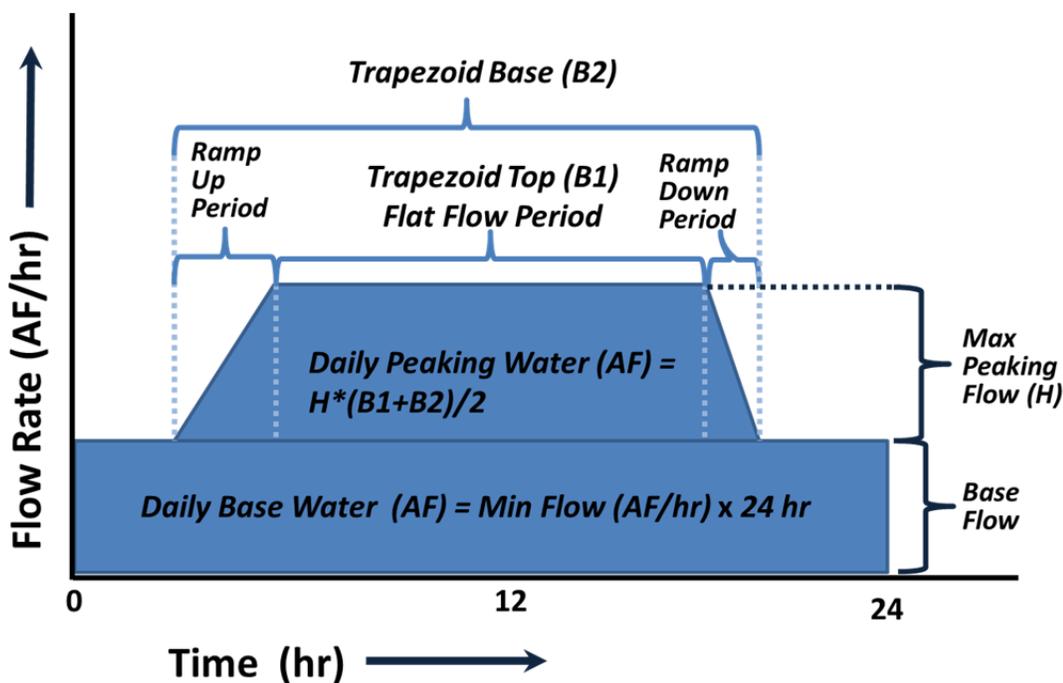

Daily Peaking Water (AF) + Daily Base Water(AF) = CRSS Monthly Water(AF)/Days in a Month

FIGURE K.1-23 Illustration of the Trapezoidal Method Used to Compute Capacity at Flaming Gorge Dam

To protect endangered native fish in the Green River basin, the U.S. Fish and Wildlife Service released a biological opinion (FWS 1992) designed to protect the Colorado Squawfish and Razorback Sucker. The overall intent of the opinion was to structure releases from the Flaming Gorge reservoir so that they resemble natural hydrograph and water temperature conditions. A final set of restrictions was implemented in WY 2006 following completion of a final EIS on the operation of Flaming Gorge Dam (Reclamation 2005) and issuance of its ROD (Reclamation 2006) in February 2006.

High spring release volumes are being structured to enhance river flows during spring spawning periods. Flow volumes include full powerplant output (approximately 4,500 cfs or 141 MW) to full plant output plus bypass tubes and spillways combined. The high release period could be held for as long as 4 weeks. The actual volume and duration of release from Flaming Gorge is determined by the river volume desired on the Green River below the Jensen measurement gage at Jensen (or Jensen Gage) and inflow support from the Yampa River. The high spring release is patterned around the peak runoff period, which varies each year based on weather conditions and endangered fish spawning activities. High peak spring releases transfer water that historically was released during summer and winter peak months to spring months. This shifting of water among months of the year is factored into CRSS model runs that provide input data into the Large Plant Capacity Spreadsheet.

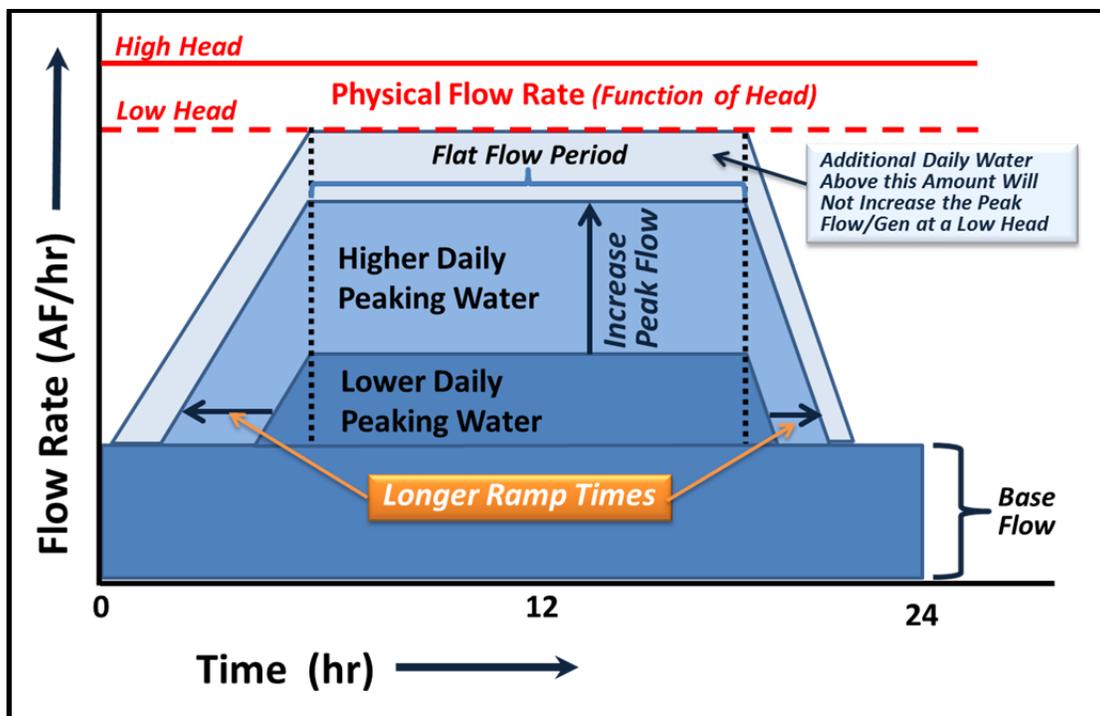


FIGURE K.1-24 Illustration of Ramping Time Increase as a Function of Increasing Water Volumes at Flaming Gorge Dam

After the high spring release is completed, flows on the Green River below the Jensen Gage are held to an average of 1,600 cfs, if possible. The gage is about 94 mi downstream of the reservoir, receiving water not only from Flaming Gorge but also from the uncontrolled Yampa River, which joins the Green River approximately 65 mi downstream of the dam. This means that releases from the Flaming Gorge power plant are held to a minimum of 800 cfs (25 MW) until a time when the combined average flows on the Green and Yampa rivers below Jensen fall below the desired level of 1,600 cfs average. This powerplant restriction can last from 3 to 8 weeks, depending on snowpack conditions.

Flaming Gorge operations must also be patterned such that daily stage readings at the Jensen Gage do not fluctuate by more than 0.1 m. These stage readings are a function of hourly water releases from Flaming Gorge, inflows into the Green River from the Yampa River (105 km [65 mi] downstream of the dam), downstream flow rate attenuations, and water travel times. Although the influence of Jensen Gage constraints are not factored into the capacity estimate, at low daily water release volumes the daily range of Jensen Gage flow rates are also low.

Small SLCA/IP Resources. Relatively small SLCA/IP hydropower plants including Towaoc, McPhee, Elephant Butte, Upper Molina, and Lower Molina power plants. In total, these facilities contribute a relatively small amount of capacity and all but the Molina power plants are flat flow facilities. Powerplant capacities for small powerplants are computed in a spreadsheet based on historical monthly generation data as archived in Form PO&M-59. For the small

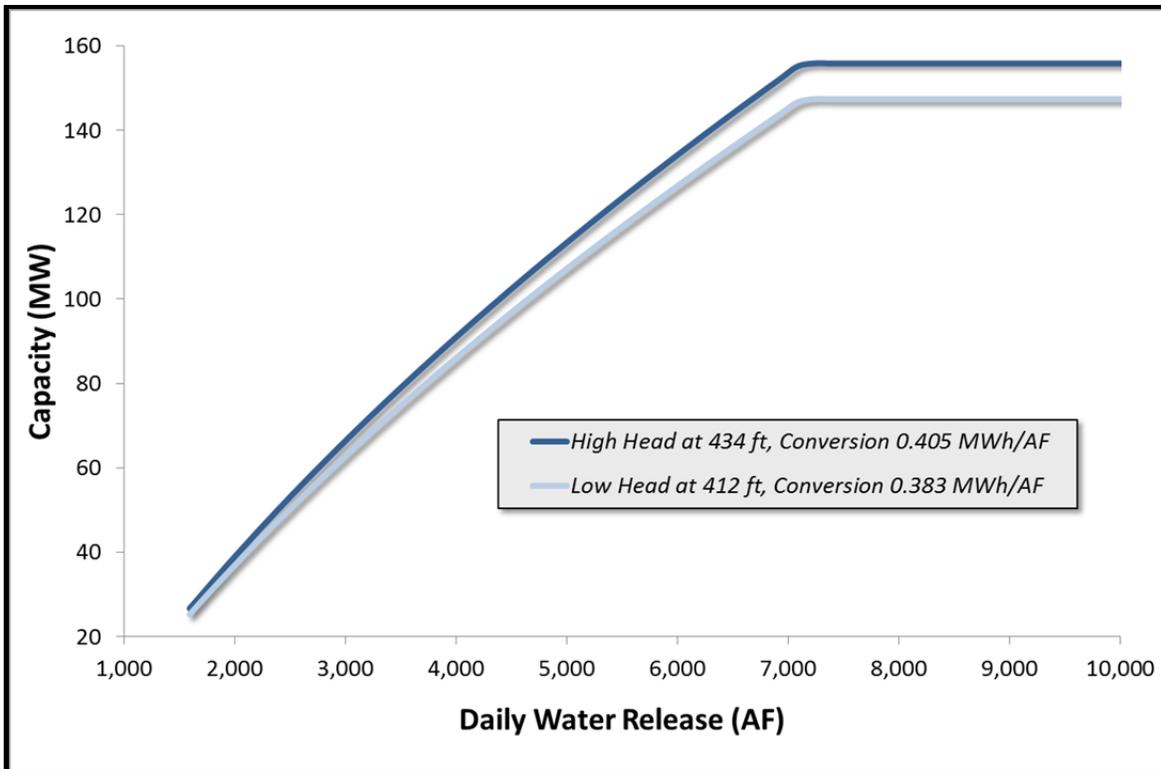


FIGURE K.1-25 Capacity Values at Flaming Gorge Dam Calculated over a Wide Range of Daily Water Releases Using the Trapezoidal Method

powerplants that are run at flat flow, the firm capacity credit is primarily a function of monthly estimates of total energy production divided by the number of hours in a month.

However, Molina powerplants are dispatchable and operated in unison. The spreadsheet algorithm evenly divides Form PO&M-59 monthly generation among all days in the month. The spreadsheet then operates Molina at maximum output continuously until the entire daily generation is exhausted; that is, the units start and stops once per day and no power is produced in any other hours. The block of operating hours is based on market prices such that the economic value of Molina resources is maximized.

Risk-Based Firm Capacity Operating Criteria

As discussed previously, numerous factors influence the amount of firm capacity that is credited toward reserve margin computations for SLCA/IP system. Two of these factors are discussed in this section. These include (1) the month when system peak load occurs and (2) the percentage of time that the entire firm capacity or more will be available to meet the system peak load.

System Peak Load Month. The month in which the system peak load occurs and upon which firm capacity calculations would be based was debated and ultimately jointly decided upon by staff from Reclamation, WAPA, National Park Service (NPS), and Argonne. August was chosen as the month when the system peak load occurs. This decision was made after examining historical FERC Form-714 data for CY 2006 through CY 2012, inclusive. Hourly load data were available for all eight large customer utilities. However, NTUA and Deseret data was only available for the first 4 of the 7 years. No hourly load data were available for any of the small LTF customers.

An examination of large LTF customer historical peak loads over this time period showed that individual customer peaks almost always occurred during the summer. A few exceptions occurred. CSU experienced one annual peak load in April 2006 and another peak in December 2009. In addition, NTUA, which has the lowest peak load of the eight large customers, experiences its peak load in either December or January. Figure K.1-26 shows that the NTUA peak load is about 1% of the non-coincidental sum of the eight large customer average annual historical peak loads. The sum of these annual non-coincidental peaks changed very little during the 2006 to 2012 time period, and averaged approximately 11,800 to 11,900 MW.

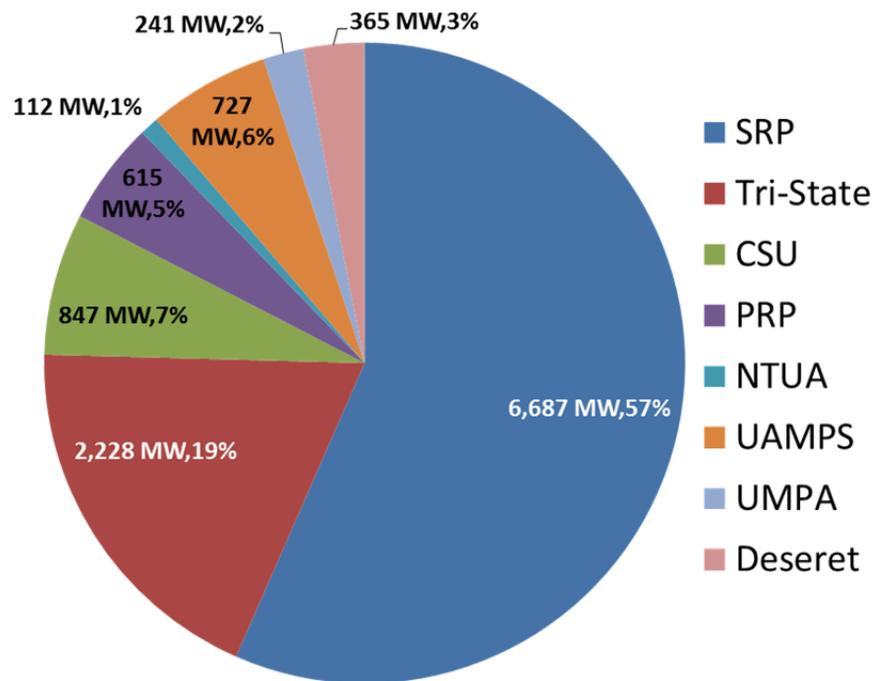


FIGURE K.1-26 Average Historical Non-coincidental Annual Peak Loads (in MW) for the Eight Large Customers and Percentages Relative to the Total

When the peak occurs in the summertime, it almost always occurs in either July or August. Only CSU experienced a different summer peak; it occurred in June of 2012 and was 2 MW greater than the highest load in July. A close examination of when the peak occurred also revealed that, for several utilities, there was no clear pattern of which month the peak occurs in. For example, SRP, which accounts for a majority of the non-coincidental total, experienced 3 years during which the annual peak occurred in July and 3 years during which the peak occurred in August. In 2007, the maximum load in July equaled the maximum in August. In addition, July and August maximum loads tend to be very similar across all systems.

Coincidental annual peak loads were also examined. The coincidental peak was determined by first summing up the available loads for the eight large customers on an hourly basis and then identifying the month in which the maximum total hourly load occurred. Results of this exercise also showed that, historically, July and August both had very similar maximum loads. Figure K.1-27 shows annual coincidental monthly maximum loads for 4 years (CY 2006 through CY 2009), based on data for all eight large SLCA/IP customers. In chronological order, the bars show annual peaks and the line shows the average. Figure K.1-28 shows the same information, except it is for an additional 3 years (CY 2010 through CY 2012) and is based on only six utilities. Information is presented in two separate figures because all load data were not available for all 7 years. As mentioned previously, FERC hourly data were not available for NTUA and Deseret during this time period. It should be noted that, for CY 2011 and CY 2012, the August peaks were markedly higher than those in July. The representative lead profile for the large customers has a coincidental peak load of about 12,370 MW.

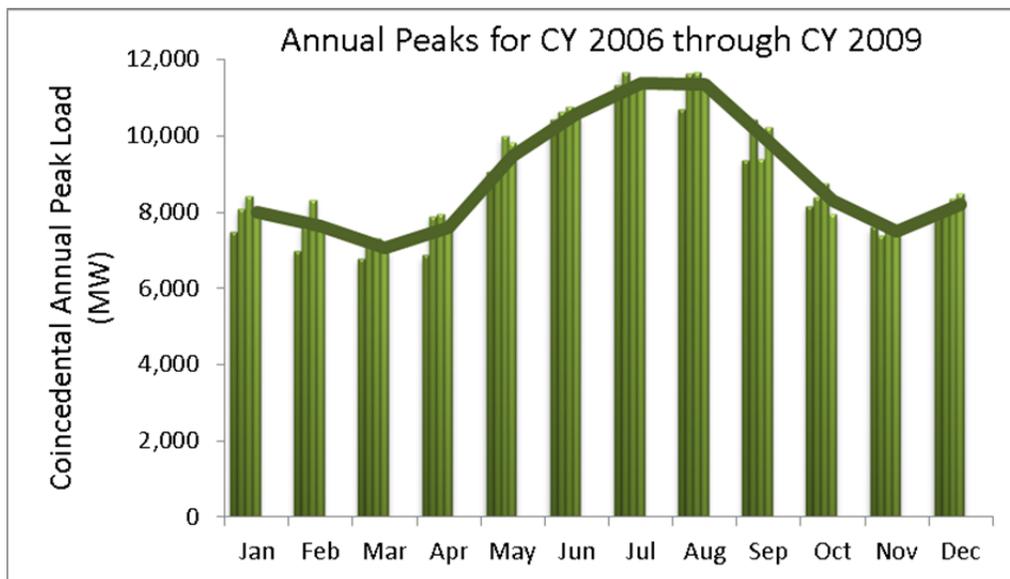


FIGURE K.1-27 Historical Coincidental Annual and Average Peak Loads for the Eight Large Customers during the CY 2006 through CY 2009 Time Period

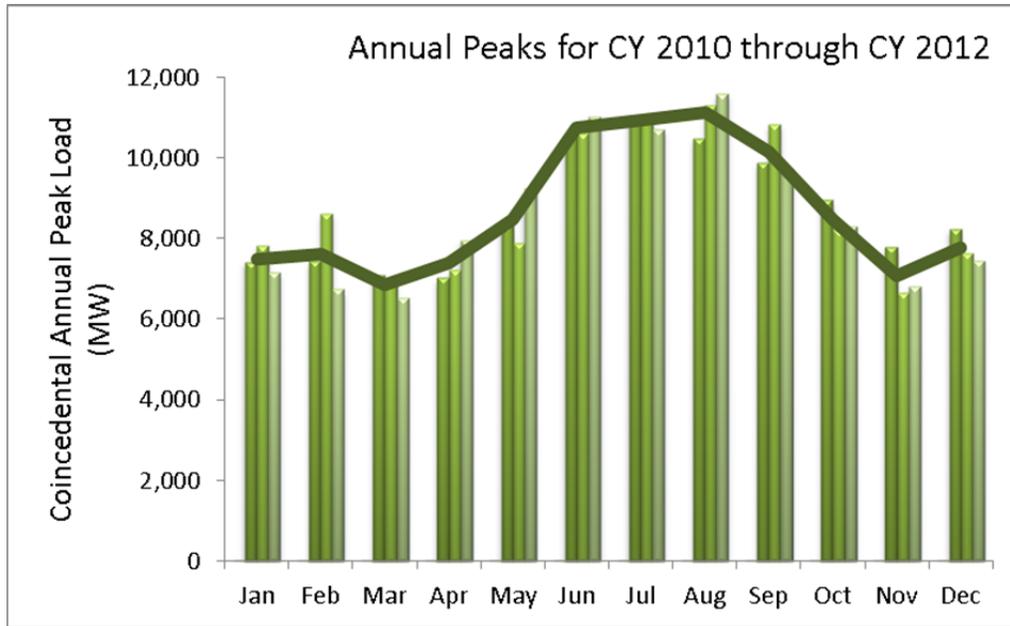


FIGURE K.1-28 Historical Coincidental Annual and Average Peak Loads for Six Large Customers during the CY 2010 through CY 2012 Time Period

Firm Capacity Risk Level. Assumptions regarding the level of risk that would be used in the LTEMP power systems analyses to determine firm capacity levels under each alternative were debated and jointly decided upon by staff from Reclamation, WAPA, NPS, and Argonne. Again, historical information was used to help in the decision-making process. However, unlike the process that was used to determine the timing of the peak load, which primarily relied on historical data, these methods also required the use of modeling tools—most of which were previously described in the Modeling Tools section.

Under terms of the SLCA/IP 2004 LTF contracts, WAPA’s CRSP Management Center Office is obligated to provide its LTF customers with a minimum capacity level (SHP). The SHP level must be supplied regardless of the state or condition of SLCA/IP hydropower resources. These LTF contracts became effective on October 1, 2004, and will continue until September 30, 2024. When SLCA/IP resources are incapable of fulfilling WAPA’s entire obligation, WAPA must make power purchases to cover any shortfalls. Therefore, WAPA and its LTF customers are exposed to market risks because the future of both reservoir conditions and the operating state of generating units are not known with certainty. Argonne conducted an analysis to roughly approximate risk levels to which WAPA is exposed under its current SHP obligation. For this analysis, risk exposure is measured as the probability that WAPA will not be able to meet its daily SHP obligations during peak summer load months. Argonne staff estimate this probability by computing daily SLCA/IP hydropower powerplant capacity under many possible hydrological futures while accounting for the impacts of unit-level outages and environmental operating limits. This analysis is merely a retrospective study of WAPA’s SHP level using current hydrological data. The methodology used in this analysis was not necessarily used by WAPA to determine its current SHP obligations.

SLCA/IP hydropower facilities span a large range of powerplant sizes and operational flexibility. For this analysis, WAPA’s SLCA/IP hydropower resources are divided by size as shown in Figure K.1-20.

The capacity from the WAPA SLCA/IP system is estimated using the models and method shown in Figure K.1-29, which leverages LTEMP tools and methods. A brief overview of capacity computations is as follows:

1. Glen Canyon Dam Powerplant resource capacity under many plausible futures is based on Reclamation’s CRSS and SBM models, along with maximum daily production levels projected by the Argonne GTMax-Lite model;
2. Other CRSP and Fontenelle daily capacities under many plausible futures are estimated by the Large Powerplant spreadsheets that compute unit-level maximum output based on CRSS model results and unit-level outages;

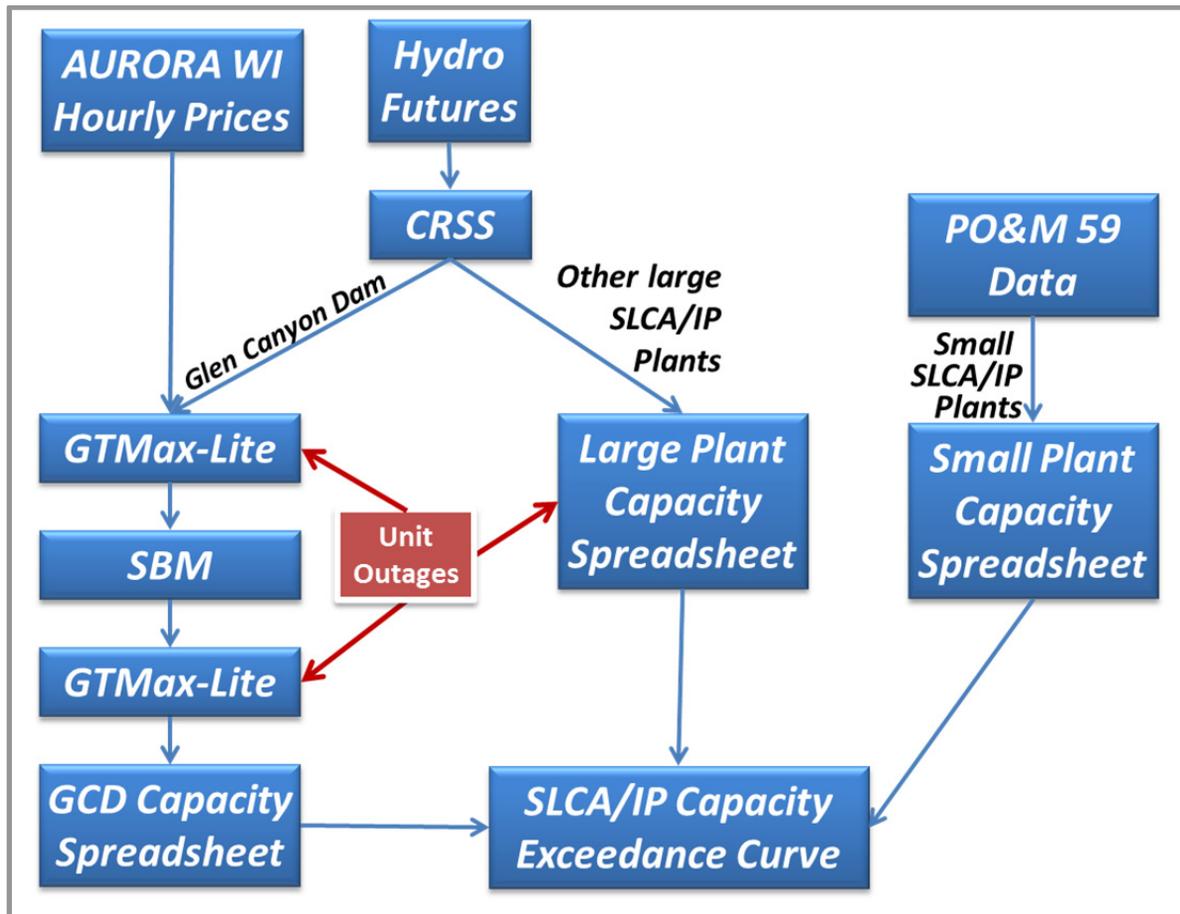


FIGURE K.1-29 SLCA/IP Models Used for Estimating SHP Capacity

3. Flaming Gorge capacity is further reduced under most hydrological conditions because operating criteria and other agreements further constrain its maximum daily output; and
4. For the remaining SLCA/IP resources (i.e., Towaoc, McPhee, Elephant Butte, Upper Molina, and Lower Molina), monthly capacity computations are based on historical monthly operating information contained in Form PO&M-59.

After trace-specific time series of plant-level capacities are computed, the Firm Capacity Spreadsheet creates SLCA/IP hydropower capacity exceedance curves. For each day in a month, the routine totals the daily coincidental peak capacities of all large powerplants. To this sum the routine adds monthly capacities for all small powerplants and subtracts capacity that is reserved for other purposes as described in previous sections.

After a time series of plant-level capacities was computed for all facilities and all traces over the 20-year study period, the data were processed further in a separate routine to determine exceedance levels for the peak loads months of July and August. For each day in a month, the routine totals the daily coincidental peak capacities for both Glen Canyon Dam and the other large SLCA/IP federal facilities for 21 hydrology traces over the 20-year study period. The resulting values are used to create SLCA/IP hydropower marketable capacity exceedance curves.

WAPA's current sustainable hydropower (SHP) commitment level was located on these exceedance curves to determine how much of the time SLCA/IP resources would be able to meet all of WAPA's current contractual and operating obligations. SHP is the minimum aggregate level of LTF capacity and energy that will be provided by WAPA to all SLCA/IP customers through the contract period, regardless of the hydropower condition. The location of the WAPA's SHP commitment on the exceedance curve will determine the level of capacity risk to which WAPA is currently exposed.

From WAPA's data over at least the last 10 years, its SHP commitment for July has been about 750 MW. As shown on the SLCA/IP capacity exceedance curve in Figure K.1-30, this level is exceeded about 89.5% of the time; in other words, there is a 10.5% probability that WAPA will need to make purchases to fulfill its entire SHP. In August the risk is somewhat lower. Figure K.1-31 shows that WAPA has enough SLCA/IP hydropower capacity to meet its SHP capacity obligation of 721.4 MW about 91% of the time. Therefore, WAPA's current capacity risk is at about the 90% exceedance level.

K.1.7.4 Firm Capacity Curves for LTEMP Power Systems Analyses for the Peak Month of August

Similar to the above assessment of risk for the CRSP Management Center, exceedance curves were constructed to analyze risk levels associated with firm capacity used for SLCA/IP system reserve margin calculations. The left panel of Figure K.1-32 shows the marketable capacity for the seven primary alternatives at exceedance levels ranging from 10% to 99% for

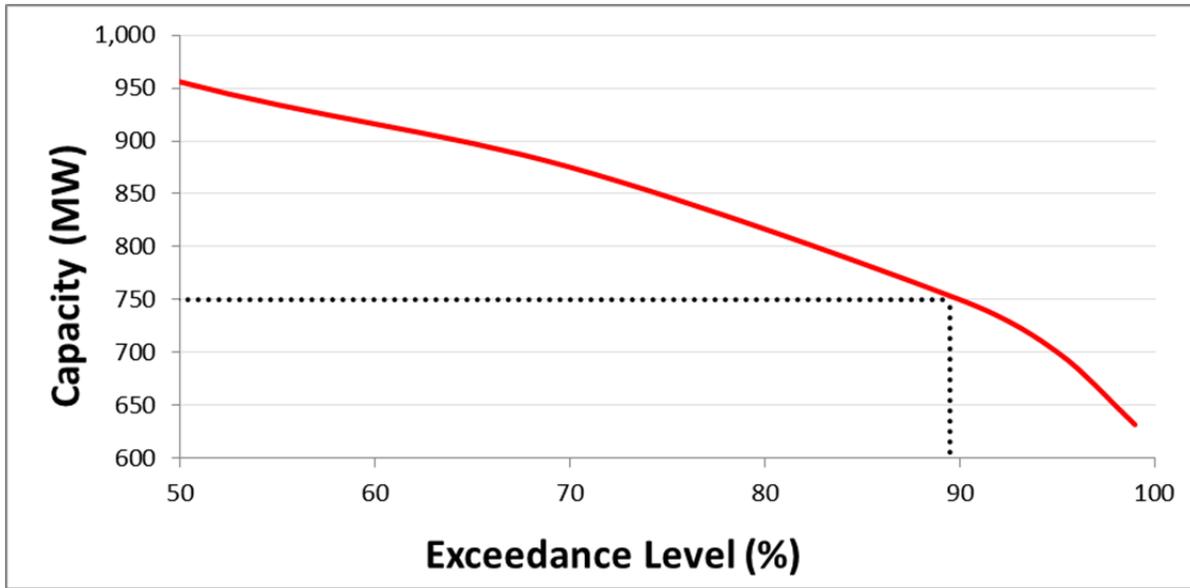


FIGURE K.1-30 Historical SHP Capacity Obligation and WAPA Estimated Risk Level in July

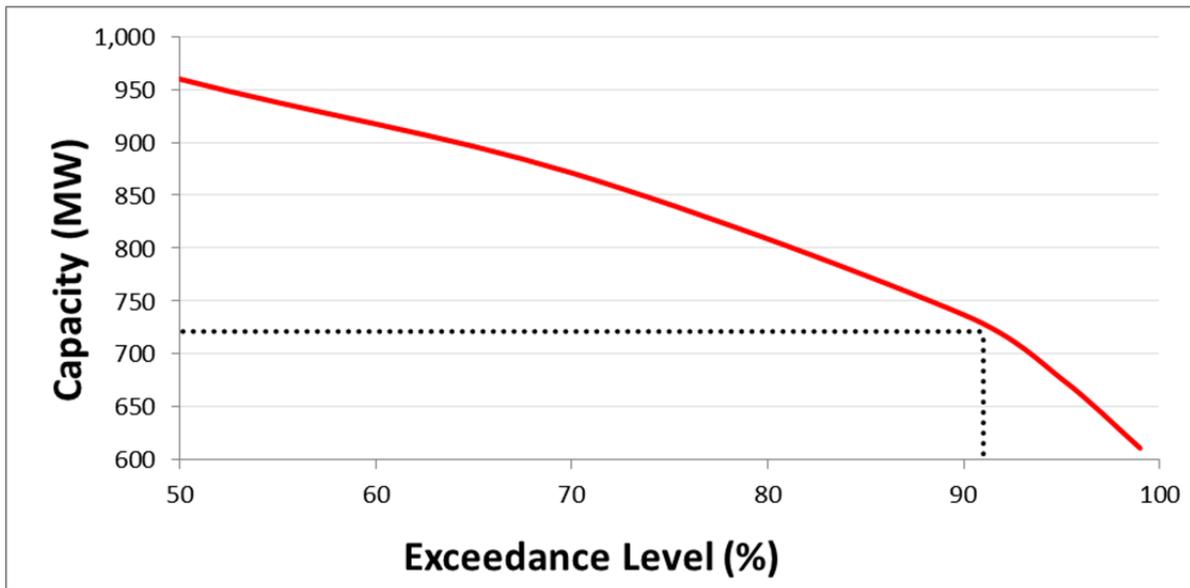


FIGURE K.1-31 Historical SHP Capacity Obligation and WAPA Estimated Risk Level in August

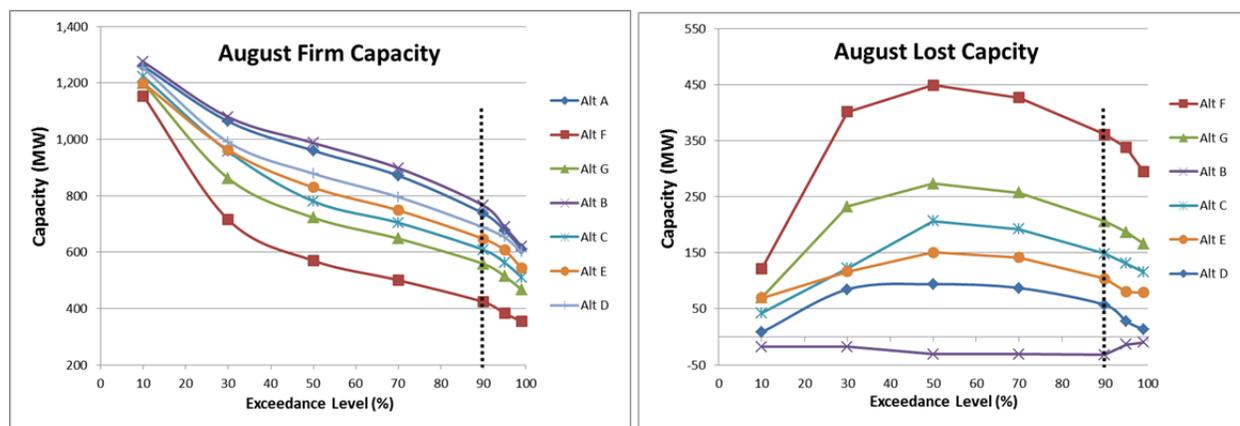


FIGURE K.1-32 Comparison of Firm Marketable Capacity Determinations across Alternatives, Exceedance Levels, and Summer Peak Months

combined SLCA/IP federal hydropower resources. These results assume that the peak system load will occur in August. All alternatives except for Alternative B have less firm capacity at all exceedance levels than Alternative A; this is expected, however, because Alternative B has the least restrictive operating restrictions of any alternative.

Under the assumption that the peak load occurs in August, the right panel of Figure K.1-32 shows the difference in firm capacity compared to Alternative A. The graphs show that the greatest difference in capacity occurs at the 50% exceedance level and the smallest at the 99% exceedance level. Based on the current CRSP Management Center risk exposure of 10%, the determination of firm capacity for all LTEMP alternatives will also be based on this risk level. Note that the results reported in Chapter 4 of the main document also assume a 10% risk level (90% exceedance level) for a peak load that is anticipated to occur in August. However, WAPA has no obligation to use this exceedance level when setting future LTF capacity offers to its preference customers; therefore a sensitivity analysis that uses a range of exceedance levels was conducted. The results of the analysis are presented in Section K.1.10.4.

The power systems methodology assumes that lost Glen Canyon Dam Powerplant capacity replacement costs due to more stringent operating criteria under an alternative will be assessed at the systems level.

The costs of past expenditures to build a powerplant, including the Glen Canyon Powerplant, cannot be altered. Therefore, capital investment differences among alternatives for these facilities are zero. Similarly, fixed O&M costs are assumed to be unaffected by any of the alternatives because retirement schedules and powerplant improvements are assumed to be static. It is also assumed that the total physical 1,320 MW of nameplate capacity at Glen Canyon Dam is identical under all LTEMP EIS alternatives, and that the capacity of all powerplant units will not change over the study period. Therefore, the only differences in the economic cost of capital and fixed O&M costs among alternatives is due to changes in capacity expansion pathways. The sections below describe the method that is used to determine these pathways.

Capital costs only factor into LTEMP EIS economic calculations for capacity expansion units because the retirement schedule of existing units and the online date of committed units does not change among alternatives; therefore, the economic cost difference between Alternative A and other alternatives is equal to zero. Fixed O&M costs only factor into LTEMP EIS economic calculations for capacity expansion units because the retirement schedule of existing units and online dates for committed units do not change among alternatives; therefore, the economic difference of these “fixed” costs between Alternative A, which serves as a reference point, and other alternatives is equal to zero.

K.1.7.5 AURORA Capacity Expansion Reserve Margin Targets and Capacity Additions

The AURORA model was used as a tool to aid power system modelers and analysts at Argonne in finding reasonable capacity expansion plans for each LTEMP alternative using the topology previously shown in Figure K.1-3 and described in Section K.1.5.9. This section provides more details on how it was used for capacity expansion. The network topology shown in Figure K.1-3 consists of two power pools. Pool A is made up of all SLCA/IP hydropower resources and WAPA’s eight large customers. Pool B consists of the aggregate of WAPA’s small customers and all project use loads.

The network was modeled as two power pools for the purpose of calculating a system reserve margin. WAPA’s eight large customers and hydropower resources were put into Pool A because these customers (except for NTUA) satisfy their loads from a combination of their own generation, generation owned jointly with another large customer(s), WAPA firm hydropower allocations, bilateral contracts, and market purchases. Customers in Pool B have no generation and serve loads only through WAPA firm hydropower allocations, bilateral contracts, and market purchases. It is assumed that customers in Pool A would satisfy their combined reserve margin by constructing new generation. Customers in Pool B would satisfy their reserve margin by making individual purchases from large Pool A customers and from the Western Interconnection market transactions.

The model builds new units when the capacity reserve margin of the aggregate SLCA/IP system, which includes WAPA and all of its LTF customers, would otherwise drop below 15%. Based on a review of utility IRPs in the Western Interconnection, it was found that a 15% reserve margin is a typical capacity expansion goal. This value was therefore used as a reserve margin goal for the LTEMP power systems analysis.

Capacity that is credited toward the reserve margin frequently differs from the rated nameplate capacity, because the maximum output from the powerplant may differ from the rated level. For example, a high atmospheric temperature typically reduced the maximum output from gas-turbine technologies. Therefore, the firm capacity that is used in the reserve margin calculation is less than the nameplate capacity if the system peak load is expected to occur during a hot summer afternoon. The firm capacity that is given to VERs can be very complicated. It is often based on system-level reliability calculations that determine an equivalent “100% reliable” capacity that yields the same loss-of-load probability as the VER.

The power system analysis uses an estimate of firm capacity for all existing and new units instead of the nameplate capacity. In some cases, this requires that sometimes the nameplate capacity is significantly derated. For example, it is assumed that the firm capacity credit of new solar and wind farms is only 10% of the nameplate capacity. This is the default used by AURORA. The firm capacity of WAPA’s SLCA/IP hydropower resources that is credited toward this system reserve margin was described in Section K.1.7.4. In addition, as noted previously, only the daily capacity of Glen Canyon Dam differs among alternatives.

Figure K.1-33 provides a simplified illustration of the impact of the firm capacity credit at Glen Canyon Dam on the timing of new construction to meet future loads and the reserve margin target. Two cases are shown in this example for illustrative purposes only. Under Case 1, Glen Canyon Dam has a larger firm capacity and Case 2 has a smaller credit. The orange line shows the annual coincidental peak load for the system. Because WAPA's firm allocation is non-contingent, that capacity amount can be subtracted from the system peak load before calculating the reserve margin. The reserve margin is then applied to that resulting curve to obtain a revised load curve that includes the required reserve margin. This curve is then compared with the capacity in Pool A to determine where they intersect. The year in which they intersect is when

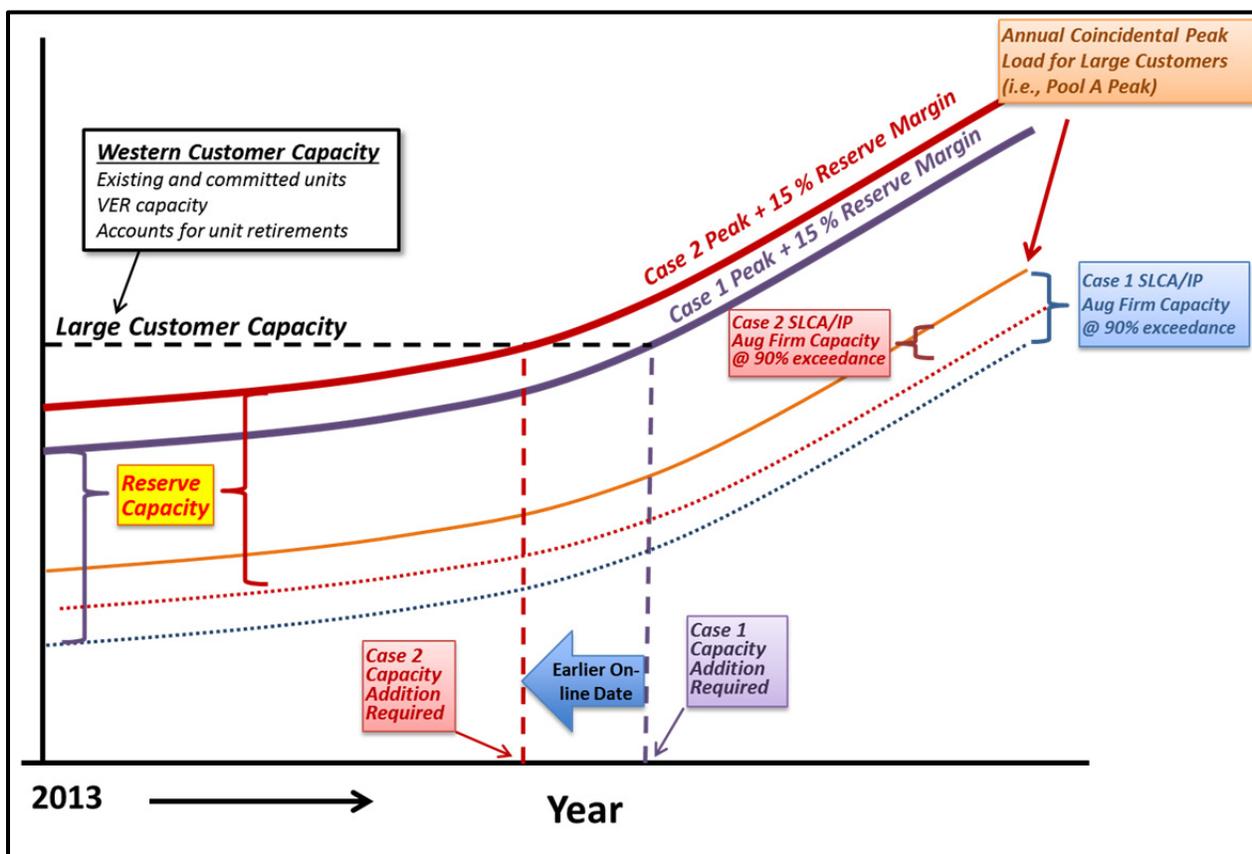


FIGURE K.1-33 Timing of Capacity Additions in AURORA

new capacity is needed to meet the reserve margin. The graph shows that Case 2 needs new capacity before Case 1 because WAPA's firm capacity credit under Case A is smaller.

To reliably serve projected load growth, fossil and non-fossil generation units are constructed by AURORA. AURORA also sheds load at specified market price trigger points.

Capacity shortfalls that remain after complying with renewable resource expansion goals specified in each utility's IRP are resolved by building new electric generating units from a list of candidates. The cost and characteristics of candidate technologies for future capacity expansion that were used for power systems analysis were provided in Table K.1-1. These technologies and associated attributes and costs were based for data found in EIA's 2014 AEO (EIA 2014).

The AURORA capacity expansion feature was used to guide the selection of a plausible capacity expansion plan for the SLCA/IP system. The methodology utilized models the expansion path for an aggregate eight large customer pool labeled "Pool A" in Figure K.1-3. The expansion plan determined under each alternative meets a 15% target reserve margin for pool A (large customers and SLCA/IP federal hydropower resources), plus additional capacity to replace lost Glen Canyon capacity that is allocated to small customers. Under an alternative, large customers therefore replace the entire lost capacity even though only a portion (i.e., about 75% under current SLCA/IP LTF capacity allocations) of this lost capacity would contractually affect these larger utilities. Small customers pay for this capacity by purchasing it from the large customers via LTF contracts.

Because the AURORA model builds capacity for the "joint system," it implicitly assumes that a capacity shortfall in one customer utility system could be temporarily fulfilled by another utility that has excess. Conceptually, this could be achieved via a short-term firm bilateral capacity contract between the two systems, thereby delaying a physical capacity addition by the utility that is "short" capacity. For example, because small customers would most likely not build capacity in the future, it was assumed the lost capacity allocated to these small utilities (i.e., about 25%) would be replaced via the capacity expansion pathways of the aggregate eight large systems (Pool A).

The modeling approach used simplifies reality because currently, there is no centralized energy or capacity market in the region of the Western Interconnection where SLCA/IP federal hydropower resources and WAPA's LTF customers are located. Capacity expansion decisions and energy transactions in this area are done autonomously to meet the objectives of each independent utility. In addition, each utility has limited information about the entire grid and the independent actions/decisions made by other entities in the system. In contrast, the AURORA mode assumes "perfect" information about the entire system to optimize a system-wide objective and builds new powerplants to meet the pool-level reserve margins, not to serve the objectives of each independent utility.

The "joint system" capacity expansion model therefore assumes a level of cooperation and coordination that currently exceeds current-day practices. However, it would be unrealistic for each individual utility to build capacity independently. Only a few customers own capacity;

most rely solely on purchasing capacity and energy resources from other utilities to serve all of its load requirements. Also, it is not uncommon for utilities in the region to cooperate. For example, some of the large customer utilities that own capacity have jointly built generating resources. For example, Salt River Project, Platte River Power Authority, and Tri-State G&T all have joint ownerships in both Units 1 and 2 at the Craig plant. The Salt River Project partly owns Unit 2 at the Hayden Plant. Also, Desert and UAMPS have ownership shares in Hunter Unit 2, and Desert and UMAP have joint ownerships in both Units 1 and 2 of the Bonanza power plant.¹ These cooperative ventures have benefited all parties involved, because a large plants is less expensive to build on a \$/MW basis than several smaller ones.

Another modeling simplification is that transmission capacity limits were not considered in the AURORA model topology. It was assumed that capacity replacement would be built by customers at locations such that power injections did not create additional transmission congestion. It should also be noted that Glen Canyon Dam output under all alternatives except Alternative B tend to be lower during critical times of daily peak load, thus freeing some transmission line capacity that could potentially be used to transfer power among customers. Under most alternatives, generation at Glen Canyon tends to be higher during off-peak hours, but transmission congestion is normally minimal during these times. In addition, WAPA customers can also take advantage of customer displacement power (CDP) that allows customer utilities to use WAPA's transmission lines up to CROD levels when lines are not congested. Lastly, EIS power transfers among customers account for transmission costs that tend to dampen energy transactions among utilities. These costs are included in both AURORA capacity expansion and dispatch model runs.

The two modeling simplifications discussed above regarding utility cooperation and transmission may potentially underestimate capacity expansion costs. For example, a customer utility may decide to add capacity instead of making a short-term firm capacity purchase and/or reject CDP for long-term planning purposes based on reliability considerations. Underestimates, however, would occur under all alternatives, including Alternative A. Therefore, these errors tend to either cancel out or be significantly reduced because the power systems analysis uses a comparative analysis that focuses on the difference between Alternative A and another alternative, not the absolute value of each alternative independently. Also, the methodology is based on the economics of the entire system. Financial transactions among individual utilities, such as short-term firm capacity purchases and sales, are considered.

As discussed previously, new units are constructed when the capacity reserve margin of the aggregate system would otherwise drop below 15%. Additions are made in unit capacity increments resulting in a plan that has a "lumpy" reserve margin time series. The reserve margin requirement (i.e., modeled as a "hard" constraint) also produces a solution that almost always exceeds the 15% target. These relatively small excess capacities that fluctuate over time are beneficial to the system dispatch and production-cost economics. Although most analyses would assume that this excess capacity has no value, it could potentially be sold to a neighboring utility outside the SLCA/IP marketing area, thereby reducing expansion costs. A simple post-model

¹ It should be noted that there are several other joint ownerships in addition to those described in this paragraph.

sensitivity study was performed that assumed this capacity could be sold. The results of the study are reported later in this appendix.

Depending on AURORA model parameters and run settings, the expansion plans suggested by AURORA can be considerably different for Alternative A, and, in many instances, add significantly more generating units than the number required to maintain a 15% reserve margin. This in part stems from the fact that the optimization problem AURORA attempts to solve is extremely difficult to find. After discussion with EPIS staff and examinations of expansion results, Argonne concluded that new capacity addition decisions made by the model are based on financial objects rather than a single global economic objective. AURORA builds a new unit if it is financially attractive. The end result is a realistic expansion path. However, solutions that focus on local unit additions that are financially viable based on the NPV of costs and revenues over the study period result in expansion pathways that often differ from the one that costs the least over the entire multi-utility system.

Given the size of the modeled SLCA/IP area, the focus/capabilities of AURORA, and Argonne staff skill level in the use of the model, finding the global least-cost economic solution for Alternative A is intractable; that is, Argonne could not mathematically prove that any one of the many solutions produced by AURORA was the global least-cost solution. It was also judged that the mathematical optimum path would most likely not be found within a reasonable amount of time and effort (i.e., several weeks or months). Given this modeling limitation, however, the technologies selected by AURORA consistently indicated that combustion turbines (CTs) and natural gas-fired combined cycle units will be constructed in the future. This solution is consistent with available IRPs that Argonne reviewed for SLCA/IP large customers and several large systems (typically investor-owned utilities) that neighbor the SLCA/IP marketing area. A summary of these IRPs is shown in Table K.1-6 (see Table 2 of Attachment K.9 for additional information). More detailed information about these IRPs is provided in Attachment K.9.

It should be noted that the methodology only represents SLCA/IP physical assets and production levels. It does not reflect changes in SLCA/IP contract that may be implemented in October 1, 2024, or financial implications as they affect WAPA and individual customers. This topic will be discussed in the Wholesale Rate Analysis section.

K.1.7.6 Dispatch Performed by AURORA Model Capacity Expansion Runs

The methodology used represents all of SLCA/IP hydropower energy assets in the AURORA model to measure the economics of changes in Glen Canyon Dam operating criteria. GTMax-Lite and customized small SLCA/IP resource spreadsheet results provide AURORA with alternative-specific SLCA/IP dispatch and an hourly schedule of energy injections into the power grid. By doing so, AURORA recognizes the basic role of hydropower resources as they affect the dispatch of the SLCA/IP system and energy transactions with the Western Interconnection.

Due to the complexities of SLCA/IP hydropower operating criteria and non-power considerations, AURORA could not model the dispatch of these resources at the level of detail

TABLE K.1-6 Summary of Utility IRPs for Four Large SLCA/IP Customers and Other Large Utilities in Areas Neighboring the SLCA/IP System

Utility	Utility Type	Type of Generation Added	When Added	Capacity Added (MW)
Public Service of CO	Investor	Gas Turbines	2018 to 2022	1,211
	Owned	Combined Cycle	2023 to 2032	1,929
Public Service of NM	Investor	Gas Turbines	2016 to 2033	736
	Owned	Solar PV	2015 to 2022	283
Rocky Mountain Power	Investor	Combined Cycle	2014, 2024	645, 423
	Owned	Wind	2024	432
Arizona Public Service	Investor	Natural Gas (unspecified)	2019 to 2029	4,200
	Owned	Renewable (unspecified)	2019 to 2029	425
Tucson Elect. Power	Investor	Natural Gas (unspecified)	2015 to 2028	1,214
	Owned	Renewable (unspecified)	2014 to 2028	529
Nevada Power Company	Investor	Combined Cycle	2018 to 2024	3,813
	Owned	Gas Turbines	2023 to 2032	2,043
		Solar PV	2016 to 2021	50
Sierra Pacific Power	Investor	Gas Turbines	2023 to 2029	1,975
	Owned	Combined Cycle	2025	571
Platte River Power	WAPA	Gas Turbines	2021	Unspecified
Colorado Springs Utilities	Customer			
	WAPA	Gas Turbines	2029 to 2031	39
Tri-State G & T Assn.	Customer	Renewable (unspecified)	2018 to 2029	20
	WAPA	Combined Cycle	2019 to 2026	1,176
Salt River Project	Customer	Renewable (unspecified)	2016 to 2027	350
	WAPA	Natural Gas (unspecified)	FY2018+	Projected 581-MW gap in 2017

required for this study. Instead, powerplant-specific hourly production levels were projected over the study period using the previously discussed two GTMax-Lite model configurations and the Small SLCA/IP Powerplants Spreadsheet. Energy injections into the system from Glen Canyon Dam are based on average hourly GTMax-Lite results over all 21 hydrology traces from the SBM. Hourly energy injections from all other large SLCA/IP resources are based on GTMax-Lite results, which use average monthly hydrological conditions over the 21 hydrology traces produced by CRSS. Last, energy injections from small SLCA/IP hydropower plants are based on average historical conditions reported in Form PO&M-59.

Annual CY energy generation for Glen Canyon Dam and all other SLCA/IP hydropower resources combined are shown in Figure K.1-34 under Alternative A. Annual generation from the Glen Canyon Dam Powerplant averages about 4,114 GWh, and ranges from about 3,665 GWh to 4,338.2 GWh. The lowest generation value occurs in 2013 due to low initial reservoir elevations that were observed at the end of CY 2012. That is, because the simulation starts out at a point in time when the Glen Canyon Dam reservoir is low, water releases tend to be less since more water is retained in the reservoir in an attempt to increase the water storage level. On average, Glen Canyon Dam is expected to account for about 72% of the total annual SLCA/IP hydropower generation. Because annual WY releases are nearly the same under all

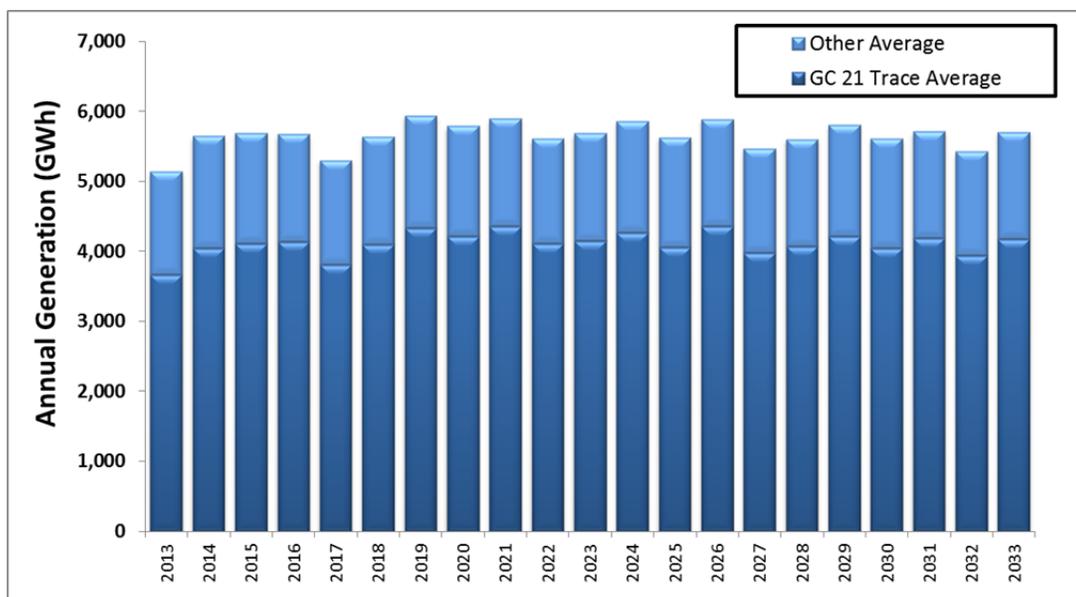


FIGURE K.1-34 Annual Average Hydropower Generation for the Glen Canyon Dam Powerplant and the Aggregate Generation for All Other SLCA/IP Resources

alternatives, total CY annual generation levels for all alternatives are within about 1.7% of Alternative A. Those alternatives that have more HFEs tend to have lower annual average generation levels. This topic will be discussed in more detail in Section K.1.10.

Although annual Glen Canyon Dam generation levels are similar among alternatives, the monthly distribution of generation within a year is substantially different among alternatives. Projected monthly generation produced by other SLCA/IP hydropower resources is essentially identical under all alternatives. Figure K.1-35 shows that alternatives such as Alternatives A and B have high Glen Canyon Dam average daily generation levels during the peak summer months when marginal energy production costs are relatively expensive. These energy levels produce higher economic values than those with lower summertime generation levels, such as Alternative F.

Interactions between all entities in the SLCA/IP marketing area and the rest of the Western Interconnection are represented by a single point where non-firm hourly energy transactions occur. This point, labeled “Spot Market” in Figure K.1-3, contains an inelastic time vector of market prices for system energy purchase and sales.

Power transfers between utilities and the Western Interconnection node incur a charge that varies by on-peak and off-peak periods. All purchases and sales that a customer makes incur an additional transfer cost that also varies by on-peak and off-peak periods. The eight large customer utilities and small customers only purchase energy from the spot market node; spot sales are not possible. This assumption was made to ensure that the SLCA/IP system would not construct capacity on a speculative basis for the purpose of selling energy to the Western Interconnection; that is, it constructs capacity primarily for internal purposes. Because the

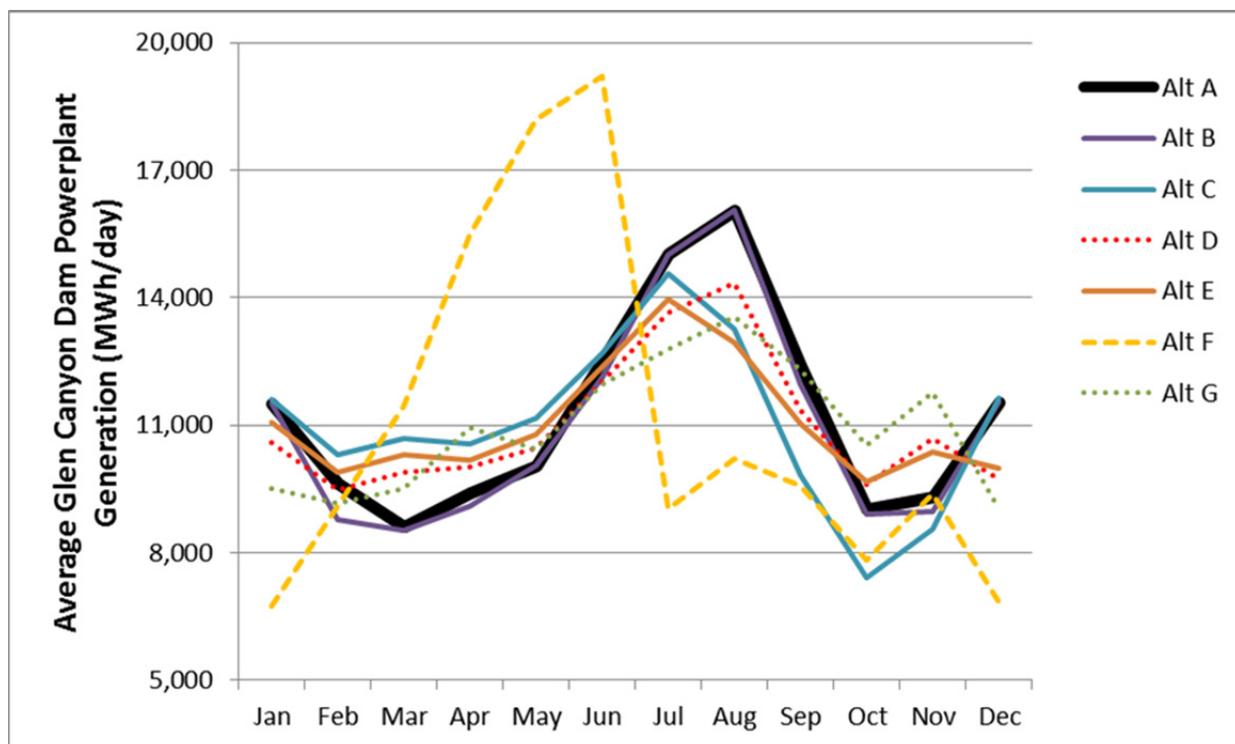


FIGURE K.1-35 Average Daily Glen Canyon Dam Powerplant Hydropower Generations by Month Based on the Average of All 21 CRSS/SBM Hydrology Traces

Western Interconnection prices tend to be more expensive than production costs in the SLCA/IP system, purchases from the Western Interconnection tend to be small. However, the Western Interconnection energy was made available for purchase by the SLCA/IP systems in situations where internal production costs became expensive. In addition, reserve margin requirements were configured to exclude Western Interconnection purchases as a source of firm capacity. Therefore, the SLCA/IP system is prevented from leaning on the Western Interconnection for capacity during times of peak load.

Depending on the customer's location, loads and resources are designated as east or west regional entities. Energy flows among entities via system linkages. Some links have limitations and/or associated costs. Energy flows on links connecting SLCA/IP resources to WAPA's customer loads. Limits on energy transfers on those links represent customer CROD allocations. Under hydrological conditions in which SLCA/IP total generation exceeds the total CROD, the excess energy flows on links that represent WAPA's shorter-term energy transactions with its LTF customers.

Very small cost premiums are placed on some connections to represent WAPA's service priorities and to roughly approximate energy flows. Energy generated by Glen Canyon Dam is transmitted to loads in the following priority order: (1) project use in the west region, (2) project use in the east region, (3) LTF customers in the west region, and (4) LTF customers in the east region. The higher the priority, the lower the power delivery cost; that is, the lower the assigned

link cost. Energy flow priorities for other SLCA/IP resources mirror the Glen Canyon Dam pattern. The priority order for SLCA/IP resources other than Glen Canyon Dam is (1) project use in the east region, (2) project use in the west region, (3) LTF customers in the east region, and (4) LTF customers in the west region.

Figure K.1-3 also shows that an LTF customer has direct connections to all other LTF customers in the region where the customer resides. These connections are used for energy transactions but are subject to transmission costs of \$3.5/MWh during off-peak hours and \$6.5/MWh during on-peak hours based on historical information provided by WAPA. This topology/configuration assumes a higher level of cooperation and coordination among WAPA and its customers than what actually occurs. However, WAPA and its customers do buy and sell energy via both day-ahead and hour-ahead bilateral agreements using market signals, insights, and data such as that provided by ICE as a guide. Also, energy transfer costs among LTF customers dampen power transfer levels relative to a centralized market arrangement, such as a regional transmission operator (RTO) market, which does not incur these transmission costs in the system dispatch. The resulting system dispatch for large customers is consistent with historical operations as shown in see Figure K.1-14).

K.1.7.7 Rationale for the Selection of Hydrology Conditions Used for Capacity Expansion Runs

The low hydropower condition of 90% exceedance used to select SLCA/IP hydropower capacity credits is fairly conservative because the system is slow to respond to capacity shortfalls. New units take a relatively long time (years) to plan/engineer, permit, construct, test, and eventually bring online. Therefore, if insufficient capacity is built, the system may experience years of unacceptably high reliability risks when hydrology/hydropower capacity is low.

On the other hand, average energy conditions are used for power injections into the grid for capacity expansion modeling because the system quickly adapts to various hydrological situations through system dispatch and short-term energy transactions (e.g., purchases when hydropower energy production is below normal). Although it does not provide an exact estimate of energy economics, given all of the other uncertainties involved with long-term projections, an average hydrological condition provides a good approximation of the *relative* economics among the enormous number of capacity expansion pathways that are theoretically possible for the SLCA/IP study area.

K.1.8 Glen Canyon Dam Energy Economic Benefits Methodology

The Glen Canyon Dam Powerplant generates large amount of energy that yields significant economic benefits to the grid. It serves SLCA/IP market system demands and this system responds/reacts to its powerplant operations. Therefore, the economic impacts of changes in Glen Canyon Dam operations are measured for the system as a whole by computing SLCA/IP market system operating costs. On the production side, costs include energy production costs that

are comprised of fuel expenditures, variable O&M costs, and unit startup expenses. Costs are also incurred to deploy price-sensitive loads. The AURORA model run in dispatch mode was used to estimate production levels and associated costs for each generating unit and DSM program in the SLCA/IP market system during the study period.

AURORA dispatch mode computations are based on a given set of resources, as previously determined by AURORA runs that were made in capacity expansion mode. Hourly SLCA/IP federal hydropower production input into AURORA is based on GTMax-Lite runs for Glen Canyon Dam and the other five large hydropower plants. These runs adhere to all physical and institutional operating criteria, including those needed to supply project use loads and fulfill ancillary service requirements. Energy costs for each LTEMP alternative are computed as the difference between the AURORA dispatch results for Alternative A and another alternative.

The LTEMP EIS affects the system-level operating costs and therefore energy economics because operating criteria bind the timing and routing of water releases through Glen Canyon Dam. From a system dispatch perspective, power produced by the Glen Canyon Dam Powerplant yields the highest economic benefits when the limited amount of water it releases during a WY is routed through the powerplant's generating turbines to produce power that either displaces energy generation or demands curtailment from expensive grid resources. For example, Glen Canyon Dam has a high economic value when the energy it produces reduces or eliminates the operation of an old, inefficient gas turbine with high production costs. On the other hand, it has a much lower value when it displaces low-cost power generation. As discussed earlier, LMPs that are specified at the Western Interconnection spot market node interface represents Western Interconnection marginal cost production savings when it purchases power from the SLCA/IP market system. On the other hand, when the SLCA/IP market system buys from the Western Interconnection, operating costs of the system are reduced, but it pays for the purchase at the LMP price. For the LTEMP EIS, these prices were determined by the Western Interconnection model run and a scaling algorithm applied to the Palo Verde market hub. Purchases are only made when the LMP is less expensive than the incremental cost of both power production and DSM deployment.

The average annual energy produced by the Glen Canyon Dam Powerplant varies by less than 2% among alternatives. However, at varying levels of stringency, alternative criteria bind the daily and hourly operational flexibility at Glen Canyon Dam and affect both Lake Powell monthly reservoir elevations and Glen Canyon Dam monthly water release volumes. One of the primary differences between the AURORA dispatch in capacity expansion mode and when AURORA is run in dispatch mode is the hydrological information used for SLCA/IP federal hydropower conditions. When run in dispatch mode, the AURORA model uses GTMax-Lite results for Glen Canyon Dam and the other five large SLCA/IP federal hydropower plants, based on hydrological information for the representative trace. As shown in Figure K.1-36, average annual SLCA/IP federal hydropower plant generation for the representative hydrology trace (i.e., Trace 14) used for economic dispatch runs is significantly different from that used for AURORA capacity expansion runs, shown in Figure K.1-33. It should be noted that there is significantly more generation volatility in Glen Canyon Dam Powerplant energy production used for economic dispatch runs. The lowest annual Glen Canyon Dam generation level using Trace 14 is 2,781 GWh, which occurs in CY 2015. Generation under that same trace is

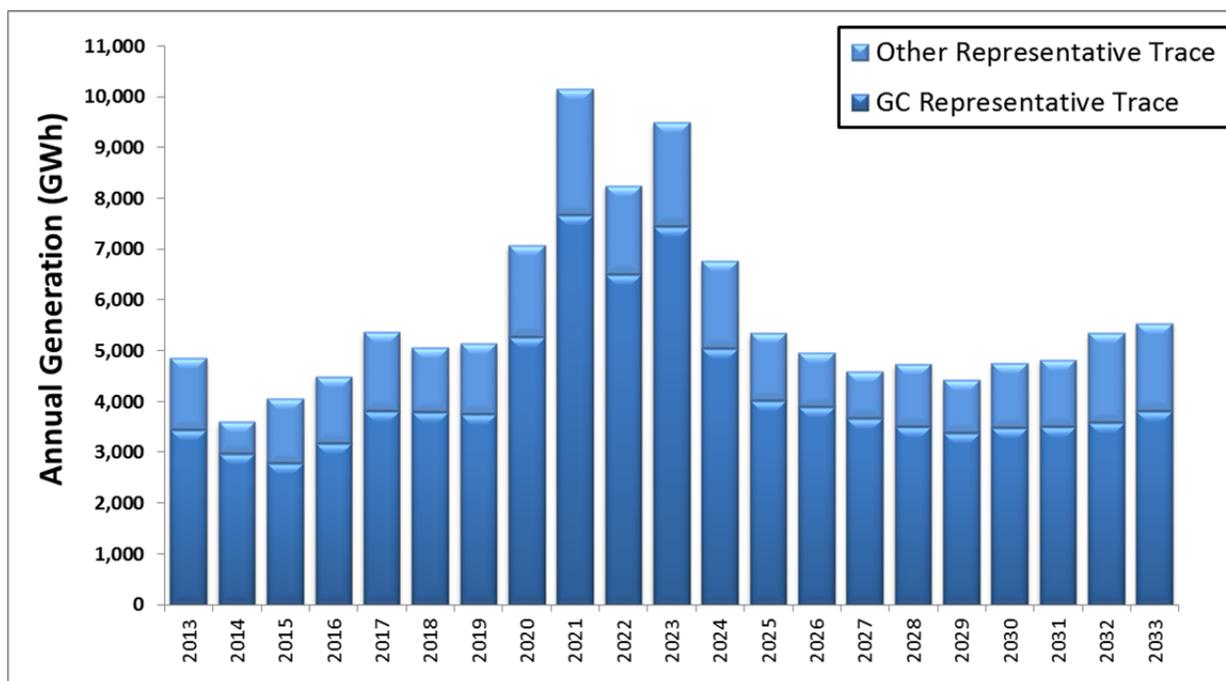


FIGURE K.1-36 Average Annual Glen Canyon Dam Powerplant Generation for the Representative CRSS/SBM Hydrology Trace

7,677 GWh in CY 2021; therefore, those years differ by a factor of about 2.7. This is consistent with historical volatility levels. As described in Section K.1.2, Glen Canyon Dam Powerplant annual generation varied by a factor of 2.6 between CY 1980 and CY 2013.

Trace 14 average daily generation over the LTEMP period produced by the Glen Canyon Dam Powerplant by month is shown in Figure K.1-37. These values are similar to the ones used for the AURORA capacity expansion runs shown in Figure K.1-34. It is one of the attributes of Trace 14 that make it “representative.”

As described in more detail in Section K.1.10, the combination of LTEMP operating criteria, Glen Canyon Dam monthly water releases volumes, SLCA/IP market system loads, and spot market LMPs drive EIS differences in economic dispatch cost among alternatives. The system-level dispatch methodology for computing energy economic costs captures the following key aspects of EIS alternative operating criteria:

- Marginal dispatch costs at a location to serve loads increase as the system load-level increases. Resources with low costs are dispatched first. As the load increases, more expensive resources are dispatched to balance the supply and demand.
- The Glen Canyon Dam energy value is based on SLCA/IP market system cost reduction as a consequence of powerplant energy injections into the grid.

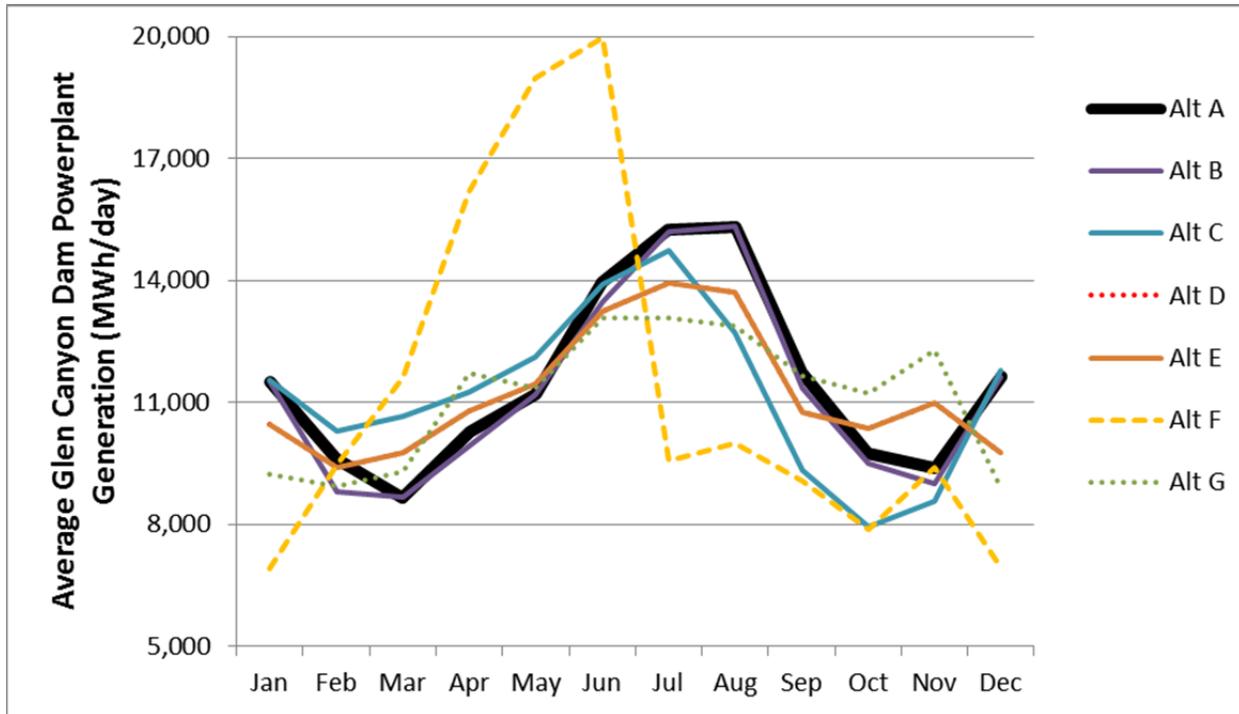


FIGURE K.1-37 Representative Trace Average Daily Glen Canyon Dam Powerplant Generations by Month

- Over short-term operations such as daily and weekly dispatch, energy economic differences among alternatives are highly dependent on operational flexibility allowed under the alternative and the marginal production cost and LMP spread between off- and on-peak periods. If costs and prices are always the same, operational criteria would have minimal impacts.
- On an annual timeframe, energy economic differences among alternatives are dependent on the correlation of monthly water release volumes to monthly marginal production costs and LMP. Alternatives with a positive correlation have a much higher energy economic value than those with a negative correlation. The larger the monthly price and cost spreads, the greater the economic cost of the alternative. If costs and prices are always the same, monthly water release volumes would have minimal impacts.
- Unlike daily, weekly, and monthly economic differences that are a function of price/cost spreads, economic differences from HFEs are a function of absolute energy price/cost levels. Some water bypasses the turbines because the required HFE flow rate can exceed the turbines' maximum flow capability. Water that bypasses the turbines does not generate electricity for sale to customers and therefore has zero power value.

K.1.9 Net Present Value Calculations and Study Period Adjustments

As described in previous sections, all costs input into GTMax-Lite and AURORA are expressed in 2013 dollars. For many of these inputs, this required that input values reported in the literature be converted to 2013 dollars. For example, the cost of candidate technologies for new construction was expressed in terms of 2012 dollars. The index used for dollar conversion is application specific. Attachment K.10 provides more information on the dollar year conversion process.

By expressing all present and future cost inputs in terms of real dollars, the effects of inflation are removed from all AURORA model calculations. Therefore, for each year all costs projected by the model are measured on a common and consistent basis. However, LTEMP EIS alternatives incur different levels of cost at different times over the study period. Therefore, to account for the time value of money in which the present worth of money is typically, but not necessarily, higher today than the same amount of money in the future, the NPV of all costs are calculated to facilitate a common point in time for cost comparisons among alternatives. The process of discounting is used to make costs that occur at different points in time commensurate with each other.

The NPV computation takes a chronological stream of values over time and discounts each one to a specified point in time based on a defined discount rate. These values are then summed. Although the mechanics of the discounting process are very straightforward, the magnitude of the discount rate greatly influences the degree to which future costs and benefits “count” in the decision. As a result, the choice of discount rate is the subject of much debate. For the LTEMP EIS, NPV calculations are based on a discount rate of 3.375%. The use of this discount rate was in part based on information contained in Attachment K.4, which was provided by Reclamation staff. At the recommendation of WAPA staff, a second discount rate of 1.4% was used in a sensitivity study.

Because of discounting, the NPV calculation places more importance on near-term economic costs as compared to those that occur in the more distant future. For example, a dollar cost incurred during the first year of the study period has a \$1 NPV impact. However, at a 3.375% discount rate, the same dollar impact in the 20th year of the analysis has only a \$0.5322 impact (i.e., slightly more than half) on the NPV. The selection of the representative trace does not consider the discount effect on NPV outcomes. It may be important, however, because the energy costs of an alternative are sensitive to hydrological conditions. The selected representative hydrology trace starts out dry, becomes very wet in the middle of the period, and by the last few years it returns to a dry condition. All other factors constant, the NPV calculation would yield a different value if the sequence of dry, average, and wet hydrological conditions differed from Trace 14. A sensitivity analysis of the impacts of the sequence of hydrological conditions on EIS energy NPVs would help quantify the range of possible outcomes.

All detailed model calculations were made and expressed in 2013 dollars. This was in part due to CRSS and SBM, which used the beginning of CY 2013 as a starting point. Cost was computed over the 20-year length of the long-term experiment: a period that begins at the start of CY 2013 and ends at midnight on the last day of CY 2032. However, to be consistent with other

EIS disciplines, the power system analysis period was directed by project co-leads to cover CY 2015 through CY 2034 and express all costs in terms of 2015 dollars. The request was made at a point in the modeling process when all model runs, computations, and most aspects of the analysis had been completed. It was therefore necessary to make adjustments to the CY 2013 to CY 2032 results. The power systems team and co-leads agreed that the following adjustments were reasonable given time and budget constraints.

1. All energy costs were shifted by 2 years. That is, CY 2013 energy costs were assumed to take place in CY 2015 using Trace 14 hydrology for CY 2013, energy costs in CY 2014 were assumed to occur in CY 2016, and so on.
2. The energy costs were then adjusted to account for real changes in energy prices over time. This was accomplished in a two-step process. First, an energy price index benchmarked to 2013 dollars was computed. The index is based on the yearly average energy cost to serve load from the AURORA SLCA/IP market systems model. This index was then applied to the shifted energy costs from step 1 for all years. For example, because energy prices in real 2013 dollars decreased during CY 2013 to CY 2015 timeframe (according to AURORA and in actuality), the costs are adjusted downward using the AURORA-generated energy price index. The end result is chronological annual costs from CY 2015 through CY 2034 in beginning year 2013 dollars.
3. The energy cost time series is then converted to 2015 dollars using a general price index. For this analysis, the seasonally adjusted GNP IPD was applied to the 2013 dollars (see Table 1 in Attachment K.10).
4. The capital cost dollar for new unit construction from the EIA's 2014 AEO (EIA 2014) expressed in nominal 2012 was adjusted to beginning year 2015 dollars using the "Powerplants" index contained in Reclamation (undated). Fixed O&M costs were converted to 2015 dollars used the same table, except that the "Powerplant Accessory elect. & misc. equip" index was used.
5. No adjustments were made to the online dates of new units constructed to the study period, because the capacity reserve margin was greater than 15% in 2015 under all alternatives. However, because the analysis period is shifted, there were no AURORA capital or fixed O&M cost computations for the last 2 years. Therefore, average cost values over the last 5 years of the AURORA model run were assumed for CY 2033 and CY 2044.
6. The stream of all future costs are discounted to beginning year 2015 at an annual discount rate (i.e., 3.375%) specified by the Reclamation for cost-benefit studies of projects.

A final EIS and ROD will not be completed until after WY 2015. The reader should recognize that the economic analysis for electrical power systems is sensitive to the years that are modeled. Currently, the region affected by a change in the operation of Glen Canyon Dam is in

“capacity surplus.” This means that generating capacity in the affected region currently exceeds peak electrical demand more than is necessary to achieve an acceptable level of reliability. However, a growing regional economy and population will soon cause electrical demand to catch up to supply. Depending on the actual ROD implementation date, the SLCA/IP market system and the Western Interconnection may need to build additional capacity above committed levels before completion of the ROD.

K.1.10 Power Systems Results

This section details the results of the power systems analysis, focusing primarily on total SLCA/IP market system costs under each alternative relative to Alternative A. It also describes the sensitivity studies that were performed to test the robustness of model results and analysis conclusions. One set of sensitivity studies was on the risk preference or exceedance level that is used to determine SLCA/IP federal hydropower firm capacity. The results in the main EIS were based on a 90% exceedance level. This section presents power system results for exceedance levels of 50% and 99% to reflect the possibility of WAPA considering different risk levels in future marketing efforts.

Another sensitivity study was performed on discount rate. The discount rate used in the main EIS was 3.375% because the Bureau of Reclamation is required to employ an administratively determined discount rate known as the federal plan formulation and evaluation rate, when undertaking economic analyses of water resource and related matters pursuant to 42 U.S.C. 1962d-17. The plan formulation and evaluation rate for fiscal year (FY) 2015 is 3.375% (Reclamation 2014a,b). This section will show how power system results will change if a lower discount rate, namely, 1.4%, is used. This value was used to explore a “real” interest rate based on treasury notes and bonds, as determined by the Office of Management and Budget in Circular A-94 Appendix C.

Two other sensitivity studies were also performed. One studied the sensitivity of the baseline capacity expansion pathway used in Alternative A to different assumptions about the candidate plants that would be constructed. AURORA invariably chose a combination of advanced combustion turbines and advanced combined cycle plants as the preferred expansion path. However, to test the sensitivity of the results to different expansion pathways, we ran the AURORA model for two extreme expansion pathways for Alternative A: one allowed construction of only advanced combustion turbines, and the other only natural gas combined cycle plants.

The next study determined the sensitivity of the AURORA results to the choice of hydrological conditions. The results of another hydrological condition were compared against the results of the representative trace (i.e., Trace 14).

Finally, as described in Section K.1.7.3, ancillary services are no longer expected to increase as much and as rapidly as assumed in GTMax-Lite model runs. Therefore, a sensitivity study was performed to determine whether and by how much power system results would change if current ancillary service projection had been used. The results of the sensitivity study showed

that ancillary services assumptions under a range of plausible futures have little to no effect on firm capacity and energy value for the LTEMP alternatives (see Section K.1.10.8 for further detail).

K.1.10.1 Main Drivers of Differences among Alternatives

Among all alternatives, annual water release volumes differ by less than 1% and the total volume of water released from Glen Canyon Dam over the 20-year LTEMP period is nearly identical. Therefore, the economic cost of an LTEMP alternative is not caused by changes in long-term water release volumes, but rather from altering the routing and timing of water releases during monthly, daily, and hourly timeframes within a year.

Figure K.1-38 shows monthly average daily generation produced by water releases that are routed through the powerplant’s turbines. Each alternative has a unique monthly water release pattern. For example, as compared to Alternative A, Alternative F turbine releases are much higher during March, April, May, and June and much lower during July and August. When water/generation is shifted from a month that has higher system production costs to a month with lower costs, the economic value of power produced by the Glen Canyon Dam Powerplant is reduced. Ultimately, this generation shift increases costs to the SLCA/IP market system, and therefore the cost of the alternative, because more expensive generation serves system electricity demand. Figure K.1-39 shows the average daily minimum, maximum, average, and range of electricity market prices by month forecasted for the Palo Verde market hub during the 20-year LTEMP period. In general, the more generation is produced in months with high electricity prices, the lower the alternative’s cost will be relative to Alternative A. This allocation of limited water resources allows Glen Canyon Dam to serve system loads when the power it generates has the highest value.

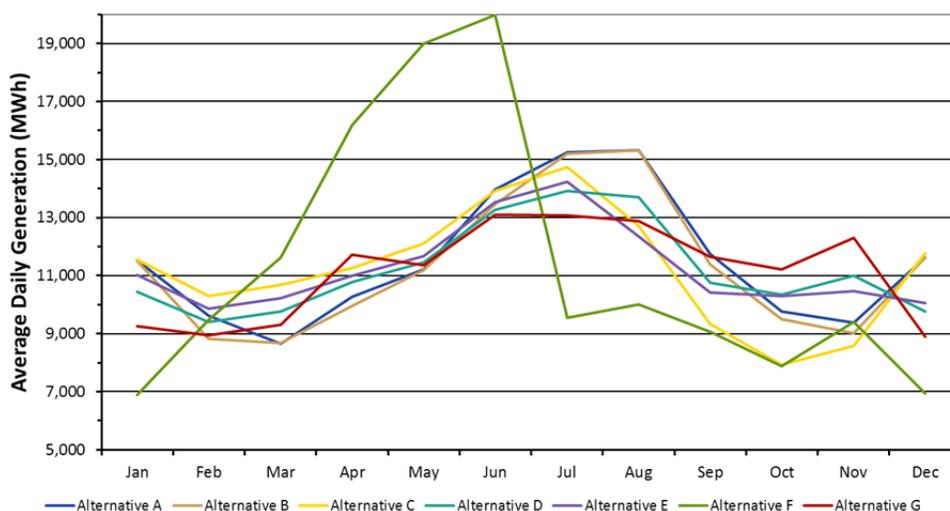


FIGURE K.1-38 Average Daily Generation by Month for Each Alternative

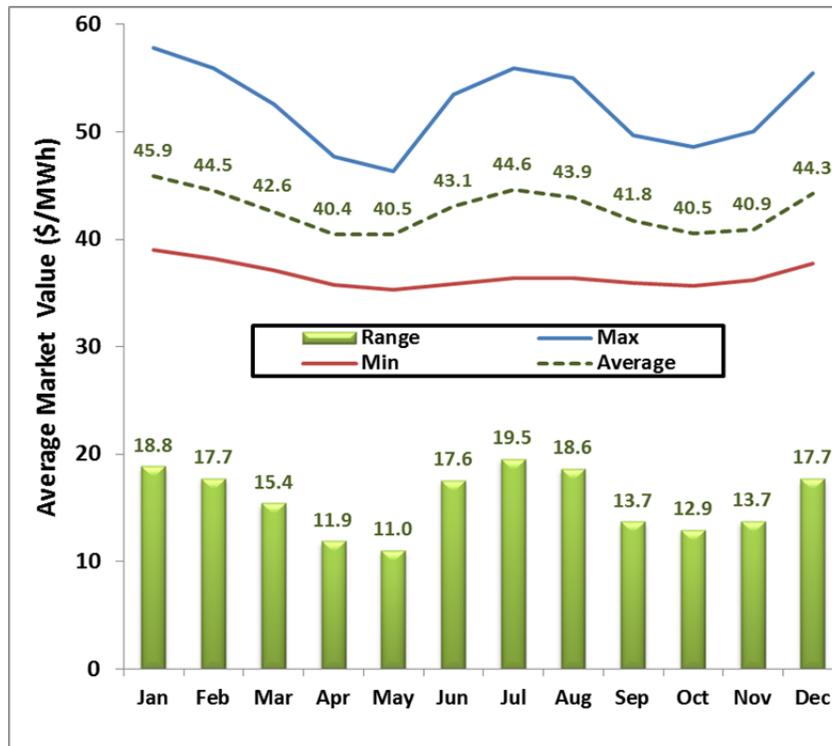


FIGURE K.1-39 Palo Verde Average Daily Electricity Market Price Statistics by Month during the 20-Year LTEMP Period

Alternatives also impact the daily profile of water releases. Changes in operating criteria, such as maximum and minimum release restrictions and mandates that limit water release changes over time, result in very different release patterns during most days. For example, except when transitioning between months or when HFEs are being conducted, Alternatives F and G require water releases from Glen Canyon Dam to be at a constant rate during each month. In contrast, other alternatives allow powerplant operators to change water release levels during a day in response to market price signals and system marginal production cost patterns. Alternatives that allow for only a small range between maximum and minimum releases and permit only minimal changes in water releases over time decrease the value of Glen Canyon Dam power production by shifting water releases from high price peak hours to low price off-peak hours. Figure K.1-40 shows typical Western Interconnection hourly electricity price patterns for winter and summer and the price spread between peak and off-peak hours.

Finally, alternatives affect the routing of water releases from the dam. Water is typically released through one or more of Glen Canyon Dam’s eight turbines to produce electricity. However, depending on the pressure exerted by the water elevation in Lake Powell, only a limited amount of water can flow through turbines during an hour. In addition, the generating capacity of a unit indirectly limits the flow of water through it. Therefore, whenever a water release is required to exceed the combined flow capabilities of the generating units that are in operation, some of the water is released through hollow jet tubes (bypass) and spillways. These non-power releases produce no energy. Each alternative has a unique set of HFE specifications

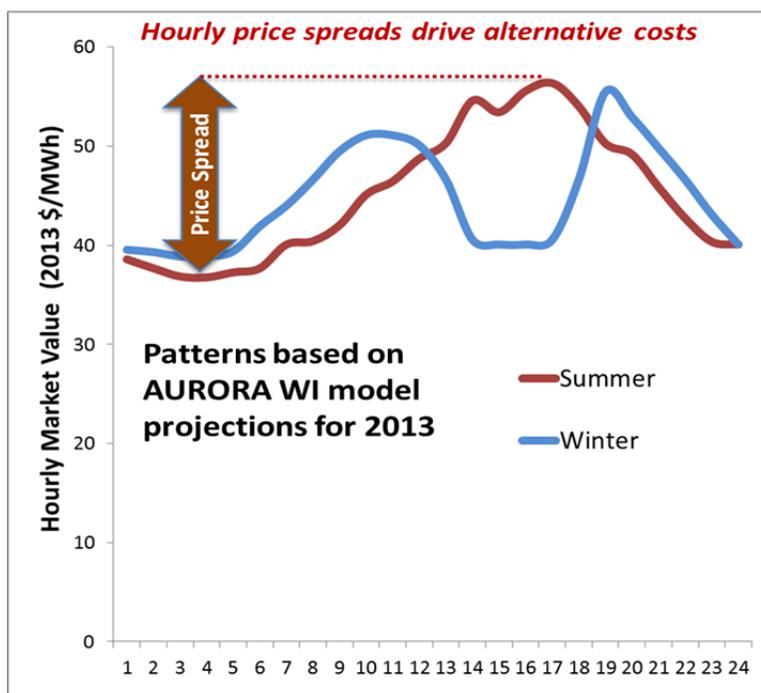


FIGURE K.1-40 Typical Hourly Winter/Summer Price Patterns in the Western United States

that affect the frequency and duration of Glen Canyon Dam non-power releases. Water is only released over the spillway (referred to as spilled water or spills) under emergency conditions associated with dam safety. Figures K.1-41 and K.1-42 show the average number of HFES and the average amount of water spilled by alternative over the LTEMP period, respectively. Averages shown are based on all 21 hydrology traces of sediment Trace 2 and disaggregated by type of HFE. Alternative G has the highest number of HFES; Alternatives C, D, E, and F have fewer HFES; and Alternatives A and B have the fewest HFES. Similarly, the greatest average volume of non-power releases occurs under Alternatives D and G; a lower volume of non-power releases occurs under Alternatives C, E, and F; and the lowest volume of non-power releases occurs under Alternatives A and B.

Water is also bypassed during very low (i.e., dry) hydropower conditions when the water elevation in Lake Powell is below the minimum turbine water intake level. During those times, it is assumed that all of the water released from Glen Canyon Dam produces no electricity until the water level rises to the minimum intake level. Figure K.1-43 shows the average annual number of hours, by alternative, the Lake Powell elevation is below the minimum penstock intake over the 20-year study period for all 21 traces of sediment Trace 2. Alternative G averages the greatest number of hours when the elevation is too low, resulting in an average of 8.5 hr over the 8,760-hr year, or 0.1% of the time; Alternatives A, B, C, D and E have somewhat fewer hours; and Alternative F has no hours when the elevation is too low to produce electricity.

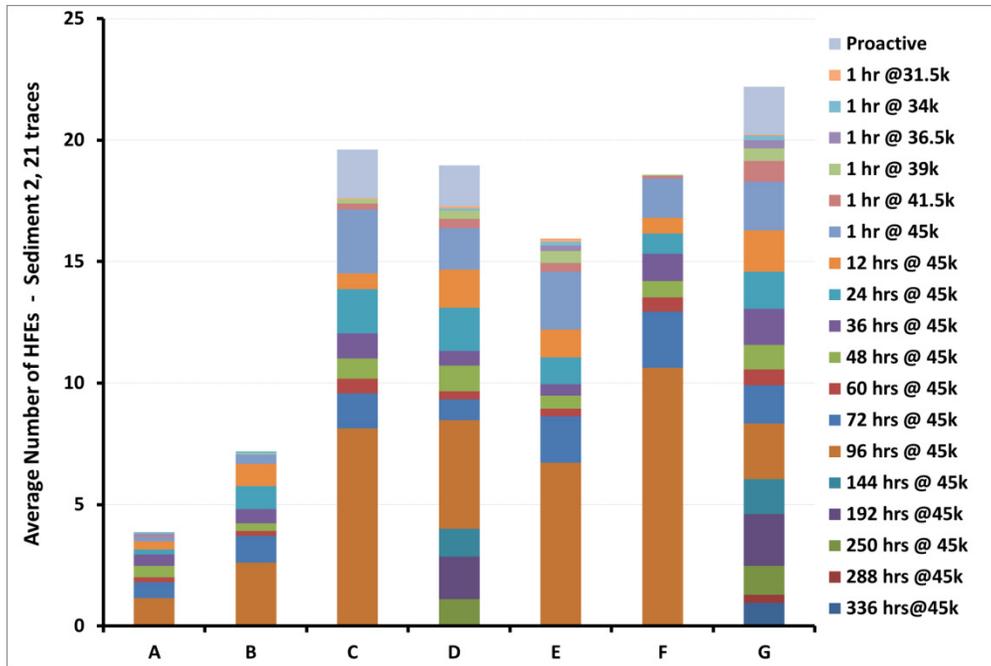


FIGURE K.1-41 Average Number of HFEs by Alternative for All 21 Hydrology Traces of Sediment Trace 2

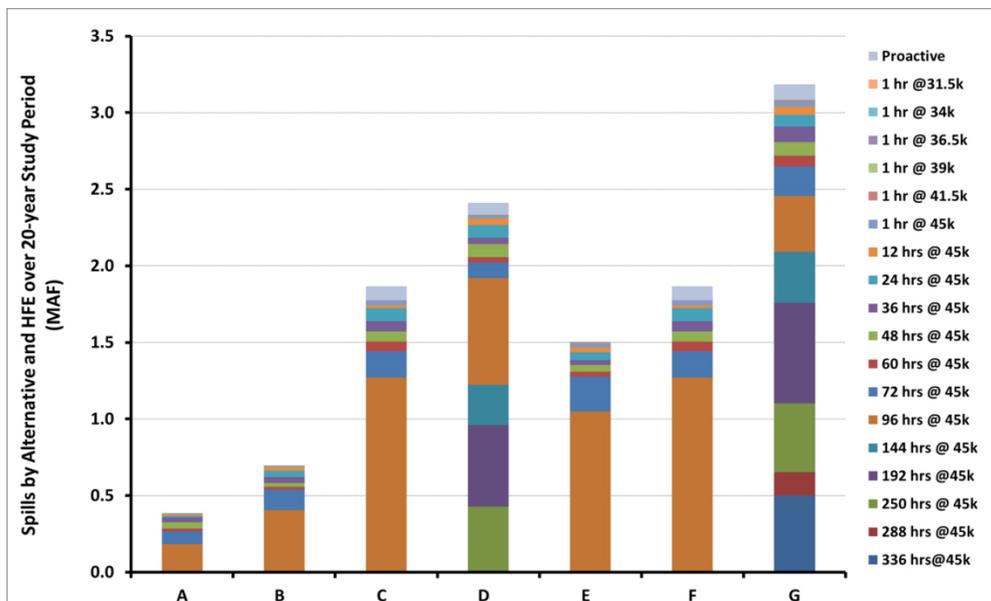


FIGURE K.1-42 Average Amount of Non-Power Water Releases by Alternative for All 21 Hydrology Traces of Sediment Trace 2

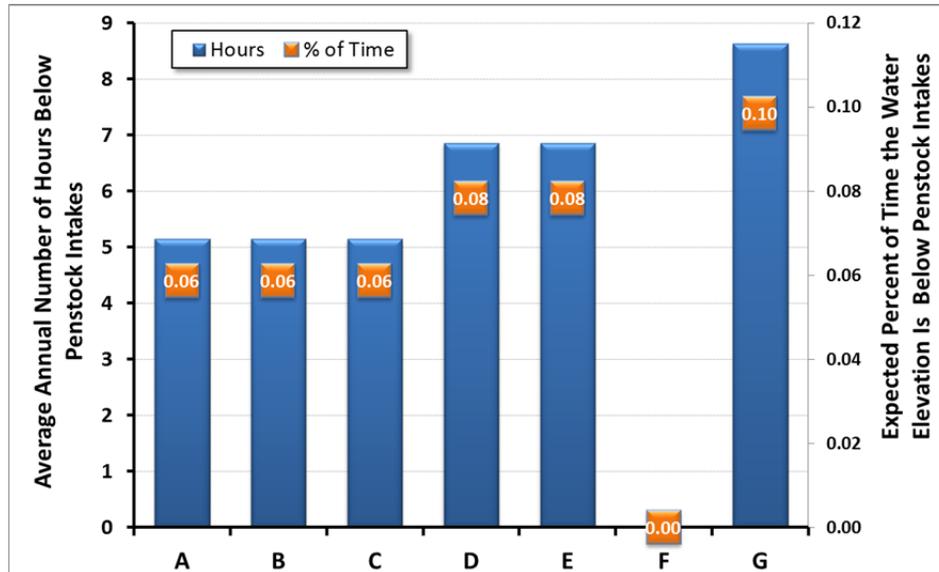


FIGURE K.1-43 Average Annual Number of Hours the Lake Powell Elevation Is below the Penstock Intake by Alternative for All 21 Hydrology Traces of Sediment Trace 2

Figure K.1-43 also shows that the percentage of time the reservoir at Glen Canyon Dam is expected to be below the penstock is very small (i.e., at most about one hourly occurrence out of every 1,000 hr). However, most of these occurrences are concentrated in fairly long, continuous periods of time. For example, under Alternative G, all hours with elevations below the penstocks occur during a continuous 3-month period starting in January 2018, under hydrology Trace 19, and during the entire month of April 2024, under hydrology Trace 8. Therefore, the risk of encountering zero generation periods is small, but when it does occur, the economic implications are very costly.

Finally, non-power water releases can also occur as a result of inflow forecast error. High reservoir conditions in combination with unanticipated large water inflow volumes into Lake Powell will result in bypassed or spilled water if there is inadequate spare reservoir capacity to accommodate all of the water inflows minus maximum turbine flow rates.

K.1.10.2 Capacity Expansion Modeling

Capacity expansion plans for each alternative during the study period are determined by running the AURORA model in capacity expansion mode. The plans specify the type of technology built, unit capacity, and the year a new unit begins operation. The model also computed the annual capacity investment and O&M costs for all new units built over the study period except those previously committed and contained in the unit inventory. As noted in section K.1.6.3, the AURORA model was given a wide selection of technologies from which to choose for future capacity additions, including conventional and advanced natural gas combustion turbines, conventional and advanced gas/oil combined cycle units, scrubbed and

pulverized coal units, integrated gasification combined cycle units, nuclear units, wind farms, and solar thermal and photovoltaic projects.

The firm SLCA/IP federal hydropower capacity input to the AURORA expansion model is credited toward meeting the system reserve margin. The quantity input depends on the combined operating capabilities of these resources at the time of the system peak demand, and on a defined exceedance level. Table K.1-7 shows marketable capacity by alternative at the 90% exceedance level (i.e., a 10% risk of having a lower peak operating capability than the specified firm level at the time of system peak load). The table also shows the difference in firm capacity compared to Alternative A (referred to as lost capacity). Except for Alternative B, which has 28.1 MW more firm capacity than Alternative A, all other alternatives have approximately 50 MW to 314 MW less firm capacity at the 90% exceedance level. This indicates that the need for additional generating capacity to replace capacity losses at Glen Canyon would range from 6.7 to 42.6% relative to Alternative A.

A retrospective study performed by Argonne on marketable capacity offered by CRSP Management Center over the last 10 years shows that it markets capacity at a 90% exceedance level. That is, WAPA has enough SLCA/IP federal hydropower resource capacity to meet its obligation 90% of the time. Therefore, the baseline LTEMP analysis used the same exceedance level to determine SLCA/IP federal hydropower firm capacity. However, in the future WAPA may choose another exceedance level to determine marketable capacity. Results are presented later in Section K.1.10.4 for exceedance levels of 50% and 99%; this range will bracket the risk preference level that the CRSP Management Center will likely, but not necessarily, choose to use when determining future LTF capacity commitment levels.

TABLE K.1-7 SLCA/IP Marketable Capacity at the 90% Exceedance Level

Capacity Type	Alternative A (No Action)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
SLCA/IP Firm Capacity (MW) ^a	737.2 (no change from current condition)	765.3 (3.8% increase)	608.1 (17.5% decrease)	687.6 (6.7% decrease)	647.0 (12.2% decrease)	423.1 (42.6% decrease)	558.2 (24.2% decrease)
SLCA/IP Lost Capacity (MW) ^b	Not applicable	-28.1	129.1	49.6	90.2	314.1	179.0

^a Marketable capacity is calculated based on all 21 hydrology traces with median sediment input (sediment Trace 2), which has the highest likelihood of occurrence. It is calculated at the 90% exceedance level, using August as the peak load month. That is, combined SLCA/IP federal hydropower resources are able to attain peak output at the firm capacity level or higher 90% of the time during the August peak load.

^b Lost capacity is the difference between the marketable capacity in Alternative A and the marketable capacity of another alternative; it represents the capacity that would need to be replaced somewhere in the power system if that alternative was implemented.

The AURORA expansion model only selected natural gas-fired technologies in its SLCA/IP market system plan to meet future demand; no other thermal or renewable technologies were chosen. Wind and solar plants were added in the expansion pathway, but only to meet the expansion goals specified in the utility IRPs as described in Section K.1.6.3. The natural gas-fired technologies chosen by AURORA were the 400-MW advanced combined cycle unit and 230-MW advanced combustion turbine.

The expansion pathway chosen by AURORA was consistent with projections made in the 2014 AEO (EIA 2014), and with expansion plans reported in IRPs developed by utilities in the region. Figure K.1-44 shows the 2014 AEO projects of cumulative capacity additions for the three geographic regions in the Western Interconnection for the next 20 years. In the future, the AEO projects only renewable generation; natural gas combined cycle plants and combustion turbines; and distributed peaking generation, which is most often fueled by natural gas.

As noted in Section K.1.6.3, Argonne conducted a survey of the current IRPs available on the websites (which typically had publication dates of either 2013 or 2014) of WAPA's customers and investor-owned utilities in the geographic and "electrical" area of WAPA's customers to determine the timing and type of resources these utilities were planning to meet future electric demand. The results of that survey were shown in Table K.1-6. As in the 2014 AEO (EIA 2014), utilities are forecasting that future capacity additions to their systems will consist of renewables (mainly wind and solar) and natural gas-fired combined-cycle plants and combustion turbines. A conclusion that can be drawn from Table K.1-6 is that because new generators are forecasted to come online in the very near term (the next 2 to 3 years) there will be little or no excess capacity in the region that would be available to replace capacity lost at Glen Canyon Dam at the time when the ROD is issued.

Figure K.1-45 shows the cumulative capacity additions selected by the AURORA expansion model for Alternative A (combustion turbines are labeled CT and natural gas combined-cycle units are labeled NGCC). Table K.1-8 shows the difference from Alternative A in cumulative capacity additions for each alternative. Because units are built in large increments, capacity expansion is often said to be "lumpy." The green line in the figure shows the amount of capacity in excess of the 15% reserve margin. Due to the lumpy expansion path, some years significantly exceed the 15% reserve margin target, while others have just enough to satisfy the reserve margin. However, the capacity above the reserve margin could be sold to utilities that are short of capacity at the market price, thereby reducing the total net cost to the SLCA/IP market system. Sales of excess capacity will be explored and quantified in the analysis of alternatives.

It should be noted that the first capacity addition under Alternative A comes online in 2018 under the current joint system analysis. Therefore, there will be very little or no excess capacity when operational changes at Glen Canyon Dam could possibly be implemented. Furthermore, lost capacity would need to be replaced soon after the ROD.

Although CRSP Management Center LTF customers typically engage in economical firm capacity and energy transactions, the joint planning approach assumes a higher level of coordination and cooperation among LTF customers than may currently exist. Results shown in Figure K.1-45 are based on a methodology that projects the expansion plan for the combined

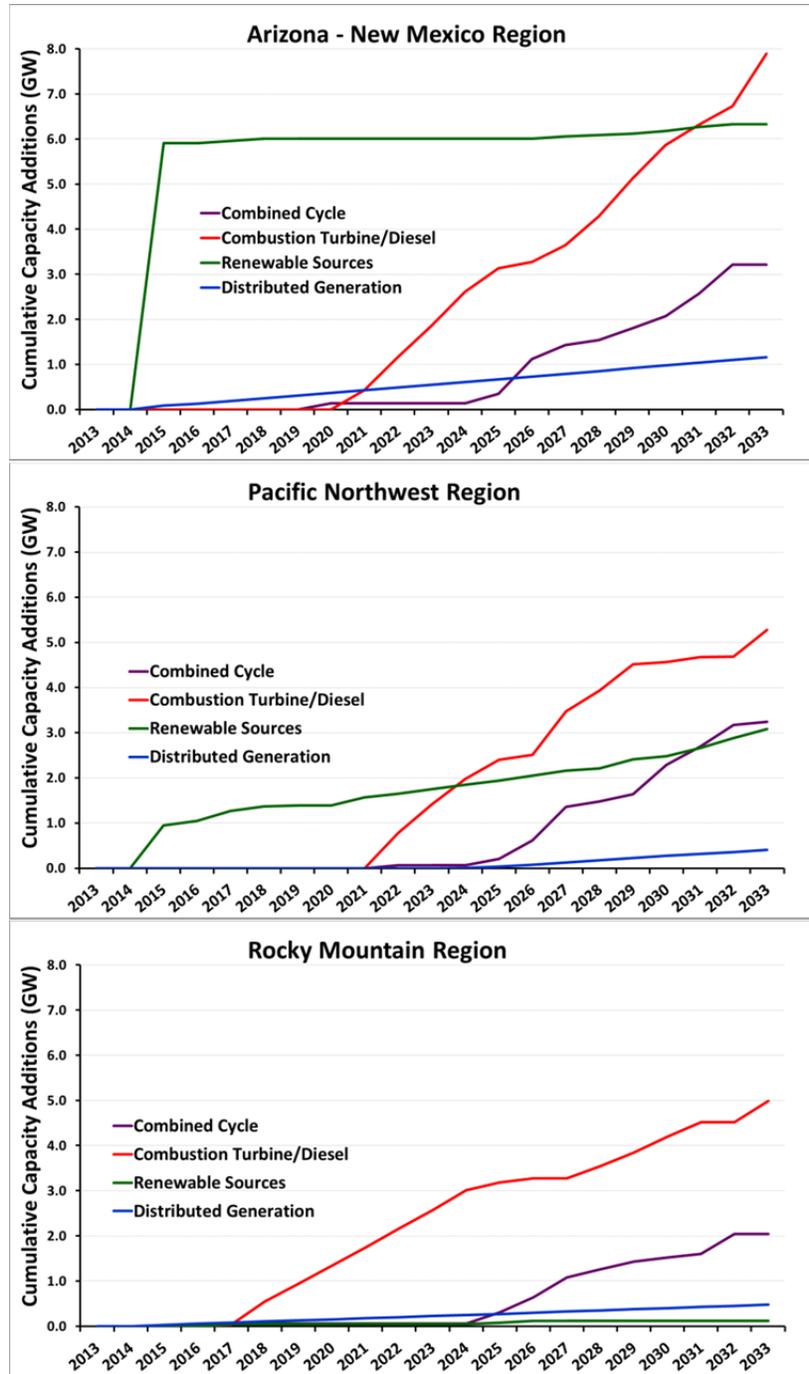


FIGURE K.1-44 2014 Annual Energy Outlook Projections of Capacity Additions in the Western Interconnection over the LTEMP Period

TABLE K.1-8 Difference in Cumulative Capacity Additions of Each Alternative Relative to Alternative A (90% Exceedance Level)

Year	Difference in Capacity (MW) per Year Relative to Alternative A						
	Alternative A Expansion (MW)	Alternative B, Long-Term Strategy 1	Alternative C, Long-Term Strategy 1	Alternative D, Long-Term Strategy 4	Alternative E, Long-Term Strategy 1	Alternative F	Alternative G
2013	0	0	0	0	0	0	0
2014	0	0	0	0	0	0	0
2015	0	0	0	0	0	0	0
2016	0	0	0	0	0	0	0
2017	0	0	0	0	0	230	0
2018	230	0	230	0	0	460	230
2019	630	0	230	0	0	460	230
2020	1,030	0	230	0	0	460	230
2021	1,030	0	230	230	230	460	230
2022	1,430	0	230	230	230	460	230
2023	1,830	0	230	230	230	460	230
2024	2,060	0	230	0	0	460	230
2025	2,290	0	230	0	0	460	230
2026	2,520	0	230	0	230	460	230
2027	2,750	0	230	230	230	460	230
2028	2,980	0	230	230	230	460	230
2029	3,440	-230	0	0	0	230	230
2030	3,670	0	0	0	0	230	230
2031	3,900	0	0	0	0	230	230
2032	4,590	0	230	230	230	460	230
2033	4,820	0	230	230	230	460	230
Average		-11	142	77	88	329	175
GC Reduction		-28	129	49	90	314	179
Difference		17	13	28	-2	15	-4

system in which the costs and benefits of new generating resources would be shared among both large and small customers. This approach has a number of advantages related to modeling efficiency while representing the general system response to changes in Glen Canyon Dam firm capacity, but understates the cost impacts. This joint planning approach indicates that numerous units would be constructed by the system. For example, by 2034, 14 new advanced combustion turbines and four advanced combined cycle units would be constructed under Alternative A (see Table K.1-9). Each unit could be operated by an individual utility or as a joint dispatch, whatever arrangement is more advantageous. If technical or institutional barriers did not allow joint unit dispatch, a new unit could be built by a single owner/operator. Furthermore, if the new unit created excess capacity in the owner's utility, it may be able sell capacity from other system resources that are more conducive to joint dispatch. Alternatively, the capacity-long system could sell the excess without specifying the individual supply resource.

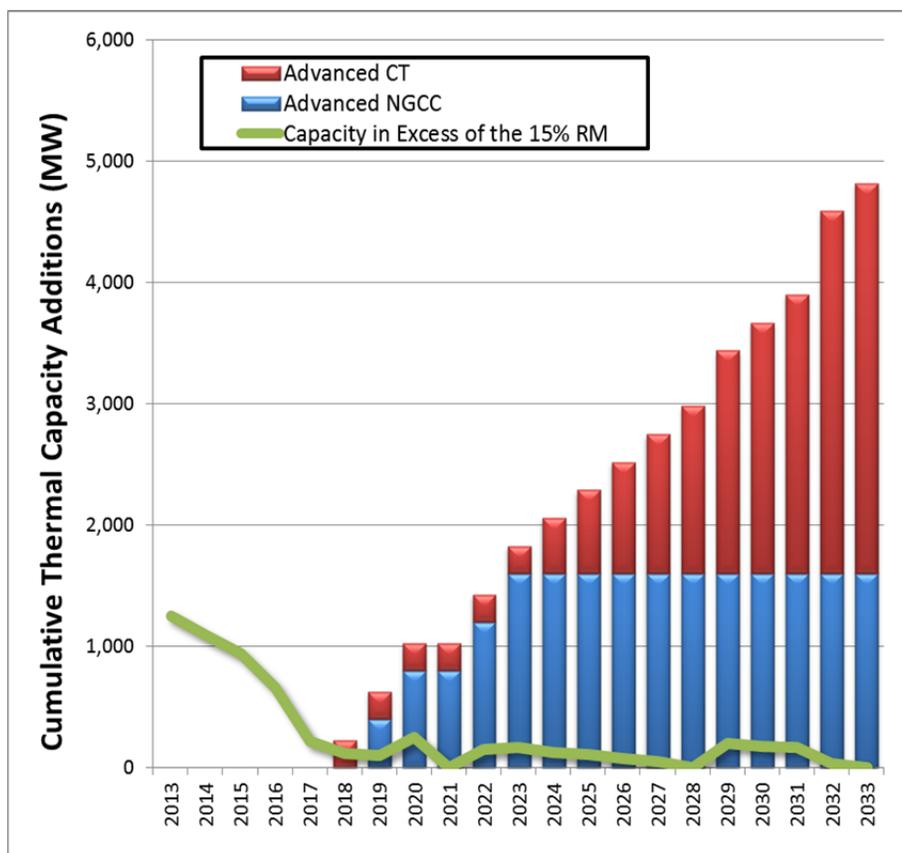


FIGURE K.1-45 Cumulative Capacity Additions for Alternative A (90% Exceedance Level)

The cost of capacity replacement in general would be higher if each individual utility were modeled as isolated entities (i.e., without mutually beneficial arrangements), which is how new units would actually be constructed. This model solution would, in many respects, be uneconomical and unrealistic because each utility that is capacity short would need to either (1) build a relatively large efficient unit to replace its allocation of the lost capacity, which in most cases is very small, or (2) build a very small unit that is typically less efficient and, because of economies of scale, is more costly per kilowatt of installed capacity to construct. Utilities that are capacity long may not need to construct any replacement capacity. The capacity expansion plan would also be very lumpy.

The capacity expansion pathway for Alternative A will replace existing powerplant capacity that will retire in the future and meet forecasted increases in electricity demand in the SLCA/IP market system. The expansion pathways for all other alternatives are a modification of this pathway. Differences in firm capacity among alternatives were evaluated in terms of the amount and timing of new generating units constructed in the future. All alternatives except Alternative B have a decrease in firm capacity compared to Alternative A. Alternatives that have less firm capacity would be expected to install capacity earlier and/or install more capacity than Alternative A. Conversely, Alternative B would be expected to have a delay in capacity additions

compared to Alternative A. Table K.1-9 compares the capacity expansion pathways for Alternatives A and F. Alternative F has the most lost capacity of all alternatives.

Table K.1-9 shows that Alternative F installs combustion turbines (labeled CT1, CT2, etc.) 1 to 7 years earlier than Alternative A. By the end of the LTEMP period Alternative F also installs more capacity, two more combustion turbines. Because the number and timing of natural gas combined cycle units (labeled NGCC1, NGCC2, etc.) is identical under both alternatives, lost Glen Canyon Dam capacity is replaced exclusively by advanced combustion turbines. This accelerated capacity addition schedule occurs because Alternative F has 314 MW less SLCA/IP federal hydropower firm capacity than Alternative A.

Table K.1-8 shows a comparison of capacity additions for all alternatives. This table lists the cumulative additional capacity for Alternative A and then shows the difference in cumulative capacity between it and the other alternatives. The difference represents the capacity that is constructed to replace lost Glen Canyon Dam capacity. Note that the replacement capacity in the table are -230 MW, 230 MW, or 460 MW; capacity changes occur in increments of an advanced combustion turbine unit. At the bottom of the table are values showing the average annual amount of replacement capacity, the lost firm capacity, and the difference between those two values. As expected, for each alternative, the amount of lost capacity and average annual capacity replacement amount ranges from -4 MW to 28 MW.

Under Alternative A, an estimated 4,820 MW of new capacity is built in the SLCA/IP market system. Capacity additions are phased in over time, such that a minimum 15% capacity reserve margin is attained in each year of the 20-year LTEMP period. Under all alternatives except Alternative B, more new generating capacity must be built and the capacity must also be built sooner. Like Alternative A, Alternative B adds 4,820 MW of new capacity by CY 2034; however, because Alternative B has slightly more firm capacity, one new generating unit would be constructed a year later than under Alternative A. All other alternatives have less firm capacity than Alternative A. Under Alternatives C, D, E, and G, 5,050 MW of new capacity additions would be required by CY 2034; this amounts to one more combustion turbine than Alternative A, which is an increase in capacity of 4.8%. Under Alternative F, 5,280 MW of new capacity is built by CY 2034, which is two more combustion turbines than Alternative A. This amounts to an increase in capacity of 9.5%.

TABLE K.1-9 Comparison of the Amount and Timing of New Capacity Additions for Alternatives A and F (90% Exceedance Level)

On-Line Date	New Additions	
	Alternative A	Alternative F
2014		
2015		
2016		
2017		CT1
2018	CT1	CT2 & CT3
2019	NGCC1	NGCC1
2020	NGCC2	NGCC2
2021		
2022	NGCC3	NGCC3
2023	NGCC4	NGCC4
2024	CT2	CT4
2025	CT3	CT5
2026	CT4	CT6
2027	CT5	CT7
2028	CT6	CT8
2029	CT7 & CT8	CT9
2030	CT9	CT10
2031	CT10	CT11
2032	CT11-CT13	CT12-CT13
2033	CT14	CT16

In addition, it is noteworthy that because capacity is built in discrete sizes/increments that do not match the amount of lost capacity, system expansion differences among the alternatives do not typically match the amount of lost capacity. In some years, the replacement capacity is larger than the lost capacity, while in other years it is smaller. Again, this result shows the “lumpiness” of capacity expansion, which allows for possible sale of capacity above the 15% reserve margin to be sold at market price to reduce the total cost of an alternative.

K.1.10.3 Economic Impacts

When the capacity expansion pathways were determined for each alternative, the AURORA model was run in dispatch mode to simulate the operation of the system for every hour in the entire study period for hydrological Trace 14, which is the representative trace. Selection of the representative trace was discussed in Section K.1.5.2, and Attachment K.3 of this appendix describes in detail how that trace was chosen.

The AURORA dispatch model computes all SLCA/IP market system costs associated with the production of electrical energy to meet the system load and to generate additional energy for power sales to the spot market. Production costs are the sum of powerplant fuel costs, variable O&M costs, and cost of power purchased from the spot market. Revenues from the power sales to the spot market are subtracted from these costs to compute the net economic cost. This technique was used to compute the production costs of serving only SLCA/IP market load. Results from the AURORA expansion and dispatch models (i.e., capital, fixed O&M, and production or energy costs) are combined to determine the total annual costs for each alternative. The net present value stream of costs is also calculated to facilitate comparison of each alternative to Alternative A. This single lump-sum value is based on a discount rate of 3.375%, a rate used by Reclamation for cost-benefit studies of projects pursuant to U.S.C. 1962d-17.

The total economic impacts at the 90% exceedance level by alternative are summarized in Table K.1-10. Costs are disaggregated by system-wide net production cost, which was obtained from AURORA dispatch model simulations, and by capital costs and fixed O&M costs, which were both obtained from AURORA expansion model simulations. This table also includes calculating a benefit from the sale of excess capacity above that required to satisfy the reserve margin. This benefit would reduce the total cost of each alternative.

All alternatives except for Alternative B have less firm SLCA/IP federal hydropower capacity than Alternative A. Therefore, the NPV of capital and fixed O&M costs are higher than under Alternative A. Alternative B had the same total amount of new capacity at the end of the LTEMP study period as Alternative A, but the construction of one combustion turbine was delayed by a year due to its slightly higher firm SLCA/IP federal hydropower capacity, which resulted in slightly lower capital and fixed O&M costs. Although Alternatives C, D, E, and G have the same amount of new capacity at the end of the LTEMP study period, they have different NPVs for capacity and fixed O&M because of the difference in the timing of the installation of the new capacity. The differences in timing are found in Table K.1-8.

TABLE K.1-10 Total Economic Impacts by Alternative at the 90% Exceedance Level

Economic Impact Measure	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
System-level generating capacity additions (MW) ^a	4,820 (no change from current condition)	4,820 (no change from current condition)	5,050 (4.8% increase)	5,050 (4.8% increase)	5,050 (4.8% increase)	5,280 (9.5% increase)	5,050 (4.8% increase)
SLCA/IP system-wide production cost (\$million) ^b	34,228 (no change from current condition)	34,221 (0.02% decrease)	34,255 (0.08% increase)	34,270 (0.1% increase)	34,249 (0.06% increase)	34,373 (0.4% increase)	34,345 (0.3% increase)
SLCA/IP Capital cost (\$million) for capacity expansion ^b	1,643 (no change from current condition)	1,635 (0.5% decrease)	1,746 (6.3% increase)	1,696 (3.2% increase)	1,703 (3.7% increase)	1,882 (14.5% increase)	1,769 (7.7% increase)
Fixed O&M cost (\$million) for capacity expansion ^b	345 (no change from current condition)	344 (0.3% decrease)	363 (5.2% increase)	354 (2.6% increase)	355 (2.9% increase)	385 (11.6% increase)	366 (6.1% increase)
Total cost (\$million) ^b	36,216 (no change from current condition)	36,200 (0.04% decrease)	36,364 (0.41% increase)	36,320 (0.29% increase)	36,307 (0.25% increase)	36,640 (1.2% increase)	36,480 (0.73% increase)
Difference in Total Costs (\$million) Relative to No Action	Not applicable	-16	148	104	91	424	264
Rank (lowest to highest total cost)	2	1	5	4	3	7	6
Potential capacity sales (\$million) ^b	86	99	99	106	82	105	85
Adjusted total cost (\$million) ^b	36,130 (No change from current conditions)	36,101 (0.08% decrease)	36,265 (0.37% increase)	36,214 (0.23% increase)	36,225 (0.26% increase)	36,535 (1.1% increase)	36,395 (0.73% increase)

TABLE K.1-10 (Cont.)

Economic Impact Measure	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
Difference in Adjusted Total Costs (\$million) Relative to No Action	Not applicable	-29	135	84	95	405	265
Adjusted Rank (lowest to highest total cost)	2	1	5	3	4	7	6

^a Additional generation capacity required under the LTEMP alternatives for WAPA’s customers over the 20-year LTEMP period to not only meet future load demand and replace unit retirements, but also account for loss/gain in capacity at Glen Canyon Dam due to the alternative operating constraints.

^b Net present value (\$million 2015) of costs to meet total system electric demand over the 20-year study period for all SLCA/IP customers under representative trace. Discount rate is 3.375%. The excess capacity may have some economic value; however, that value would depend on the timing and details of the replacement, and thus results are presented both with and without this potential excess.

Table K.1-10 also shows the amount of potential sale of excess capacity of generating units constructed by WAPA’s customers above that mandated by the reserve margin. As a result of the lumpy nature of capacity additions, there are short periods of time (i.e., typically less than 2 years) in which slightly more system capacity is built than is needed to meet the reserve margin target. It is assumed this small amount of capacity (i.e., less than the size of one generating unit) may have some value and could be sold to entities outside of the SLCA/IP system. Sales of this excess capacity lower the total cost of all alternatives, but do not substantially affect their relative ranking from lowest to highest cost alternative. If alternatives are ranked based on the difference in adjusted total cost, the order of alternatives from lowest to highest cost is as follows: Alternative B, Alternative A, Alternative D, Alternative E, Alternative C, Alternative G, and Alternative F. If the potential for sale of excess capacity is not factored into the total alternative cost, then the ranking of alternatives changes only slightly; Alternatives E and D change places in the ranking. All other alternatives remain in the same order.

Cost of Experimental Releases

LTEMP alternatives and associated long-term strategies are composed of operating criteria and several experimental elements, as shown in Table 4.1-1. Economic evaluations presented for the Structured Decision Analysis (SDA) (Appendix C) and detailed power systems analysis (Section 4.13 and Section K.1) bundle all of the costs associated with an alternative

(including operational changes and experiments) into a single value (NPV). This section provides estimates of the “unbundled” economic cost of several types of experiments.

These estimates are computed by comparing the estimated effects of long-term strategies of alternatives that differ only in inclusion of a particular experiment.² The one element that differs between the two alternatives is the element for which the economic impacts are measured. For example, to measure the economic cost of low summer flows, two long-term strategies for Alternative D are compared (D1 and D4). Both have identical operating criteria and the same experimental elements except that under long-term strategy D1 low summer flows are included in the second 10 years of the LTEMP period, while under long-term strategy D4 low summer flows would not be conducted. Subtracting NPV results for D4 from D1 yields the NPV cost of conducting the experiments over the 20-year LTEMP period. Using this methodology, the approximate cost of conducting different types of experimental elements can be “unbundled” from the total aggregate costs previously reported.

Although the SDA modeling results do not include all possible combinations of operating criteria and experiments, a general estimate of the relative costs of each type of experiment can be gained by comparing selected pairs of SDA NPV model results as described in the example above. Using information provided in Table 4.1-1, the following pairs of alternatives were selected to approximate costs associated with individual experimental elements:

1. Low summer flows
 - a. Long-term strategies D4 (without low summer flows) and D1 (with low summer flows)
 - b. Long-term strategies E3 (without low summer flows) and E5 (with low summer flows)
2. TMFs
 - a. Long-term strategies D3 (without TMFs) and D1 (with TMFs)
 - b. Long-term strategies E3 (without TMFs) and E6 (with TMFs)
3. Steady weekend flows for macroinvertebrate production
 - a. Long-term strategies D1 (without steady weekend flows) and D2 (with steady weekend flows)
4. Fall HFE
 - a. Long-term strategies C3 (without HFEs) and C4 (with HFEs)
 - b. Long-term strategies E3 (without HFEs) and E4 (with HFEs)

² Mechanical trout removal is not included in the comparison of elements because it not a factor in estimates of either SDA or power systems costs.

Consistent with both the SDA and detailed power system results, costs for each experiment are computed for both Glen Canyon Dam Powerplant energy production and replacement capacity. These estimates are based on 21 hydrology traces over the 20-year LTEMP study period. Note that the cost of a single element type differs by alternative pairing. For example, the average NPV energy costs difference between long-term strategies E3 and E5 is bigger than the difference between long-term strategies D4 and D1. In this case, the difference is due to several factors including interactions among the experimental element that is being measured (i.e., low summer flows), and both the operating criteria and other experiments. Note that both E3 and E5 do not include other experiments while both long-term strategies D4 and D1 include TMFs and HFES. It is therefore apparent that operating criteria and other experiments have an impact on the incremental cost of conducting a specific experiment.

As discussed in more detail below, the cost of conducting an experiment is dependent not only on the water release specifications of the experiment but also the frequency of the experiments and the length of time that it takes to conduct an individual experiment. For example, the energy cost to conduct each benthic invertebrate steady weekend flow experiment is relatively low, while it is much more costly to conduct an individual low summer flow. However, as shown in the following discussion, steady weekend flows are much more costly than low summer flows because of the high frequency of steady weekend flows throughout the 20-year LTEMP period. Approximately seventeen 2-day steady flows would take place every year under the former scenario while on average over all 21 traces less than one low summer flow 92-day experiment is expected over the entire 20-year LTEMP period under the latter scenario.

Capital costs for experimental elements display a pattern that is distinctly different from energy costs. For example, among the experimental elements, fall HFES are one of the more expensive, while replacement capital costs are zero. Because these HFES are conducted exclusively during the month of November, there are small impacts on Glen Canyon Dam Powerplant maximum output levels in August when firm capacity is measured. This is especially the case under dry hydrological conditions (e.g., 90% exceedance) under Alternative C and Alternative E operating criteria. There are also no firm capacity cost impacts associated with TMFs because these are conducted in May, June, and July and require no water reallocation among months of the year.

The following sections discuss in more detail each experimental element in terms of the cost to conduct an individual experiment, the frequency of experiments, and duration of each experiment.

Cost of Low Summer Flows. The average per trace difference in the NPV of energy costs over 20 years is \$1.97 million between long-term strategies D1 and D4 and \$3.36 million between long-term strategies E3 and E5. These costs are lower than both macroinvertebrate production flows and HFES. This outcome is due to the timing and infrequent occurrence of low summer flow experiments. Among all 21 hydrology traces over the 20-year LTEMP period (i.e., $20 \times 21 = 420$ outcomes), only 15 low summer flow experiments were triggered

(an average of 0.714 experiments per trace). On an annual basis, the chance that a low summer flow will be conducted is only 3.6% ($15/420 \times 100$). Furthermore, all low summer flows occur during the last 10 years of the LTEMP period. Because the NPV calculation uses an annual discount rate, a low summer flow experiment in a later year has a lower weight in the NPV calculation compared to the same experiment conducted in an earlier year. Based on the total energy cost of conducting low summer flow experiments over the 20-year LTEMP period and their frequency of occurrence, the average NPV energy cost of a single low summer flow experiment is about \$2.76 million (\$1.97 million/0.714) for Alternative D and about \$2.21 million (\$3.36 million/1.523, the average number of experiments for strategy E5) for Alternative E. Because a low summer flow experiment takes place during the entire months of June, July, and August (92 days), the average daily NPV cost to conduct a low summer flow experiment is about \$30,000 for Alternative D and about \$24,000 for Alternative E.

The annual levelized capacity replacement costs for low summer flows are approximately \$0.91 million based on a comparison between long-term strategy D1 and long-term strategy D4 (or a per trace NPV cost of \$13.03 million over 20 years), and about \$1.24 million based on a comparison between long-term strategy E3 and long-term strategy E5 (or a per trace NPV cost of \$17.86 million over 20 years). Because low summer flow experiments directly impact operations in the critical peak load month of August by reducing both monthly water release volumes and operational flexibility, there is an impact on firm capacity estimates and therefore the cost of lost capacity at the Glen Canyon Dam Powerplant. Based on the total NPV of the capacity replacement cost of the low summer flow experiments and their frequency of occurrence in the 20-year LTEMP period, the average NPV capital cost of a single experiment is about \$18.25 million (\$13.03 million/0.714) for Alternative D, and about \$11.72 million (\$17.86 million/1.523) for Alternative E; that is, an average daily NPV cost of about \$198,000 for Alternative D and about \$127,000 for Alternative E. Adding the low summer flow costs for energy and capacity yields a per experiment cost of \$21.01 million and \$13.93 million for Alternatives D and E, respectively.

In WY 2000, a low summer steady flow experiment was conducted and the financial energy cost of this experiment was estimated to be about \$25 million in nominal dollars (Veselka et al. 2011). Because the low summer steady flow was a one-time experiment, it was assumed that there were no firm capacity impacts. The WY 2000 low summer steady flow experiment was several times more expensive than the projected energy costs of the low summer flow experiments considered for the LTEMP period, for which costs were estimated to be \$2.76 million and \$4.70 million for Alternatives D and E, respectively. Although both have similar-sounding names and are conducted in the summertime, there are several factors that make the historical low summer steady flow distinctly different from low summer flows under LTEMP. These include but are not limited to following:

1. The WY 2000 low summer steady flow lasted 6 months (Veselka et al. 2011). In contrast, LTEMP low summer flow experiments are 3 months long.
2. The WY 2000 low summer steady flow had zero operational flexibility, whereby water and therefore power plant output was almost always constant.

There is comparatively more operating flexibility allowed under the LTEMP low summer flow.

3. During WY 2000, energy prices were driven by the California market, which at that time experienced extraordinary price spikes due to the market design structure in place at that time (e.g., the average on-peak price in August was approximately \$114.29/MWh) and daily price spreads between on- and off-peak periods were up to \$90/MWh.
4. The WY 2000 low summer steady flow required two “spike flows” (the predecessor of HFEs) in the spring and fall.

Cost of Trout Management Flows. For TMFs,³ the average per trace difference in the NPV of energy costs over 20 years is \$3.49 million between long-term strategies D1 and D3 and \$0.98 million between long-term strategies E3 and E6. Like low summer flows, these costs are relatively low compared to both the low steady weekend flow and the HFE experiments. The average number of TMFs conducted in a 20-year trace for Alternatives D and E is 7.76 and 2.38, respectively. Based on the total energy cost of conducting TMFs over the 20-year LTEMP period and their frequency of occurrence, the average NPV energy cost of a single TMF is about \$450,000 (\$3.49 million/7.76 TMFs over 20 years) for Alternative D and about \$410,000 (\$0.98 million/2.38 TMFs over 20 years) for Alternative E. Because a TMF takes place for a period of 5 days in May, June, and July, or a total of 15 days, the average daily NPV cost to conduct a TMF is about \$30,000 for Alternative D and about \$27,400 for Alternative E.

There is no capacity replacement cost for TMFs because these experiments only occur in the months of May, June, and July, and water is only reallocated within the same month to conduct the experiments; there is no water reallocation among other months of the year. Therefore, there is no capacity impact in the month of August when firm capacity is measured.

Cost of Macroinvertebrate Production Flows.⁴ The average per trace difference in the NPV of energy costs over 20 years is \$10.66 million between long-term strategies D2 and D1. Under this experiment, low steady weekend flows would be conducted each weekend in the months of May through August when implemented. The average number of macroinvertebrate production flow experiments conducted per trace under Alternative D was 12.24 over 20 years. Based on the total energy cost of conducting macroinvertebrate production flows and their frequency of occurrence, the average NPV energy cost of this experiment is about \$871,000

³ Trout management flows consist of repeated cycles of high and low flows over a season (see Section 2.2.3.2 for a description of TMFs). The modeling conducted for the LTEMP considered three cycles—one each in May, June, and July. In the cost of experiment analysis, a TMF experiment is assumed to be a single three-cycle implementation.

⁴ Under this experiment, weekend days from May through August would be held steady at the minimum flow for each month to support increased production of aquatic macroinvertebrates.

(\$10.66 million/12.24 experiments over 20 years). Since there are 34 weekend days from May through August, the average daily NPV cost is about \$25,600 (\$871,000/34 days).

Macroinvertebrate production flows would have a capacity benefit of 42.3 MW. This benefit occurs because in the months of May through August, weekend flows are limited to the minimum flow for that month. Since there is no change in monthly releases for this experiment, lower weekend water releases result in larger water releases, more electric generation, and higher capacity on weekdays. Because capacity exceedance values are based on the peak month of August, an alternative with this experiment has more capacity available during weekdays, when peak loads occur, than an alternative that does not have this experiment.

The annual levelized capacity benefit for this experiment is about \$2.12 million (i.e., \$30.5 million over 20 years). Based on the total NPV benefit and the number of flows that can occur over 20 years, the cost per experiment is \$2.49 million (\$30.5 million/12.24 flows over 20 years). The average daily benefit would be about \$73,200 (\$2.49 million/34 days per year). Adding the cost of energy and the capacity benefit yields a per-experiment benefit of about \$1.62 million. The average daily NPV benefit is about \$47,600.

Cost of Fall High Flow Experiments. The average per trace difference in the NPV of energy costs over 20 years is \$24.98 million between long-term strategies C3 and C4 and \$24.54 million between long-term strategies E3 and E4. These costs are relatively high compared to the energy cost for other experiments. This outcome is due to the frequent occurrences of fall HFEs and the high energy cost associated with conducting each individual fall HFE. On average, 15.4 HFEs per hydrology trace would be conducted under long-term strategy C4, and 16 HFEs would be conducted under long-term strategy E4. Based on the total energy cost of conducting fall HFEs over the 20-year LTEMP period and their frequency of occurrence, the average NPV energy cost of a single fall HFE is about \$1.62 million (\$24.98 million/15.4 HFEs per 20-year trace) for Alternative C and about \$1.65 million (\$24.54 million/14.9 HFEs per 20-year trace) for Alternative E.

The number of days it takes to conduct a fall HFE experiment varies based on the type of HFE. An HFE can last from 2 to 16 days, including the up and down ramping periods. On average, a fall HFE lasts about 4.7 days under long-term strategy C4 and 4.6 days under long-term strategy E4. Therefore, the average daily NPV costs to conduct a fall HFE experiment in November is about \$345,000 for Alternative C and about \$358,000 for Alternative E. As discussed previously, there is no lost capacity cost associated with a fall HFE because November HFEs have little to no impact on maximum output levels at the Glen Canyon Dam Powerplant in August (i.e., the month with the highest peak load).

The cost for an individual HFE computed in this analysis is somewhat lower than the estimated cost of the fall HFE conducted in WY 2014, which ranged from \$2.44 million to \$2.59 million (Graziano et al. 2015). Several factors contributed to the higher historical costs and include (1) WY 2014 HFE was a longer 6-day event; (2) costs were not discounted; and (3) the WY 2014 HFE study was a financial analysis.

Experimental Element Summary. Table K.1-11 summarizes the results of the pairwise comparison of alternatives to determine the costs of individual experiments.

K.1.10.4 Sensitivity of Results to Exceedance Level

One sensitivity study investigated the effect of exceedance level on results. The previous section discussed results at the 90% exceedance level. This section will show results at the 50% and 99% exceedance levels and discuss how they compare to each other and to results at the 90% exceedance level. Table K.1-12 shows at each exceedance level and alternative the firm capacity, the capacity replacement requirement, and the system-level capacity additions at the end of the LTEMP study period.

Table K.1-12 shows that, compared to the 90% exceedance level, the 99% exceedance level results in a lower firm capacity and the 50% exceedance level results in a higher firm

TABLE K.1-11 Estimated Cost of LTEMP Experiments

Experimental Element and Pair	Average NPV Cost Difference over 20 Years (\$ million)			Average NPV Cost Per Experiment (\$ million)			Average Daily NPV Cost (\$ million)		
	Energy	Capacity	Total	Energy	Capacity	Total	Energy	Capacity	Total
Low summer flows (long-term strategies D4, D1)	1.97	13.03	15.00	2.76	18.25	21.01	0.03	0.20	0.23
Low summer flows (long-term strategies E3, E5)	3.36	17.86	21.22	2.21	11.72	13.93	0.02	0.13	0.15
TMFs (long-term strategies D3, D1)	3.49	0.00	3.49	0.45	0.00	0.45	0.030	0.00	0.030
TMFs long-term strategies (E3, E6)	0.98	0.00	0.98	0.41	0.00	0.41	0.027	0.00	0.027
Macroinvertebrate production flows (long-term strategies D1, D2)	10.6	-30.5	-19.9	0.871	-2.49	-1.62	0.026	-0.073	-0.048
Fall HFEs (long-term strategies C3, C4)	24.98	0.00	24.98	1.62	0.00	1.62	0.35	0.00	0.35
Fall HFEs (long-term strategies E3, E4)	24.54	0.00	24.54	1.65	0.00	1.65	0.36	0.00	0.36

TABLE K.1-12 Comparison of Marketable Capacity, Replacement Capacity, and Capacity Additions by Exceedance Level

Capacity Type	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
99% Exceedance Level							
SLCA/IP Marketable Capacity (MW) ^a	611.2 (no change from current condition)	619.9 (1.4% increase)	510.7 (16.4% decrease)	599.8 (1.8% decrease)	542.2 (11.3% decrease)	354.5 (42.0% decrease)	466.8 (23.6% decrease)
SLCA/IP Replacement Capacity (MW) ^b	Not applicable	-8.8	100.5	11.3	68.9	256.7	144.3
System-Level Generating Capacity Additions (MW) ^c	5,050 (no change from current condition)	5,280 (4.6% increase)	5,280 (4.6% increase)				
90% Exceedance Level							
SLCA/IP Firm Capacity (MW) ^a	737.2 (no change from current condition)	765.3 (3.8% increase)	608.1 (17.5% decrease)	687.6 (6.7% decrease)	647.0 (12.2% decrease)	423.1 (42.6% decrease)	558.2 (24.2% decrease)
SLCA/IP Lost Capacity (MW) ^b	Not applicable	-28.1	129.1	49.6	90.2	314.1	179.0
System-Level Generating Capacity Additions (MW) ^c	4,820 (no change from current condition)	4,820 (no change from current condition)	5,050 (4.8% increase)	5,050 (4.8% increase)	5,050 (4.8% increase)	5,280 (9.5% increase)	5,050 (4.8% increase)
50% Exceedance Level							
SLCA/IP Firm Capacity (MW) ^a	959.9 (no change from current condition)	987.0 (2.8% increase)	780.2 (18.7% decrease)	878.3 (8.5% decrease)	829.1 (13.6% decrease)	569.6 (59.3% decrease)	722.1 (24.8% decrease)
Lost (positive values) or Gained (negative values) Capacity (MW) ^b	Not applicable	-27.2	179.7	81.6	130.8	390.3	237.8

TABLE K.1-12 (Cont.)

Capacity Type	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
System-Level Generating Capacity Additions (MW) ^c	4,820 (no change from current condition)	4,590 (4.8% decrease)	5,050 (4.8% increase)	4,820 (no change from current condition)	4,820 (no change from current condition)	5,280 (9.5% increase)	5,050 (4.8% increase)

- ^a Additional generation capacity required under the LTEMP alternatives for WAPA’s customers over the 20-year LTEMP period to not only meet future load demand and replace unit retirements, but also to account for loss/gain in capacity at Glen Canyon Dam due to the alternative operating constraints.
- ^b Lost capacity is the difference between the marketable capacity in Alternative A and the marketable capacity of another alternative; it represents the capacity that would need to be replaced somewhere in the power system if that alternative was implemented.
- ^c Additional generation capacity required under the LTEMP alternatives for WAPA’s customers over the 20-year LTEMP period to not only meet future load demand but also account for loss/gain in capacity at Glen Canyon Dam due to the alternative operating constraints

capacity. A higher exceedance level means SLCA/IP federal hydropower resources will be able to supply the system with all of the computed firm capacity more often than when a lower exceedance level is used. In addition, in the 50 to 99% exceedance range, the higher the exceedance level, the lower the firm capacity difference among alternatives. Therefore, the higher the exceedance level, the smaller the difference in in capital and fixed O&M costs among alternatives.

The AURORA model was run both in capacity expansion and dispatch mode to determine the NPV costs of the new expansion pathways and the production costs for the 50% and 99% exceedance levels for the representative trace. Figures K.1-46, K.1-47, and K.1-48 show results for the 50%, 90%, and 99% exceedance levels, respectively. These figures also show the difference in cost between various alternatives and Alternative A for each of the three components that compose the total cost of the alternative: capital, fixed O&M, and production or energy. The black bar for each alternative shows the total cost of the alternative if excess capacity above the amount required to satisfy the reserve margin is sold to the market. This sale of excess capacity could either raise or lower the total alternative cost compared to Alternative A. Results shown in all three figures are based on a 3.375% discount rate. The relative ranking of alternatives for these two sensitivity analyses are similar to the 90% exceedance level (that is, in order from highest to lowest, Alternatives B, A, D, E, C, G, and F). In addition, this ranking is identical whether excess firm capacity is either sold or not sold.

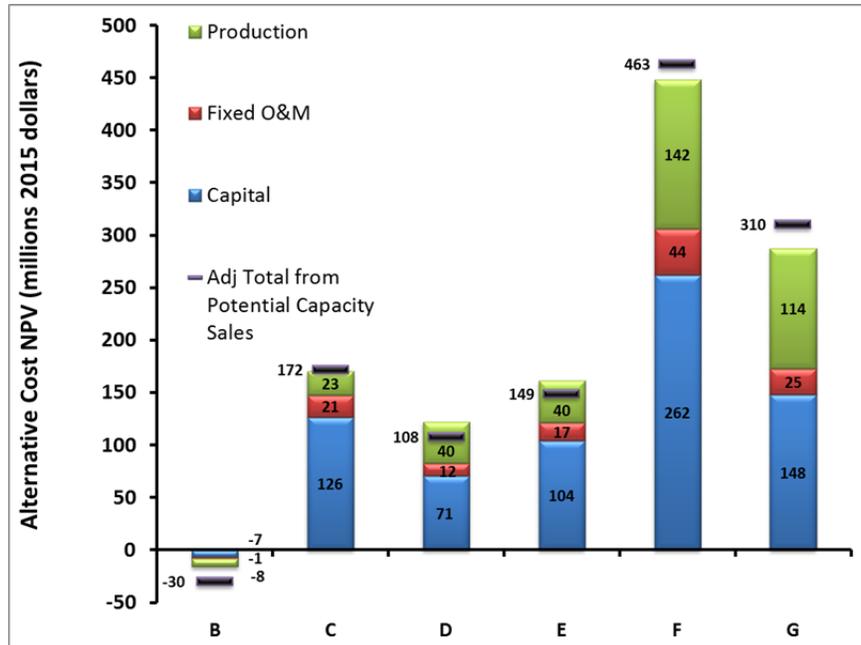


FIGURE K.1-46 Cost Difference of Alternatives Compared to Alternative A at 50% Exceedance Level and 3.375% Discount Rate

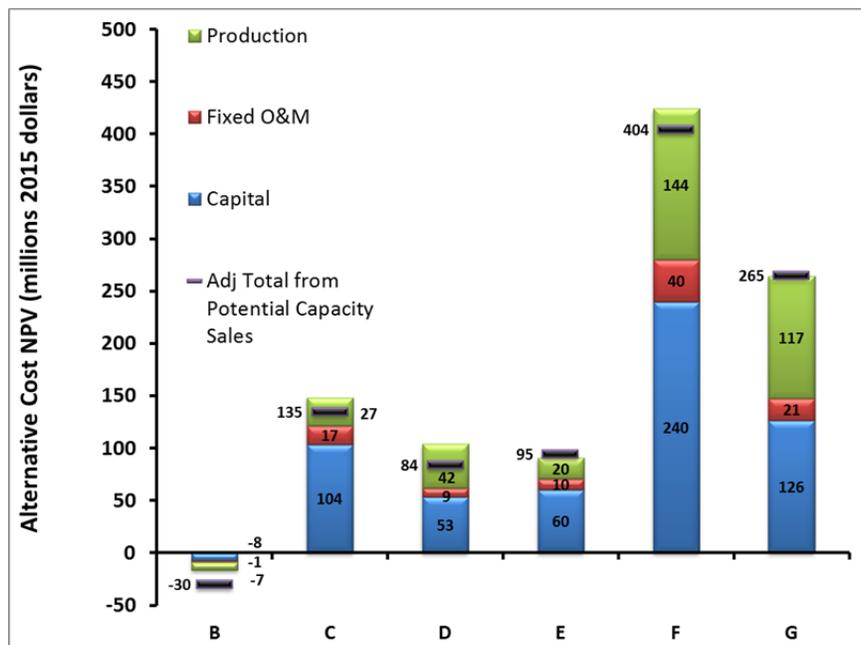


FIGURE K.1-47 Cost Difference of Alternatives Compared to Alternative A at 90% Exceedance Level and 3.375% Discount Rate

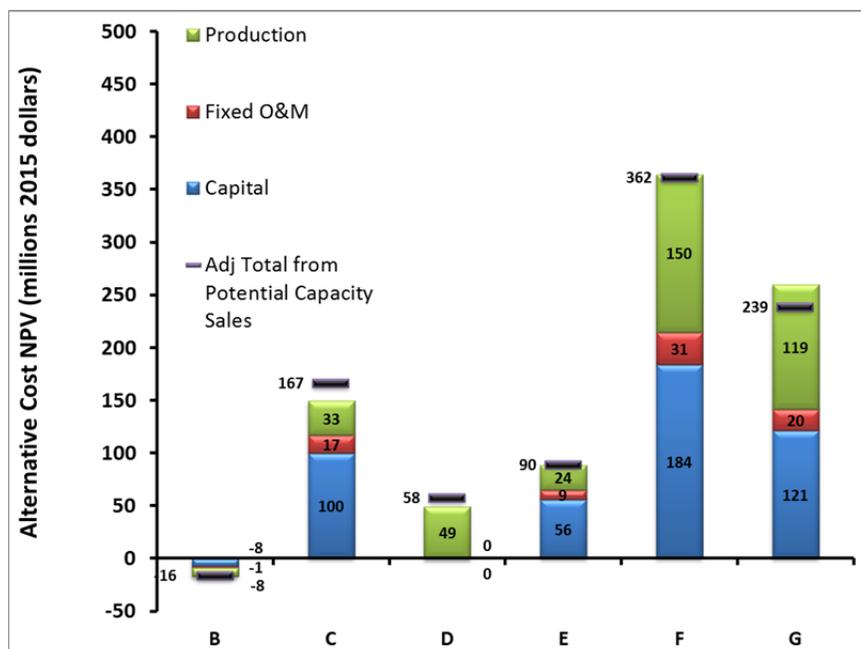


FIGURE K.1-48 Cost Difference of Alternatives Compared to Alternative A at 99% Exceedance Level and 3.375% Discount Rate

The figures show that as the exceedance level increases, the difference in the cost of each component and the total cost compared to Alternative A decreases. The alternative cost differences are smaller because the difference in firm SLCA/IP federal hydropower capacity between the various alternatives and Alternative A is lower as the exceedance level increases. Because a smaller amount of new capacity is needed to replace capacity lost at Glen Canyon Dam compared to Alternative A, each cost component and the total cost of the alternative is reduced.

At all exceedance levels, the cost of Alternatives F and G, which both have steady flow operating requirements, have the highest costs of all alternatives because they have the lowest firm capacity and no operational flexibility. Therefore, both require the largest amount of new capacity additions to replace lost Glen Canyon Dam capacity. Alternative F is the highest cost because, unlike Alternative G, it has very high monthly water releases at a time of the year (i.e., spring) with relatively low marginal production costs, and low releases during the high-production-cost summer months of July and August. In contrast, Alternative B is always the lowest cost alternative because it has a higher firm capacity than Alternative A and slightly more operational flexibility. The other three alternatives also have approximately the same ranking across all three exceedance levels.

Note that in Figure K.1-48 (the 99% exceedance level), the capital and fixed O&M cost differences between Alternatives A and D are zero. This occurs because the capacity expansion schedule is identical in both alternatives; that is, the amount and type of capacity is brought online at exactly the same time. Table K.1-12 has examples of other alternatives that have the same amount of capacity additions at the end of the LTEMP period as Alternative A, but still

have a difference in the capital and fixed O&M costs compared to Alternative A. This occurs because of the difference in timing of capacity additions. This result again illustrates the lumpy nature of capacity expansion due to the fact that plants used for capacity expansion have a discrete size; thus, adding one or a combination of several may exceed the capacity needed to just fulfill the reserve margin requirement.

Finally, the cost differences between an alternative and Alternative A are a very small percent of the total cost of the alternative across this wide range of exceedance levels. For example, Alternative F is the highest cost alternative at all three exceedance levels. At the 50% exceedance level, Alternative F costs more about \$448 million more than Alternative A. However, this difference is only about 1.2% of the total cost of Alternative A, which is about \$36.2 billion.

K.1.10.5 Sensitivity of Results to Discount Rate

Up to this point NPVs have been calculated using an annual discount rate of 3.375%, which is a rate used by Reclamation for project cost-benefit studies. The LTEMP hydropower subject matter expert team that helped guide this power systems study expressed concern that the 3.375% rate appears to be too high under current economic conditions. Therefore, a real annual discount rate of 1.4% was used for the sensitivity study. That value was obtained from the Office of Management and Budget Circular A-94, Appendix C (available at https://www.whitehouse.gov/omb/circulars_a094/a94_appx-c). That rate is the real interest rate on treasury notes and bonds with a maturity of 30 years.

Figure K.1-49 shows the 20-year NPV cost differences between each alternative and Alternative A for the representative trace at the 90% exceedance level using the 1.4% real discount rate. This figure should be compared to Figure K.1-47, which is the same exceedance level but for the baseline discount rate. When using a lower discount rate, the NPV costs of alternatives relative to Alternative A are larger because costs at the end of the study period have a larger contribution to the NPV. Note that the NPV cost difference between Alternatives F and A is approximately a half billion dollars (\$508 million, if adjustment for potential excess capacity sales is not included). However, the relative ranking of alternatives from lowest to highest cost, and relative percent difference from Alternative A do not change for these two discount rates. Alternative B is the lowest cost alternative, followed by Alternatives A, E, D, C, G, and F. If it is assumed that excess capacity will be sold to an entity outside of the SLCA/IP market system, then Alternatives D and E change places in the alternative ranking.

K.1.10.6 Sensitivity of Results to the Base Capacity Expansion Path

The new generating unit additions projected by the AURORA capacity expansion model run for Alternative A represents a reasonable and plausible outlook that is consistent with utility IRPs in the region and the 2014 AEO (EIA 2014) projections. However, as stated earlier, the AURORA model bases capacity expansion decisions more on local financial objectives than on economic ones. Argonne power systems analysts also discovered that small changes in some

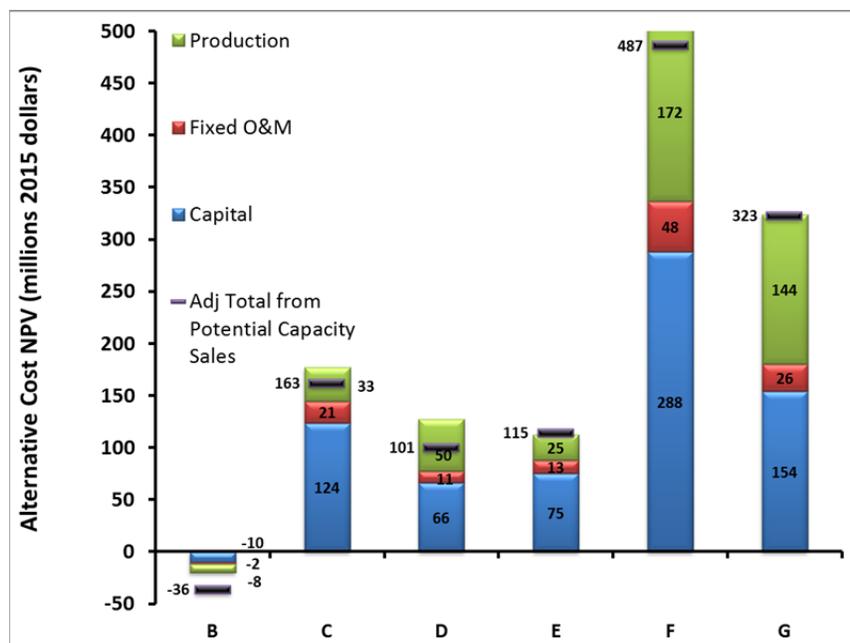


FIGURE K.1-49 Cost Difference of Alternatives Compared to Alternative A at 90% Exceedance Level and 1.4% Discount Rate

AURORA inputs would lead to substantial changes in capacity expansion pathways. This model behavior leads to uncertainty about the impact of Alternative A’s expansion pathway on the final results and about the conclusions that could ultimately be made about power systems economic impacts.

Although pathways were different, it became apparent that the advanced combustion turbines and advanced combined cycle units were the two expansion candidates used almost exclusively by AURORA for new future additions. Therefore, additional model runs were made to measure the sensitivity of the base capacity expansion pathway on economic outcomes. Two extreme Alternative A pathways were tested. Both were based on a 90% exceedance level and a 3.375% discount rate. One pathway built exclusively advanced combustion turbines and the second pathway build only the advanced combined cycle plants. The base construction pathway (i.e., the type and timing of additions) for Alternative A was used as the starting point for each of the other alternatives. Advanced combustion turbines were added to (or in the case of Alternative B, subtracted from) a base expansion pathway to accommodate capacity changes at Glen Canyon Dam. Results for these two extreme pathways are shown in Figures K.1-50 and K.1-51.

For both pathways, the comparative results show the same basic pattern as all of the previously discussed results. Alternative ranking is basically the same. However, under the advanced combined cycle base expansion pathway, costs (stacked bars) are noticeably higher for Alternatives D and E as compared to the primary assumption set reported in Chapter 4 (i.e., mixed technology expansion, 90% exceedance, and a 3.375% discount rate shown in Figure K.1-47). Also under the advanced combustion turbine base expansion pathway, costs for

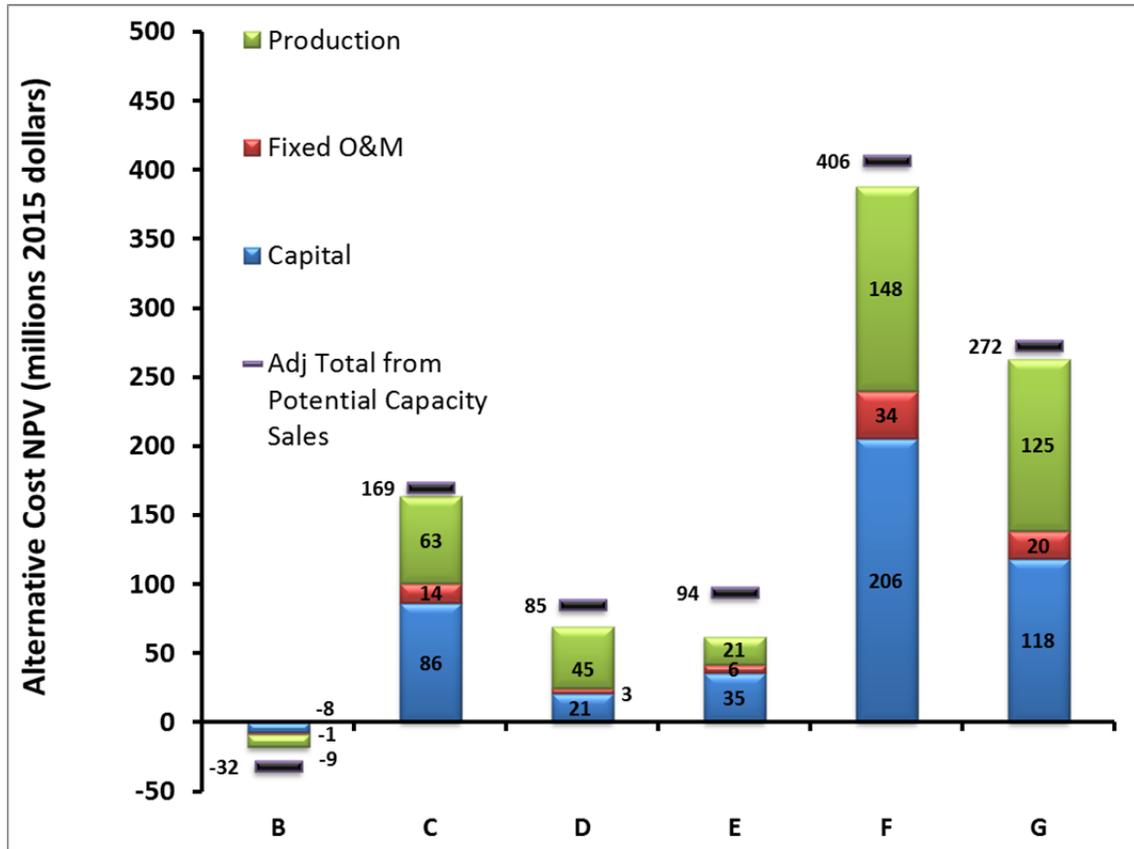


FIGURE K.1-50 Cost Difference of Alternatives Compared to Alternative A at 90% Exceedance Level and 3.375% Discount Rate, Assuming All Alternative A New Capacity Additions Are Advanced Combustion Turbines

Alternatives D, E, F, and G are lower. This is due primarily to the lumpy nature of capacity additions. If excess capacity can be sold, the effects of this lumpy behavior are significantly reduced. Note that for each alternative the black bars for the three base expansion pathways are very similar.

K.1.10.7 Sensitivity of Results to the Assumed Future Hydrological Conditions

Hydrology Trace 14 in combination with sediment Trace 2, which was the most probably sediment condition, was used as the representative trace. However, as noted earlier, the impacts of an alternative are dependent on the hydrological conditions. Therefore, the timing of dry, average, and wet hydrological condition is important because discounting in the NPV computation gives a higher weight to near-term costs as compared to costs that are incurred in the more distant future.

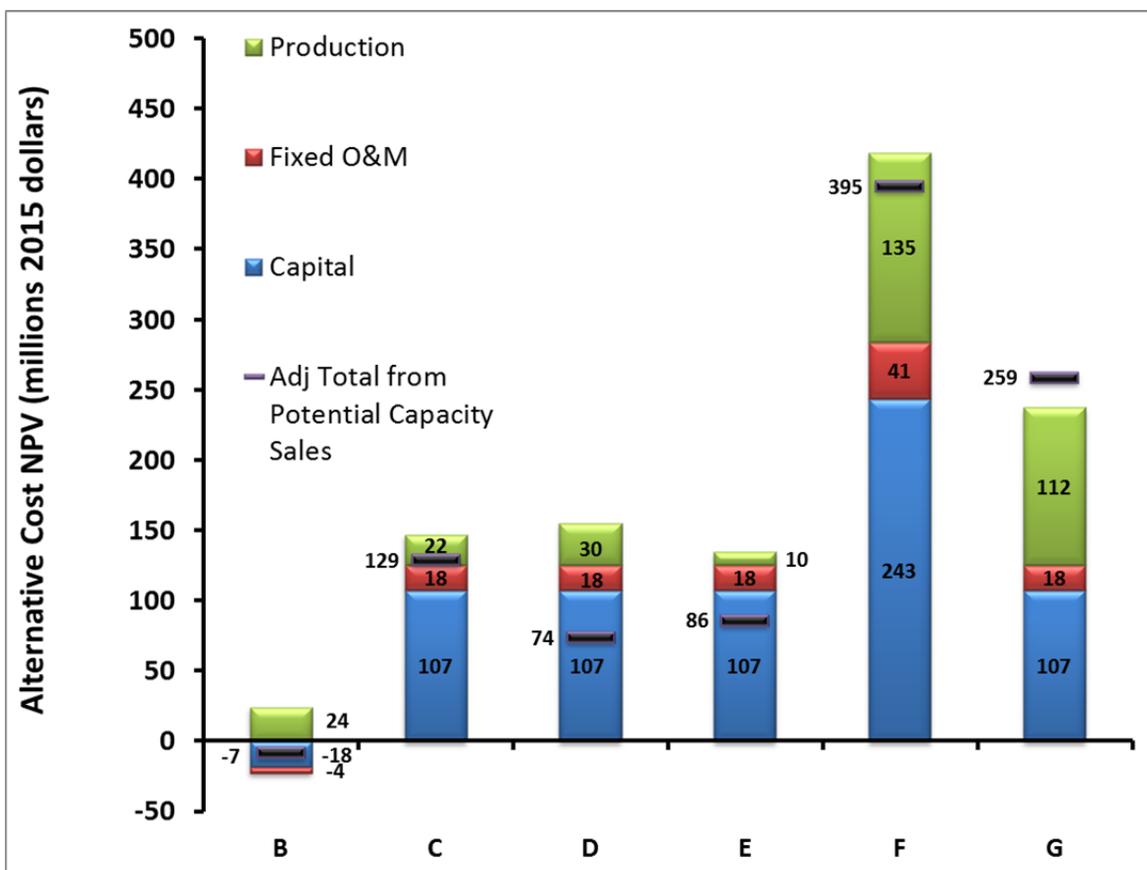


FIGURE K.1-51 Cost Difference of Alternatives Compared to Alternative A at 90% Exceedance Level and 3.375% Discount Rate, Assuming All Alternative A New Capacity Additions Are Advanced Combined Cycle

This section is intended to provide insights into the economic results' sensitivity to the selected hydrological condition. Ideally, all possible combinations of the 21 hydrology traces and three sediment traces would be simulated with the AURORA model in dispatch mode over the 20-year study period. However, such an effort would be very time consuming. As a simplification, only one other hydrological condition was run. For each hour of the LTEMP study period, this condition uses the average hourly generation from all 21 traces under sediment Trace 2 as projected by GTMax-Lite runs of Glen Canyon Dam. Results for this average hydropower condition are shown in Figure K.1-52.

Note that all capital and fixed O&M costs in Figure K.1-52, as shown by the blue and red bars, respectively, are identical to those shown in Figure K.1-47 for the primary assumption set. This occurs because capacity expansion decisions are made under uncertainty. For this power systems study, the expansion pathway for each alternative is based on a set of 21 plausible future hydrological conditions. It is also assumed that once the firm capacity level is determined and input into the AURORA model to determine an alternative-specific expansion path, the firm capacity level does not change regardless of the sequence of actual hydrological conditions that occur in the future. Therefore, the representative trace and the average trace use identical

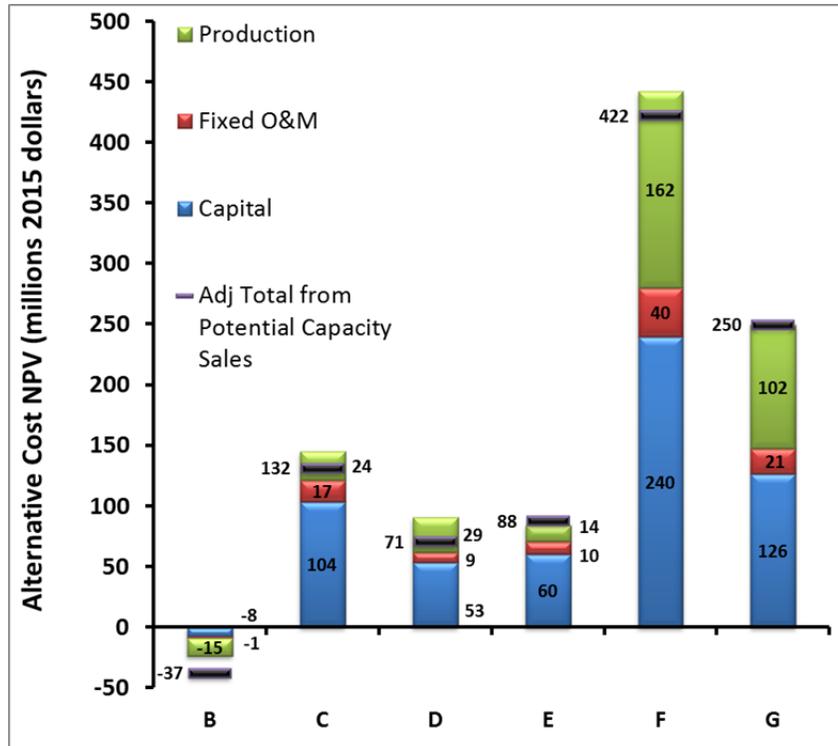


FIGURE K.1-52 Cost Difference of Alternatives Compared to Alternative A at 90% Exceedance Level and 3.375% Discount Rate Assuming Average Hydropower Conditions

capacity expansion pathways. If other hydropower conditions were run, each one would use this fixed expansion path.

Although capital and fixed O&M costs are identical, production costs (green bars) are slightly different. This does not provide definitive proof that the selected trace does not have a substantial impact on economic outcomes, but it does show that the representative trace—which has a sequence of dry, average, wet, average, and dry conditions over the study period—produces a result that is very similar to a sequence of average hydropower conditions.

K.1.10.8 Sensitivity of Results to Changes in Ancillary Services

A sensitivity study was performed on the effect changes in ancillary services (AS), which is the sum of regulation and fast spinning reserves, would have on the value of energy and firm capacity from Glen Canyon Dam. It was performed because assumptions about ancillary service requirements changed from when the GTMax-Lite model was run for the swing-weighting exercise in March 2014 (swing-weighting described in Appendix C). For this modeling, ancillary service requirements at Glen Canyon Dam were projected to be 103 MW in 2013 and then to increase to 160 MW by 2030. This case was called the high AS scenario. However, subsequent to this modeling, a second scenario was determined by WAPA to be more likely (i.e., ancillary

service requirements would remain at the same levels that exist today). Glen Canyon Dam currently supplies 67 MW of ancillary services and WAPA currently expects this not to increase during the LTEMP study period. This case was called the current AS scenario. This section reports the results of the study.

Using a lower ancillary service requirement will affect Glen Canyon Dam dispatch, firm capacity levels, and economic evaluations. In addition, alternatives that allow higher operational flexibility may be affected more than ones with very stringent limitations. Therefore, a sensitivity analysis was conducted to evaluate the magnitude of change that would occur in model results if the current AS scenario had been used.

Because it would have been costly to redo the entire analysis using current ancillary service requirements, a sensitivity analysis was performed that used a simpler methodology to gage differences in firm capacity and energy economics among Alternatives A, D, and F under two disparate ancillary service market assumptions. Prior to conducting the sensitivity analysis, it was determined that, if differences in the marketable capacity and energy for these three alternatives were dissimilar (e.g., more than 5% different) under the two AS cases, a second phase analysis would be performed. Since the results showed very little difference between the ancillary services scenarios, the more detailed second phase analysis was deemed unnecessary.

Alternatives A, D, and F were chosen because they span a wide range of firm capacities that the LTEMP alternatives exhibit. Alternative A is the current operating regime and has the second highest firm capacity; Alternative F is a steady flow alternative and has the lowest marketable capacity; and Alternative D represents a mid-range firm capacity level. To expedite the analysis, end-of-month elevations and monthly release values from the CRSS model for just Trace 14 (i.e., the representative hydrology trace) was analyzed. Monthly releases input to the Glen Canyon Dam GTMax-Lite model were not adjusted for experiments (either HFEs or TMFs) because CRSS results did not account for them. Experiments are only added by the SBM and are assumed to have relatively small impacts on firm capacity at exceedance levels over 50%.

The GTMax-Lite model was run and results were stored for hourly generation over the entire study period. Firm capacity for several exceedance levels above 50% under the three alternatives were then estimated for both sets of ancillary service values. The value of generation was determined by multiplying hourly generation levels by corresponding hourly Palo Verde LMPs. Hourly values were then summed to determine the total economic energy value. Next, differences in firm capacity and energy value among the three alternatives were computed and results from the ancillary services cases were compared.

Ancillary services sensitivity analysis results are shown in Tables K.1-13 through K.1-15 below. Table K.1-13 shows the capacity at exceedance levels ranging from 0 to 100% for the three alternatives and the two ancillary service scenarios. At capacity exceedance levels of interest for the LTEMP analysis (namely, 50% to 99%), the capacity differs by less than 5% between the two ancillary services scenarios.

TABLE K.1-13 Firm SLCA/IP Federal Hydropower Capacity (MW) at Various Exceedance Levels at Glen Canyon Dam by Alternative and Ancillary Service Scenarios

Exceedance	Alternative A (No Action Alternative)		Alternative D (Preferred Alternative)		Alternative F	
	Current AS	High AS	Current AS	High AS	Current AS	High AS
100	519	495	458	458	191	191
99	519	495	458	458	191	191
90	550	549	484	481	212	212
80	575	575	525	511	232	232
70	630	623	546	544	241	241
60	647	647	564	564	251	251
50	673	673	591	584	259	259
40	694	694	595	595	267	267
30	716	716	620	607	276	276
20	890	830	887	827	692	692
10	975	967	987	967	985	985
1	1097	1097	1097	1097	1097	1097
0	1097	1097	1097	1097	1097	1097

Table K.1-14 shows capacity (MW), energy (GWh), energy lost in non-power releases (bypasses and spills) (GWh), and the NPV of all cost components for the 3 alternatives. The capacity shown in Tables K.1-14 and K.1-15 is at the 90% exceedance level; it shows that there is a very small difference (less than 0.8%) in the capacity and energy, in terms of MW and GWh, respectively, between the high AS and current AS scenarios for Alternatives A and D. There is no difference between the ancillary service scenarios for Alternative F. The difference in total NPV between the two scenarios for Alternatives A and D is \$2.86 million (0.08%) for Alternative A and \$4.71 million (0.14%) for D. There is no difference between the ancillary services scenarios for Alternative F.

Table K.1-15 compares the differences in firm capacity and energy in Alternatives D and F relative to Alternative A for both ancillary services scenarios. Again, the ancillary services scenario has only a very minor effect on the relative difference between each alternative and Alternative A.

These results show very little difference among ancillary services scenarios. The primary reason for this is that under all three alternatives operating criteria do not allow the Glen Canyon Dam Powerplant to utilize a significant amount of its capacity under most hydropower conditions; that is, the criteria almost always restrict the maximum Glen Canyon Dam output to a level that is significantly below the physical maximum capacity. This gap between maximum output and physical capacity can be used for ancillary services because all alternatives allow exception criteria and restrict hourly average flow rates, but not instantaneous rates. For example, under Alternatives A and D, daily change specifications typically limit maximum output levels far (more than 160 MW) below the maximum physical output of the plant. Therefore, ancillary services requirements do not usually bind operations. Note that the power

TABLE K.1-14 Comparison of Capacity and Energy Values at Glen Canyon Dam by Alternative and Ancillary Services Scenarios at the 90% Exceedance Level

Ancillary Service Scenario and Alternative	Capacity (MW)	Energy (GWh)	Energy Lost in Non-Power Releases (GWh)	NPV (\$millions)			Increase in Value Compared to Current AS
				Capacity	Energy	Total	
High AS Scenario							
Alternative A	548.9	88,754	1,824	422.77	3,054.06	3,476.82	Not Applicable
Alternative D	480.7	88,794	1,552	370.29	3,043.68	3,413.97	Not Applicable
Alternative F	212.3	88,081	1,918	163.53	2,916.39	3,079.92	Not Applicable
Current AS Scenario							
Alternative A	550.3	88,757	1,821	423.87	3,055.81	3,479.68	2.86
Alternative D	484.2	88,798	1,548	372.95	3,045.73	3,418.68	4.71
Alternative F	212.3	88,081	1,918	163.53	2,916.39	3,079.92	0.00

TABLE K.1-15 Difference Relative to Alternative A (value of Alternative A minus value of alternative)

Strategy	Capacity (MW)	Energy (GWh)	Non-Power Releases (GWh)	NPV (\$millions)		
				Capacity	Energy	Total
High AS Scenario						
Alternative D	68.13	-40.77	272.04	52.48	10.38	62.85
Alternative F	336.55	672.59	-93.50	259.23	137.67	396.90
Current AS Scenario						
Alternative D	66.10	-41.04	272.31	50.92	10.09	61.00
Alternative F	337.98	676.04	-96.95	260.33	139.42	399.76
Difference (Current-High)						
Alternative D	-2.02	-0.27	0.27	-1.56	-0.22	-1.78
Alternative F	1.43	3.45	-3.45	1.10	1.76	2.86

systems analysis did not evaluate the value of any unused capacity (i.e., the differences between the physical powerplant capacity minus the sum of generation plus ancillary services).

Based on insights gained from this study, it was concluded that ancillary services assumptions under a range of plausible futures have little to no effect on firm capacity and energy value for the LTEMP alternatives. Therefore, it was not necessary to conduct more detailed analyses on ancillary services.

K.1.10.9 Sensitivity of Results to Customer Capacity Expansion Assumptions

There are uncertainties regarding the actual capacity replacement that may come to fruition. For example, utilities usually consider other factors beyond costs when determining new thermal power plant additions. Also capacity expansion models such as AURORA make many simplifying assumptions regarding plant siting, system unit commitments, and power plant operations in order to make the expansion problem it solves tractable. Models are therefore only an approximation of reality and decision makers typically factor modeling limitations into the capacity expansion planning process.

Because of modeling limitations and the complexity of determining optimal build schedules, a sensitivity analysis was performed. The sensitivity analysis considered a separate case in which capacity expansion changes relative to Alternative A would be made using a mix of 60% NGCC and 40% CT in terms of MW of capacity. This mix is approximately equal to the current average thermal capacity expansion mix contained in the IRPs in the joint system and utilities in surrounding area. It was derived from a review of IRPs that were available online in May 2016. Attachment K.11 provides a summary of capacity additions through the end of CY2034.

The capacity expansion analysis performed with the AURORA model and described in Section K.1.10.2 shows that in the future, the joint system would build a combination of advanced CT and NGCC units along with renewable technologies under all alternatives. However, as shown in Table K.1-8, only the timing and number of CT unit additions differ among alternatives; that is, the NGCC build schedule remained static. Therefore, the lost capacity at Glen Canyon Dam due to more restrictive operating criteria under Alternatives C, D, E, F, and G would be exclusively replaced by CT capacity additions. Alternative B shows a delay in the construction of one CT unit.

In terms of \$/MW, both capital and fixed O&M costs are higher for the advanced NGCC technology as compared to the advanced CT technology (see Table K.1-1). Therefore, assuming a mix of replacement technologies impacts the estimated cost of alternatives. Similar to the sensitivity analysis that was performed for ancillary service assumptions (Section K.1.10.8), the GTMax-Lite model was used to estimate the range of LTEMP alternative capital and fixed O&M costs. This modeling method was selected because it runs more rapidly with far fewer resources than AURORA, yet it produces similar results in terms of both differences in total NPV among

alternatives and alternative ranking.⁵ To roughly estimate costs under the mixed capacity replacement assumption, GTMax-lite was run for the two cases under consideration—replacement capacity provided by new CT plants only or a mix of 60% NGCC/40% CT plants. The difference between the two cases represents the higher cost of replacing lost Glen Canyon Dam capacity via a mix of thermal technologies instead of adjusting only CT capacity additions.

Table K.1-16 shows that using a mix of CT and NGCC replacement technologies at the 90% exceedance level would increase costs for all alternatives except for Alternative B which has a higher benefit (shown as a negative cost) of approximately \$11.0 million. The costs for all other alternatives increase from \$17.1 million under Alternative D (Preferred Alternative) to \$93.4 million under Alternative F. Note that assuming a mix of capacity replacements does not change alternative rankings.

The estimated incremental cost shown in Table K.1-13 uses a simplified method and should therefore be viewed as an approximation of changes in costs between the CT only replacement case and the mixed technology replacement case. It does not capture the impact of capacity additions on the system dispatch and therefore changes in production costs. Because NGCC technologies are more efficient than CTs, the higher capital and fixed O&M costs for

TABLE K.1-16 Alternative Cost Increase Estimates for Mixed NGCC/CT Technology Capacity Replacement Relative to CT Only Replacement as Estimated Using GTMax-Lite

Alternative	Relative Cost of CT Only Replacement (million 2015\$) ^a	Relative Cost of Mixed NGCC/CT Replacement (million 2015\$) ^b	NGCC/CT Cost Increase (million 2015\$)	Rank
A	0.0	0.0	0.0	2
B	-46.2	-57.2	-11.0	1
C	133.8	175.9	42.0	5
D (Preferred)	81.3	98.4	17.1	3
E	93.2	125.0	31.8	4
F	395.0	488.4	93.4	7
G	260.7	317.1	56.4	6

^a Costs are relative to those of Alternative A. Assumes natural gas combustion turbines would be used to replace all capacity from Glen Canyon.

^b Costs are relative to those of Alternative A. Assumes a 60% natural gas combined cycle/40% natural gas combustion turbine mix would replace lost capacity.

⁵ The GTMax-lite expansion approach produced rankings that are identical to the AURORA model except that Alternative D (Preferred Alternative) has a slighter higher power systems ranking (i.e., lower cost) using GTMax-lite, and Alternative E has a slightly lower one.

NGCCs are partially offset by lower system production costs. Compared to an advanced CT, the advanced NGCC technology would be operated more frequently, generates more energy, and displaces more generation from expensive energy producing resources. Also, the GTMax-Lite methodology immediately replaces lost capacity compared to the AURORA method that, under most alternatives, replaces capacity 2 to 3 years after the start of the study period. As a result, the GTMax-Lite method tends to overestimate the incremental cost associated with replacing lost capacity with a mix of technologies.

K.1.10.10 Summary of Economic Ranking

Power systems analysis results show that there are three distinct groups of outcomes. Alternatives A and B are clearly the most favorable for hydropower economics, while Alternatives F and G are the least favorable. Alternatives C, D, and E rank between these two extremes. As shown in Table K.1-17, the ranking of alternatives is very consistent regardless of changes in assumptions that were made in the sensitivity runs. Alternatives D and E switched ranking under only two sets of assumptions. This order switch between the third and fourth rank is mainly attributed to the lumpy nature of capacity expansion paths. Among the sensitivity analyses conducted the discount rate assumption had the largest impact on absolute economic costs, but in terms of percent changes in total system costs that were tracked, it had negligible effects.

It is noteworthy that as the exceedance level increased from 50% to 99% the cost of the alternatives decreased, but the rankings did not change except for the aforementioned switching of Alternatives D and E. Although cost differences among alternatives decrease, higher exceedance levels increase overall SLCA/IP market system costs for all alternatives; however, system reliability improves with higher exceedance levels since there is more capacity built in the system.

Last, the rankings of alternatives are also in general agreement with those found in the structured decision analysis (SDA). The SDA report shows that the value of GCD hydropower production is the highest under Alternative B followed closely by Alternative A. Alternatives F and G have the least value, respectively, and the remaining alternatives are between these bookends.

K.2 WAPA'S SLCA/IP FIRM ELECTRIC SERVICE RATE IMPACTS⁶

The SLCA/IP firm electric service (FES) rate is the price paid per unit of product sold by WAPA's CRSP Management Center to its SLCA/IP FES customers. Two SLCA/IP commodities are sold, namely firm capacity and firm energy. Each has a separate price. This section

⁶ New terms and acronyms used in this section are defined at first use, and definitions of those terms are provided at the end of the section.

TABLE K.1-17 Summary of Economic Rankings for Baseline and All Sensitivity Scenarios

		Assumptions			Alternative Rank (lowest to highest total cost)						
Exceedance Level (%)	Excess Capacity Sales	Hydrology	Base Expansion Path	Discount Rate (%)	A	B	C	D	E	F	G
90	Yes	Representative Trace	CT & NGCC	3.375	2	1	5	3	4	7	6
50	No	Representative Trace	CT & NGCC	3.375	2	1	5	3	4	7	6
50	Yes	Representative Trace	CT & NGCC	3.375	2	1	5	3	4	7	6
99	No	Representative Trace	CT & NGCC	3.375	2	1	5	3	4	7	6
99	Yes	Representative Trace	CT & NGCC	3.375	2	1	5	3	4	7	6
90	No	Representative Trace	CT & NGCC	1.4	2	1	5	4	3	7	6
90	Yes	Representative Trace	CT & NGCC	1.4	2	1	5	3	4	7	6
90	No	Average Hydropower	CT & NGCC	3.375	2	1	5	4	3	7	6
90	Yes	Average Hydropower	CT & NGCC	3.375	2	1	5	3	4	7	6
90	No	Representative Trace	CT	3.375	2	1	5	4	3	7	6
90	Yes	Representative Trace	CT	3.375	2	1	5	3	4	7	6
90	No	Representative Trace	NGCC	3.375	2	1	4	5	3	7	6
90	Yes	Representative Trace	NGCC	3.375	2	1	5	3	4	7	6

documents the methods and calculations used to determine the impact of the LTEMP EIS alternatives on the SLCA/IP capacity and energy rates.⁷ The analysis was performed by WAPA CRSP Management Center staff with assistance from Argonne.

The analysis in this section begins with the calculations of economic impact performed and described in Section K.1. Section K.1 describes the economic impact on electrical power production, which is the impact—measured in dollars—on the economy. It includes the system cost of changing the timing and routing of water releases at Glen Canyon Dam. It also includes the expense of constructing (or savings resulting from forgoing construction of) additional electrical generators because of changes in firm SLCA/IP hydropower capacity.

Several calculations were performed to determine the impact of the LTEMP EIS alternatives on the SLCA/IP rates. Three rates were calculated for each of the seven alternatives: (1) a firm energy rate, (2) a firm capacity rate, and (3) a composite rate. This section describes the methods and assumptions used to determine these financial rate impacts.

⁷ The term “rate” will be used rather than “price.” This is the standard convention for wholesale electrical commodities. Rate is the price charged for an energy unit, whether capacity or energy. Rate is often used to describe wholesale prices because it is the price of wholesale units and not necessarily the units used for retail sales.

This analysis is a financial study. It uses the economic estimates described in Section K.1 as input values to conduct a financial analysis. Because existing FES contracts are firm obligations to deliver electrical power, the economic impact described in Section K.1 will affect the SLCA/IP rates through the period specified under contract. This analysis describes how the economic impacts are “stepped down,” through changes in the SLCA/IP rate, to utilities that purchase Glen Canyon Dam electrical power. The analysis assumes that WAPA’s contractual obligation to deliver power to its current FES customers remains unchanged from current levels through the end of the marketing period.

K.2.1 Relationship between the Economic Impacts of LTEMP Alternatives and Impacts on SLCA/IP FES Rates

It is important that this analysis of the impacts of LTEMP alternatives on SLCA/IP FES rates be compatible with the economic analysis of the impacts of alternatives on Glen Canyon Dam power production and value (as presented in Section K.1). Economic impacts are changes in the value of power systems resources. The power system economic analysis described in Section K.1 determines the economic loss (or gain) of changing the operation of Glen Canyon Dam. The economic information resulting from the analysis presented in Section K.1 is used as input values for the SLCA/IP rate analysis. This financial analysis is a “step down” from the economic analysis described in Section K.1. It demonstrates how the economic impact of alternative-specific differences in Glen Canyon Dam electric power generation affects the per-unit cost of electricity to FES customers through changes in the SLCA/IP rate.

K.2.2 Temporal Scope of the Analysis and Input Data

The SLCA/IP rate analysis is a 20-year analysis encompassing the CY 2015 through CY 2034 time period. It is assumed that the SLCA/IP rate associated with the alternative does not change throughout the power repayment study (PRS) repayment period, which extends beyond CY 2034.

As explained in Section K.2.3, the SLCA/IP rate is required to be sufficient to repay authorized irrigation projects, which have construction and repayment periods that extend for another 50 years. Therefore, although the analysis includes LTEMP EIS alternative-specific costs that differ by alternative over the 20-year time frame of the LTEMP EIS, the rate study continues with other operations and repayment expenses for many years thereafter.

Rate changes as a result of alternative operating criteria for Glen Canyon Dam impact all FES customers.⁸

⁸ “FES customers” and “SLCA/IP LTF customers” are used synonymously.

Data described in Section K.1 are key input data for the SLCA/IP rate impact analysis. These data include:

- The hourly SLCA/IP electrical production under each alternative for the representative 20-year trace⁹ that is simulated by both the GTMax-Lite model and the Small SLCA/IP Powerplant Spreadsheet that is produced for the economic impact analysis;
- The hourly FES customer requests for energy and capacity under the terms of their contractual agreements with WAPA; and
- The estimated capacity cost for each alternative that is set equal to the AURORA model's capacity expansion plan multiplied by the technology-specific levelized cost of capital plus annual fixed O&M expenses.

K.2.3 SLCA/IP Rate Setting

A typical regulated electrical utility sets a rate based on a “test year” using a formula that recoups its estimated operations expenses and allows a fair return on its capital investment. For electrical utilities regulated by State Commissions, their rates are reviewed and approved by the Commission. This approach is quite different from the rate setting process required of WAPA.

WAPA sets SLCA/IP rates in order to repay all costs associated with power generation. WAPA must establish power rates sufficient to recover operating, maintenance, and purchase power expenses. In addition, WAPA sets rates in order to repay the federal government's investment in building these generation and transmission facilities within 50 years. Outside of the 50-year repayment period, this is similar to a regulated electrical utility. The biggest difference lies in the requirement that WAPA's rates must also be set to cover certain non-power costs Congress has assigned to power users to repay. These are authorized irrigation costs in excess of water users' ability to repay. For the CRSP, authorized irrigation projects have repayment periods that extend for another 50 years. WAPA must demonstrate to the Federal Electrical Regulatory Commission (FERC) that its SLCA/IP rate is set appropriately to make required repayment of all authorized projects. Even though FERC approves a SLCA/IP rate that expires in 5 years, it is a rate that has been demonstrated to make all required repayment of all authorized projects.

Another approach to this analysis would be to add LTEMP EIS alternative-specific expenses for 5 years, estimate a SLCA/IP rate based on that, do it again for another 5 years, and again and again. The LTEMP EIS alternative-specific impact would then show four SLCA/IP rates that cover the 20-year temporal scope of the EIS. We could then do a net present value

⁹ The basis for selection of a representative trace is described in Attachment K-3 of Appendix K.

calculation to 2015. This approach would have made the SLCA/IP rate analysis more comparable to the approach used in Sections K.1 and K.3. This approach would be a straight-forward calculation similar to that of a regulated utility that uses a “test year” to set rates. The expenses related to a “test year” would be available for each of the 20 years included in the LTEMP EIS time frame from the analysis in Section K.1. As explained in the previous paragraph, this approach would be significantly different from WAPA’s required method of setting SLCA/IP rates. In addition, the schedule for completion of this analysis did not allow for the added time required

K.2.4 Calculation of Net Electrical Energy Expense

Figure K.2-1 illustrates the method used to determine the yearly expense of electrical energy over the 20-year study period.

K.2.4.1 SLCA/IP Electrical Production

Data on the combined amounts of electrical energy produced by all of the SLCA/IP federal hydropower plants under each alternative were generated for the economic analysis described in Section K.1, and were used as input to the SLCA/IP wholesale rate analysis. The data are hourly over the 20-year study period. There is one set of these hourly data for each LTEMP EIS alternative.

K.2.4.2 Sustainable Hydropower (SHP) and Available Hydropower (AHP) Capacity and Energy

WAPA’s Energy Management and Marketing Office (EMMO) schedules electrical capacity and energy to serve FES customer energy requests. Each FES customer requests energy according to the terms and conditions of CRSP Management Center FES contracts. An FES customer can schedule an amount of energy to be delivered up to a specified capacity amount. This is known as the SHP capacity.¹⁰ SLCA/IP FES customers also have a monthly amount of electrical energy that WAPA is obligated to deliver. A customer schedules the monthly allocation of electrical energy within the capacity limit mentioned above. This is known as the SHP energy allocation. Both capacity and energy amounts differ by customer and by month. Table K.2-1 shows CRSP Management Center current total SHP contractual obligations and project use required deliveries by month.

¹⁰ Specific descriptions of the terms and conditions of FES contracts will not be discussed here. The abbreviated descriptions provided here are intended only to explain the process of calculating the impact of the LTEMP DEIS alternatives on the SLCA/IP wholesale rate.

TABLE K.2-1 SHP Contractual Obligations and Project Use Required Deliveries by Month

Month	Firm Electric Service			Project Use		Total	
	Capacity (kW)	Energy (kWh)	CROD ^a (kW)	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)
Jan.	863,726	463,462,717	1,403,777	7,639	4,200,824	871,365	467,663,541
Feb.	851,326	409,824,542	1,403,777	7,639	4,200,824	858,965	414,025,365
Mar.	765,761	422,665,276	1,403,777	42,539	21,916,824	808,300	444,582,100
April	638,196	365,283,663	1,317,779	52,634	23,184,158	690,830	388,467,820
May	623,515	378,216,775	1,317,779	52,634	23,184,158	676,149	401,400,933
June	646,035	397,635,769	1,317,779	52,634	23,184,158	698,669	420,819,927
July	740,916	434,536,678	1,317,779	52,634	23,184,158	793,550	457,720,836
Aug.	714,683	437,867,014	1,317,779	52,634	23,184,158	767,317	461,051,172
Sept.	618,576	380,082,095	1,317,779	52,634	23,184,158	671,210	403,266,253
Oct.	739,646	398,608,181	1,403,777	42,539	21,916,824	782,185	420,525,004
Nov.	775,589	408,041,232	1,403,777	7,639	4,200,824	783,228	412,242,055
Dec.	869,160	455,561,848	1,403,777	7,639	4,200,824	876,799	459,762,672

^a CROD = Contract Rate of Delivery

Because SLCA/IP FES customers are allowed to schedule SHP energy according to their individual needs, the hourly shaping of energy differs from day to day and from customer to customer. Therefore, it is necessary to estimate the aggregate daily shape of electrical energy schedules submitted to the EMMO by all FES customers. WAPA used average weekday, Saturday, and Sunday shapes for each month of WY 2014 to represent these schedules. When a holiday occurs, the load shape for Sunday is used. These SHP loads are provided in Table K.2-2.¹¹ In addition, the EMMO must serve project use loads that vary over time. WAPA used WY 2014 data, rather than averaging several years of loads or projecting different load shapes for future years, because the SHP daily shape does not differ substantially from year to year.

¹¹ In some situations, it is difficult to separate customer SHP and project use loads that are submitted to Western's EMMO. For this analysis, it is assumed that the loads in Table K.2-2 are only SHP loads even though small amounts of project use loads are included. This assumption will have minimal impact on the results, since the same hourly loads are used for all alternatives.

TABLE K.2-2 SHP Hourly Load Shapes by Month and Type of Day

Month	Day of the Week	Hour of Day																							
		1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
Oct.	Wkday	275	271	267	279	320	454	594	596	673	695	714	707	717	713	720	727	734	742	748	750	729	656	451	366
	Sat.	294	288	282	280	297	417	539	538	625	653	676	671	680	672	676	686	691	701	707	711	701	640	427	352
	Sun.	272	290	275	269	287	384	467	459	494	518	562	581	588	590	599	620	632	643	652	658	627	558	382	340
Nov.	Wkday	354	295	287	291	363	460	643	676	676	697	689	677	665	657	656	680	721	773	780	776	770	734	507	441
	Sat.	351	299	290	294	363	449	580	617	639	677	672	666	654	647	644	665	702	758	767	762	753	707	504	433
	Sun.	314	270	268	267	331	391	490	518	525	525	525	510	506	509	543	591	673	702	699	696	648	426	399	
Dec.	Wkday	346	325	319	322	391	525	698	794	785	764	760	740	721	676	665	676	719	836	853	849	833	791	612	506
	Sat.	356	342	332	334	386	496	654	751	747	735	738	722	704	662	643	652	707	823	839	835	820	776	601	489
	Sun.	324	307	309	297	347	448	568	602	586	565	570	551	537	511	509	521	586	698	765	764	752	712	490	453
Jan.	Wkday	375	358	351	379	445	586	771	810	810	784	749	735	714	698	692	689	724	845	854	850	833	793	565	441
	Sat.	376	381	375	398	435	516	691	710	725	714	691	680	662	648	639	641	677	822	835	831	788	750	559	430
	Sun.	356	343	343	340	400	449	548	562	582	559	536	523	514	504	501	511	567	688	723	721	683	629	457	394
Feb.	Wkday	360	346	340	343	374	481	769	793	805	806	740	711	691	677	624	633	664	838	861	860	843	807	608	464
	Sat.	363	361	353	352	356	425	684	725	729	736	676	652	636	621	576	587	616	780	813	815	777	745	624	446
	Sun.	341	338	344	333	334	379	557	558	569	576	520	504	490	473	470	489	531	693	777	780	739	637	532	360
Mar.	Wkday	348	334	334	359	465	585	671	704	726	723	711	703	698	689	685	689	698	744	765	770	733	641	523	411
	Sat.	367	354	351	368	450	531	609	625	682	685	677	670	667	653	645	646	664	715	747	746	719	643	513	425
	Sun.	347	342	346	353	413	479	535	541	558	552	536	537	539	527	525	536	562	622	658	660	661	586	462	409
Apr.	Wkday	307	299	296	342	396	501	548	589	601	604	632	640	646	633	632	629	630	636	649	653	633	600	510	415
	Sat.	318	309	304	328	363	471	529	562	581	587	615	618	623	609	611	613	613	619	635	641	618	585	497	409
	Sun.	301	299	293	305	328	406	428	460	479	486	490	504	517	532	541	548	554	560	573	587	570	538	446	386
May	Wkday	379	339	335	345	412	513	552	593	609	630	632	641	640	637	633	642	644	657	647	645	641	615	528	452
	Sat.	392	358	348	354	397	488	510	523	560	595	600	607	607	607	605	619	622	639	636	638	631	602	524	467
	Sun.	373	333	323	326	368	449	463	469	480	506	557	580	582	584	584	589	593	613	609	612	604	573	509	413
Jun.	Wkday	475	435	398	422	438	519	605	634	672	681	681	685	691	691	691	696	695	692	682	681	673	666	632	511
	Sat.	474	442	420	404	401	473	549	606	640	658	667	675	679	680	681	687	686	681	675	675	662	648	626	507
	Sun.	410	395	410	403	375	396	446	457	471	501	521	571	576	592	599	612	608	604	599	607	594	572	548	491
Jul.	Wkday	478	428	425	421	443	553	582	617	649	675	685	711	747	751	752	756	755	771	762	761	736	693	609	554
	Sat.	489	443	428	423	441	520	562	576	605	653	669	700	738	739	741	745	743	758	754	748	723	678	598	532
	Sun.	449	418	442	438	442	509	526	526	542	610	624	635	683	702	707	710	708	721	714	695	671	629	577	528
Aug.	Wkday	499	433	413	412	438	531	644	678	667	667	679	696	727	763	764	768	766	761	757	745	736	700	663	571
	Sat.	490	446	431	414	429	510	594	638	631	640	662	680	720	760	762	767	764	759	753	740	728	691	656	572
	Sun.	472	402	425	421	402	424	484	491	511	552	616	633	677	683	683	686	687	688	683	674	665	609	589	561
Sep.	Wkday	428	394	391	399	440	500	549	576	608	616	621	623	637	663	666	668	667	663	661	657	652	646	577	512
	Sat.	446	392	382	378	408	467	502	548	594	605	612	613	628	652	653	656	654	653	653	648	639	629	567	501
	Sun.	400	383	375	375	395	436	471	476	492	521	564	605	620	638	640	643	653	650	649	645	641	629	546	478

When seasonal SLCA/IP federal hydropower resources are significantly greater than combined SHP commitments and project use loads plus the energy required to cover delivery losses,¹² the CRSP Management Center offers its FES customers capacity and/or energy above the SHP levels. These additional offers plus SHP are referred to as available hydropower (AHP). The methodology applied for the wholesale rate analysis offers a seasonal AHP, which is distributed monthly. The seasons that met the AHP offer criteria were largely a function of hydrological condition rather than of the alternative. Each of the seven alternatives had the same number of seasons that met the AHP criteria. The alternatives differed, however, in the amount of AHP that was offered.

Based on the sequence of hydrological conditions contained in the representative trace, AHP offers were calculated for any season that met the 20% excess AHP offer criterion; that is, an AHP offer is made only if hydropower resources in a season are at least 20% greater than the seasonal SHP level.

WAPA is required under its FES contracts to provide AHP, by season, when available. However, the contracts do not specify how much energy above SHP is required to make a seasonal AHP offer. There are no set criteria for offering AHP. It is the current practice of the CRSP Management Center to review and release information for the upcoming season and decide whether to offer AHP. CRSP Management Center power marketing managers confer with EMMO managers and consider anticipated release information, market prices, the amount of anticipated energy and capacity above SHP, and other factors in making an AHP offer for the upcoming season.

For the purposes of completing this analysis, CRSP Management Center managers and staff that are involved in the seasonal determinations were surveyed to establish a criterion based on past practices. The 20% trigger represents a reasonable amount of additional available hydropower that could be efficiently and equitably offered to WAPA's more than 135 customers. Offers to FES customers are made prior to the beginning of the season.¹³ If the predicted energy production above AHP levels did not occur, and an AHP offer was made, the resulting short position must be resolved by energy market purchases. When available seasonal hydropower is less than 20% it is assumed that the excess energy would be offered to the market. The 20% trigger used for this analysis is for modeling purposes only and does not represent an established policy or practice.

The amount of AHP offered in a particular month was the smaller of the percent energy above the SHP energy and the percent capacity above the SHP capacity. Once this was determined, the SLCA/IP hourly energy delivery obligation (i.e., SHP load) was scaled by the

¹² Energy delivery losses were conservatively set equal to 8.5% of the total SLCA/IP hourly federal hydropower generation when computing FES rates and seasonal customer offers above AHP levels. This level is consistent with historical levels used for ratemaking, but somewhat higher than the 5% loss rate used for power systems economic analyses presented in Section K.1.

¹³ SLCA/IP power is marketing in two seasons: the "summer" season is April through September, the "winter" season is October through March.

appropriate percentage for each hour in the months that offer seasonal AHP. Project use loads were not adjusted.

AHP is sold to SLCA/IP FES customers at the FES energy rate. Since the FES energy rate is typically lower than the hourly spot market price, the addition of AHP tends to reduce CRSP Management Center revenues when compared to selling this excess (or long) energy to the spot market. There is typically a relatively minor (if any) financial impact on WAPA from offering AHP capacity. All SLCA/IP FES customers are billed monthly for the CROD capacity allocation, regardless of the particular SHP or AHP capacity allocation for the month. However, there is a financial impact on WAPA when SHP capacity offers exceed the amount available from SLCA/IP federal hydropower resources (due to, for example, the aforementioned forecast error), because WAPA must purchase capacity to fill the deficit.

Seasonal SLCA/IP federal hydropower generation is almost always either above or below the SHP obligation. The logic that is used to model this energy imbalance is shown in Figure K.2-1. If generation is below the SHP obligation, it is assumed that WAPA will be a net seasonal power purchaser and cover the short energy position via the spot market at spot market prices.¹⁴ If generation is above the SHP obligation, the excess seasonal energy is sold to the spot market at spot market prices, unless it is a season in which the AHP offer criteria are met, in which case the seasonal excess energy is sold to SLCA/IP customers at the FES energy rate.

Although WAPA may be short during a specific season, on an hourly basis it may produce SLCA/IP federal hydropower in excess of FES SHP loads (i.e., FES customer energy requests). For example, during the middle of the night, under a steady flow alternative, loads may be less than generation. Likewise, there are some hours when hydropower resources produce less energy than loads when there is excess seasonal energy. Therefore, the wholesale rate analysis uses a methodology in which long and short positions along with associated costs and revenues are computed hourly under each alternative. Spot prices are the same scaled AURORA Western Interconnection LMPs at the Palo Verde hub that are used for power system economic analyses.

K.2.5 Calculation of Capacity Expenses and Total Net Costs

In addition to the annual net expense related to electrical energy for each alternative, WAPA will have a cost related to electrical capacity purchases or, in the case of Alternative B,

¹⁴ Western's CRSP Management Center has several decades of experience with the vicissitudes of hydrological conditions in the Colorado River basin. There have been years in which electrical production from the SLCA/IP was inadequate to meet SHP commitment levels. Western once hedged its risk of dealing with this condition by making a long-term capacity and energy purchase. Outside of one instance, Western's firming purchases have only been on the day-ahead market or for a season when conditions were forecasted to require this.

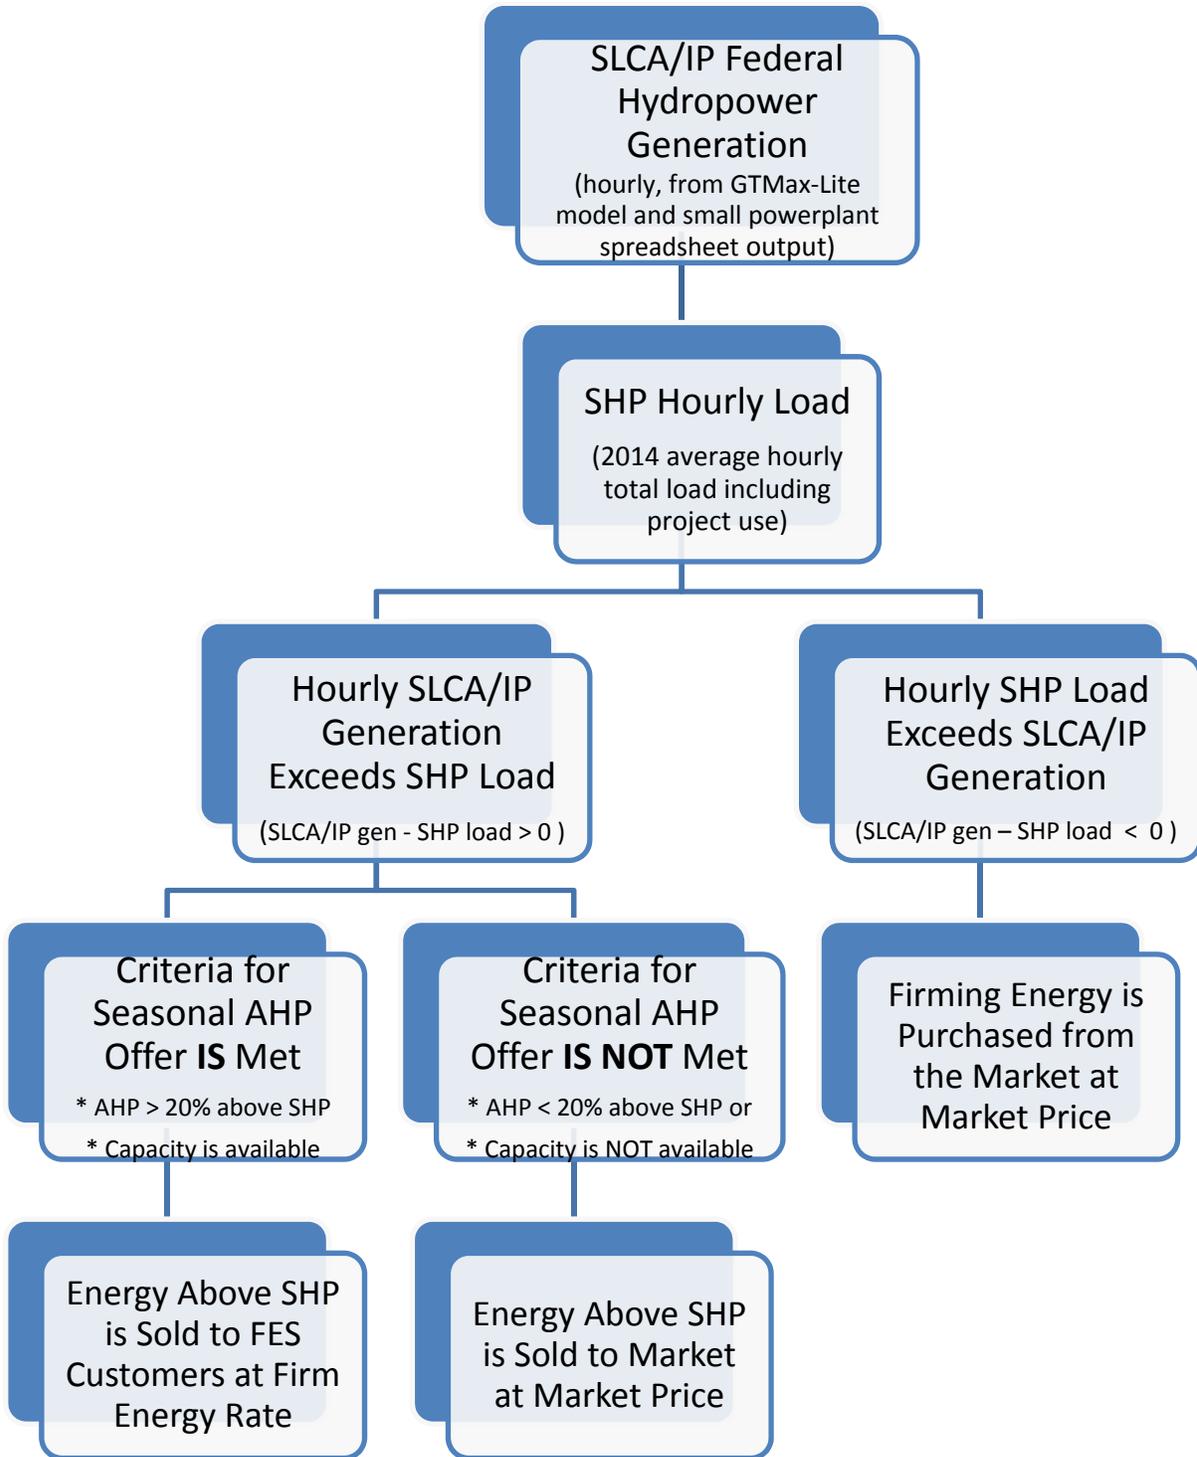


FIGURE K.2-1 Determination of Energy Hourly Expense or Revenue

capacity cost avoided.¹⁵ As explained in Section K.2.1, an important requirement of this SLCA/IP wholesale rate analysis is to maintain compatibility with the economic analysis presented in Section K.1. The AURORA capacity expansion module applied in the analysis indicated that additional capacity facilities (construction of new generation) would be required over the 20-year LTEMP period. Table K.2-3 contains the same costs that were used in the power systems economic analysis described in Section K.1. It shows the capacity expense required over the 20-year period for each alternative.

The net energy expense for each alternative is computed as described above and illustrated in Figure K.2-2. Added to this figure is the capacity cost, by year, for each alternative. The sum of these two numbers is the total WAPA expense that is incorporated into the computation of wholesale rates (Figure K.2-2).

TABLE K.2-3 Total Levelized Capital and Fixed O&M Cost (million 2015\$) for System Capacity Expansion by Alternative and Year

Year	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
2015	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2016	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2017	0.0	0.0	0.0	0.0	0.0	12.2	0.0
2018	12.2	12.2	24.5	12.2	12.2	36.7	24.5
2019	46.7	46.7	58.9	46.7	46.7	71.2	58.9
2020	81.1	81.1	93.4	81.1	81.1	105.6	93.4
2021	81.1	81.1	93.4	93.4	93.4	105.6	93.4
2022	115.6	115.6	127.8	127.8	127.8	140.1	127.8
2023	150.0	150.0	162.2	162.2	162.2	174.5	162.2
2024	162.2	162.2	174.5	162.2	162.2	186.7	174.5
2025	174.5	174.5	186.7	174.5	174.5	199.0	186.7
2026	186.7	186.7	199.0	186.7	199.0	211.2	199.0
2027	199.0	199.0	211.2	211.2	211.2	223.5	211.2
2028	211.2	211.2	223.5	223.5	223.5	235.7	223.5
2029	235.7	223.5	235.7	235.7	235.7	248.0	248.0
2030	248.0	248.0	248.0	248.0	248.0	260.2	260.2
2031	260.2	260.2	260.2	260.2	260.2	272.5	272.5
2032	297.0	297.0	309.2	309.2	309.2	321.5	309.2
2033	309.2	309.2	321.5	321.5	321.5	333.7	321.5
2034	270.0	267.6	274.9	274.9	274.9	287.2	282.3

¹⁵ Capacity in this context is LTF capacity that Western must acquire as a result of a reduction in Glen Canyon Powerplant output that is caused by a change in operating criteria specified under an LTEMP alternative. It is distinctly different from the short-term capacity discussed in the previous section that is dependent on natural short-term hydrological variability.

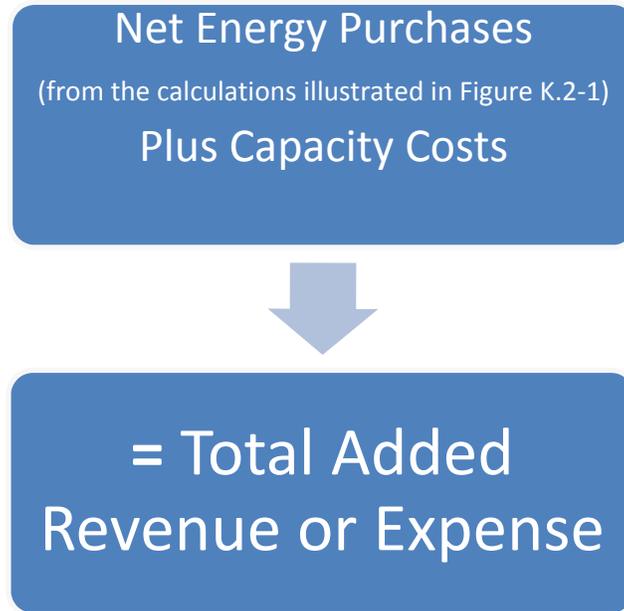


FIGURE K.2-2 Determination of Total Net Expense or Revenue by Year for Each Alternative

Table K.2-3 is a reproduction of a table from Section K.1. It is the estimated expense of capacity construction under each alternative. Alternative A includes capacity expenses, not because of a changed operation at Glen Canyon Dam or a change in SLCA/IP commitment levels by WAPA, but because of growth in electrical demand and the need for SLCA/IP customers to have to build new generating units to meet growing electrical demand. Based on the analysis described in Section K.1, existing generating units are sufficient to meet electrical demand until 2017.

The difference between the capacity expenses under Alternative A and the other alternatives is a function of how the LTEMP EIS alternatives affect the available capacity at Glen Canyon Dam. Differences in capacity expenses from Alternative A are a result of implementing the alternative. Table K.2-4 shows the differences in capacity expenses from Alternative A. The numbers in Table K.2-4 (differences from Alternative A) were used in this analysis. Notice that no capacity expense is required until 2018 under all alternatives except for Alternative F, which requires a capacity expense in 2017.

TABLE K.2-4 Total Levelized Capital and Fixed O&M Cost (in millions of 2015\$) for System Capacity Expansion by Alternative and Year Expressed as the Difference from Alternative A

Year	Total Levelized Capital and Fixed O&M Cost (millions 2015\$)—Difference from Alternative A					
	Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
2015	0	0	0	0	0	0
2016	0	0	0	0	0	0
2017	0	0	0	0	12.2	0
2018	0	12.3	0	0	24.5	12.3
2019	0	12.2	0	0	24.5	12.2
2020	0	12.3	0	0	24.5	12.3
2021	0	12.3	12.3	12.3	24.5	12.3
2022	0	12.2	12.2	12.2	24.5	12.2
2023	0	12.2	12.2	12.2	24.5	12.2
2024	0	12.3	0	0	24.5	12.3
2025	0	12.2	0	0	24.5	12.2
2026	0	12.3	0	12.3	24.5	12.3
2027	0	12.2	12.2	12.2	24.5	12.2
2028	0	12.3	12.3	12.3	24.5	12.3
2029	-12.2	0	0	0	12.3	12.3
2030	0	0	0	0	12.2	12.2
2031	0	0	0	0	12.3	12.3
2032	0	12.2	12.2	12.2	24.5	12.2
2033	0	12.3	12.3	12.3	24.5	12.3
2034	-2.4	4.9	4.9	4.9	17.2	12.3

K.2.6 WAPA Replacement Resources

Using AURORA capacity expansion path modeling, the power systems analysis identified lost Glen Canyon Dam Powerplant capacity that would result from alternative-specific differences in operations and changed system capacity expansion paths. However, WAPA’s FES power obligations are unaltered over the time period of this analysis, at least through FY 2024. Therefore, it is assumed for this analysis that WAPA purchases this capacity and incurs capacity firming costs.

When capacity in the region is in short supply, WAPA’s firming purchases either include a capacity premium or WAPA makes a capacity purchase. For this analysis, it is assumed that WAPA purchases the electrical capacity projected by the AURORA capacity expansion module. The capacity expenses included in this analysis are the differences from those for Alternative A.¹⁶

¹⁶ See Section K.1 for details on the generation types, years in which construction occurs, and pricing assumptions.

WAPA's purchase of electrical power to meet contractual obligations is a common occurrence. It is quite typical for WAPA to make these purchases during drier years with low release targets. Even in average years, WAPA purchases firming energy on some days or for some hours. Typically, WAPA purchases electrical energy on an hourly basis for the days or months ahead. However, WAPA's CRSP Management Center has also purchased firming energy for a future season or year. WAPA has also once contracted for electrical power and energy over a multi-year period.

It is also assumed that, when electrical capacity in the region is in short supply, utilities that buy electricity at a price that covers the average cost, including the cost of capital and fixed O&M. For this analysis, it is assumed that WAPA purchases the capacity needed to make up for losses in capacity that results from alternative-specific changes in Glen Canyon Dam operations (i.e., the difference between FES capacity and the alternative-specific SLCA/IP federal hydropower firm capacity that is based on a 90% exceedance level).

Electrical capacity additions by WAPA's FES customers are required under Alternative A over the 20-year analysis period, with existing SLCA/IP contractual obligations in place. These additions are required because of growth in electrical demand. However, if there is a change in the operation of Glen Canyon Dam that reduces the powerplant's firm capacity—as would occur under most of the LTEMP alternatives—additions to electrical capacity would be required.¹⁷ The assumption used for this analysis is that WAPA purchases the capacity identified as the amount lost under each alternative, costing the amounts specified in Table K.2-3. The differences in total costs include levelized capital and fixed O&M between each alternative and Alternative A.

To be clear, Table K.2-3 is a duplication of the power economic analysis (Section K.1). WAPA would not incur the capacity expansion costs for Alternative A. Added capacity costs needed for load growth in Alternative A are not included. Only the differences in capacity costs between Alternative A and the other alternatives are included in the analysis.

K.2.7 Post-2024 Marketing Period

WAPA markets SLCA/IP electrical power under firm, long-term contracts. Under these contracts, WAPA is required to deliver this electrical power to federal points of delivery regardless of hydrological conditions or changes in the operational criteria of the SLCA/IP hydropower plants. The current FES marketing contracts expire on September 30, 2024. For the period following 2024, WAPA is currently engaged in developing a marketing plan. This requires a formal public process in compliance with applicable federal law.

¹⁷ This is not the case for Alternative B. Under Alternative B, Glen Canyon Dam marketable capacity is increased over that of Alternative A. Fewer capacity additions are required.

For the purpose of completing this analysis, certain assumptions had to be made. First, it was assumed that WAPA will continue with its current SLCA/IP obligations until the current marketing period ends and the existing contracts expire.¹⁸ This requires that WAPA deliver the same amount of electrical power and energy to SLCA/IP customers until the end of FY 2024, regardless of the alternative analyzed. Second, recognizing that there is a period of uncertainty between 2025 and 2034, net firming expenses for the post-2024 time period were analyzed under two sets of assumptions. These are as follows:

- A continuation of existing SLCA/IP FES contract commitments between FY 2025 and FY 2034 (no change); and
- A reduction in SLCA/IP FES contract commitments so that net firming expenses are equal to \$0 between FY 2025 and FY 2034. This means, for the numbers included in the SLCA/IP power repayment study, zero dollars of firming expense and zero additional dollars of revenue from market sale or from AHP sales (resource available).

These two assumptions constitute “bookends” regarding the outcomes possible in the development of the post-2024 marketing plan.¹⁹

These bookends are for modeling purposes only. They represent a very broad range of possible FES obligations of electrical power in the post-2024 marketing period.

Obligations of electrical capacity under the current marketing plan were based on a 90% exceedance level (i.e., the amount of hydropower capacity available 90% of the time). This level of marketable capacity is consistent with marketing plans established by other WAPA regional offices. In establishing power obligations for the post-2024 marketing period, WAPA will consider the capacity and energy available from the SLCA/IP units including those at the Glen Canyon Dam Powerplant and will establish, through a public process, an appropriate and reasonable amount of marketable capacity and energy to provide to FES customers. The range of SLCA/IP impacts described for these bookends will almost certainly encompass the actual rate impact, once the post-2024 marketing plan is completed.

¹⁸ There is a provision in the existing SLCA/IP contracts to modify the FES obligations upon a 5-year notice to SLCA/IP customers. However, considering the probable timing of new operating criteria for the Glen Canyon Dam following the completion of the LTEMP DEIS and the issuance of a ROD, a 5-year notice would not be significantly different than the end of the current marketing period.

¹⁹ Western could choose a post-2024 SLCA/IP FES obligation of electric power that exceeds its current obligation. However, prior to completion of the required public process it would be difficult to determine what the higher obligation would be that could be considered a reasonable bookend. Moreover, the time-frame available to complete this analysis required that the analysis be simplified. The assumption that the post-2024 SLCA/IP FES obligation continues existing commitments was easier to accomplish since much of the data related to this assumption was produced in Section K.1.

It should be noted that the establishment of these bookends is not an attempt to predict or to anticipate WAPA's choice prior to the conclusion of the required public process. This is an analysis, not a description of policy or attempt to predict WAPA's post-2024 marketing plan. This set of bookends is intended to reflect the range of reasonable possibilities. It is reasonable that WAPA would continue existing commitment levels to ensure continued customer access to the transmission associated with the energy. Moreover, it is also reasonable to believe that WAPA would establish post-2024 marketing plan commitments that exactly follow the power resource available at the SLCA/IP power system.

K.2.8 Power Repayment Studies to Determine Rate Impacts

WAPA sets rates as low as possible consistent with sound business principles to repay the federal government's investment in generation and transmission facilities in addition to specific non-power costs that power users are legislatively required by Congress to repay, such as irrigation costs that are beyond the irrigators' ability to repay. Sales of federal electric power and transmission repay all costs (including interest) associated with generating and delivering the power. WAPA prepares a PRS for each specific power project to ensure the rates are sufficient to recover expenses, including O&M, transmission, interest, replacement/upgraded equipment, purchased power, and wheeling. The PRS consists of two parts: historical data and future forecasted data. The historical data is a record of project repayment from the beginning of the project to the most recent year for which audited financial data are available. The first future year in the PRS is the first year for which forecasts, rather than actual data, are used. The last future year in the PRS must cover the final year allowed for repayment of historical investment.

Although the tool used to calculate the PRS has changed many times in the past, the principles underlying project repayment have not. These principles are summarized in U.S. Department of Energy (DOE) Order RA 6120.2 that governs project repayment and financial reporting for the DOE Power Marketing Administrations. In addition to Order RA 6120.2, WAPA's PRSs must meet the Federal Energy Regulatory Commission's rate filing requirements and procedures in 18 CFR Part 300.

K.2.8.1 PRS Expenses

All annual costs that are to be repaid by power customers must be included in the PRS. These costs include O&M, purchased power, transmission and other expenses, and interest expense. Interest expense is calculated by multiplying each investment's prior year unpaid balance by the appropriate interest rate.

Tables K.2-5 and K.2-6 show the total net purchase power costs for each year for each alternative. These tables show net purchase power expenses only. They do not include other O&M expenses, interest or principle payments. Positive numbers indicate net purchase power

TABLE K.2-5 Total Net Purchase Power Expenses (thousand 2015\$) by Year and Alternative for the Continuous Current Obligations Scenario^a

Year	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
2015	31,200	29,800	35,300	32,000	31,600	44,100	34,800
2016	96,900	95,200	93,500	98,300	96,800	104,200	98,800
2017	68,600	68,800	70,500	69,700	70,300	89,920	73,800
2018	49,500	74,100	68,320	54,200	51,500	87,930	72,020
2019	17,700	13,300	30,820	22,900	18,000	49,730	38,220
2020	34,700	33,000	48,220	37,100	35,700	69,930	53,020
2021	31,400	29,900	48,420	47,920	46,920	70,630	52,620
2022	4,350	3,650	13,020	14,750	15,400	26,780	16,570
2023	-82,550	-79,810	-63,220	-67,640	-67,550	-59,290	-66,150
2024	-36,580	-33,010	-6,710	-43,190	-41,360	-20,400	-36,130
2025	-70,810	-69,840	-55,780	-64,110	-70,420	-47,120	-59,360
2026	11,480	11,990	24,340	9,370	24,860	45,600	11,620
2027	29,400	29,900	46,320	53,320	45,120	68,830	62,320
2028	52,200	50,100	69,820	69,820	68,920	89,930	80,920
2029	75,000	60,680	76,800	77,000	76,100	99,620	97,220
2030	66,800	66,000	67,700	67,700	66,800	91,120	86,620
2031	89,100	89,900	95,300	94,600	93,400	115,420	120,720
2032	70,900	70,200	84,320	84,120	83,420	108,630	91,520
2033	67,800	66,500	84,820	84,920	84,020	107,730	91,720
2034	35,900	31,240	48,130	46,830	46,230	71,540	72,020

^a These numbers are compared to a condition in which generation is just equal to SHP obligations. Positive numbers indicate net firming purchases. Negative numbers indicate revenues collected above a condition in which generation is just equal to SHP obligations.

expenses. Negative numbers indicate that generation from SLCA/IP power plants is sufficient to meet SHP obligations and include additional sales of electricity to FES customers (AHP) or additional sales to the market. The numbers in these tables are net purchase power expenses compared to a condition in which electrical generation is just sufficient to meet SHP obligations without firming expenses and without sales of surplus electricity to FES customers or to the market. Note that the negative numbers occur in the years 2023-2025 and carry across all the alternatives in these years. These are the wettest years of the representative trace used for this analysis.

Table K.2-5 is purchase power for the scenario in which the existing SLCA/IP commitment levels for energy and capacity are maintained. Table K.2-5 is purchase power for the scenario in which WAPA reduces its commitment levels, post-2024, to just the amount of

TABLE K.2-6 Total Net Purchase Power Expenses by Year and Alternative for the Reduced Obligations to Match Resource Scenario^{a,b}

Year	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
2015	31,200	29,800	35,300	32,000	31,600	44,100	34,800
2016	96,900	95,200	93,500	98,300	96,800	104,200	98,800
2017	68,600	68,800	70,500	69,700	70,300	89,920	73,800
2018	49,500	74,100	68,320	54,200	51,500	87,930	72,020
2019	17,700	13,300	30,820	22,900	18,000	49,730	38,220
2020	34,700	33,000	48,220	37,100	35,700	69,930	53,020
2021	31,400	29,900	48,420	47,920	46,920	70,630	52,620
2022	4,350	3,650	13,020	14,750	15,400	26,780	16,570
2023	-82,550	-79,810	-63,220	-67,640	-67,550	-59,290	-66,150
2024	-36,580	-33,010	-6,710	-43,190	-41,360	-20,400	-36,130
2025	0	0	0	0	0	0	0
2026	0	0	0	0	0	0	0
2027	0	0	0	0	0	0	0
2028	0	0	0	0	0	0	0
2029	0	0	0	0	0	0	0
2030	0	0	0	0	0	0	0
2031	0	0	0	0	0	0	0
2032	0	0	0	0	0	0	0
2033	0	0	0	0	0	0	0
2034	0	0	0	0	0	0	0

^a These numbers are compared to a condition in which generation is just equal to SHP obligations. Positive numbers indicate net firming purchases. Negative numbers indicate revenues collected above a condition in which generation is just equal to SHP obligations.

^b Zeroes indicate that no purchase power expenses are required to firm contract obligations; however, other expense, such as operations, maintenance, repayment of investment and interest payments would continue.

energy and capacity provided by the resource. These data were developed as described above and include the following:

- Purchase power expense net of additions to revenue from the sale of AHP, and
- Cost of capacity including capital and fixed O&M expenses relative to Alternative A.

K.2.8.2 PRS Revenue Distribution

The CRSP Management Center uses a balloon payment methodology for repayment of project costs. This means that principal payments for capital costs are not due until the end of their repayment period. For example, if an investment has a repayment period of 50 years, the total principal payment can be made in the 50th year. The revenue distribution described in this section, and the PRS calculations described in the next section, pertain to the balloon payment methodology.

Within the PRS, electrical power revenues within the year must first be applied to the annual O&M costs. Interest expense is considered an operational cost, but it is the last in priority. After all annual costs are paid, capital costs must be repaid in the following order: (1) required principal payments, (2) deficits, and then (3) the highest interest-bearing investment. Required payments are payments on those investments that still have an unpaid balance at the end of their repayment period.

K.2.8.3 The SLCA/IP PRS

The SLCA/IP PRS includes the revenue requirements for the CRSP, Collbran, and Rio Grande projects, which were integrated for marketing and ratemaking purposes on October 1, 1987, in addition to two participating projects of the SLCA/IP system that have power facilities, the Dolores and the Seedskadee Projects. The CRSP Management Center forecasts 5 years of firming purchased power in the PRS. This reflects the firming purchase power requirements between projected generation and FES contract obligations. For the remaining future years, a forecast of \$4 million per year is projected to cover operational purchase power costs for the EMMO located in Montrose, Colorado.

WAPA used the FY 2015 preliminary SLCA/IP PRS as the template to calculate the rate impacts for all the alternatives. The generation, project use, energy, and capacity values for each alternative were updated in the PRS, and the rate was computed for each alternative. The rate-setting period in the PRS is determined by calculating the revenue requirement from the first future year through the year with the highest revenue requirement, which is referred to as the pinch-point year. For this rate analysis, the first future year used in the template is FY 2018. The pinch point used in the template is FY 2025 and is driven by a multi-million dollar Aid-to-Participating-Projects required payment due that year. Consequently, the rate-setting period for the template, from the first future year to the pinch point, is FY 2018 through FY 2025. The revenue requirements are recovered through a 50/50 split between the energy and capacity rates. Three rates calculated in the PRS are energy, capacity, and composite.

The energy rate is the rate that sets forth the charges for energy. It is expressed in mills/kWh and is applied to each kilowatt-hour delivered to an FES customer. The energy rate is estimated by a rates specialist and manually entered in the PRS, and a study is run to determine if the rate is sufficient to cover costs without creating a deficit. If the study produces a deficit balance, a new rate is entered into the PRS and the study is run again. The estimated rate is increased until the study no longer produces a deficit.

The capacity rate is the rate that sets forth the charges for capacity. It is expressed in \$/kW-month and applied to each kilowatt of the CROD. The formula for the capacity rate is linked to the energy rate and is simultaneously updated to ensure the revenue requirement is recovered through a 50/50 split between the capacity and energy rates.²⁰

The composite rate is the rate for firm power, which is the total annual revenue requirement for capacity and energy divided by the total annual energy sales. It is expressed in mills/kWh and used for comparison purposes only. The composite rate is calculated after the energy rate is computed and the rate-setting period is established. The composite rate, in mills/kWh, is calculated as the ratio of the total revenue required during rate-setting period to the total projected sales during the rate-setting period.

K.2.8.4 Standard PRS Rate-Setting Method Versus the Method Used in This Analysis

In order to accurately compute the impact of each alternative in terms of energy and capacity rates, projected power purchases for the entire rate-setting period of 2015 through 2034 were used. This deviates from WAPA's normal 5-year forecast in order to accurately capture each alternative's rate impacts. Table K.2-4 shows power purchase costs, assuming that current FES obligations would continue after FY 2024, and Table K.2-5 shows results for the marketing structure that would incur zero firming expenses after 2024. Table K.2-6 shows the SLCA/IP rate impact for each alternative.

K.2.9 Results

Table K.2-6 shows the estimated SLCA/IP energy and capacity rates by alternative. This reflects WAPA's current method of billing. SLCA/IP FES customers are billed monthly for the amount of energy used and for their capacity allocation. A composite rate is an index number that includes the energy and capacity rates together and may be useful for comparison purposes.

Table K.2-7 shows that there is a significant difference between the "bookend" assumptions. Comparing the composite rate, the No Change condition results in higher SLCA/IP rates across all alternatives compared to the Resource Available condition. For the No Change condition, the highest rate occurs under Alternative G (38.75 mills/kWh). The lowest SLCA/IP

²⁰ The production of hydropower that Western markets requires the construction of a dam and water storage. The fuel for these hydropower facilities is water, which is costless. Under the law, Western is required to set "cost-based" rates. If Western used production costs to set capacity and energy rates, the energy rate would be zero or near zero. It has been Western's practice to set FES rates so that 50% of the revenues collected through the sale of power are through the capacity rate and 50% of the revenues collected are through the energy rate. Other Federal power marketing agencies use different rate-setting strategies, but their rates are also required to be cost-based. The "50/50 split" is not a legal requirement, but, rather, a common Western practice.

TABLE K.2-7 SLCA/IP Rate Impact by Alternative^a

	Alternative A (No Action Alternative)		Alternative B		Alternative C		Alternative D (Preferred Alternative)		Alternative E		Alternative F		Alternative G	
	NC ^b	RA ^c	NC	RA	NC	RA	NC	RA	NC	RA	NC	RA	NC	RA
	Pinch-Point FY	2031	2055	2031	2055	2031	2055	2031	2055	2031	2055	2025	2057	2031
Composite (mills/kWh)	32.64	25.19	32.69	25.07	33.77	25.65	33.65	25.22	33.41	25.16	37.79	27.53	38.75	26.65
Energy (mills/kWh)	13.52	13.40	13.54	13.22	13.99	14.55	13.94	13.78	13.84	14.01	15.67	16.86	16.07	15.22
Capacity (\$/kW- month)	5.74	5.69	5.75	5.62	5.94	6.18	5.92	5.85	5.88	5.95	6.66	7.16	6.83	6.50

^a Rate impacts in this table are in part based on net purchase power costs shown in Tables K.2.5 and K.2.6 which include the impacts of LTEMP experiments

^b NC = No change from current FES commitment levels.

^c RA = Resource available. Commitment level equals available SLCA/IP federal hydropower resource.

rate occurs under Alternative A (32.64 mills/kWh), although Alternative B is almost the same rate (32.69 mills/kWh). The range is 6.11 mills/kWh, with Alternative G producing a rate that is 19% higher than Alternative A (the no action alternative). The Resource Available condition produces similar results. The lowest SLCA/IP rate occurs under Alternative B (25.07 mills/kWh), almost identical to Alternative A (25.19 mills/kWh). Under this condition, the highest SLCA/IP rate occurs under Alternative F (27.53 mills/kWh). The range is smaller under this condition with Alternative F producing a rate that is 2.46 mills/kWh or 10% higher than Alternative B.

It is worth noting that under either of the post-2024 “bookend” conditions, Alternatives A, B, C, D, and E produce similar SLCA/IP rates. Alternatives F and G produce significantly higher SLCA/IP rates.

As described previously, the no change and resource available bookends are used for modeling purposes only and do not represent estimates or indications of the post-2024 commitment levels that may result from the public process. Alternative impacts on SLCA/IP rates illustrated in Table K.2-7 are indications of the rank order of the alternatives and the direction of impacts (positive or negative), and they encompass a reasonable range of the actual future rate impacts once the post-2024 marketing plan has been implemented. For the final LTEMP EIS, assumptions concerning post-2024 commitment levels may be revised to duplicate the range examined in the economic analysis described in Section K.1. This would be a SLCA/IP capacity obligation based on the 99th, 90th, and 50th percentile exceedance levels. The resulting

range will likely be somewhat narrower than the results of the bookend analysis presented in this draft.

K.2.9.1 Pinch-Point Year

Table K.2-7 includes pinch-point year information. The pinch point is the year in which the largest revenue requirement occurs in the future and is influential in setting the SLCA/IP rate.

There were three common pinch points that occurred when determining alternative-specific rates:

- 2025, caused by a required Aid-to-Participating-Projects Payment (Duchesne);
- 2031, caused by purchase power expense; and
- 2055, caused by a required Aid-to-Participating-Projects Payment (Starvation Reservoir).

As described in Section K.2.3, WAPA's SLCA/IP rates are set to assure repayment of all authorized water projects. In the current PRS, repayment of existing projects and repayment of yet-to-be constructed water projects will be completed in 50 years. The pinch-point is the year in which the largest future revenue requirement occurs. These pinch-points occur when a large water project – or “block” of a large water project – requires a repayment. After this pinch-point year, revenues are sufficient to complete repayment of remaining water projects. Therefore, it is said that the pinch-point year drives the rate.

Higher purchase power requirements require increasing the revenue requirement in the pinch-point year. Because the amount of purchase power is not consistent across alternatives, neither is the revenue requirement. The pinch-point year varies among alternatives because of the variation of purchase power amounts by alternative. It is not possible to use a consistent pinch-point year because each alternative produces different annual revenue requirements, and therefore a different schedule for completing repayment. The only way to have a consistent pinch-point year is to have consistent revenue requirements across each alternative.²¹ With a fixed rate, the lower the purchase power, the more revenue available for discretionary repayment of investments which reduces annual interest and ultimately the annual revenue requirements. Conversely, increases in purchase power reduce the amount available for repayment on investment which leads to higher interest payments and subsequently, higher annual revenue requirements.

²¹ One could argue that the SLCA/IP rate analysis should “force” the SLCA/IP rate to have the same pinch-point year for each alternative so that the impact of the alternatives is a more “apples to apples” comparison. This was considered as an approach, but it was decided that forcing such a condition would require a significant change in the rate-setting process. Moreover, it may be useful to the reader to know how alternatives differ in terms of their effect on setting a pinch-point year.

K.2.10 Definitions Used in Section K.2

Available Hydropower (AHP): The amount of SLCA/IP electrical energy and/or capacity available to FES customers for either the summer or winter seasons. This is designated for each month of the season.

Aid to Participating Projects: This is the part of an authorized irrigation/water project that is assigned to power for repayment. There is an assigned amount in the PRS for each authorized project.

Composite Rate: This is not a rate that is used for billing purposes. It is for comparisons. One takes the capacity rate and the energy rate, assumes a load factor and calculates the average rate per kilowatt-hour.

Contract Rate of Delivery (CROD): the amount of capacity allocated to an FES customer, by season, for the marketing period. It represents the “ceiling” obligation. An FES customer can utilize AHP capacity up to this amount.

Colorado River Storage Project (CRSP): Federal hydropower facilities in the Upper Colorado River Basin including Glen Canyon, Flaming Gorge, Fontenelle and the Aspinall Units.

CRSP Management Center: WAPA’s Colorado River Storage Project Management Center. This is the WAPA office that has the responsibility for marketing the SLCA/IP power resources and for setting SLCA/IP FES rates.

Federal Energy Regulatory Commission (FERC): A federal commission that regulates the interstate transmission of electricity, natural gas, and oil. FERC also reviews proposals to build liquefied natural gas terminals and interstate natural gas pipelines as well as licensing hydropower projects. The FERC has limited jurisdiction over WAPA’s rates, but must ensure that WAPA’s project rates are sufficient to repay authorized projects.

Load Factor: A proportion of average energy used over a specified time period compared to peak demand for the same time period.

No Change Scenario (NC): This scenario represents a post-2024 condition where WAPA continues its current obligations to provide capacity and energy from the SLCA/IP resources.

Pinch Point Year: In setting the SLCA/IP FES rate, this is the year in which the highest payment obligation exists. It is said to “drive” the rate.

Project Use: Electrical capacity and energy reserved to power authorized water projects.

Power Repayment Study (PRS): this is the name of the model used by WAPA to set rates. PRS models are project specific.

Resources Available Scenario (RA): This scenario represents a post-2024 condition where WAPA reduces its current commitment of SLCA/IP energy and capacity to exactly match the production of power from the SLCA/IP resources.

Sustainable Hydropower (SHP): The amount of SLCA/IP electrical energy and capacity available to FES customers over the course of the marketing plan. This is the “firm” commitment that WAPA, in low release conditions, must firm up. There is an SHP capacity and energy amount for each month of the season.

Salt Lake City Area Integrated Projects (SLCA/IP): The Collbran, Rio Grande, and the Colorado River Storage Projects were integrated by WAPA in 1986 for marketing and rate-setting purposes.

K.3 IMPACTS ON RETAIL ELECTRICITY RATES

This section documents the effects of LTEMP alternatives on retail electricity rates and bills. Retail rate impacts measure how LTEMP alternatives affect electricity bills paid by household and business consumers who buy electricity from utility systems that directly or indirectly receive power from the SLCA/IP through WAPA. These impacts are documented in three sections that first explain the methodological approach, then summarize results, and finally present the impacts. The measured rate impacts do not use the wholesale rate impacts described in Section K.2 as an input, meaning that there is no direct connection between Section K.2 and this section. Instead, the rate impacts are directly computed from wholesale power costs that are derived directly from the power systems analysis. The retail rates are directly impacted by the LTEMP experiments and include both capacity and energy cost impacts. The wholesale costs that are measured directly from the power systems analysis using the carrying charge analysis described below are greater than the measured wholesale rates discussed in Section K.2, with the exception of Alternative G. This implies that the rate impacts would be lower had the wholesale rates from Section K.2 been used rather than the wholesale costs explained in this section (again, with the exception of Alternative G).

K.3.1 Analysis Approach

Retail rate and residential bill impacts are derived from the power systems analysis (described in Section K.1), SLCA/IP allocations, and publicly available retail rate and sales data using various allocation formulas. The foundation of the analysis is a database of retail sales, retail rates, and SLCA/IP energy allocations for utility systems that are given preference in power allocation from the SLCA/IP (referred to here as preference power). Rate impacts are based on the assumption that the capital, operating, and administrative costs of Glen Canyon Dam do not substantively change under different LTEMP alternatives when the energy output from the dam changes. Because these operating and administrative costs are not affected by the LTEMP alternatives, rate impacts result from changes in the cost associated with replacing capacity and/or energy with changes in dam operations. The wholesale power costs associated with changes in dam operations are labeled “grid costs” and include costs of replacement

capacity, changed production costs (fuel costs, purchased power costs, and variable operation and maintenance [O&M] costs), and differential fixed O&M costs. Using the retail data along with aggregate grid costs, the retail rate impacts of the LTEMP alternatives were determined for the vast majority of municipal, cooperative, and other entities that directly or indirectly receive preference power from SLCA/IP. A separate analysis was made for American Indian Tribes using SLCA/IP allocations to the Tribes combined with contract price data for special arrangements that are made with Tribes for SLCA/IP energy and capacity. The special contract arrangements imply that rate impacts for Tribes are generally greater than the rate impacts for non-Tribal systems. This analysis is presented in Section K.4.

The primary output from the rate impact analysis is a set of figures and tables that present the percent increase or decrease in electric rates and the changes in monthly electricity bills paid by residential consumers of municipal utilities, cooperative distribution utilities, Tribal authorities, and irrigation districts. (Retail consumers include businesses households and other institutions, while residential only includes households.) The rate impacts of different LTEMP alternatives are presented relative to Alternative A (the no action alternative). Rate impacts were estimated for all of the utility systems that have available retail energy sales data published by the Energy Information Agency (EIA) and incorporated more than 90% of entities that receive power from the SLCA/IP in terms of energy allocation. Entities for which rate impacts cannot be measured directly because of a lack of publicly available data include direct retail consumers such as military bases, universities, and the DOE Albuquerque office. In addition to computing rate impacts for companies with available data from the EIA, retail rate impacts for American Indian Tribes were calculated. This calculation used data from utility systems that serve the Tribes at a retail level combined with the effects of net benefit contracts between the Tribes and wholesale utility systems that directly compensate for wholesale power. Contracts between Tribes and wholesale systems to provide benefits are termed net benefit contracts. This analysis is presented in Section K.4.

Four primary tasks were undertaken to compute the rate impacts on retail consumers. These tasks were:

1. Compiling retail energy sales (\$), rate (\$/MWh), and residential bill (\$/month) data for each utility system directly or indirectly receiving an allocation of SLCA/IP federal preference power;
2. Computing year-by-year grid costs under LTEMP alternatives from the power systems analysis and analyzing how the capital cost of new capacity is translated into retail revenue requirements (the capital recovery factor or carrying charge rate);
3. Allocating the aggregate grid cost impacts under LTEMP alternatives to individual retail utility systems; and,
4. Presenting the disparate retail rate and residential bill impacts over time for different systems.

Three information sources, as illustrated in Figure K.3-1, were used to compute the rate impacts of LTEMP alternatives. The first set of inputs for the analysis was a database of sales, rates, and SLCA/IP allocations for utility systems that receive federal preference power from the SLCA/IP. The second set of inputs consisted of the aggregate grid cost combined data from the power systems analysis with capital recovery charge analysis that represents the wholesale power costs. The third set was macroeconomic data from the Energy Information Administration (EIA) (EIA 2015b,c). These inputs were used to determine the relative rate impacts for individual systems from different LTEMP alternatives. Varying impacts on individual systems were largely driven by (1) the amount of preference power allocated to each system relative to the total generation resources of the system, and (2) the current retail rate, which influences the percentage change calculation (a higher rate results in a smaller percent change).

Explanations of analytical methods for determining rate impacts are organized around Figure K.3-1. The next three sections explain the data input items listed on the left side of Figure K.3-1. Section K.3.1.4 describes details of the calculation process referenced in the middle of Figure K.3-1, and Sections K.3.2 and K.3.3 describe the rate impacts that are cited on the right side of the figure. Additional description of the process to compute rate impacts for American Indian Tribes appears in Section K.4.

K.3.1.1 Database of Sales, Rates, and SLCA/IP Allocation for Retail Utility Systems

The explanation of the database is separated into two parts that address: (1) how a list of utility systems that receive federal preference power from SLCA/IP and distribute power to retail

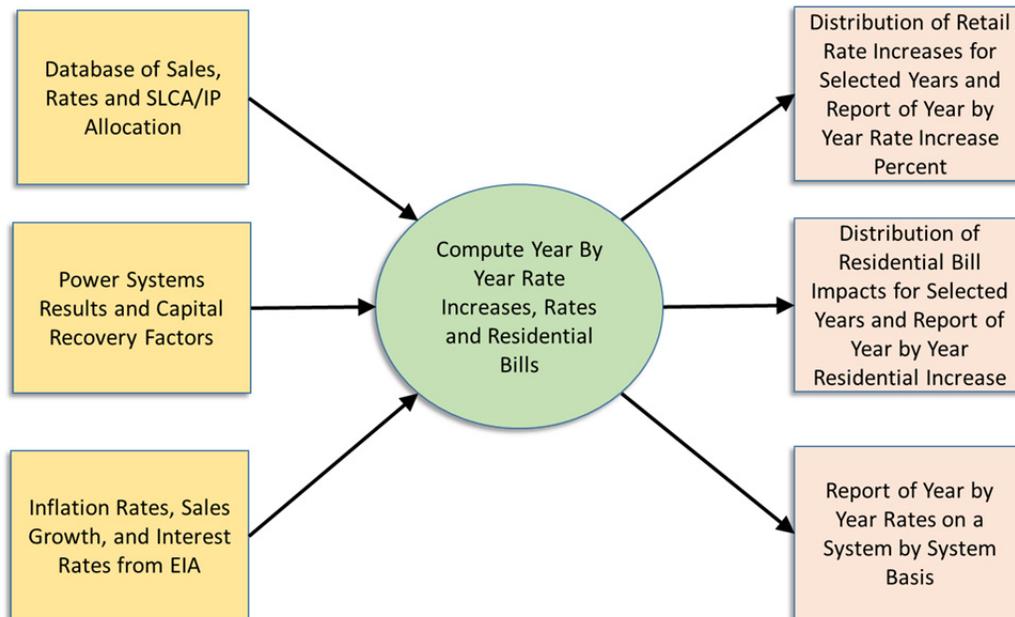


FIGURE K.3-1 Flowchart Diagram of Rate Impact Analysis Process

residential, commercial, industrial and other consumers was compiled; and (2) how retail statistics are gathered for utility distribution systems from Form EIA-861 detailed data files (EIA 2015a).

List of Utility Systems that Distribute Power to Retail Consumers

Developing the database for retail rate analysis involved arranging a list of utility systems that sell electricity on a retail basis and that directly or indirectly receive SLCA/IP federal preference power allocations. The starting point for this list is tabulating utility systems that receive federal preference power from SLCA/IP. WAPA provided this information in a spreadsheet of allocations for the period October 1, 2008, through September 30, 2024 (Osiek 2014). The allocation data included information for 154 different systems that receive separate preference power allocations.

Some of the utility systems listed in the Allocation Report do not sell power on a retail basis to residential and business retail consumers. Five systems including (1) the Wyoming Municipal Power Agency (WMPA), (2) the Utah Municipal Power Agency (UMPA), (3) the Platte River Power Authority (Platte River), (4) the Colorado River Commission of Nevada (CRCN), and (5) Tri-State Generation and Transmission Cooperative (Tri-State) receive preference power allocations from SLCA/IP and then re-allocate power to distribution systems. Table K.3-1 shows that these five indirect systems comprise 47% of the total SLCA/IP federal preference power. Deseret Generation and Transmission Cooperative and the Utah Associated Municipal Power Systems are not included in the five indirect allocation entities because for these two systems, each of their member distribution systems receives distinct direct allocations.

TABLE K.3-1 Energy Allocations for Systems Receiving Indirect SLCA/IP Allocations

System	Annual SLCA Energy Allocation (MWh)	Percent of Total Allocation
Systems Receiving Indirect Allocation		
Wyoming Municipal Power Agency	24,753	0.50%
Utah Municipal Power Agency	290,604	5.87%
Platte River Power Authority	502,467	10.15%
Colorado River Commission of Nevada	88,212	1.78%
Tri-State Generation and Transmission	1,424,012	28.76%
Subtotal Systems with Indirect Allocation	2,330,048	47.05%
Systems Receiving Direct Allocation	2,621,739	52.95%
Total Energy Allocation	4,951,787	100.00%

For the systems with indirect allocation listed in Table K.3-1, it is necessary to compile retail sales and rate data on all of the individual systems that sell power to retail consumers because the larger wholesale systems do not sell to retail consumers. A list of retail entities that are members of indirect retail systems (e.g., distribution cooperatives [co-ops] that are members of Tri-State) have been obtained from Websites for the five indirect allocation utility systems (CRCN 2015; Platte River Power Authority 2015; Tri-State 2015; UMPA 2015; WMPA 2015). After including the retail systems that are members of indirect allocation utilities, the total number of retail utility systems in the database increases from 154 to 226.

Retail Statistics for Distribution Utility Systems from the Form EIA-861 Database

Rate impact calculations for each entity required data for residential and nonresidential sales revenues and sales quantity. The primary source for the existing retail rates and retail residential, commercial, industrial, and other energy sales is the Form EIA-861 database (EIA 2015a). Data for direct retail consumers such as military bases and most American Indian Tribes are not included in the primary EIA database. After adjusting for complications associated with differences in system names, historical data availability, and systems that operate in multiple states, 91% of the preference power can be associated with retail sales data available in the EIA 861 database as shown in Table K.3-2. This table does not include additional data that has been separately gathered for the American Indian Tribes and is described in Section K.4. Additional data for American Indian Tribes is derived from utility companies that serve the Tribal Reservation along with wholesale utility systems that are the SLCA/IP benefit crediting partners (see Section K.4). Tribal entities that provide data to the EIA 861 database (representing the figure of 44.19% in Table K.3-2) included Ak-Chin, Tohono O'odham Reservation, and the Navajo Tribal Utility Authority. These three systems operate their own utilities and do not have special contracting arrangements to secure their SLCA/IP allocation. After accounting for special net benefit contracts used by Tribal Authorities combined with retail utilities that serve the Tribes, the coverage of Tribes is 100%. The 44.19% shown in Table K.3.2 does not include the additional data that is described in Section K.3.2.

K.3.1.2 Incorporation of Power Systems Analysis and Capital Recovery Factors

The second category of information input to the rate impact analysis shown in Figure K.3-1 is projected grid cost data derived from the power systems analysis and capital recovery factors. The amount of annual aggregate capacity (in MW) that is added on an annual basis, the total annual variable production cost, and the fixed O&M costs for new capacity are obtained from the power systems analysis described in Section K.1. The amount of capacity that needs to be added under each LTEMP alternative due to changes in operations is converted to revenue requirements using a carrying charge analysis combined with the projected cost of constructing new generating plants.

TABLE K.3-2 Coverage of Retail Information from EIA Database Relative to SLCA/IP Preference Power Allocation^a

System	SLCA Annual Energy Allocation (MWh)	Percent of Total Energy Allocation	SLCA Energy with Retail Sales	Percent of Energy With Retail Sales
WMPA, UAMPS, UMPA, CRCN, Platte River	1,231,926	24.87	1,229,054	99.77
Tri-State, Deseret	1,840,470	37.15	1,840,470	100.00
Co-ops not Included in Larger Entities	210,951	4.26	210,951	100.00
Electric Districts and Irrigation Districts	123,588	2.49	108,401	87.71
Municipalities not in JAAs (including SRP)	921,408	18.60	921,408	100.00
Military Bases	70,550	1.42	0	0.00
Tribal Authorities	464,030	9.37	205,051	44.19
Universities and DOE Office	91,401	1.84	0	0.00
Total	4,954,323	100.00	4,515,334	91.14

^a Note: CRCN = Colorado River Commission of Nevada; JAA = Joint Action Agency; SRP = Salt River Project; UAMPS = Utah Associated Municipal Power Systems; UMPA = Utah Municipal Power Agency; WMPA = Wyoming Municipal Power Agency.

To integrate power systems analysis with the rate impact calculations, selected results are summed together over the different systems that are simulated. Aggregating data from the power systems analysis across the large systems that were modeled and then allocating those costs to individual systems means that, in terms of the rate impact analysis, there is no difference in treatment between the small systems and the other eight utilities modeled in the power systems analysis. Equations used to convert the generation cost and capacity expansion data to aggregate grid cost impacts are listed below, where t represents the annual period, i represents the LTEMP alternative, and c represents the capacity type. The summation is over the new capacity type:

$$\text{Capacity Cost}_{t,i} = \sum \text{New Capacity}_{t,i,c} \times \text{Capacity Cost}_{t,i,c} \times \text{Carrying Charge Rate}_t$$

$$\text{Fixed O\&M}_{t,i} = \sum \text{Accumulated Capacity}_{t,i,c} \times \text{Fixed O\&M Cost/kW-yr}_c \text{, and}$$

$$\text{Grid Cost}_{t,i} = \text{Production Cost}_{t,i} + \text{Capacity Cost}_{t,i} + \text{Fixed O\&M}_{t,i}$$

Carrying Charge Factors Applied to New Capacity That Account for Ownership and Financing Structures of Municipal and Cooperative Systems

Rate impacts cannot be directly calculated from outputs generated by the power systems analysis because of the manner in which plants are financed. The annual cost of new capacity that is charged to consumers is established from dollar amounts that are paid to bondholders who lend money for constructing a new plant. Annual funds collected to compensate for the cost of building new capacity is termed the “capital recovery factor” or the “carrying charge rate.” A detailed analysis has been made of carrying charges for individual municipal and cooperative

systems as part of the rate impact analysis. The carrying charges used data from financial reports and derived revenue requirements from changes in the quantity of generating capacity. The analysis includes effects of municipally financed debt, debt service requirements, the tenor of debt, and other assumptions including the interest rate. Some of the considerations in deriving the carrying charge analysis include:

- The carrying charge for purposes of the rate impact depends on the debt structure used to finance the investment. If the bond repayment period is not the same as the plant life and/or the bond repayment does not increase with inflation (both of which are generally true) then the capital recovery for purposes of the rate impact analysis is different than the economic carrying charge used in the power system analysis;
- The carrying charge for rate impact analysis does not reflect differences in risks associated with generating alternatives that are borne by consumers (for example, the capacity from Glen Canyon Dam already exists, while the ultimate cost of capacity from new generation plants has uncertain capital and operating costs);
- The carrying charge for rate impact analysis is affected by the debt service coverage and other specific features of bonds issued to finance construction for municipal and cooperative systems;
- The year-by-year carrying charge measured using actual interest rates relevant for measuring rate impacts is flat over the prospective tenor of the debt (by contrast, the real carrying charge used in economic analysis in the initial year of the plant life is lower than subsequent years);
- The carrying charge for generation and transmission cooperatives may be affected by patronage capital that is generally part of the financing of a new powerplant;
- The interest rate used in the calculation of carrying charges for rate impact analysis should reflect the credit rating and the tax status of entities that will finance the new construction; and
- The interest rate used for the carrying charge analysis changes over time when interest rates change (as projected by the EIA).

The carrying charge rates implemented in the rate impact analysis are shown on Figure K.3-2. The carrying charges applied in the rate impact simulation are a weighted average of the carrying charges for taxable (e.g., co-op) and municipal financing. The weighted average is derived from the energy allocations for (1) systems that issue taxable debt (co-ops and irrigation districts), and (2) systems for which the interest is exempt from federal income taxes (municipal systems). The weighted average carrying charge that converts one-time capital costs for construction of new capacity into projected annual revenue requirements begins at a level of

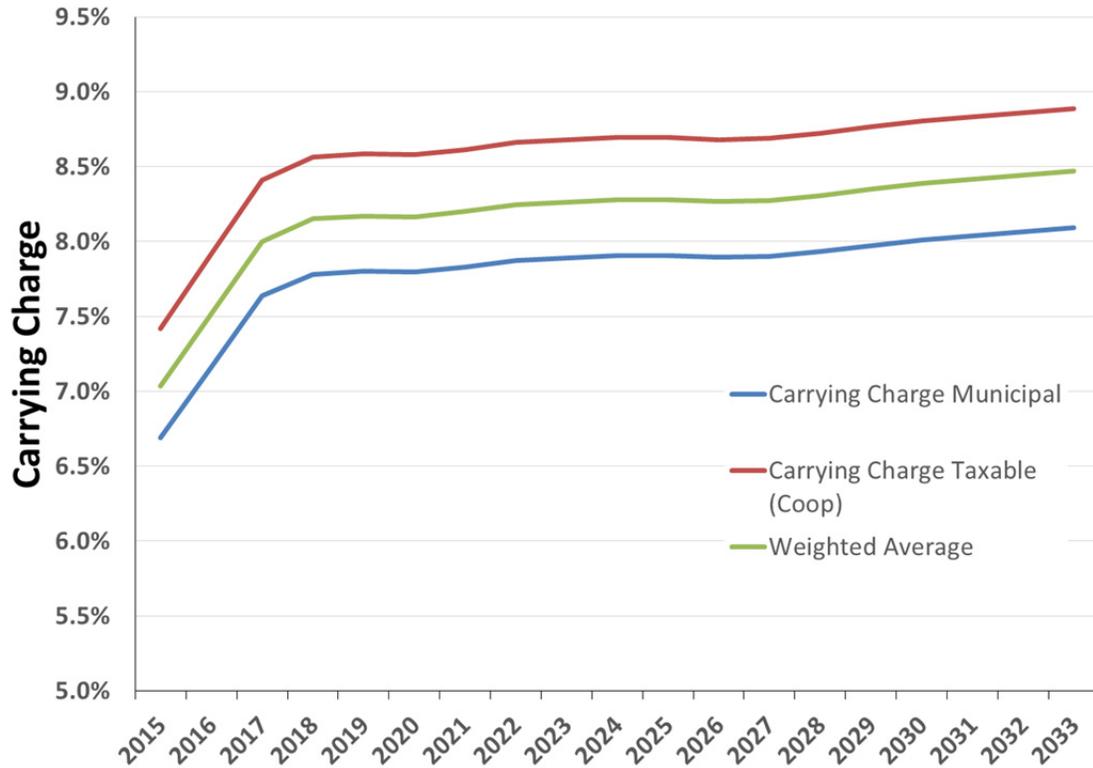


FIGURE K.3-2 Projected Carrying Charge Rates Used in Rate Impact Analysis

7.03% in 2015 and eventually increases to 8.50% (the middle line in Figure K.3-2). By contrast, if the same interest rate and inflation assumptions were applied to computing economic carrying charges, the real capital recovery factor would only be 4.38% in 2014. This higher carrying charge increases measured rate impacts.

K.3.1.3 Inflation Rates, Sales Growth, and Interest Rates from EIA

The third set of input data presented on the left side of Figure K.3-1 consists of general macroeconomic variables that drive the prospective level of base retail rates for each utility system. Macroeconomic factors include the expected level of electricity rates and the expected level of retail sales growth in the southwest region, as well as future interest rates for the municipal and cooperative systems. Data for these items has been derived from information provided in EIA regional forecasts presented in the 2015 Annual Energy Outlook (EIA 2015b). Projections from the EIA annual outlook (EIA 2015c) are also used for macroeconomic data including prospective inflation rates and interest rates.

K.3.1.4 Calculation Process for Computing Rate and Bill Impacts

The middle of Figure K.3-1 represents calculations made for computing rate impacts after the inputs are established. The computations of rate impacts for individual systems involve a series of allocations under each LTEMP alternative. Figure K.3-3 shows three allocation procedures that were part of calculating rate impacts. The first allocation involved attributing total grid cost to individual utility systems using SLCA/IP allocation data (shown in red in Figure K.3-3). For the indirect allocation systems defined in “List of Utility Systems that Distribute Power to Retail Consumers” above, a second allocation involved attributing SLCA/IP power from the Generation and Transmission Cooperative or the Joint Action Agency to individual members (shown in yellow in Figure K.3-2). These two allocations define impacts measured by the percent change in retail rates. The only allocation that involves assumptions with respect to utility-specific ratemaking processes is the computation of residential bill impacts. To compute the residential bill impact, costs must be allocated between residential and nonresidential consumers (shown in green in Figure K.3-2). For this allocation, the assumption is made that capacity and energy costs are allocated in the same proportion as existing overall rates.

Then next five sections describe the allocation process used to compute the rate impacts. The first section explains why wholesale rates were not needed in the allocation process and how

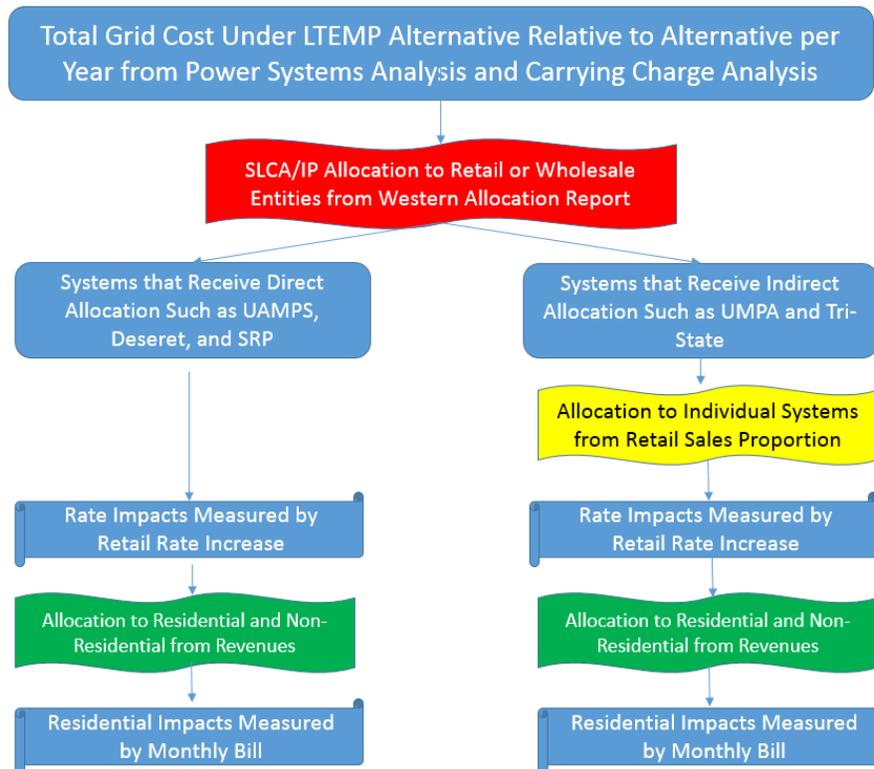


FIGURE K.3-3 Flowchart Diagram of Allocation Process

the aggregate grid cost impacts can be compared to SLCA/IP wholesale revenues. The second section describes the allocation of aggregate grid costs to different systems, and the third section describes the allocation process for indirect systems. The fourth section explains the allocation process for residential rates, and the final section demonstrates the process with a case study.

Using Grid Costs Rather than SLCA/IP Wholesale Rates for Computing Retail Rate Impacts

A fundamental concept underlying the rate impact analysis is that rate impacts of LTEMP alternatives occur because of differences in alternatives with regard to capacity that is lost and energy that must be purchased during different periods, not WAPA's cost structure. WAPA must collect the same amount of revenue to cover its costs under all of the LTEMP alternatives, even though marketable capacity has declined and timing of energy production has changed. For LTEMP alternatives that increase grid cost relative to Alternative A, retail consumers of entities that receive SLCA/IP capacity and energy in one way or another pay for replacing capacity and more expensive energy. (It is assumed that consumers who are not associated with entities that receive SLCA/IP capacity do not incur added costs.) This implies that rate impacts can be computed directly from grid costs rather than WAPA wholesale tariffs. For benchmarking purposes, the average annual production, fixed O&M, and investment costs on SLCA/IP customers are presented relative to the dollar amount of revenues collected by WAPA presented in Sections K.1 and K.3.2.2. Wholesale grid costs used as the basis for computing rate impacts have been compared to the aggregate wholesale amounts that would be paid under projected SLCA/IP rates described in Section K.2. This analysis evaluated the aggregate incremental grid cost for each alternative as compared to the aggregate wholesale power cost that would be paid under the wholesale SLCA/IP rates computed in Section K.2. The analysis demonstrates that for LTEMP alternatives other than Alternative G, the SLCA/IP wholesale rates would result in lower measured impacts than the aggregate grid costs.

The fact that retail rate impacts can be computed without separate calculations of WAPA wholesale rates can be demonstrated with a hypothetical example of three rate calculation approaches, the first of which does not include wholesale rate calculations, while the second and third apply different possible changes in wholesale tariffs that result from various LTEMP alternatives. All three of the wholesale rate techniques result in the same retail rate impact. The first method does not require measurement of SLCA/IP wholesale rates and is consistent with the approach illustrated in Figure K.3-3. Using this approach, rate impacts are computed by directly allocating grid costs under different LTEMP alternatives. The second method assumes that WAPA increases wholesale capacity charges to cover the fixed costs associated with lower amounts of capacity from changes in Glen Canyon Dam operations. This method assumes that the utility systems themselves procure the capacity and energy to make up for the changes in dam operations. The total amount of wholesale revenues received by WAPA does not change in this second method, and the utility systems themselves incur the increased grid costs in this scenario. Because WAPA's revenues do not change and utilities procure the capacity and energy deficits created from the LTEMP alternatives, the second scenario produces the same revenues as the first method, in which wholesale rates are not considered. The third approach assumes that WAPA, instead of the utility systems, procures the deficient capacity and energy. This means the

grid cost impacts are included in the WAPA wholesale rates and, from the perspective of the utility systems, the capacity quantity does not change. The same amount of capacity and energy must be procured by WAPA as would be procured by the individual utility systems. Ultimately, SLCA/IP rates change in different LTEMP alternatives to cover changes in the cost of capacity and energy.

Allocation of Aggregate Grid Costs to Retail Systems

The primary allocation formula applied to compute rate impacts involves allocating total grid costs to different systems using the annual SLCA/IP energy as reported in Osiek (2015). This allocation process, illustrated in red in Figure K.3-3, is represented by the following equation (recall that retail rates include rates to residential, business, and other consumers served by the utility system):

$$\text{Retail Change for Individual System Relative to Alternative A (\$)} = \frac{[\text{SLCA/IP Energy Allocation to Individual System (MWH)} / \text{Aggregate SLCA/IP Energy Allocation to All Systems (MWH)}] \times \text{Aggregate Grid Cost Impact of LTEMP Alternative Relative to Alternative A (\$)}}{1}$$

SLCA/IP energy allocation in the above formula is applied by summing the summer and winter energy allocation for each system listed in Osiek (2015). The actual allocation that determines the amount each system pays for SLCA/IP power involves both energy and capacity and is differentiated by season. This raises the question of whether summer capacity, winter capacity, summer energy, and winter energy should be applied in a more complex allocation process. The question is resolved because the allocation shares to individual systems would be virtually identical if either the capacity or energy allocation were used. This is demonstrated by the fact that the annual load factor in SLCA/IP allocations is similar across different systems. If the load factor across systems is the same, then allocation of total grid costs using either capacity or energy will result in the same percentage of aggregate grid cost being attributed to each individual system. The similarity of annual load factors (average hourly energy for the winter and summer divided by the average summer and winter capacity) is illustrated in Figure K.3-4. Because the load factor is nearly identical for almost all distribution systems in Figure K.3-4, the use of capacity or energy does not influence the allocation process.

Given total retail revenues attributed to individual systems, the calculation of percent change in retail rates from LTEMP alternatives can be represented by the two formulas shown below. In these formulas, t is a subscript for the year and i represents the individual system. The term $\text{Retail Change}_{t,i}$ shown in the equation is the result of the equation presented at the beginning of this section.

$$\text{Rate Change Percent}_{t,i} = \text{Retail Change}_{t,i} / \text{Retail \$ Revenue under Alternative } A_{t,i}$$

Retail Revenue under Alternative $A_{t,i}$ comes from retail revenue for each individual system that is part of the database. Increases in retail revenues from sales growth and from price increases

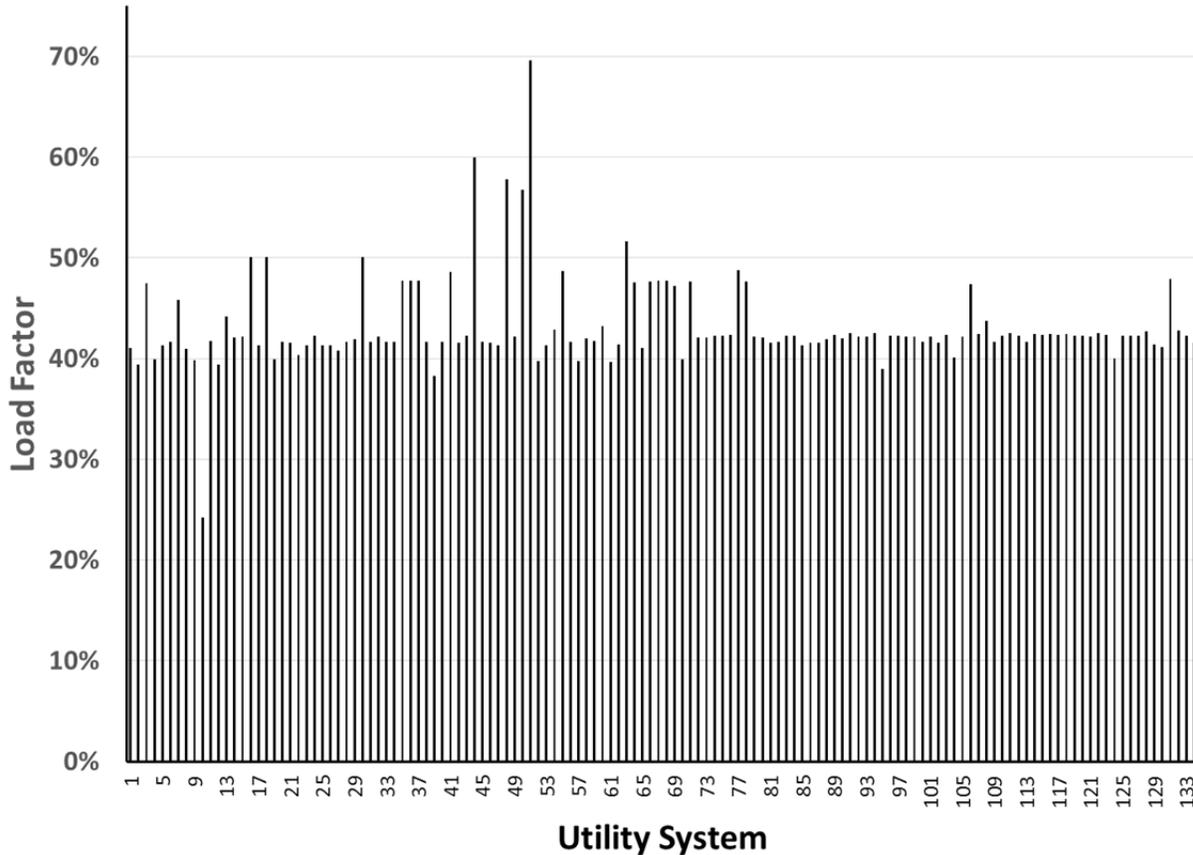


FIGURE K.3-4 Load Factors of SLCA/IP Power (Source: Osiek 2015)

after the base period are calculated from the EIA energy outlook for the Southwest region as represented by the following equation:

$$\text{Retail Rate (\$/MWh) under Alternative } A_{t,i} = \text{Retail Rate under Alternative } A_{t-1,i} \times (1 + \text{Electricity Price Inflation from EIA}_t) \times (1 + \text{Sales Growth from EIA}_t).$$

SLCA/IP Energy for Indirect Allocation Systems

The second allocation issue highlighted in Figure K.3-3 involves allocation of SLCA/IP energy and capacity to individual retail entities from systems that receive indirect allocations. For the indirect allocation systems other than Tri-State (WMPA, UMPA, Platte River, and CRCN), the allocation of SLCA/IP energy to individual member utility systems is made on the basis of the retail sales proportion. Retail sales of the individual member system are divided by aggregate retail sales accumulated for the wholesale system (e.g., WMPA). The percentage of retail sales is multiplied by the aggregate SLCA/IP allocation to the large system reported in Osiek (2015). For Tri-State, the same general process was used, with the exception that

distribution cooperatives in Nebraska are not assumed to receive any SLCA/IP preference power and are not included in the aggregate sales calculation. The method for allocating SLCA/IP energy to individual distribution systems that are part of the larger indirect allocation systems can be represented by the following equation:

$$\text{Allocation of SLCA/IP to Distribution Entity (MWh)} = \frac{[\text{Annual Retail Sales of Distribution Entity (MWh)} / \text{Total Aggregate Retail Sales of Distribution Systems in Group (MWh)}] \times \text{Total SLCA/IP Allocation to Group (MWh)}}{1}$$

Allocation Process from Computing Residential Bill Impacts

The final allocation process illustrated in Figure K.3-3 is the allocation of overall retail revenues (residential and non-residential revenues) to residential consumers and computation of residential bills. Calculation of residential bills involves two steps. The first step is to allocate a portion of the total retail increase for the system to residential consumers. This allocation is made with the ratio of residential revenues to total retail revenues for each system. Using the residential revenue percent, the dollar amount of change in residential revenue under LTEMP alternatives relative to Alternative A can be represented by the following equation:

$$\text{Residential Revenue Change } \$_{t,i} = \text{Change in Grid Cost}_{t,i} \times \text{Residential Percent}_i$$

The second step is computing the monthly residential bill change from residential revenue change. The change in monthly residential bill relative to Alternative A is computed by dividing the total residential revenue change by projected residential consumers and then by 12. The number of residential consumers is projected through dividing the overall sales growth by 2 (implicitly assuming half of the growth is from increased use per customer). Calculation of monthly residential bills relative to the Alternative A is demonstrated in the equations below:

$$\text{Residential } \$ \text{ Bill Increase}_{t,i} = \text{Residential } \$ \text{ Increase}_{t,i} / \text{Residential Customers}_{it} / 12,$$

where:

$$\text{Residential Customers}_{it} = \text{Residential Customers}_{i,t-1} \times (1 + \text{Sales Growth EIA}_t/2).$$

Case Study Illustration of the Allocation Process

The process of calculating rate impacts can be demonstrated by considering a case study. Tri-State is used to show how aggregate grid costs are allocated to determine rate impacts and why wholesale rates are not necessary in computing retail rate impacts. To demonstrate how rate changes are established, the grid cost impact under Alternative F in the highest impact year is used. On an aggregate basis, grid costs in this case increase by \$41 million (in real 2015 dollars) relative to Alternative A. Tri-State members had retail revenues of \$1.476 billion (computed from aggregating revenues for the Tri-State systems excluding the Nebraska members using the

database).²² Tri-State energy allocations represent 29.0% of the total SLCA/IP (derived from the allocation report and recorded in the database). The amount of grid cost increase allocated to Tri-State can be computed as 29.0% multiplied by the aggregate grid cost change of \$41 million, or \$11.89 million. Note this calculation is made without any wholesale rate calculations. This calculation implies that the increase in average retail rates for Alternative F in the high-impact year across Tri-State member systems is \$11.89 million/\$1,476 billion = 0.81%.

The same retail rate calculation can be made by first computing impacts on SLCA/IP wholesale rates. Using the current capacity and energy allocations, WAPA revenues collected from SLCA/IP power are current published rates multiplied by aggregate allocations. Total revenues from multiplying capacity charges by total SLCA/IP capacity and energy charges by total SLCA/IP energy, sum to approximately \$143 million. The total increase in wholesale rates would then be 28.67%, or \$41 million/\$143 million, if WAPA did not change capacity and energy allocations in the SLCA/IP tariff. Tri-State payments for wholesale power without the increase are the Tri-State allocation percent multiplied by total SLCA/IP revenues or $29.0\% \times \$143 \text{ million} = \41.47 million . For Tri-State, the increase in wholesale costs is $28.67\% \times \$41.47 \text{ million} = \11.89 million . Thus, the wholesale cost increase is the same whether it is calculated directly from aggregate grid costs as in the last paragraph or whether it is computed using wholesale rates as in this paragraph, and the \$143 million of revenues collected from wholesale rates is not necessary for computing retail rate impacts. The wholesale impact of \$11.89 million translates into the same retail impact of 0.81% discussed above. The example demonstrates that a large wholesale rate increase of 28.87% translates to a much smaller retail rate impact.

Rate Impact Measurement for American Indian Tribes

A detailed retail rate impact analysis has been prepared for American Indian Tribes. The analytical approach and results are described in Section K.4.

K.3.2 Results

Retail rate and residential bill changes are affected by the aggregate grid costs that occur under the various LTEMP alternatives relative to Alternative A. Once grid cost changes are established (that correspond to SLCA/IP wholesale rate changes), differential retail rate changes experienced by individual systems are affected by the amount of power that a system receives from SLCA/IP relative to total generation resource requirements of the system. The ratio of SLCA/IP allocation to retail sales for a particular system is termed the “preference ratio.” Measurement of aggregate grid cost and the effect of SLCA/IP allocation guide presentation of the rate analysis in this section. The first part measures the aggregate grid cost change relative to

²² By comparison, Tri-State’s wholesale revenues were \$1.019 billion in 2013, as reported in its Financial Report (Tri-State 2015).

wholesale revenues that are currently collected for SLCA/IP capacity and energy. Second, differential retail rates for individual systems are explained in the context of the preference ratio.

K.3.2.1 Grid Cost Changes Relative to WAPA Wholesale Revenues

Retail rate impacts of LTEMP alternatives relative to Alternative A are relatively small for individual utility systems. This is because grid cost impacts are spread over a wide consumer base and because SLCA/IP is only one out of a multitude of generating resources for the retail utility systems. Given the small rate impacts on retail systems, changes in annual grid costs relative to the total SLCA/IP revenues are introduced to provide a benchmark for comparing LTEMP alternatives. Table K.3-3 presents the average annual real grid cost increases per year from 2015 through 2035 (the LTEMP period) for LTEMP alternatives relative to Alternative A. (Grid costs that include capacity costs and production costs are defined in Section K.3.1.) Table K.3-3 shows that using the benchmark of wholesale revenues collected for SLCA/IP federal preference power, the increase in annual real grid costs divided by current wholesale revenues is as much as 20% for Alternative F. The grid cost increase is between 4% and 5% of current SLCA/IP wholesale revenues for Alternatives E and D. Capacity differences between the respective LTEMP alternatives and Alternative A, presented as the capital recovery of capacity costs, are the most important drivers of grid cost changes. The average annual capacity that is constructed under Alternative A that corresponds to the two right-most columns in Table K.3-3 is 2,701 MW.

TABLE K.3-3 Average Annual Grid Cost Relative to SLCA/IP Wholesale Revenues Relative to Alternative A

Alternative	Average Annual Grid Cost Increase Relative to Alternative A (in thousands of 2015\$)	WAPA Revenues from SLCA/IP Capacity and Energy Charges (in thousands of 2015\$)	Percentage Change Relative to WAPA Revenues	Average Capacity Differential Relative to Alternative A After 2017 (MW)	Maximum Capacity Differential in Single Year Relative to Alternative A (MW)
A		143,000	0.00%		-
B	(976)	143,000	-0.68%	(13.53)	(230.00)
C	9,820	143,000	6.87%	189.41	230.00
D	6,831	143,000	4.78%	121.76	230.00
E	6,392	143,000	4.47%	135.29	230.00
F	28,751	143,000	20.11%	392.35	460.00
G	17,218	143,000	12.04%	230.00	230.00

K.3.2.2 Retail Rate Changes for Individual Systems and SLCA/IP Power Relative to Total Resources

Variation among retail rate changes for individual utility systems under different LTEMP alternatives are driven in large part by the ratio of SLCA/IP energy allocation compared to the total generation resources required for the system. Using the database described in Section K.2.1.2, the proportion of SLCA/IP power to total resources can be measured by computing the ratio of SLCA/IP annual energy allocation to total retail sales. If this preference ratio is low for a retail utility system, then even a relatively large increase in SLCA/IP costs will probably have a small rate impact. Figure K.3-5 displays the range in preference ratios for individual systems, together with the size of the systems, in a scatter plot. The size of the system on the x-axis is represented by annual retail sales. The y-axis of the graph demonstrates that the range in preference ratio varies from less than 1% to more than 60% for different systems in the database. Points in the upper left corner of Figure K.3-5 demonstrate that most of the systems with high preference ratios are small. This is likely due to the history of allocations for preference power. If a system was small when it originally received a preference power allocation, but has subsequently grown large, it will have a relatively lower ratio of SLCA/IP allocation to retail sales (sales have increased and the SLCA/IP allocation has remained the same). On the other hand, if a system has not grown much since the original allocation was made (i.e., it is a small system with relatively low retail sales), the preference ratio could remain relatively high.

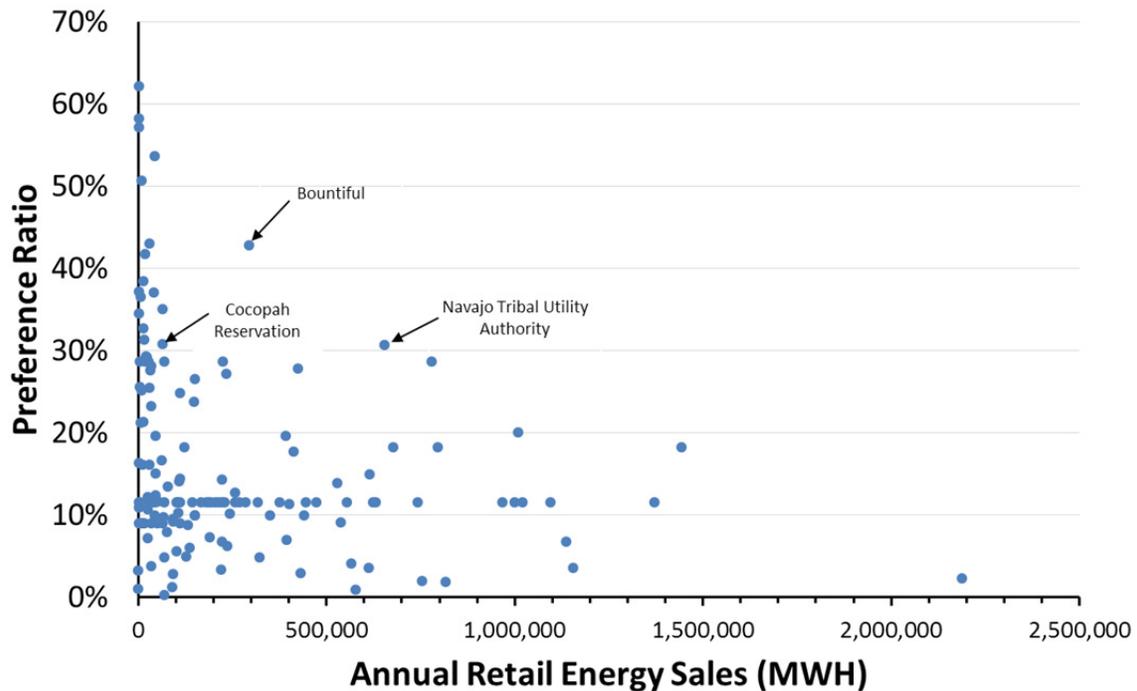


FIGURE K.3-5 Scatter Plot of Preference Ratio and Annual Retail Sales

Two of the Tribes that provide data to the EIA 861 database are highlighted in Figure K.3-5 as background for the rate impacts that are discussed in Section K.3.4.²³ The Navajo Tribal Utility Authority represents a large proportion (about 40%) of the SLCA/IP allocation to Tribes.²⁴ Figure K.3-5 shows that the Tribes with EIA data do have relatively high preference ratios. The only other utility system with a relatively high preference ratio that is not a very small system is the City of Bountiful, a member of UAMPS (highlighted in Figure K.3-5).

The relationship between the preference ratio and rate changes for individual systems is demonstrated by scatter plots of the percentage retail rate change and the preference ratio. In the scatter plots, the retail rate change is measured relative to Alternative A, implying that a scatter plot for Alternative A is not meaningful. Figure K.3-6 presents scatter plots of the preference ratio and the percent rate change relative to Alternative A for Alternatives B through G. In displaying the scatter plots for each LTEMP alternative relative to Alternative A, a single year is selected so that each system represents a single point. In each panel of Figure K.3-6, the year shown is the year with the highest rate impact for the respective LTEMP scenario. Because the highest rate changes do not occur in the same year for the various LTEMP alternatives, as explained in Section K.3.3.2, the scatter plots use different years.

The scatter plots shown in Figure K.3-6 demonstrate that much of the rate impact on individual systems is driven by the preference ratio. For each of the panels in Figure K.3-6, a regression equation of the percent retail rate change versus the preference ratio is displayed. The R^2 statistic displayed on each of the panels is 0.87. This indicates that 87% of the variation in percentage rate change can be explained by variation in the preference ratio. The 13% of variation in percentage retail rate changes that is not explained by the preference ratio represents other factors that include the level of retail rates, the load factor of the system, distribution costs, and the capacity and energy costs paid for non SLCA/IP power.

Scatter plots displayed in Figure K.3-6 have differently scaled y-axes. The y-axes represent the range in possible rate changes for the respective LTEMP alternative in the year with the highest (absolute value) percent change. The upper end of the y-axis therefore represents the absolute maximum retail rate percent increase for the LTEMP alternative across systems. Finally, regression equations are presented in each panel of Figure K.3-6 that shows the relationship between the preference ratio and the percent retail rate change in the year with the maximum change for each LTEMP alternative. These regression equations can be used to approximate rate impacts for systems that are not included in the database, as explained in the next section.

²³ Fifty-three different Tribal entities receive capacity and energy allocations from SLCA/IP, representing 8.85% of the total energy allocation. Because the Tribes do not report sales and revenues as part of Form EIA-861 database, accessing sufficient data to make individual rate impact assessments was not possible. Instead, the analysis focused on two Tribal systems: Navajo Tribal Utility Authority and the Cocopah Reservation.

²⁴ Retail data for the Navajo Tribal Utility Authority was derived from its Integrated Resource Plant (IRP) and Website (<https://ww2.wapa.gov/sites/western/es/irp/Documents/NTUA2012.pdf>) rather than from the EIA-861.

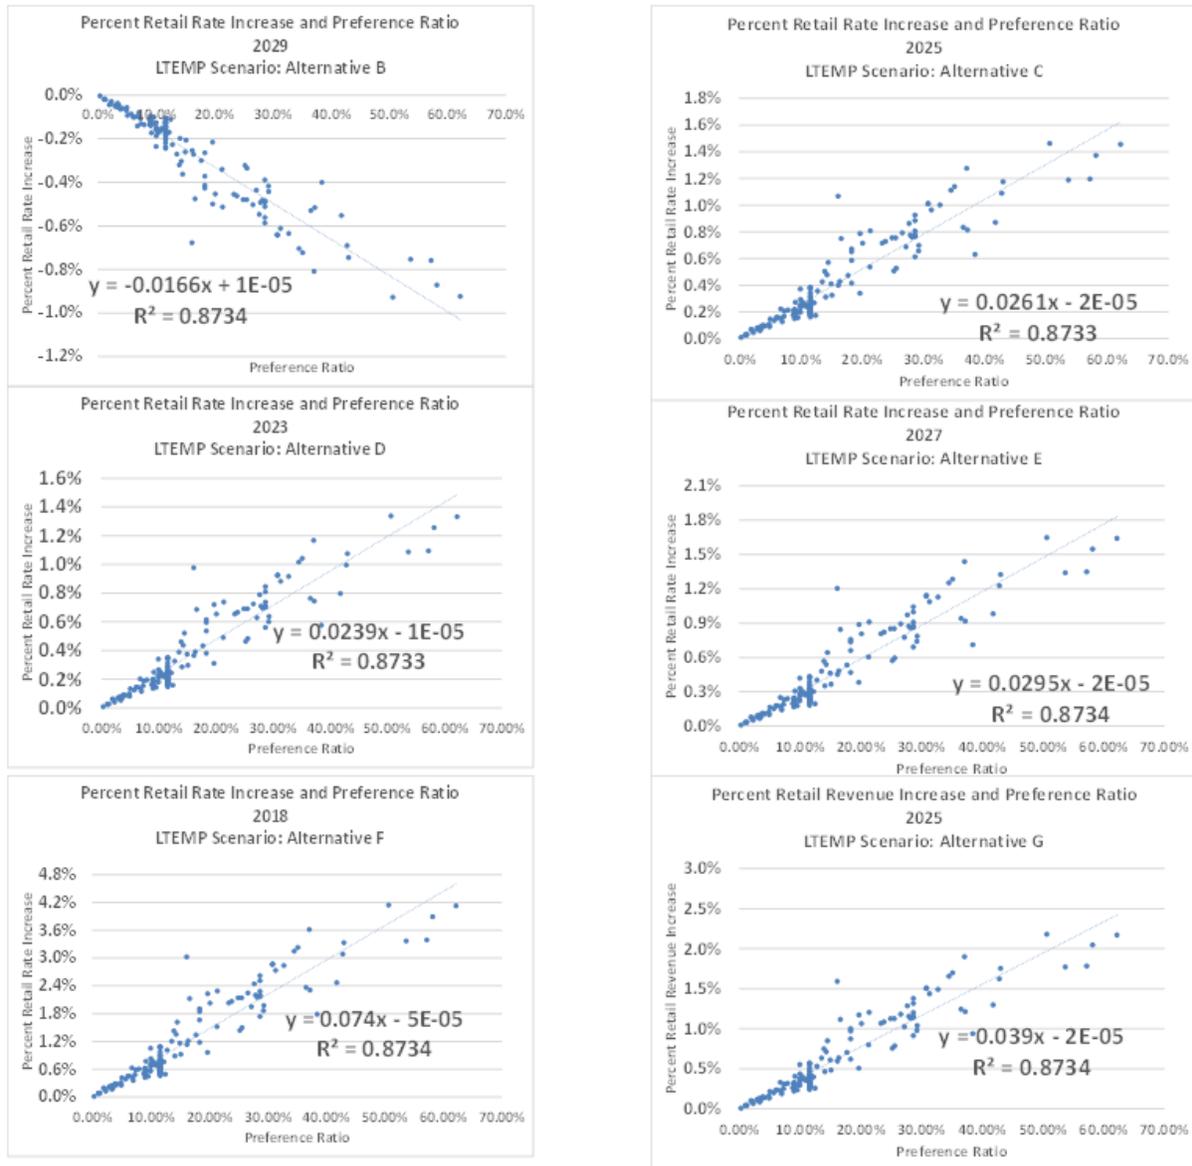


FIGURE K.3-6 Scatter Plots of Percent Retail Rate Change and the Preference Ratio

K.3.2.3 Using Regression Equations to Approximate Retail Rate Changes for Systems Not Included in the Database

For small Tribal systems and other entities that do provide retail sales and rate data to the EIA, the rate impacts can be approximated using the regression equations shown in Figure K.3-6. To compute rate impacts for systems that are not directly evaluated in the database, the preference ratio should be computed first through dividing annual SLCA/IP energy allocations by the retail electricity usage of consumers for the system. This preference ratio can then be multiplied by the coefficient shown in each of the panels of Figure K.3-6. For example, under Alternative F in the high-impact year, the coefficient is 0.074. If the ratio of SLCA/IP energy to

total energy consumption is 50% for an entity such as a U.S. Air Force base or for a Tribe that does not report to the EIA, the estimated rate increase would be 3.7% ($0.074 \times 50\%$).

K.3.3 Summary of Impacts

Retail rate and residential bill impacts under the LTEMP alternatives were compiled for 147 different utility systems during the LTEMP period, 2015 to 2035, on an annual basis. The retail rate impacts and the residential bill impacts under Alternatives B–G are presented relative to Alternative A. Due to the large number of retail utility systems that receive federal preference power and the number of LTEMP alternatives, various different techniques were used to summarize the rate impact results.

Rate and bill impacts are presented in four parts. First, the aggregate impacts are averaged across all systems and across the entire LTEMP period. Second, the impacts of LTEMP alternatives are presented on a year-by-year basis averaged across all systems. This section also includes a summary comparison of maximum-impact-year rate and bill impacts across different LTEMP alternatives. Third, rate and bill impacts for specific utility systems are listed under different LTEMP alternatives and the impacts under each LTEMP alternative are discussed. Fourth, the rate impacts on small systems and Tribes are explained.

K.3.3.1 Average Rate Impacts under LTEMP Alternatives over the 20-Year LTEMP Period

To demonstrate the general magnitude of rate impacts and evaluate the relative impact of different LTEMP alternatives on retail electricity rates, impacts are presented in terms of average impacts across utility systems and the LTEMP period. Before introducing the rate and bill impacts for Alternatives B, C, D, E, F, and G relative to Alternative A, retail rates and residential bills for Alternative A are described. The retail rates and residential bills under Alternative A provide a benchmark for gauging impacts of other alternatives. For example, a monthly residential bill increase of \$1.00 under a particular LTEMP alternative relative to Alternative A can be evaluated relative to the average and median monthly residential bills in Alternative A.

Figures K.3-7 and K.3-8 display retail rates in \$/MWh and residential bills in \$/month under Alternative A. Note that none of the tables and figures in this section include the impacts on Tribes that have special net benefit contracts. Rate impacts for Tribes with net benefit contracts are addressed in Section K.3.4.2. Figure K.3-7 shows the distribution of retail rates across the utility systems. Retail rates are computed by dividing retail revenues collected from residential, business and other consumers by retail sales for the consumers. Rates and bills are represented in Figures K.3-7 and K.3-8 with distribution analyses. The increments on the x-axes demonstrate the highest and lowest ranges for rates and bills across different systems. The average and the median statistics, as well as the ranges, are shown in the graph titles. The range in retail rates under Alternative A varies from \$55/MWh to \$177/MWh, with an average rate of \$104/MWh. The level of retail rates influences the reported rate increase percent in subsequent

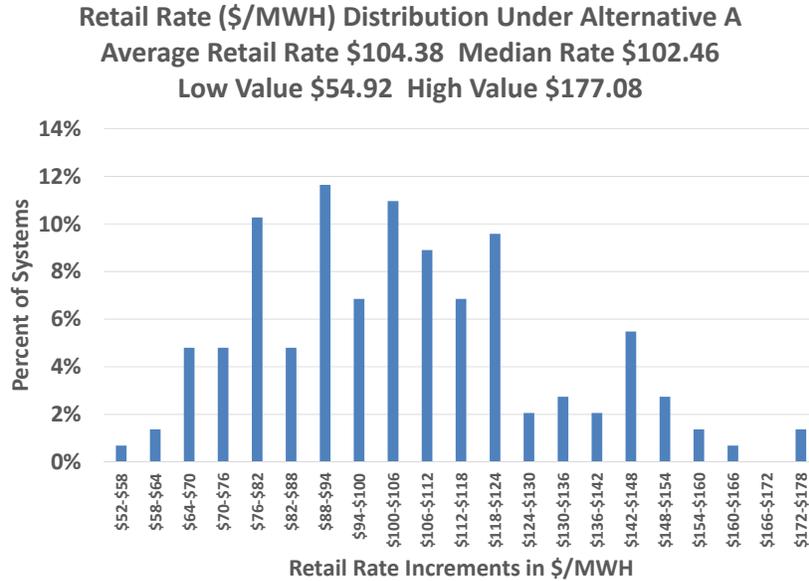


FIGURE K.3-7 Retail Rate Distribution under Alternative A

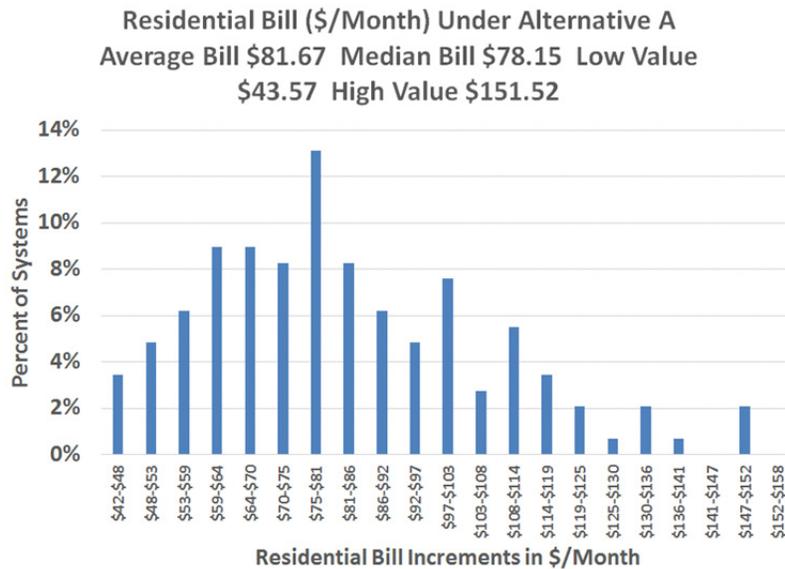


FIGURE K.3-8 Monthly Residential Bill Distribution under Alternative A

presentation of rate impacts. For example, a lower retail rate for a particular system results in a higher percent increase, all else being equal, because the allocated aggregated cost increase is divided by the retail rate. On the other hand, a lower retail rate does not influence the residential bill calculation because bill impacts are measured on an absolute basis.

Figure K.3-8 presents monthly residential bills that are calculated by dividing annual residential revenues of a system by the number of residential consumers and then dividing the product by 12. Average monthly bills under Alternative A range between \$44 and \$151 per month, with an average of \$82 per month. This implies that an increase of \$1 from an LTEMP alternative other than Alternative A results in a typical percent increase in monthly bills of somewhat more than 1%.

Figures K.3-9 and K.3-10 illustrate the average impacts on retail rate changes and on monthly residential bills across different systems relative to Alternative A. Residential bill impacts in Figure K.3-10 and in the rest of the subsequent rate impact presentation are measured in real 2015 dollars. The graphs in Figures K.3-9 and K.3-10 display averages across systems that are not weighted by the size of the systems. This means that a small system with less than 1,000 consumers is given the same weight as a large system with hundreds of thousands of customers (such as SRP). Because rate impacts tend to be greater for small systems, evaluating impacts using averages weighted by the sales size results in lower increases (about half of the unweighted average). Weighted average impacts are discussed in Section K.3.3.3 and presented in Table K.3-4. Figure K.3-9 demonstrates that even the most extreme LTEMP alternative in terms of changing dam operations (Alternative F) results in rate changes for retail consumers below 1%. Under Alternative F, there is an average rate increase of 0.75% relative to Alternative A. Figure K.3-10 shows that the highest average residential bill impact is 69 cents per month. Alternatives E and D have much lower retail rate impacts that are approximately 20% of the rate impact under Alternative F. (Note that individual rate impacts on particular systems can be higher than the average impacts.)

K.3.3.2 Average Year-by-Year Rate Impacts

Rate impacts presented in the previous paragraphs, which average rate and bill changes across the entire LTEMP period, mask the year-to-year rate impacts. Impacts in a single year can be different than average impacts across years because of the manner in which capacity changes occur and the effects of dam operations on production costs. Maximum rate impacts in a single year may be of concern to stakeholders. Therefore, the average annual retail rate and bill impacts from year to year are presented in this section. Figures K.3-11 and K.3-12 show the year-by-year averages for the overall retail percent changes and residential bill changes under different LTEMP alternatives. Year-by-year impacts for LTEMP alternatives are measured relative to Alternative A and the averages are not weighted by system size. Figure K.3-11 demonstrates that in terms of average percent changes in retail rates across all of the utility systems, the changes are not constant from year to year. Retail rate impacts from Alternative F are above the other alternatives, except in 2 of the years. The largest percent changes other than under Alternative F are under Alternative G, which has relatively constant changes over the LTEMP period. The

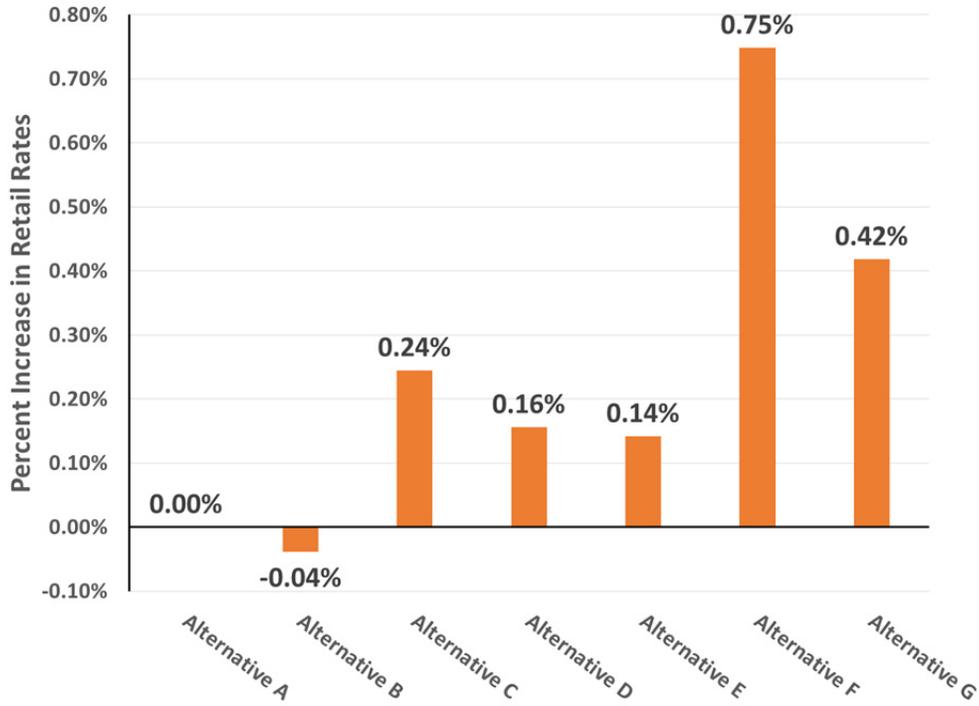


FIGURE K.3-9 Average Retail Rate Impacts under LTEMP Alternatives Relative to Alternative A

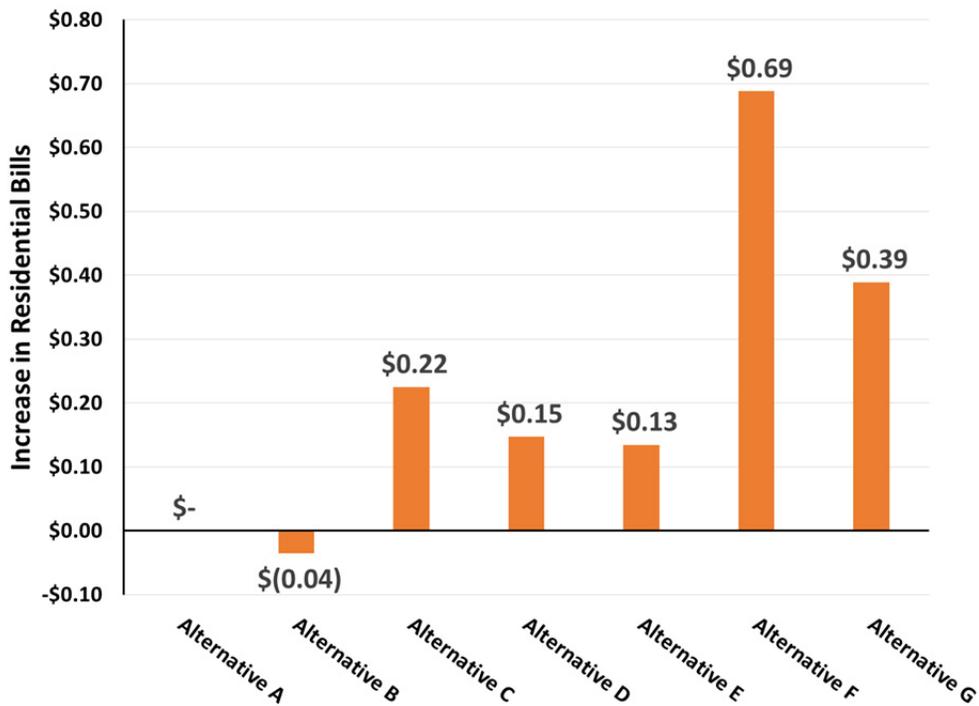


FIGURE K.3-10 Average Residential Bill Impacts under LTEMP Alternatives Relative to Alternative A

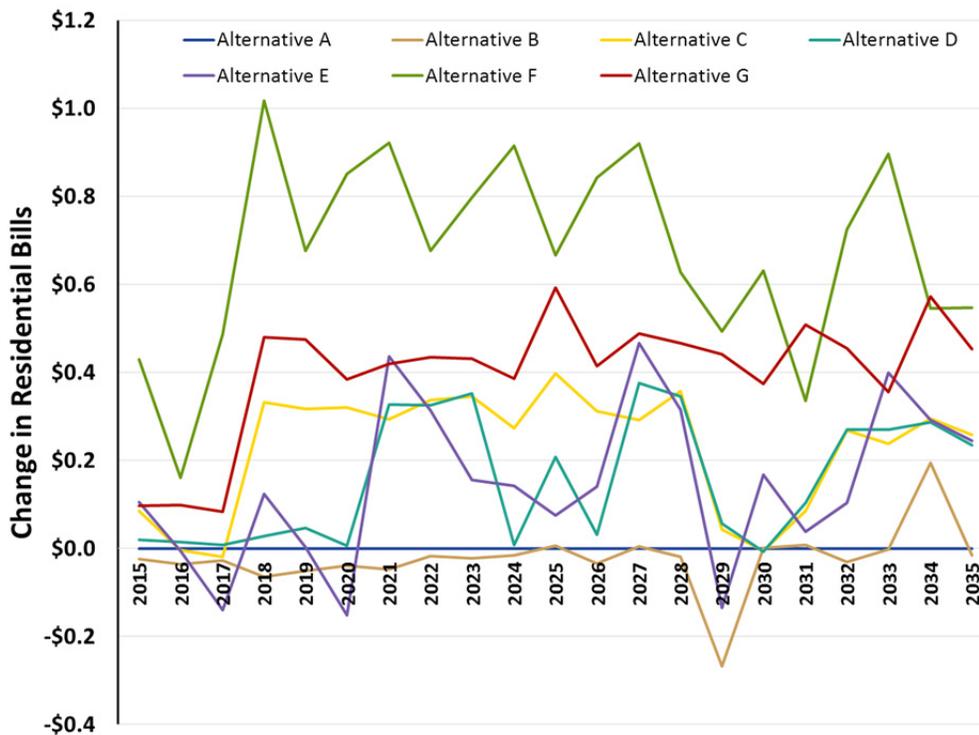


FIGURE K.3-11 Average Retail Percent Revenue Increase Relative to Alternative A

third-highest rate impacts are from Alternative C; these are constant until 2028, after which the impacts decline. Alternatives D and E have varying impacts from year to year that are driven by differences in construction of new capacity. Alternative B has impacts below zero (bill reductions relative to Alternative A), except in 2034, when construction of new capacity is accelerated relative to Alternative A. All of the tables and figures in this section include the Ak-Chin, Tohono O’odham Reservation, and Navajo Tribal Utility Authority Tribes but do not include the impacts on Tribes that have special net benefit contracts. Rate impacts for Tribes with net benefit contracts are addressed in Section K.3.4.2.

Figure K.3-12 shows that in terms of monthly bill changes from year to year, the annual patterns are similar to the trends in retail bill changes. The highest monthly bill impact in a single year is just above \$1.00 per month under Alternative F, relative to Alternative A in 2018. The year 2018 for Alternative F is termed the maximum impact year. For Alternative G, the maximum residential monthly impact is just below 60 cents per month in the year 2025. Impacts for the maximum year are presented in Table K.3-4. Figure K.3-11 also demonstrates that monthly bill impacts are more variable from year to year under Alternative E than other LTEMP alternatives. Alternative E has bill changes below zero in the years 2017, 2020, and 2029. The bill impacts are higher for Alternative E than Alternative D, but Alternative D does not have any impacts that are below zero.

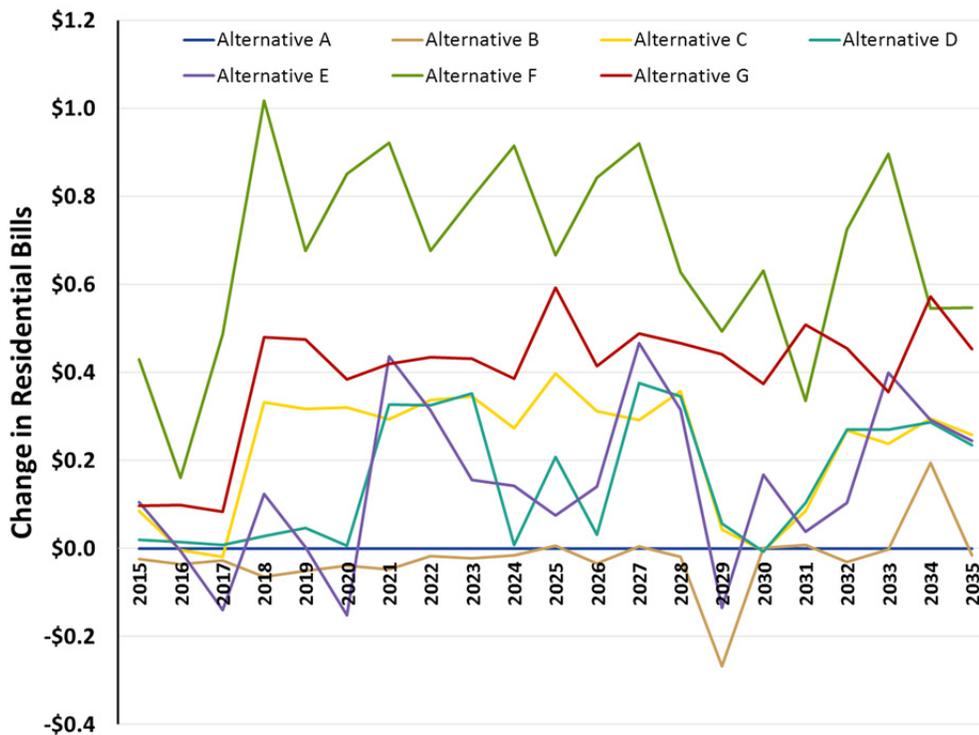


FIGURE K.3-12 Average Monthly Residential Bill Changes Relative to Alternative A

Maximum and average rate and bill impacts are recorded in Table K.3-4, which summarizes the average impacts across systems in the maximum impact year and over the LTEMP period. Unlike the impacts presented up to this point, Table K.3-4 also presents the averages and maximum impacts using an alternative weighting method where the size of different systems is considered. The weighting method places a higher weight on larger systems by multiplying all of the impacts by the ratio of retail sales for a system to aggregate retail sales across all systems. When averages are weighted by sales, the rate and bill impacts are approximately half of the amount without weighting. For example, the maximum monthly bill impact of \$1.02 per month under Alternative F in 2018 is reduced to 50 cents when small systems are given lower weight and larger systems are given higher weight. The large reduction in impacts from weighting by sales comes about in part because SRP and the City of Colorado Springs have low rate impacts and a very high level of sales relative to other systems. The sales of these two systems alone represent 45% of the total sales for all systems in the analysis. When weighting by sales, the weighting calculation shown in Table K.3-4 excludes SRP and the City of Colorado Springs in the aggregate sales tabulation.

In addition to displaying average impacts across years and average rate impacts in the maximum change year, median impacts are also shown in Table K.3-4. Median statistics show the rate or bill change for which 50% of companies are above the value and 50% are below the value. The median values are less affected by extreme high values or low values and result in

TABLE K.3-4 Summary Table of Comparative Values

Impact	Alternative A (No Action Alternative)	Alternative B	Alternative C	Alternative D (Preferred Alternative)	Alternative E	Alternative F	Alternative G
Percent change in average grid cost relative to WAPA revenues	No Change	-0.68	6.87	4.78	4.47	20.11	12.04
No Weighting by size							
Percent change in retail rates (average across years)	No Change	-0.04	0.25	0.15	0.14	0.75	0.42
Average percent change in retail rates (maximum impact year)	No Change	-0.27	0.43	0.39	0.50	1.21	0.64
Median percent change in retail rates (maximum impact year)	No Change	-0.20	0.27	0.25	0.30	0.76	0.40
Change in monthly residential bill (average across years)	No Change	-\$0.04	\$0.22	\$0.15	\$0.13	\$0.69	\$0.39
Average change in monthly residential bill (maximum impact year)	No Change	-\$0.27	\$0.40	\$0.38	\$0.47	\$1.02	\$0.59
Median change in monthly residential bill (maximum impact year)	No Change	-\$0.23	\$0.31	\$0.27	\$0.09	\$0.78	\$0.46
Weighting by size with adjustments for SRP and Colorado Springs							
Percent change in retail rates (average across years)	No Change	-0.03	0.19	0.12	0.11	0.59	0.33
Percent change in retail rates (maximum impact year)	No Change	-0.21	0.34	0.31	0.39	0.96	0.50
Median percent change in retail rates (maximum impact year)	No Change	-0.19	0.26	0.24	0.30	0.75	0.39
Change in monthly residential bill (average across years)	No Change	-\$0.03	\$0.18	\$0.12	\$0.11	\$0.56	\$0.32
Change in monthly residential bill (maximum impact year)	No Change	-\$0.25	\$0.32	\$0.31	\$0.38	\$0.83	\$0.48
Change in monthly residential bill (average across years)	No Change	-\$0.22	\$0.31	\$0.27	\$0.10	\$0.79	\$0.46

K-178

lower observed impacts because a few systems with high rate impacts skew the averages. The top half of Table K.3-4 shows data on an unweighted basis that have been shown above. The lower half shows weighted averages, including the median. The top part of Table K.3-4 demonstrates that the maximum impact is lower when measured by the median instead of the average. For example, under Alternative F, the maximum residential bill impact of \$1.02 that is averaged for all systems is more than 20% less (78 cents) when the median is used to measure the typical impact. The impact is further reduced when the impacts are weighted by sales size, as shown at the bottom of the table. Weighting by sales reduces the measured rate impact. For example, under Alternative G, the average retail rate increase is reduced from 0.64% to 0.50% when the average is weighted by adjusted sales size. When the median sales weighted statistic is measured, the number for the maximum year under Alternative G falls to 0.39%.

K.3.3.3 Individual System Impacts and Summary Descriptions of LTEMP Alternatives

This section addresses individual rate and bill impacts on particular systems rather than presenting results in terms of averages. Detailed rate impacts on selected individual utilities are presented separately for systems that experience relatively large and relatively small impacts. Four tables, Table K.3-5 through Table K.3-8, demonstrate the large and small individual impacts on different systems. The tables show the year with the maximum retail rate and monthly bill impact for each alternative relative to Alternative A. Using the lists of systems with the highest rate impacts and the graphs and tables from previous sections, each alternative is summarized.

Lists of Individual Systems with Largest and Smallest Impacts

Table K.3-5 lists the 30 systems with the largest percentage retail rate impact (in absolute value) for the LTEMP alternatives. Given the aggregate grid cost change from an LTEMP alternative, the retail rate impact for a particular system depends on the SLCA/IP energy allocation, the preference ratio, and the current retail rate. None of these three items change with different operations of the dam. This means the ranking of systems does not change under different alternatives and lists of systems with the largest and smallest impact can be presented on a single table. The percentage rate impact is shown under the letter of the respective alternative. The year of the maximum impact for which the retail rate impact is displayed is shown below the alternative title. Table K.3-6 displays the 30 systems with the smallest percentage retail rate impact in a similar format. The size of systems as measured by the number of residential consumers and the preference ratio is presented for each system. The year for which the impact is measured is also shown on Table K.3-5.

Many of the entities that experience the largest impacts are part of the UAMPS system and have a high ratio of preference power to sales. The systems with the highest rate impacts generally are relatively small, such as the City of Enterprise (with 517 consumers). The systems that experience the smallest impact are often large systems and have relatively low preference power ratios.

TABLE K.3-5 Individual Systems with the Largest Percent Retail Rate Impacts Relative to Alternative A

Number	Utility System	Preference Ratio	Number of Residential Consumers	Percent Rate Impact Relative to Alternative A					
				Alternative B 2029	Alternative C 2025	Alternative D 2023	Alternative E 2027	Alternative F 2020	Alternative G 2025
1	Beaver (UAMPS)	25.51	1,500	-0.48	0.76	0.69	0.85	2.14	1.13
2	Ephraim (UAMPS)	28.19	1,731	-0.48	0.76	0.70	0.86	2.15	1.13
3	Manti (UMPA)	28.65	1,274	-0.49	0.77	0.70	0.86	2.17	1.14
4	Murray (UAMPS)	27.89	13,977	-0.49	0.78	0.71	0.88	2.20	1.16
5	Spanish Fork (UMPA)	28.65	9,712	-0.49	0.78	0.71	0.88	2.20	1.16
6	Dixie Escalante R.E.A.	19.68	13,831	-0.50	0.79	0.72	0.89	2.23	1.17
7	Brigham City	26.57	6,643	-0.50	0.79	0.73	0.89	2.25	1.18
8	Provo (UMPA)	28.65	31,204	-0.51	0.81	0.74	0.91	2.29	1.20
9	Ocotillo I.D.	21.36	19	-0.51	0.81	0.74	0.91	2.29	1.21
10	Paragonah (UAMPS)	37.22	250	-0.52	0.82	0.75	0.92	2.31	1.22
11	Fairview (UAMPS)	36.53	714	-0.53	0.84	0.76	0.94	2.37	1.25
12	Flowell E.A., Inc. (Deseret)	27.66	194	-0.55	0.86	0.79	0.97	2.44	1.29
13	Morgan (UAMPS)	41.79	1,429	-0.55	0.87	0.80	0.98	2.47	1.30
14	Levan (UMPA)	28.65	317	-0.56	0.89	0.81	1.00	2.51	1.32
15	Nephi (UMPA)	28.65	1,890	-0.59	0.93	0.85	1.04	2.62	1.38
16	Parowan (UAMPS)	31.33	1,237	-0.61	0.97	0.88	1.09	2.73	1.44
17	Monroe (UAMPS)	32.73	916	-0.63	1.00	0.92	1.13	2.84	1.49
18	Navajo Tribal Authority	30.75	32,727	-0.64	1.01	0.92	1.14	2.86	1.51
19	Cocopah Reservation	30.83	3,334	-0.64	1.01	0.93	1.14	2.87	1.51
20	Helper	16.10	1,020	-0.68	1.07	0.98	1.20	3.03	1.59
21	Bountiful (UAMPS)	42.82	15,295	-0.69	1.09	1.00	1.23	3.09	1.62
22	Oak City (UAMPS)	34.51	260	-0.70	1.11	1.02	1.25	3.15	1.66
23	Gunnison	35.12	3,348	-0.72	1.14	1.04	1.29	3.23	1.70
24	Ak-Chin Municipal	43.03	282	-0.75	1.18	1.08	1.33	3.33	1.75
25	Truth or Consequences	53.69	3,572	-0.75	1.19	1.09	1.34	3.37	1.77
26	Holden (UAMPS)	57.22	215	-0.76	1.20	1.09	1.35	3.39	1.78
27	Maricopa MWCD	37.09	NA ^a	-0.81	1.28	1.17	1.44	3.62	1.90

TABLE K.3-5 (Cont.)

Number	Utility System	Preference Ratio	Number of Residential Consumers	Percent Rate Impact Relative to Alternative A					
				Alternative B 2029	Alternative C 2025	Alternative D 2023	Alternative E 2027	Alternative F 2020	Alternative G 2025
28	Kanosh (UAMPS)	58.20	284	-0.87	1.37	1.26	1.55	3.89	2.05
29	Meadow (UAMPS)	62.22	158	-0.92	1.46	1.33	1.64	4.13	2.17
30	Enterprise (UAMPS)	50.65	517	-0.93	1.46	1.34	1.65	4.14	2.18

^a NA = Not applicable (i.e., the system does not sell to residential consumers).

TABLE K.3-6 Individual Systems with the Smallest Percent Retail Rate Impacts Relative to Alternative A

No	Utility System	Preference Ratio	Number of Residential Consumers	Percent Rate Impact Relative to Alternative A					
				Alternative B 2029	Alternative C 2025	Alternative D 2023	Alternative E 2027	Alternative F 2020	Alternative G 2025
1	Frederick	0.26	3,453	0.00	0.01	0.01	0.01	0.01	0.01
2	Salt River Project	1.09	867,846	-0.02	0.03	0.02	0.03	0.08	0.04
3	Los Alamos County	0.98	7,792	-0.02	0.03	0.03	0.03	0.09	0.05
4	Wellton-Mohawk I.D.	1.24	2,768	-0.02	0.03	0.03	0.04	0.09	0.05
5	Intermountain R.E.A.	2.27	130,075	-0.03	0.05	0.04	0.05	0.13	0.07
6	Grand Valley E.C.	3.33	14,021	-0.04	0.06	0.05	0.07	0.17	0.09
7	Central Valley E.C., Inc.	2.04	5,180	-0.04	0.07	0.06	0.07	0.19	0.10
8	Lea County E.C., Inc.	1.89	6,759	-0.04	0.07	0.06	0.08	0.20	0.10
9	ELECTRICAL DISTRICT 3	3.54	19,561	-0.05	0.07	0.07	0.08	0.21	0.11
10	Washington (UAMPS)	2.89	5,578	-0.05	0.07	0.07	0.08	0.21	0.11
11	Farmers E.C., Inc.	2.93	9,739	-0.05	0.08	0.07	0.09	0.23	0.12
12	Colorado Springs Utilities	3.29	180,928	-0.05	0.09	0.08	0.10	0.24	0.13
13	Holy Cross E.A.	3.59	45,196	-0.06	0.09	0.08	0.10	0.25	0.13
14	Safford	4.91	3,378	-0.06	0.09	0.08	0.10	0.25	0.13
15	Yampa Valley Rural	4.15	21,670	-0.06	0.10	0.09	0.11	0.27	0.14
16	Santa Clara (UAMPS)	3.84	1,973	-0.06	0.10	0.09	0.11	0.29	0.15
17	Mesa (APPA)	4.85	13,257	-0.07	0.11	0.10	0.12	0.31	0.16
18	Navopache E.C., Inc.	6.96	34,867	-0.08	0.13	0.12	0.14	0.36	0.19
19	Torrington (WMPA)	5.66	3,163	-0.09	0.14	0.12	0.15	0.39	0.20
20	Glenwood Springs	5.00	4,779	-0.09	0.15	0.13	0.17	0.42	0.22
21	Fort Laramie (WMPA)	8.98	210	-0.10	0.15	0.14	0.17	0.43	0.22
22	Gallup	6.83	8,509	-0.10	0.15	0.14	0.17	0.43	0.23
23	Lamar Utilities Board	9.53	4,219	-0.10	0.16	0.14	0.18	0.45	0.24
24	Lehi (UAMPS)	6.26	14,146	-0.10	0.16	0.15	0.18	0.45	0.24
25	Kaysville (UAMPS)	6.01	7,929	-0.10	0.16	0.15	0.18	0.45	0.24
26	Sierra Electric Cooperative	11.56	3,595	-0.10	0.16	0.15	0.18	0.46	0.24
27	Tohono O'odham	9.20	3,036	-0.11	0.17	0.15	0.19	0.47	0.25
28	Thatcher	7.26	1,072	-0.11	0.17	0.15	0.19	0.48	0.25
29	Raton	12.46	3,645	-0.11	0.17	0.16	0.20	0.49	0.26
30	Sangre de Cristo Electric	11.56	10,756	-0.11	0.18	0.16	0.20	0.50	0.26

TABLE K.3-7 Individual Systems with the Largest Monthly Residential Bill Impacts Relative to Alternative A

No	Utility System	Preference Ratio	Number of Residential Consumers	Monthly Bill Impact (2015 \$) Relative to Alternative A					
				Alternative B 2029	Alternative C 2025	Alternative D 2023	Alternative E 2027	Alternative F 2020	Alternative G 2025
1	Bridger Valley E.A., Inc.	23.82	5,262	-0.43	0.63	0.56	0.74	1.62	0.94
2	Murray (UAMPS)	27.89	13,977	-0.43	0.63	0.56	0.74	1.62	0.95
3	Paragonah (UAMPS)	37.22	250	-0.43	0.64	0.56	0.75	1.63	0.95
4	Provo (UMPA)	28.65	31,204	-0.43	0.64	0.57	0.75	1.63	0.95
5	Gunnison	35.12	3,348	-0.46	0.69	0.61	0.81	1.76	1.03
6	Monroe (UAMPS)	32.73	916	-0.46	0.69	0.61	0.81	1.76	1.03
7	Salem (UMPA)	28.65	1,793	-0.47	0.70	0.62	0.82	1.79	1.04
8	Parowan (UAMPS)	31.33	1,237	-0.47	0.70	0.62	0.82	1.79	1.04
9	Nephi (UMPA)	28.65	1,890	-0.49	0.73	0.65	0.85	1.86	1.09
10	Spanish Fork (UMPA)	28.65	9,712	-0.49	0.73	0.65	0.86	1.88	1.10
11	Truth or Consequences	53.69	3,572	-0.50	0.74	0.66	0.87	1.90	1.11
12	Garkane Power Assn., Inc.	27.18	10,520	-0.50	0.75	0.66	0.87	1.91	1.11
13	Manti (UMPA)	28.65	1,274	-0.50	0.75	0.66	0.88	1.92	1.12
14	Page (AZ) +	24.91	3,492	-0.51	0.76	0.67	0.89	1.94	1.13
15	Morgan (UAMPS)	41.79	1,429	-0.52	0.78	0.69	0.91	1.99	1.16
16	Dixie Escalante R.E.A., Inc.	19.68	13,831	-0.53	0.79	0.70	0.93	2.02	1.18
17	Willwood	16.37	49	-0.55	0.81	0.72	0.95	2.07	1.21
18	Levan (UMPA)	28.65	317	-0.55	0.82	0.72	0.96	2.09	1.22
19	Holyoke	29.24	937	-0.55	0.82	0.73	0.96	2.09	1.22
20	Electrical District 3 (APPA)	14.49	975	-0.56	0.82	0.73	0.97	2.11	1.23
21	Oak City (UAMPS)	34.51	260	-0.57	0.84	0.74	0.98	2.15	1.25
22	Kanosh (UAMPS)	58.20	284	-0.61	0.90	0.80	1.05	2.30	1.34
23	Ocotillo I.D.	21.36	19	-0.66	0.98	0.87	1.15	2.52	1.47
24	Electrical District 3, Maricopa County	16.62	93	-0.71	1.05	0.93	1.23	2.69	1.57
25	Bountiful (UAMPS)	42.82	15,295	-0.76	1.13	1.01	1.33	2.90	1.69
26	Meadow (UAMPS)	62.22	158	-0.78	1.15	1.02	1.35	2.95	1.72
27	Holden (UAMPS)	57.22	215	-0.78	1.16	1.03	1.36	2.96	1.72
28	Enterprise (UAMPS)	50.65	517	-0.84	1.24	1.10	1.46	3.18	1.86
29	Flowell E.A., Inc. (Deseret)	27.66	194	-0.92	1.37	1.22	1.61	3.51	2.05
30	Ak-Chin Municipal	43.03	282	-1.39	2.07	1.83	2.42	5.29	3.08

TABLE K.3-8 Individual Systems with the Smallest Monthly Residential Bill Impacts Relative to Alternative A

No	Utility System	Preference Ratio	Number of Residential Consumers	Monthly Bill Impact (2015 \$) Relative to Alternative A					
				Alternative B 2029	Alternative C 2025	Alternative D 2023	Alternative E 2027	Alternative F 2020	Alternative G 2025
1	Maricopa County	37.09	NA ^a	0.00	0.00	0.00	0.00	0.00	0.00
2	Frederick	0.26	3,453	0.00	0.01	0.01	0.01	0.02	0.01
3	Los Alamos County	0.98	7,792	-0.02	0.02	0.02	0.03	0.06	0.03
4	Wellton-Mohawk I.D.	1.24	2,768	-0.03	0.04	0.03	0.05	0.10	0.06
5	Salt River Project	1.09	867,846	-0.03	0.04	0.04	0.05	0.11	0.06
6	Intermountain R.E.A.	2.27	130,075	-0.04	0.06	0.05	0.07	0.16	0.09
7	Washington (UAMPS)	2.89	5,578	-0.04	0.07	0.06	0.08	0.17	0.10
8	Lea County E.C., Inc.	1.89	6,759	-0.05	0.07	0.06	0.08	0.17	0.10
9	Central Valley E.C., Inc.	2.04	5,180	-0.05	0.07	0.06	0.08	0.18	0.11
10	Farmers E.C., Inc.	2.93	9,739	-0.05	0.08	0.07	0.09	0.20	0.12
11	Colorado Springs Utilities	3.29	180,928	-0.06	0.08	0.07	0.10	0.21	0.12
12	Grand Valley E.C.	3.33	14,021	-0.06	0.09	0.08	0.10	0.22	0.13
13	Glenwood Springs	5.00	4,779	-0.07	0.10	0.09	0.11	0.25	0.15
14	Yampa Valley Rural	4.15	21,670	-0.07	0.10	0.09	0.12	0.25	0.15
15	Gallup	6.83	8,509	-0.07	0.10	0.09	0.12	0.27	0.16
16	Navopache E.C., Inc.	6.96	34,867	-0.08	0.11	0.10	0.13	0.29	0.17
17	Safford	4.91	3,378	-0.08	0.12	0.10	0.14	0.30	0.17
18	Torrington (WMPA)	5.66	3,163	-0.08	0.12	0.11	0.14	0.31	0.18
19	Holy Cross E.A.	3.59	45,196	-0.08	0.12	0.11	0.14	0.31	0.18
20	Fort Laramie (WMPA)	8.98	210	-0.09	0.13	0.11	0.15	0.33	0.19
21	Price	7.93	4,460	-0.09	0.13	0.11	0.15	0.33	0.19
22	Mesa (APPA)	4.85	13,257	-0.09	0.13	0.12	0.15	0.33	0.19
23	Santa Clara (UAMPS)	3.84	1,973	-0.09	0.14	0.12	0.16	0.35	0.20
24	ELECTRICAL DISTRICT 3	3.54	19,561	-0.09	0.14	0.12	0.16	0.36	0.21
25	Lusk (WMPA)	8.98	931	-0.09	0.14	0.12	0.16	0.36	0.21
26	Mora-San Miguel	11.56	10,575	-0.10	0.15	0.13	0.18	0.38	0.22
27	Lehi (UAMPS)	6.26	14,146	-0.10	0.15	0.13	0.18	0.38	0.22
28	Farmington	6.73	34,037	-0.10	0.15	0.14	0.18	0.39	0.23
29	Cody (WMPA)	8.98	5,894	-0.10	0.15	0.14	0.18	0.39	0.23
30	Kit Carson Electric	11.56	24,309	-0.11	0.17	0.15	0.19	0.42	0.25

^a NA = Not applicable.

Tables K.3-7 and K.3-8 list the systems with the highest and lowest residential monthly retail bill impacts in a similar format to the percent retail rate change tables. As with Tables K.3-5 and K.3-6, the impacts are shown for Alternatives B–G relative to Alternative A. The ranking of residential bill impacts is not the same as the rank of the retail percent increase. One of the reasons for differences in ranking is due to residential use variation among individual systems. Systems with lower residential use have a higher bill impact because grid costs are spread over a smaller base, all else being equal. Differences in residential usage are evidenced by the fact that the median average usage across the different systems is 730 kWh per month, while the maximum use for a single system is 1,680 kWh per month, and the system with the lowest annual residential usage is 391 kWh per month.²⁵ The ranking of retail percent impacts and monthly residential bill impacts also differs because residential bills are measured in absolute rather than in percentage terms. If two utility systems have the same overall percentage rate increase, but one system has a higher level of prices and higher residential bills, that system will have a higher residential bill impact relative to the percentage impact. For example, Ak-Chin has a higher ranking for bill impacts than for retail rate change impacts. This utility system has a small number of residential customers and a relatively high level of consumer bills. In 2012, the average monthly bill of Ak-Chin was about \$140, which is 69% higher than the average bill across all systems of \$84 per month.

K.3.4 Impacts on Small Systems

Two groups of utilities that are allocated a large fraction of their generation resources from SLCA/IP projects are Tribes and some small utilities, implying that the rate and bill impacts on these two groups tend to be relatively large. Impacts on small systems are presented separately in this section. Impacts on Tribes are presented in Section K.4.

To demonstrate the effect of system size on rate impacts, statistics were computed for the 20 systems with the largest impact and the 20 systems with the smallest impacts. Table K.3-9 demonstrates that, as measured by the number of residential consumers, the average size of systems with the largest rate impacts (1,680 consumers) is much smaller than the typical size of utility systems. Without adjusting for SRP and Colorado Springs, utilities with the smallest rate impacts are on average 38 times the size of the systems that have the largest rate impacts. When the two large systems are removed, the systems with the smallest impacts are still about 10 times larger than the systems with the largest percent rate increases.

The comparatively high retail rate increases on some small utility systems under the LTEMP alternatives are shown in Table K.3-10. This table shows average retail rate impacts under different alternatives relative to Alternative A for the selected groups of utility systems. In comparing rate impacts, the maximum impact year is used. The 20 systems with the largest impact have an average rate increase that is 2.52 times the average rate increase percent across all systems. On the other hand, the 20 systems with the smallest impact have an average rate

²⁵ These figures are averages for a system and do not account for the distribution of usage within the systems.

TABLE K.3-9 Size and Preference Ratio for Utility Systems with Large Rate Impacts

Statistics for Impact Analysis on Small Systems					
Group of System	Rate Impact Relative to Average	Residential Customers	Size Relative to Large Impact Systems	Preference Ratio	Preference Ratio Relative to Average
Utilities with Largest Rate Impact ^a	2.52	1,680	1.00	38.83%	2.36
Utilities with Smallest Impact ^b	0.18	69,099	41.13	3.24%	0.20
Utilities with Smallest Impact Excluding SRP and CS	0.20	17,096	10.18	3.81%	0.23
Average of All Systems	1.00	16,567.69	9.86	16.43%	1.00

^a Includes 20 systems with largest impact except Tribes.

^b Includes 20 systems with smallest rate impact.

TABLE K.3-10 Rate Impacts for Selected Groups in Maximum Impact Year

Alternative	Largest Retail Rate Change Group in Maximum Impact Year (%)	Smallest Retail Rate Change Group in Maximum Impact Year (%)	Average Retail Rate Change Across All Systems in Maximum Impact Year (%)	Rate Impact for Largest Group/ Average Rate Impact (\$)
A	0.00	0.00	0.00	–
B	–0.56	–0.09	–0.27	2.08
C	1.08	0.09	0.43	2.52
D	0.98	0.07	0.39	2.52
E	1.21	0.09	0.50	2.44
F	3.05	0.22	1.21	2.52
G	1.60	0.12	0.64	2.52

increase that is a small fraction of the average rate increase for the entire population of systems. Finally, Table K.3-10 illustrates that the preference ratio is highly correlated to the rate increase.

K.3.5 Alternative-Specific Impacts

K.3.5.1 Alternative A

Under Alternative A, SLCA/IP marketable capacity is 737.2 MW using an assumed water flow rate that is low enough that one can be 90% confident that the rate will be exceeded. Average annual daily generation and hydropower value at Glen Canyon Dam and SLCA/IP marketable capacity would not change under Alternative A. Rate impacts for each LTEMP alternative are computed relative to this alternative, meaning that the difference between two cases must be used to evaluate the change in rates.

Retail rates and residential bills are computed for Alternative A using inflation rates and sales growth from EIA forecasts (Figure K.3-13). Production costs, fixed O&M costs associated with new capacity, and the cost of new capacity from Alternative A are used as the basis for evaluating aggregate grid cost impacts for the other LTEMP scenarios.

K.3.5.2 Alternative B

Under Alternative B, rates and bills would be lower than under all other alternatives. Production costs are lower under Alternative B than under Alternative A, and there is a minor difference in the amount of capacity added for 1 year. Although the total amount of capacity added over the 20-year LTEMP period is the same as in Alternative A, a 1-year delay in constructing a new natural-gas-fired combustion turbine is projected in the power systems analysis for the year 2029. This delay in capacity additions and the difference in production cost accounts for the slightly lower annual average grid cost for Alternative B compared to Alternative A. The difference in annual grid costs averages \$976 thousand per year (real 2015\$).

When the annual grid cost reduction is translated to impacts on electric bills, the average retail rate decrease over the LTEMP period is -0.039%. The maximum rate decrease occurs in the year of the capacity deferral, 2029. The percent decrease in this year with the deferred capacity (the maximum impact year) is -0.27%. Table K.3-5 shows that the individual systems with the maximum impact have decreases that range between -0.48% and -0.93%. The average decrease in monthly residential bills over the LTEMP period is 4 cents per month, while the decrease in 2029 is 27 cents per month.

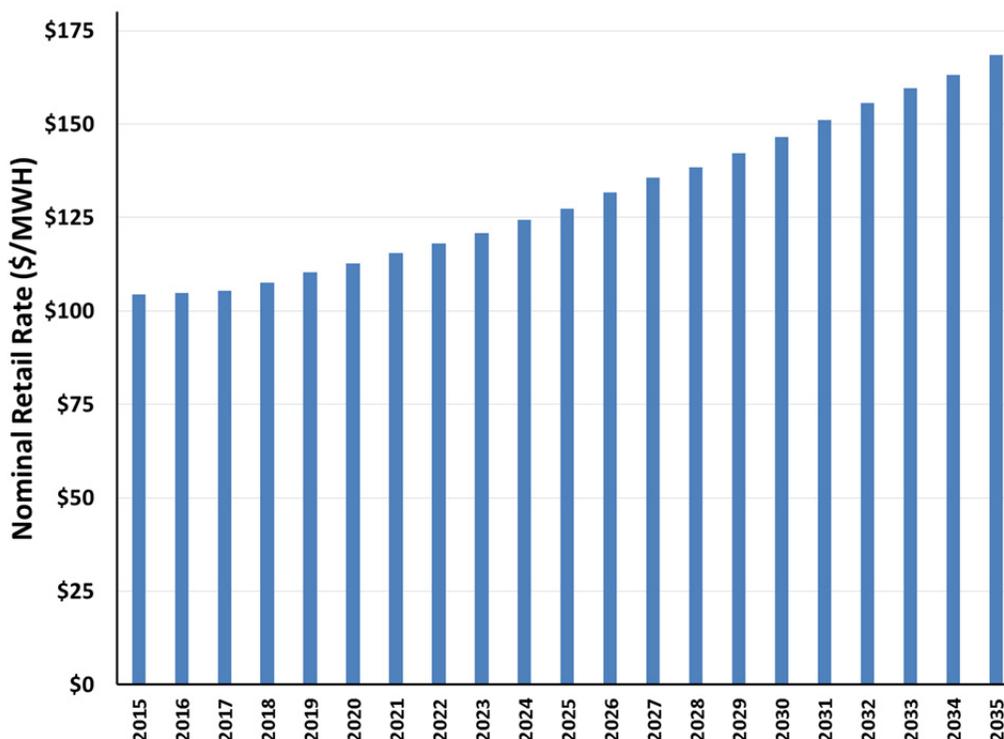


FIGURE K.3-13 Retail Rates under Alternative A

K.3.5.3 Alternative C

Retail rate increases under Alternative C relative to Alternative A are primarily driven by an increase in capacity of 230 MW that occurs for most years after 2018. This capacity increase is more than the reduction in marketable capacity of 129.1 MW. Replacement of the lost capacity and increased production costs results in varying grid cost impacts over the LTEMP period. Average grid impacts in real 2015 dollars are \$9.8 million per year relative to Alternative A. These impacts are less than under Alternative F and Alternative G, but more than under Alternatives D, E, or B. The increase of \$9.8 million in grid costs represents an increase of 6.87% relative to the annual wholesale revenues currently collected from SLCA/IP capacity and energy charges. When the wholesale grid cost of 6.87% is converted into retail rates, the averages across all systems and years range from a low of 0% to a high of 0.428% in 2025. The average percent retail rate increase across all systems for the LTEMP period is 0.245%. For the year 2025, which is the year with the maximum percent rate impact shown in Table K.3-5, individual systems experience percentage impacts ranging from less than 0% up to 1.46%.

Monthly residential bill impacts under Alternative C relative to Alternative A range from 0 to 40 cents for the LTEMP period. The average increase in residential bills is 22 cents per month. Detailed residential bill impacts under Alternative C for the maximum year are shown in Table K.3-6. Residential bill impacts in the highest impact year (2025) are not much higher than the results from Alternative D discussed in the next section. However, the average impacts under

Alternative C are 43% greater than the impacts under Alternative D. For the maximum impact year 2025, the range in residential bill impacts ranges between approximately \$0 (4 cents for SRP consumers) and \$2.07 per month (Ak-Chin Electric Municipal).

K.3.5.4 Alternative D

Retail rate increases under Alternative D relative to Alternative A are primarily driven by a reduction in capacity of 230 MW in most years. Replacement of capacity and increased production costs result in varying grid cost impacts on a year-by-year basis. Average grid impacts in real 2015 dollars are \$6.8 million per year. When translated to retail rates, the impacts as an unweighted average across all systems range from 0% to a high of 0.391% in 2023. The average retail rate increase across all systems for the LTEMP period is 0.156%. For the maximum impact year 2023, individual systems experience percentage impacts ranging from 0% to 1.38%, as shown in Tables K.3-5 and K.3-6. The maximum impact retail rate increase is lower for Alternative D than for any other alternative analyzed except Alternatives B and A.

The impacts measured in terms of residential bills for individual systems in the maximum impact year are shown in Tables K.3-6 and K.3-7. Residential bill impacts under Alternative D relative to Alternative A, measured in 2015 dollars per month, range from 0 to 38 cents over the LTEMP period. The bill increase of 38 cents per month in the high-impact year is less than the bill increase in the high-impact year of 47 cents under Alternative E. The average increase in residential bills over the LTEMP period is 15 cents per month. For the year 2023, with the maximum bill impact, the range in residential bill impacts is between 0 and \$1.83 per month.

K.3.5.5 Alternative E

Retail rate increases under Alternative E relative to Alternative A are primarily driven by an increase in capacity of 230 MW that occurs in 10 out of the 20 years of the evaluation, the average of which is more than the reduction in marketable capacity change of 90.21 MW. Replacement of the lost capacity and increased production costs results in varying grid cost impacts over the LTEMP period, some of which are lower than rates and bills under Alternative A. Average grid impacts are \$6.4 million per year, which is lower than any of the LTEMP alternatives except Alternatives A and B. When the grid cost is converted into retail rates, the average across all systems and years range from changes that are below zero in years with no capacity change, to a high of 0.497% in 2027. The average percent retail rate increase across all systems for the years 2015 to 2035 is 0.142%. When compared to Alternative D, the average increase across the LTEMP period is slightly less, but the impact in the maximum year is slightly more. For the year 2027, which is the year with the highest rate impact, individual systems experience percentage impacts ranging from 0.03% (SRP) to 1.65% (City of Enterprise).

Residential bill impacts under Alternative E relative to Alternative A range from amounts that are below zero to 47 cents over the LTEMP period. The average increase is 13 cents per month. For the year 2027 with the maximum bill impact, the range in residential bill impacts is between 5 (SRP) and \$2.42 per month (Ak-Chin Municipal Electric).

K.3.5.6 Alternative F

Retail rate increases under Alternative F relative to Alternative A are driven by increases in capacity of either 230 MW or 460 MW in various years, as well as varying amounts of production cost increases. The increase in capacity compares to the reduction in marketable capacity of 314 MW. The average grid cost increase under Alternative F is \$28.7 million per year. This is much higher than any of the other LTEMP alternatives and equates to 20.11% of the \$143 million in SLCA/IP wholesale revenues. The average retail rate increase reaches a high of 1.21% in 2018 and the average percent retail rate increase over the LTEMP period is 0.75%. When compared to the next highest impact scenario, Alternative G, the average impact is almost double. For the year 2018, the year with the maximum rate impact, individual systems experience percentage impacts ranging from 0.08% (SRP) to 4.14% (City of Enterprise, a member of UAMPS), as shown in Tables K.3-5 and K.3-6.

Residential bills under Alternative F that result from the grid cost increases are higher than bills under Alternative A in all years and are \$1.02 in the maximum impact year. The average increase in residential bills over the LTEMP period is 69 cents per month. For the year 2018, with the maximum bill impact, the range in residential bill impacts is between 11 cents (SRP) and \$5.29 (Ak-Chin Municipal Electric) per month.

K.3.5.7 Alternative G

Retail rate increases under Alternative G relative to the Alternative A are driven by an increase in capacity of 230 MW that occurs from the year 2018 forward, as well as production cost increases. The increase in capacity of 230 MW is more than the reduction in marketable capacity of 179 MW. Average grid cost increases by \$17.2 million per year, which is higher than any of the LTEMP alternatives except Alternative F. The average retail rate increase across all systems and years is above zero in all years and reaches a high of 0.638% in 2025. Across the LTEMP period and all systems, the rate increase is 0.418%. When compared to Alternative C, the average increase is almost double and the impact in the maximum year is also higher because of higher production costs. For the year 2025, which is the year with the highest rate impact in this scenario, individual systems experience percentage impacts ranging from 0.04% (SRP) to 2.18% (City of Enterprise).

Residential bill impacts under Alternative G have a high of 59 cents, while the average increase in residential bills is 39 cents per month over the LTEMP period. For the year 2025, with the maximum bill impact, the range in residential bill impacts is between 6 cents (SRP) and \$3.08 (Ak-Chin Municipal Electric) per month as shown in Tables K.3-7 and K.3-8.

K.4 FINANCIAL IMPACTS OF LTEMP ALTERNATIVES ON AMERICAN INDIAN TRIBES

The purpose of this section is to estimate the financial impact of LTEMP alternatives on American Indian Tribes that receive an allocation of SLCA/IP electrical power. This section also

compares the estimated financial impacts on these Tribes to the estimated financial impacts on other WAPA FES customers in the SLCA/IP marketing area to see how Tribal financial impacts compare with the financial impacts on others.

WAPA's post-2004 marketing plan purposely provided SLCA/IP power allocations to over 50 Tribes in its marketing area who historically had not been able to receive the financial benefits of federal hydropower. WAPA normally requires its customers to operate electric utilities, and most Tribes do not meet that requirement. Tribes are preference power customers. In order to encourage widespread use of federal hydropower, WAPA made administrative changes to allow numerous Tribes to receive an allocation of power and the associated financial benefits. There are 57 Tribes or Tribal entities who currently receive an allocation of SLCA/IP power (directly or indirectly) from WAPA.

The impact of the alternatives ranges from almost no impact to over \$3 million in financial costs for the Tribes, with the average financial impact of all the alternatives being \$1.345 million per year. Tribes may be financially impacted in three ways by the LTEMP alternatives:

- Tribes that operate their own utilities may see a change in the rate they pay for SLCA/IP power.
- Tribes that do not operate their own electric utility and have entered into benefit crediting arrangements with another utility to take their allocation, and instead receive an economic benefit from that utility, may see a change in the economic benefit, essentially a change in payment received from that other utility.
- Tribes that have entered into an economic benefit with a utility that also receives SLCA/IP power may see their economic benefit crediting payments change and may experience changes in the retail rates charged to Tribal members.

There are currently 57 Tribes and Tribal entities that received a power allocation from the SLCA/IP resources. The analysis in this report assumes that each of these Tribes will continue to receive its current allocation under each alternative of the LTEMP EIS. Nine of these Tribes operate electric utilities and receive power directly from WAPA. The remaining 48 Tribes are not electrical utilities but still receive the benefits of federal hydropower through benefit crediting arrangements with SLCA/IP customers or other electric utilities.

The purpose of benefit crediting is to provide a Tribe with the financial benefits associated with SLCA/IP power—a low-cost capacity and energy resource. This benefit is usually provided to the Tribe by an electrical service provider (supplier) that serves the area in which the Tribe is located. The benefit received by the Tribe is in lieu of a direct delivery of power by WAPA. It is intended to be the financial equivalent of a direct delivery. Because the SLCA/IP rate is generally lower than the supplier's production cost of electrical power, the difference between these costs is considered the benefit per megawatt-hour received by the

Tribe. This cost difference is multiplied by the Tribe's megawatt-hour allocation of SLCA/IP power. The product of these two numbers is the dollar benefit to the Tribe for an SLCA/IP allocation. The supplier provides the Tribe with a dollar benefit. The equation used to determine the benefit is similar to the following:

$$\text{Benefit} = \text{SLCA/IP Allocation} \times (\text{Supplier rate} - \text{SLCA/IP rate}) \quad (\text{Eq. 1})$$

Where:

- Benefit = the financial benefit received by the Tribe from the electric service provider (\$),
- SLCA/IP Allocation = SLCA/IP allocation to the Tribe in the post-2004 marketing period (MWh),
- Supplier rate = average production cost (i.e., large customer retail rate) or purchase cost of the electrical supplier (\$/MWh), and
- SLCA/IP rate = the composite SLCA/IP FES rate (\$/MWh).

K.4.1 Contractual Requirements for Calculating and Delivering Benefits to Tribes

In order to accommodate the post-2004 allocations of SLCA/IP electrical power to Tribes, WAPA contracted with seven electrical wholesale utility customers (suppliers) to establish benefit crediting arrangements, which would allow the Tribes that did not operate electric utilities to benefit from a federal hydropower allocation. WAPA and the individual Tribes made arrangements with one of the following entities:

- Public Service Company of New Mexico,
- Navajo Tribal Utility Authority,
- Page Electric Utility,
- Tri-State Generation and Transmission Association,
- Salt River Project,
- Ak-Chin Indian Community
- Deseret Generation and Transmission.

Each of these suppliers calculates the financial benefit of a Tribe's SLCA/IP power allocation according to language in three-party contracts among WAPA, the supplier, and the Tribe. The contractual language varies somewhat for each supplier. The contract for Tribal payment is typically based on the economic cost savings for the primary load serving entity. These savings are based on formulas in contracts between WAPA and the entities that compute the avoided cost of supplying the Tribal load that is ultimately served by WAPA. Essentially, the benefit each Tribe receives is the difference between the supplier's value of electrical energy and the SLCA/IP wholesale rate multiplied by the Tribe's SLCA/IP allocation. These benefit crediting arrangements are intended to capture the approximate benefit a Tribe would receive from an allocation of SLCA/IP power if it were able to receive it directly to serve its own electric load.

K.4.2 Calculation of Tribal Benefit Baseline under Alternative A (No Action Alternative)

Attachment K.11 lists the Tribes that receive an allocation of SLCA/IP electrical power, the amount of electrical capacity and energy the Tribe is currently allocated (by season), and the utility that serves the Tribal reservation or Tribal lands.

The Tribal benefit was calculated for Alternative A. Note that this benefit calculation differs somewhat from the benefit currently received by the Tribe for two reasons:

- The SLCA/IP rate developed by WAPA for Alternative A is marginally higher than the actual current SLCA/IP rate.
- The electrical rate of the supplier is estimated in several cases. WAPA's contracts may refer to "average generation cost" or to the "Class A rate," but the rate of the supplier is typically not quantitatively specified in the contract language. Therefore, the published rates for the seven suppliers that best conformed to the current contract description were used.

With these data, the calculation of the Tribal economic benefit was determined by inputting the relevant rates and Tribal allocations into Equation 1. It includes both capacity and energy components. This calculation was performed for each Tribe that has entered into a benefit crediting contract. This was not done for the nine Tribes that operate utilities; they do not receive a benefit credit because they directly receive an SLCA/IP allocation.

K.4.3 Calculation of Change in Tribal Benefit as a Result of LTEMP EIS Alternatives

Figure K.4-1 illustrates the method that was used for evaluating the impacts of LTEMP alternatives on the benefit for each Tribe.

The power economic impacts for the EIS are described in Section K.1. WAPA used these data to estimate the SLCA/IP FES rate for each alternative. The method used the results that are described in Section K.2. The financial benefit was computed for each Tribe for each alternative using the estimated SLCA/IP rate for each alternative, the estimated supplier's rate, and the Tribal allocations listed in Attachment K.11.

A simplifying assumption was used in this analysis. The Tribal allocations used for the analysis (and listed in Attachment K.11) are SLCA/IP commitment levels from the current marketing plan. This plan expires at the end of FY 2024. It was assumed that these commitment levels would continue through the LTEMP period, which extends through 2035. It should be emphasized that this is an analysis, not a description of policy or attempt to predict WAPA's post-2024 marketing plan. Although it is a reasonable assumption for the purposes of this analysis that WAPA will continue existing commitment levels after 2024, the reader should not assume that WAPA will or will not maintain these levels when the new marketing plan is finalized.

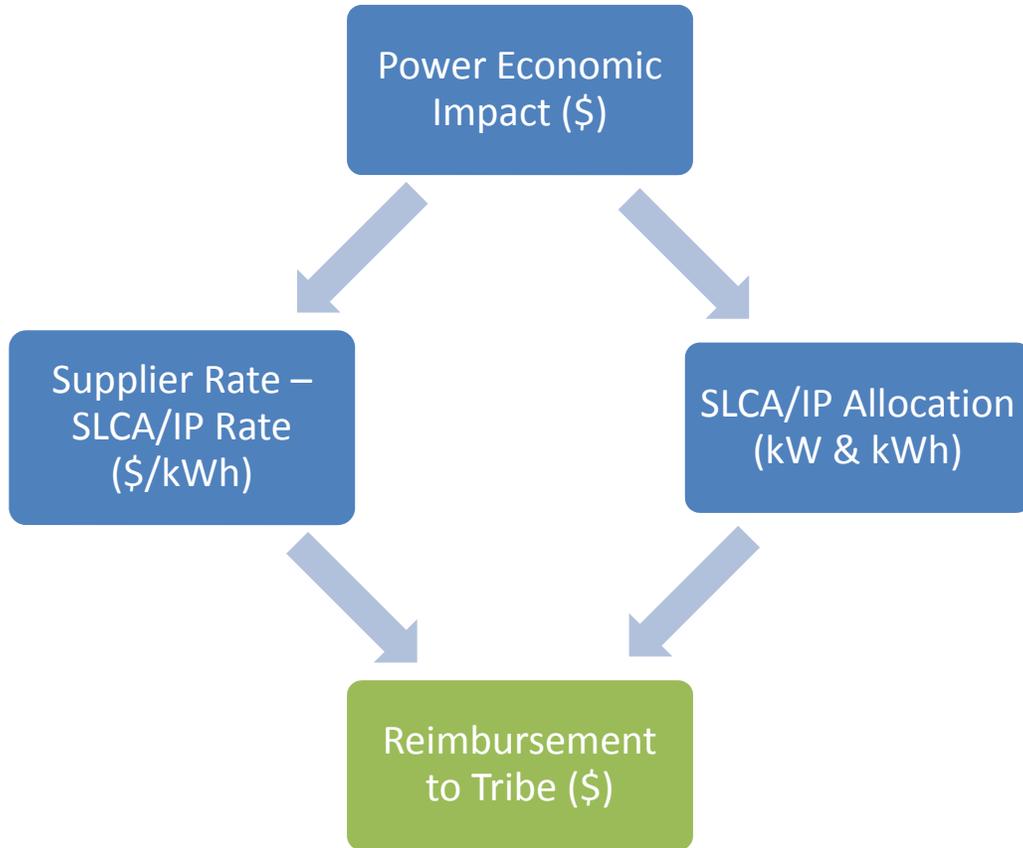


FIGURE K.4-1 Calculation of Change in Tribal Benefit Resulting from LTEMP EIS Alternatives

K.4.4 Impacts on Tribes through a Change in the Retail Rate of the Electrical Supplier to Tribal Lands

In addition to the economic impact of the LTEMP alternatives on Tribal benefits, some Tribes receive retail electric service from suppliers (such as rural cooperatives) that are SLCA/IP customers themselves. This means that Tribal households and commercial establishments on Tribal lands could pay a different retail rate for their electricity. If an alternative operating criterion at Glen Canyon Dam causes a change in the SLCA/IP rate, a utility supplying retail service to a Tribe could change its retail rate for electricity as a result of that alternative. Tribal members and commercial establishments on Tribal lands (households and businesses) could incur a change in their electrical utility bills as a result.

Attachment K.11 includes the list of the Tribes receiving their SLCA/IP allocation from a supplier along with the name of the electrical supplier that serves the Tribal reservation or Tribal lands. Section K.3 includes the estimated retail rate change for SLCA/IP customers by alternative. The financial impacts on the Tribes based on changes in the SLCA/IP rate were calculated using the following equation:

$$\text{Financial Loss/Gain} = \text{Total Reservation Electricity Consumption}^{26} \times \text{Change in Retail Rate}^{27} \quad (\text{Eq. 2})$$

Attachment K.12 is a list of Tribes receiving SLCA/IP allocations and the estimated total electrical use by Tribe. These data were partly gathered and required by WAPA as part of the development of the post-2004 marketing plan. They are referred to as applicant profile data.

These applicant profile data are believed to be out of date because they are based on electrical use by Tribes in 1998. However, more current data on Tribal electrical use were not readily available or published. Therefore, the amounts of electrical energy shown in Attachment K.12 were escalated by 2.5% per year to 2015.²⁸ The estimated Tribal electricity use calculated with Equation 2 is therefore an escalated amount and represents an estimate of the current electrical use by Tribes.

The estimated 2015 total electrical use by Tribal households and commercial establishments on Tribal lands was multiplied by the change in the retail rate estimated for the electrical service supplier—which is an SLCA/IP FES customer—as derived from the analysis described in Section K.3. This results in an estimated increase (or decrease) in the retail electrical utility costs paid by each Tribe annually under each alternative (via the Tribal members who live on Tribal lands).

K.4.5 Calculation of Tribal Impacts for Tribes That Are Direct SLCA/IP Recipients

For the Tribes that operate electrical utilities and receive SLCA/IP power directly from WAPA, the impacts of LTEMP alternatives were calculated. This calculation is the difference in the SLCA/IP FES rate between each of the action alternatives and the No Action alternative multiplied by the total escalated electrical use for each Tribe. Multiplying the change in SLCA/IP rate (from Section K.2) by the escalated Tribal electrical use yields the estimated financial impacts for each of the LTEMP EIS alternatives on each of the nine Tribes that receive SLCA/IP allocations directly from WAPA.

²⁶ This estimate is for the year 2015. It is therefore an annual amount of electrical energy used. The financial loss or gain should be interpreted as an annual financial impact.

²⁷ These estimated changes in retail rates by alternative are taken directly from Section K.3.

²⁸ Based on data reported by the EIA, 2.5% is the approximate average annual increase in electrical energy use over the last decade in states where Tribal entities reside.

Table K.4-1 is the result of the retail-rate impact analysis for the average household on a Tribal reservation or on Tribal lands. The estimates, by Tribe, presented in Table K.4-1 describe how a residential household might be impacted by the LTEMP EIS alternatives due to a changed retail rate. The numbers in Table K.4-1 are taken from the retail rate impact analysis described in Appendix K.3. That analysis computed the monthly change in an electric utility bill for an average residence across the SLCA/IP market footprint. Table K.4-2 shows this change. It is extracted from similar information in Section K.3. It assumes that residences on Tribal lands incur the same change in residential monthly electrical utility bills as other residences in the same electrical service area.

For example, the reservation of the Ute Tribe is electrically served by Moon Lake Electric. According to the estimate in Section K.3, Moon Lake Electric residences will pay slightly over a dollar a month more for electricity under Alternative F. It was assumed that the residences of the Ute Tribe on the Ute reservation, served by Moon Lake Electric, will also pay slightly over a dollar a month more for electricity under Alternative F. Remember that the information in Table K.4-1 is one of two financial impacts on the Tribes caused by the alternatives. The total financial impact on Tribes is presented in Table K.4-2.

K.4.6 Total Impact of LTEMP EIS Alternatives: Benefit Change and Rate Effect

Table K.4-2 lists the estimated Tribal financial impact by alternative relative to the impact under Alternative A. Table K.4-2 lists the total annual financial impact, which is (1) the change in Tribal benefit plus (2) the increase in the electrical utility bill of Tribal households and businesses due to a change in the SLCA/IP FES customers' retail rate.²⁹ Negative numbers indicate a positive financial benefit (this only occurs under Alternative B). Note that:

- Tribes whose electrical service is provided by a non-SLCA/IP FES customer have no retail rate change, but do experience a change in Tribal benefits;
- The Tribes that operate their own utility have no change in Tribal benefits, but do experience a change in retail rates; and
- Tribes whose lands are served by SLCA/IP customers are impacted by both a change in retail rate and a change in Tribal benefits.

²⁹ Table K.4-2 shows the total financial impact. The separate financial impacts from a change in Tribal benefits and from a change in the electrical utility payments made by Tribal households and businesses were calculated but not shown here because of space limitations.

TABLE K.4-1 Monthly Change in Residential Electric Utility Bill for Tribes by Alternative

Tribal Entity	Difference from Alternative A					
	Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
<i>Tribes that Operate Their Own Utility</i>						
Navajo Tribal Utility Authority	-0.035	0.339	0.234	0.211	1.011	0.591
Navajo Agricultural Products Industries	NA	NA	NA	NA	NA	NA
Ak-Chin Indian Community	-0.123	1.187	0.820	0.740	3.539	2.069
Tohono O’odham Utility Authority	-0.013	0.122	0.084	0.076	0.362	0.212
Fort Mojave Indian Tribe	-0.032	0.309	0.214	0.193	0.922	0.539
Bureau of Indian Affairs Colorado River Agency	NA	NA	NA	NA	NA	NA
San Carlos Irrigation Project	NA	NA	NA	NA	NA	NA
Jicarilla Apache Tribe	NA	NA	NA	NA	NA	NA
Gila River Indian Community	NA	NA	NA	NA	NA	NA
<i>Tribes That Have a Benefit Contracting Arrangement</i>						
Alamo Navajo Chapter	-0.012	0.115	0.080	0.072	0.344	0.201
Canoncito Navajo Chapter	-0.014	0.134	0.092	0.083	0.399	0.233
Cocopah Indian Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Colorado River Indian Tribes	0.000	0.000	0.000	0.000	0.000	0.000
Confederated Tribes of the Goshute Reservation	-0.015	0.145	0.100	0.091	0.433	0.253
Duckwater Shoshone Tribe	-0.015	0.145	0.100	0.091	0.433	0.253
Ely Shoshone Tribe	-0.015	0.145	0.100	0.091	0.433	0.253
Ft. McDowell Mojave-Apache Indian Community	-0.016	0.158	0.109	0.099	0.471	0.275
Havasupai Tribe	-0.123	1.187	0.820	0.740	3.539	2.069
Hopi Tribe	-0.007	0.065	0.045	0.041	0.195	0.114
Hualapai Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Las Vegas Paiute Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Mescalero Apache Tribe	-0.021	0.206	0.142	0.128	0.614	0.359
Nambe Pueblo	-0.026	0.246	0.170	0.153	0.733	0.429
Paiute Indian Tribe of Utah	0.000	0.000	0.000	0.000	0.000	0.000
Pascua Yaqui Tribe	-0.123	1.187	0.820	0.740	3.539	2.069
Picuris Pueblo	-0.018	0.170	0.118	0.106	0.508	0.297
Pueblo De Cochiti	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of Acoma	-0.014	0.134	0.092	0.083	0.399	0.233
Pueblo of Isleta	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of Jemez	-0.026	0.246	0.170	0.153	0.733	0.429
Pueblo of Laguna	-0.014	0.134	0.092	0.083	0.399	0.233
Pueblo of Pojoaque	-0.026	0.246	0.170	0.153	0.733	0.429
Pueblo of San Felipe	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of San Ildefonso	-0.026	0.246	0.170	0.153	0.733	0.429
Pueblo of San Juan	-0.026	0.246	0.170	0.153	0.733	0.429

TABLE K.4-1 (Cont.)

Tribal Entity	Difference from Alternative A					
	Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
<i>Tribes That Have a Benefit Contracting Arrangement</i>						
Pueblo of Sandia	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of Santa Clara	-0.026	0.246	0.170	0.153	0.733	0.429
Pueblo of Santo Domingo	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of Taos	-0.018	0.170	0.118	0.106	0.508	0.297
Pueblo of Tesuque	0.000	0.000	0.000	0.000	0.000	0.000
Pueblo of Zia	-0.026	0.246	0.170	0.153	0.733	0.429
Pueblo of Zuni	-0.014	0.134	0.092	0.083	0.399	0.233
Quechan Indian Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Ramah Navajo Chapter	-0.014	0.134	0.092	0.083	0.399	0.233
Salt River Pima-Maricopa Indian Community	-0.016	0.158	0.109	0.099	0.471	0.275
San Carlos Apache Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Santa Ana Pueblo	0.000	0.000	0.000	0.000	0.000	0.000
Skull Valley Band of Goshute Indians	0.000	0.000	0.000	0.000	0.000	0.000
Southern Ute Indian Tribe	-0.011	0.106	0.073	0.066	0.317	0.185
Tonto Apache Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Ute Indian Tribe	-0.009	0.086	0.059	0.054	0.256	0.150
Ute Mountain Ute Tribe	-0.035	0.338	0.234	0.211	1.009	0.590
White Mountain Apache Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Wind River Reservation	-0.020	0.189	0.130	0.118	0.562	0.329
Yavapai Apache Nation	0.000	0.000	0.000	0.000	0.000	0.000
Yavapai Prescott Indian Tribe	0.000	0.000	0.000	0.000	0.000	0.000
Yomba Shoshone Tribe	0.000	0.000	0.000	0.000	0.000	0.000

Alternative impacts listed in Table K.4-2 include the sum of both types of financial impacts.³⁰ Alternative impacts included in Table K.4-2 are indications of the rank order of the alternatives and the direction of impacts (positive or negative), and they describe an estimated financial impact under current contractual obligations. These financial impacts would continue beyond 2024 if contract commitments to all FES customers including Tribes and Tribal entities do not change. They represent one possible outcome of the post-2024 marketing plan. For the final EIS, assumptions concerning post-2024 commitment levels may be revised to duplicate the range examined in the economic analysis described in Section K.1.

³⁰ The Tribal benefit calculation is the difference the Supplier's average production cost and the SLCA/IP rate multiplied by the Tribe's SLCA/IP allocation. For simplicity, the authors assume that the supplier's average production cost does not change as a result of an LTEMP DEIS alternative. It is more likely that an increase in a SLCA/IP rate will result in a lesser increase in the average production cost of a SLCA/IP FES customer. Therefore, the calculations of Tribal benefit change are overestimates for those Tribes that are served by SLCA/IP FES customers.

TABLE K.4-2 Total Dollar Annual Impact on Tribes under LTEMP Alternatives Relative to Alternative A

Tribal Entity	SLCA/IP Allocation (MWh)	Difference from Alternative A (\$)					
		Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
<i>Tribes That Operate Their Own Utility</i>							
Navajo Tribal Utility Authority	183,625	9,090	205,442	183,625	139,991	936,304	1,110,839
Navajo Agricultural Products Industries	49,046	2,452	55,422	49,536	37,765	252,587	299,671
Ak-Chin Indian Community	11,356	562	12,705	11,356	8,658	57,905	68,699
Tohono O'Odham Utility Authority	7,765	384	8,687	7,765	5,920	39,592	46,973
Fort Mojave Indian Tribe	1,036	51	1,159	1,036	790	5,282	6,266
Bureau of Indian Affairs Colorado River Agency	2,451	121	2,742	2,451	1,868	12,497	14,826
San Carlos Irrigation Project	5,919	293	6,622	5,919	4,512	30,179	35,805
Gila River Indian Community	148,828	-13,860	206,171	148,828	128,785	705,437	564,644
Jicarilla Apache Tribe	2,464	122	2,757	2,464	1,879	12,566	14,909
<i>Tribes That Have a Benefit Contracting Arrangement</i>							
Alamo Navajo Chapter	1,222	-50	1,575	1,222	1,012	5,954	5,640
Canoncito Navajo Chapter	900	-37	1,159	900	745	4,382	4,151
Cocopah Indian Tribe	4,355	216	4,873	4,355	3,321	22,209	26,348
Colorado River Indian Tribes	18,072	895	20,219	18,072	13,778	92,150	109,327
Confederated Tribes of the Goshute Reservation	292	-7	367	292	238	1,432	1,418
Duckwater Shoshone Tribe	389	-10	490	389	318	1,912	1,892
Ely Shoshone Tribe	595	-15	749	595	486	2,923	2,895
Ft. McDowell Mojave-Apache Indian Community	8,895	380	10,065	8,895	6,825	45,202	52,851
Havasupai Tribe	887	29	1,021	887	687	4,484	5,124
Hopi Tribe	22,836	(1,580)	30,613	22,836	19,366	109,616	95,282
Hualapai Tribe	2,304	114	2,578	2,304	1,757	11,748	13,938

K-199

TABLE K.4-2 (Cont.)

K-200

Tribal Entity	SLCA/IP Allocation (MWh)	Difference from Alternative A (\$)					
		Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
Las Vegas Paiute Tribe	2,310	114	2,585	2,310	1,761	11,780	13,976
Mescalero Apache Tribe	6,322	-261	8,147	6,322	5,235	30,792	29,163
Nambe Pueblo	399	-16	514	399	330	1,942	1,840
Paiute Indian Tribe of Utah	583	29	652	583	445	2,973	3,527
Pascua Yaqui Tribe	4,754	153	5,472	4,754	3,684	24,035	27,463
Picuris Pueblo	312	-13	402	312	258	1,518	1,432
Pueblo De Cochiti	767	38	858	767	585	3,912	4,641
Pueblo of Acoma	2,669	-110	3,439	2,669	2,210	12,999	12,310
Pueblo of Isleta	4,123	204	4,612	4,123	3,143	21,021	24,940
Pueblo of Jemez	1,542	-63	1,986	1,542	1,276	7,510	7,117
Pueblo of Laguna	4,809	-199	6,197	4,809	3,982	23,422	22,183
Pueblo of Pojoaque	1,544	-63	1,989	1,544	1,278	7,523	7,130
Pueblo of San Felipe	1,406	70	1,573	1,406	1,072	7,168	8,504
Pueblo of San Ildefonso	409	-17	527	409	338	1,990	1,885
Pueblo of San Juan	1,935	-80	2,494	1,935	1,602	9,425	8,926
Pueblo of Sandia	3,278	162	3,668	3,278	2,499	16,717	19,833
Pueblo of Santa Clara	1,541	-63	1,986	1,541	1,276	7,507	7,115
Pueblo of Santo Domingo	1,662	82	1,859	1,662	1,267	8,472	10,051
Pueblo of Taos	1,811	-74	2,332	1,811	1,499	8,823	8,367
Pueblo of Tesuque	2,288	113	2,560	2,288	1,744	11,666	13,841
Pueblo of Zia	493	-20	635	493	408	2,402	2,277
Pueblo of Zuni	7,101	-293	9,148	7,101	5,879	34,587	32,771
Quechan Indian Tribe	2,319	115	2,595	2,319	1,768	11,825	14,029
Ramah Navajo Chapter	2,295	-94	2,956	2,295	1,899	11,178	10,597
Salt River Pima-Maricopa Indian Community	56,758	2,423	64,225	56,758	43,551	288,436	337,237

TABLE K.4-2 (Cont.)

Tribal Entity	SLCA/IP Allocation (MWh)	Difference from Alternative A (\$)					
		Alternative B	Alternative C	Alternative D	Alternative E	Alternative F	Alternative G
San Carlos Apache Tribe	14,791	732	16,549	14,791	11,277	75,421	89,480
Santa Ana Pueblo	1,622	80	1,814	1,622	1,236	8,269	9,810
Skull Valley Band of Goshute Indians	56	3	63	56	43	286	339
Southern Ute Indian Tribe	7,391	-305	9,523	7,391	6,119	35,996	34,095
Tonto Apache Tribe	1,364	68	1,527	1,364	1,040	6,957	8,254
Ute Indian Tribe	4,835	(342)	6,495	4,835	4,105	23,190	20,060
Ute Mountain Ute Tribe	3,169	(131)	4,083	3,169	2,623	15,432	14,618
White Mountain Apache Tribe	22,090	1,094	24,715	22,090	16,841	112,639	133,636
Wind River Reservation	7,284	(823)	10,361	7,284	6,408	34,163	25,349
Yavapai Apache Nation	6,246	309	6,988	6,246	4,762	31,848	37,784
Yavapai Prescott Indian Tribe	2,877	142	3,219	2,877	2,193	14,670	17,404
Yomba Shoshone Tribe	116	6	129	116	88	589	699
Total	658,509	-336	738,872	609,463	486,660	3,030,857	3,204,513
Total for Systems that Operate Utility		10,503	237,357	212,151	161,739	1,081,759	1,283,408
Total for Systems with Benefit Contracts		-10,839	501,515	397,312	324,921	1,949,098	1,921,105

K-201

K.4.7 Total Impact on Tribes and Tribal Members Versus Retail Rate Changes to Households

Figures K.4-2 through K.4-7 illustrate the difference between the total financial impact of the alternatives on Tribes as compared to the financial impact on non-Tribal households and businesses that receive retail service from utilities that are SLCA/IP customers.

The financial impacts on non-Tribal households and businesses are, for illustrative purposes in this analysis, the percentage change in the electrical retail rate for the SLCA/IP FES customer (or their utility system member that provides retail electrical service in a service area). This information is a duplication of the analysis included in Appendix K.3, which is the retail rate analysis of the alternatives. In Figures K.4-2 through K.4-7, the blue lines illustrate non-Tribal SLCA/IP FES customers or member systems and are the same data that are included in Section K.3.

An increase (decrease) in the retail rates of an SLCA/IP FES customer or member system causes a financial effect (positive or negative) on households and businesses in the utilities' service area by increasing (decreasing) the electrical utility cost paid. This change in the utility bill and the resulting financial effect at the household/business level is approximately equivalent to the financial impact on Tribes and Tribal members.

Figures K.4-2 through K.4-7 present the percentage difference (compared to Alternative A) of financial impacts on Tribes and non-Tribes³¹ for each alternative. Alternative B is the only alternative that results in a reduction in impacts relative to Alternative A (Figure K.4-3). The financial impacts of Alternatives C, D, and E are relatively similar (Figures K.4-3 through K.4-5), but greater than under either Alternative A or Alternative B. The financial impacts of Alternatives F and G are relatively similar to each other (Figure K.4-3), and higher than under any of the other alternatives. Alternative F has the highest financial impacts of any alternative.

K.4.8 Conclusions

Several conclusions can be drawn from this analysis:

- LTEMP alternatives are estimated to have a financial effect on Tribes that receive an SLCA/IP allocation. Compared to Alternative A, the impact is negative for Alternatives C, D, E, F, and G. These impacts are larger for Alternatives F and G. The financial impact on Tribes under Alternative B is largely positive.

³¹ The total percentage change is measured on the y-axis. For Tribal entities, this percentage change is the sum of the retail rate impact and the Tribal benefit impact. For non-Tribal SLCA/IP customers or members systems, it is the percentage change from the retail rate impact.

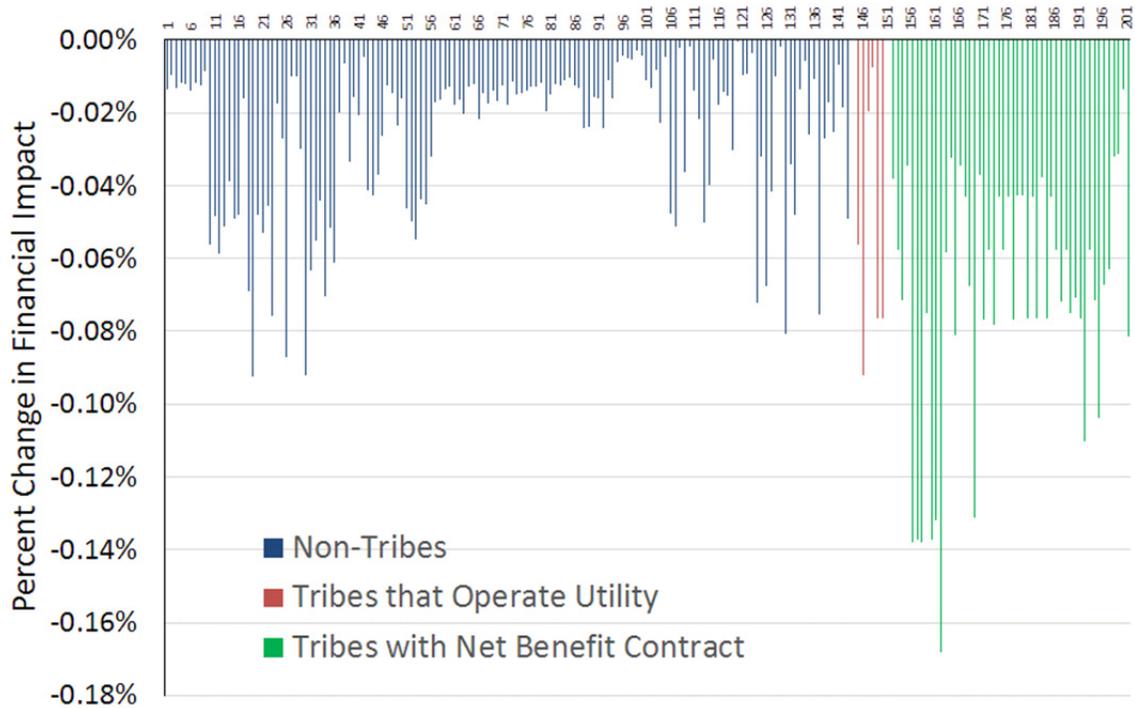


FIGURE K.4-2 Financial Impacts under Alternative B Relative to Alternative A for Tribal and Non-Tribal Entities

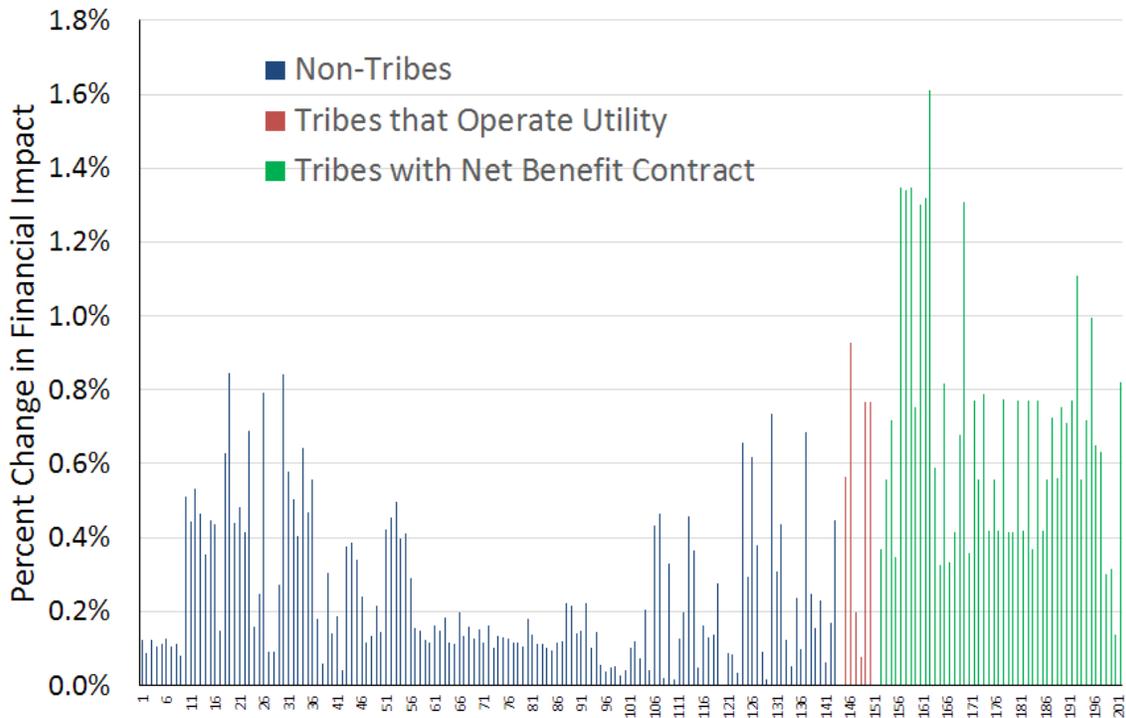


FIGURE K.4-3 Financial Impacts under Alternative C Relative to Alternative A for Tribal and Non-Tribal Entities

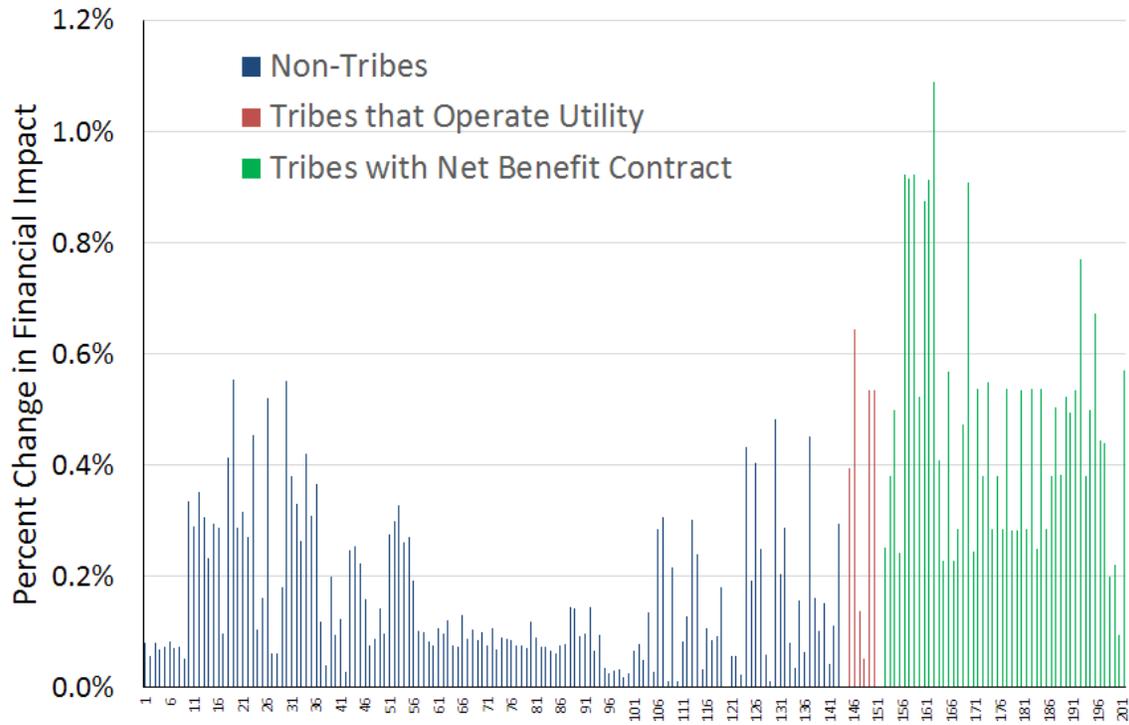


FIGURE K.4-4 Financial Impacts under Alternative D Relative to Alternative A for Tribal and Non-Tribal Entities

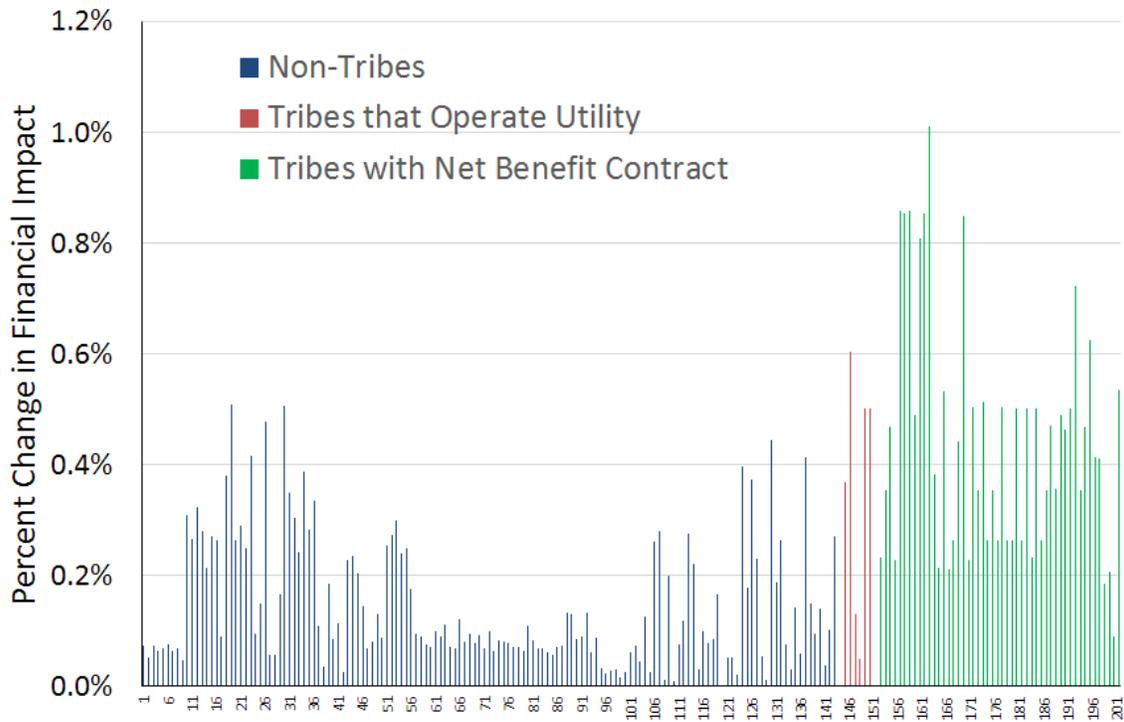


FIGURE K.4-5 Financial Impacts under Alternative E Relative to Alternative A for Tribal and Non-Tribal Entities

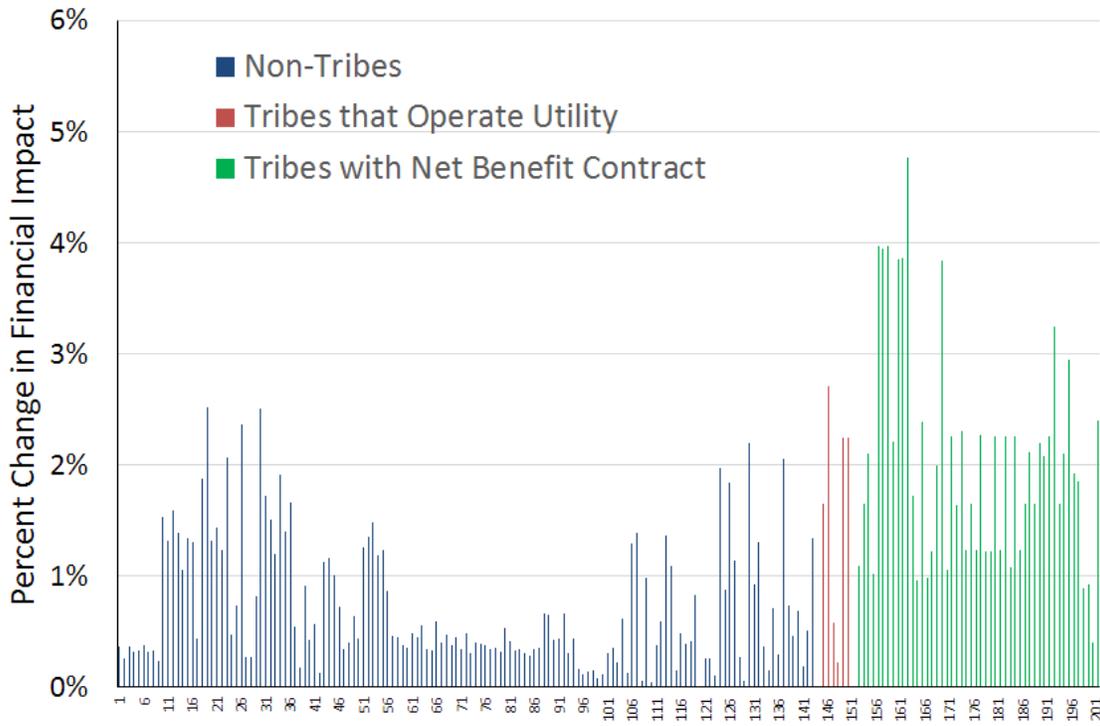


FIGURE K.4-6 Financial Impacts under Alternative F Relative to Alternative A for Tribal and Non-Tribal Entities

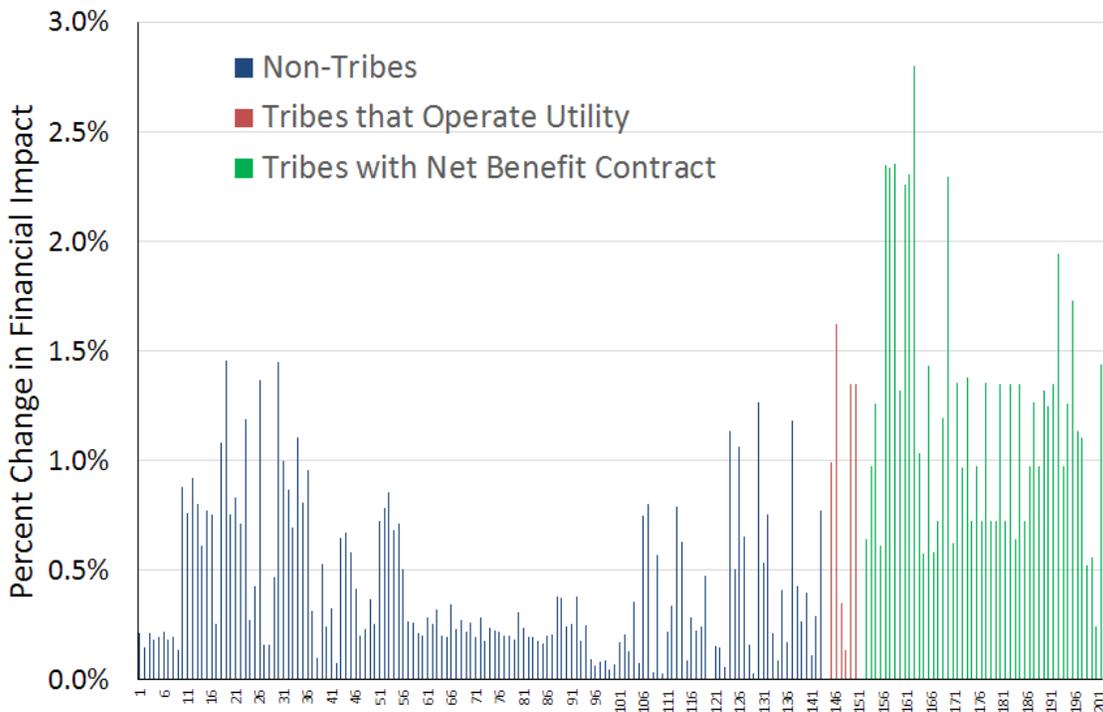


FIGURE K.4-7 Financial Impacts under Alternative G Relative to Alternative A for Tribal and Non-Tribal Entities

- The financial impacts on Tribes are from two sources:
 - A change in the Tribal benefits provided to the Tribes under benefit crediting contracts; and
 - A change in the electrical utility bills paid by Tribal members and businesses that receive retail service from a supplier that receives an SLCA/IP allocation.
- These two sources of financial impact are additive for some Tribes—those who receive Tribal benefits and whose reservation or Tribal land is served by electrical utilities that are SLCA/IP FES customers.
- Tribal financial impacts for Alternatives C, D, E, F, and G, relative to Alternative A, are larger than the financial impacts on non-Tribes.

K.5 IMPACTS OF LTEMP ALTERNATIVES ON LAKE MEAD AND THE HOOVER DAM POWERPLANT

The Hoover Dam Powerhouse has 17 turbines that have a combined hydropower nameplate capacity of 2,074 MW (<https://www.wapa.gov/About/Pages/power-projects.aspx>). Both the energy production and operating capacity of this large hydropower resource is affected by LTEMP EIS alternatives. Released water from Lake Powell through the Glen Canyon Dam travels down the Colorado River through the GCNP and then into the Lake Mead Reservoir. Monthly water release volumes from Lake Powell, however, differ by LTEMP alternative and will therefore impact pool elevations in Lake Mead, and, in some rare situations water releases from Hoover Dam, when Lake Mead's operating condition is changed as a result of differences in projected December month-end elevations. Alternatives B, D, and E have the same Glen Canyon Dam October through December total release volumes as Alternative A, and therefore do not affect the Lake Mead operating condition, and thus the release volumes from Hoover Dam.

For example, Figures K.5-1 and K.5-2 show that under Alternative F, Lake Powell monthly water releases from late winter through spring are higher than for Alternative A (dotted orange line), thereby raising the pool elevation (solid orange line) at Lake Mead above levels projected under Alternative A from April through November. Because Glen Canyon Dam annual release volumes under all alternatives are nearly identical, the impacts of changed operations are within an annual time frame. Note that all alternatives, except for Alternative F, have very similar pool elevations when comparing end of the water year values.

Monthly differences in Lake Mead reservoir elevations among alternatives may impact Hoover Dam's generation economic value. The primary factors include changes in (1) the

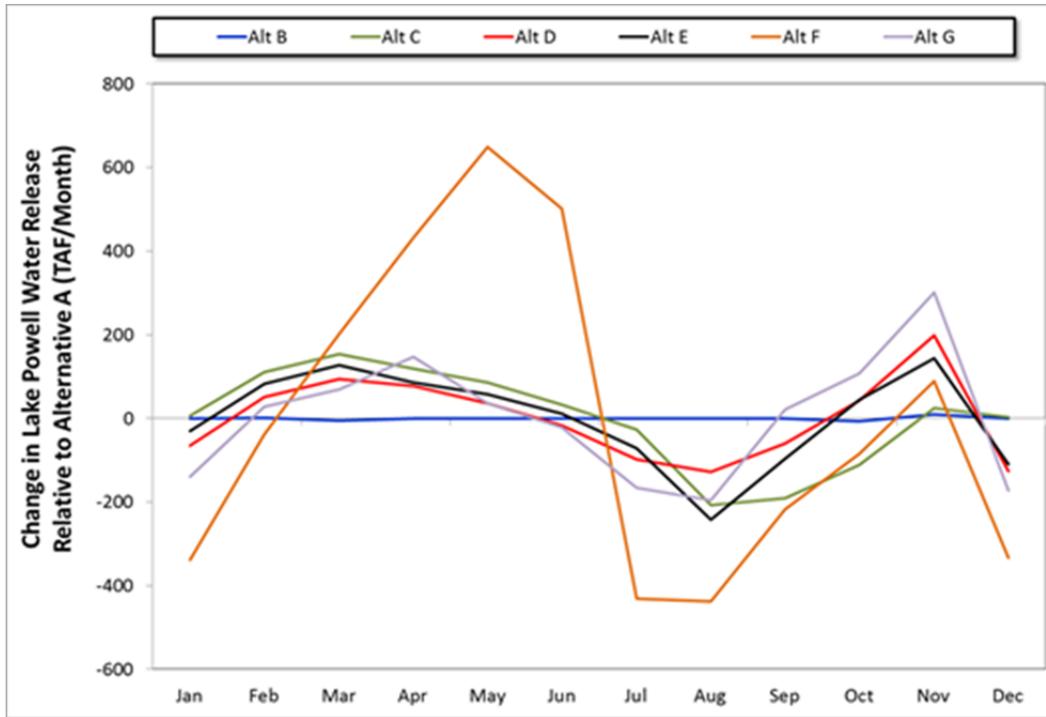


FIGURE K.5-1 Change in Lake Powell Monthly Water Release Volumes under LTEMP Alternatives

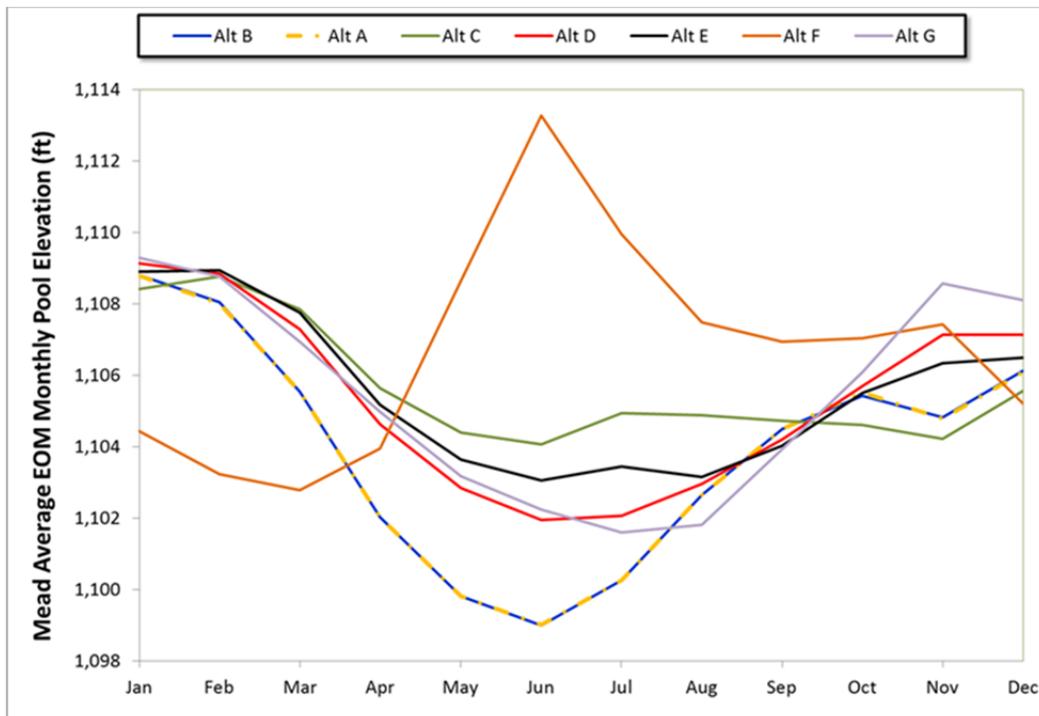


FIGURE K.5-2 Average Lake Mead EOM Pool Elevations under LTEMP Alternatives

percentage of time Lake Mead elevation is below minimum power pool³²; (2) monthly differences in power head and resulting electricity (i.e., energy) production³³; (3) maximum operating capacity; and (4) in some infrequent situations, but only for Alternatives C, F and G, differences in water release volumes from Lake Mead. In terms of the economic impacts of alternatives on the Hoover Powerplant, the first two are much larger than the latter two.

Hoover powerplant economics are composed of firm capacity and energy components. For the purpose of evaluating the economic value of the Hoover Powerplant, a distinction is made between the powerplant's nameplate capacity and its maximum operational capacity, which varies as a function of power head. This maximum operational capacity is referred to in this section as the Hoover derated capacity.

This study also refers to firm capacity, which is distinctly different from both nameplate and derated capacities. Firm capacity in this report is defined as the Hoover Powerplant derated capacity level (output potential) during the time of the regional peak electricity demand (load) at a specified probability level of occurrence. To be consistent with the definition of firm capacity used elsewhere in this EIS, Hoover firm capacity is set equal to the Hoover derated capacity at a 90% exceedance level during August. It is based on numerous forecasts of derated capacity using an ensemble of future hydrology and Lake Mead pool conditions. Note that the 90% exceedance level means that the derated capacity is lower than the firm capacity only 10% of the time, and is therefore based on a very low hydropower condition. Firm capacity is assumed to be the capacity level that would be used in either regional or utility-specific studies of current and future capacity needs such as an IRP.

At Hoover Dam, power is scheduled by WAPA's Desert Southwest Office customers, each of which is allocated a portion of the available real-time derated capacity of the Hoover powerplant. It is therefore at the discretion of each entity that receives Hoover capacity how it utilizes this capacity for long-term planning purposes; that is, how it credits Hoover as "firm" capacity. Under these contracts, the utility customer bears the risk of not meeting its firm capacity targets and system reliability goals. The utility may therefore need to acquire additional firm capacity. Marketed capacity levels are rooted in the amount that is projected to be physically available.

Hoover economic metrics for both firm capacity and energy are measured in terms of NPV and are computed for each alternative. The following sections describe the methods, model, and comparative impacts of LTEMP alternatives on Lake Mead, Hoover Powerplant operations, and power system economics.

³² For this analysis, a distinction is made between water that is routed through the powerplant turbines and water that bypasses the dam and powerplant.

³³ Turbine water releases convert the kinetic energy of falling water into mechanical energy which is then converted to electricity by a generator. The volume of water needed to generate 1 MWh of electricity is a function of several factors.

K.5.1 Hoover Analysis Methods, Model, and Supporting Data

The purpose of this analysis is to determine if impacts to Hoover Dam hydropower exist, the direction of impact, and some sense of the magnitude of that impact. A model of Hoover Powerplant operations was developed to analyze potential LTEMP impacts on Hoover Powerplant economics. Compared to the modeling of Glen Canyon Dam hydropower resources, it is a simpler representation of dam and hydropower operations because it is less detailed and it operates on monthly time steps instead of hourly. *Its purpose is to provide rough estimates of the direction, magnitude, and ranking of LTEMP alternative impacts on the Hoover Powerplant under a given set of assumptions.* As will be discussed in more detail later, model results are highly sensitive to assumptions, some of which are not yet precisely known. Because of the uncertainties of the assumptions, the magnitude of these estimates for Hoover Dam hydropower resources is not directly comparable to the results for Glen Canyon Dam hydropower resources. The above factors should be taken into consideration when interpreting model results.

The Hoover Powerplant Model utilizes monthly Lake Mead water release volumes projected by the CRSS model for 21 hydrology traces over the 20-year LTEMP study period. These water releases sometimes vary by alternative. Releases are primarily driven by the operating criteria that were established under the *Interim Guidelines for Lower Basin Shortages and Coordinated Operations for Lake Powell and Lake Mead* ROD that was signed on December 13, 2007 (Reclamation 2007b). Under Alternatives C, F, and G, changes in Lake Mead monthly releases may, in rare occasions, occur when Lake Mead's operating condition is changed as a result of differences in projected December end of month (EOM) elevations. Because monthly water release decisions for the upcoming year are made at the beginning of the calendar year and forecasts of the future are uncertain, Hoover releases sometimes differ from the ones that would have occurred had the future been known with perfect foresight.

Lake Mead EOM reservoir elevations projected by the Sand Budget Model (SBM) are also input into the Hoover Powerplant Model. For each alternative and 21 hydrology traces over the 20-year study period, the SBM schedules HFEs at Glen Canyon Dam. Scheduling is based on CRSS model results for Glen Canyon Dam and initial results from the GTMax-lite model. Because an experiment typically requires a large water release volume, the SBM reallocates CRSS Glen Canyon Dam monthly water releases within a WY in order to provide the HFE with a sufficient amount of water. Based on this reallocated monthly water and a water mass-balance equation, Lake Mead pool elevations are computed. The SBM primarily reallocates water within the same WY, not among WYs.

The SBM does not alter CRSS Hoover Dam monthly water releases, allowing the Hoover Powerplant Model to directly use CRSS water releases. The SBM does, however, change CRSS monthly inflows into Lake Mead and thus projected, water storage volumes, and reservoir elevations.

AURORA model monthly average market on-peak and off-peak prices projected for the Palo Verde hub are used by the Hoover Powerplant Model to compute economic energy values. These are the same hourly prices used elsewhere in this EIS. Also identical to the GTMax-Lite

methodology, firm hydropower capacity is based on a 90th percentile exceedance level during the month of August. Other factors such as unscheduled unit outage probabilities and unit maintenance schedules can also factor into powerplant maximum operational capacity and firm capacity computations, but were not included in this relatively simple model.

The economic value of Hoover firm capacity is based on the same replacement costs as those used for GTMax-lite and very similar to the average costs used in the power systems economic analysis. It is based on the levelized cost of capital plus annual fixed O&M costs to construct a new advanced combustion turbine (CT), which amounts to \$51,300/MW-yr. As discussed later, these capacity replacement costs are irrelevant to the final economic cost computation. The time series of Hoover economic costs are discounted at the same 3.375% annual rate used in GTMax-Lite and the power systems analysis.

K.5.2 Hoover Monthly Energy Production and Water-to-Power Conversion

The Hoover Powerplant Model projects powerplant monthly energy production over the 20-year LTEMP study period based on SBM monthly projections of Lake Mead EOM pool elevation and CRSS-projected Hoover Dam monthly water releases for each of the 21 hydrology traces. A model-derived water-to-power conversion factor³⁴ is multiplied by the monthly turbine water release volumes to project Hoover Powerplant energy production. The operating characteristics of the Hoover Powerplant were based on and derived from information provided by Reclamation.

Argonne derived a water-to-power conversion equation and its coefficients based on historical Lake Mead pool elevations and Hoover generation data, as recorded in Form PO&M-59. The equation has two components. The first component is a linear relationship between historical conversion factors and the pool elevations. The second component relates the conversion factor to monthly water release volumes in the form of a third-order polynomial function. Due to the implementation and application of new software at Hoover Dam that optimizes the powerplant unit dispatch to increase plant-level power conversion efficiency, equation coefficients in the period prior to March 2011 differ from the coefficients used after this date.³⁵

To assess the accuracy of the derived equation, a back-casting exercise was conducted. Lake Mead pool elevation and water-to-power conversion factors have a similar pattern and can be used to explain most, but not all, of the changes in power conversion over time. Monthly turbine releases yield additional accuracy to the Argonne power conversion equations, but relatively small inaccuracies remain. Average absolute conversion errors during both the

³⁴ The water-to-power conversion factor, expressed in terms of MWh/ac-ft equals the monthly turbine water release (ac-ft) divided by monthly generation. Note that this conversion factor only includes turbine releases; that is, bypass water is excluded.

³⁵ McManes (2014) discusses the change in Hoover Powerplant efficiency (3.4% improvement) that results from using unit dispatch software to guide power operations.

historical pre- and post-2011 periods are less than 0.005 ac-ft/MWh; that is, the equation estimated power conversion factors are on average within 1.2% of the actual values. The simple average of the errors equals zero. For comparative analyses such as this one, this level of accuracy was judged to be sufficient.

Projections of future monthly water-to-power conversion factors use equation coefficients derived for the post-2011 time period. In reality, conversion efficiencies (and therefore water-to-power conversion factors) will change in the future as equipment ages and changes are made to the powerplant. One such change that is partially implemented involves the replacement of old turbines with ones that can be operated over a wider range of hydraulic heads and have a narrower operating rough zone.

When the SBM projects that the Lake Mead elevation is below the minimum power pool, the Hoover Powerplant Model assumes the entire projected monthly water volume bypasses the Hoover Powerplant. Therefore, both the monthly derated capacity and generation of the Hoover Powerplant are set equal to zero. These non-power water releases are referred to in this report as “bypass” water.

Based on information and guidance from Reclamation, at the time this analysis was conducted, it was conservatively assumed that the minimum pool elevation for energy production at the Hoover Powerplant was 1,050 ft above sea level. It should be noted that at the time the final LTEMP EIS was being written, the official minimum power pool required to generate power was being revised. It appears that Hoover turbines will be capable of operating below a 1,050-ft pool elevation. This is in part supported by turbine performance curves for new wide-head turbines that are installed at some of the units. Since none of the Hoover turbines have actually been operated below this level, derated capacities and power conversion factors below 1,050 ft are somewhat speculative.

The monthly average turbine water release at Hoover Dam over the 21 traces and 20-year study period differ by alternative. As shown in Figure K.5-3, the greatest difference in turbine releases among alternatives relative to Alternative A is about 81 thousand acre-feet (kaf) (roughly 11.7% more) in June under Alternative F. In almost all cases, the difference in turbine water release among alternatives is nearly counterbalanced by differences in bypass water releases. In the example above, 69 kaf more water is bypassed under Alternative A than under Alternative F. This is due to a higher occurrence of reservoir elevations below the minimum power pool elevations under Alternative A. There is also a greater average total water release (turbine and bypass); about 12 kaf, in June under Alternative F due to the differences in the frequency of Lower Basin shortages that are projected to occur in the future. The greater water release in June is offset by lower water releases in the winter and early spring. Also note in Figure K.5-3 that on average Lake Mead turbine water releases are nearly identical in Alternatives A and B, and Alternative D has the next smallest deviations from Alternative A.

Multiplying monthly turbine water releases by the water-to-power conversion factor yields an estimate of the generation produced by the Hoover Powerplant. As shown in Figure K.5-4, Alternatives A and B have the lowest generation levels, while Alternative F typically has the most generation. The range of generation among alternatives is the largest from

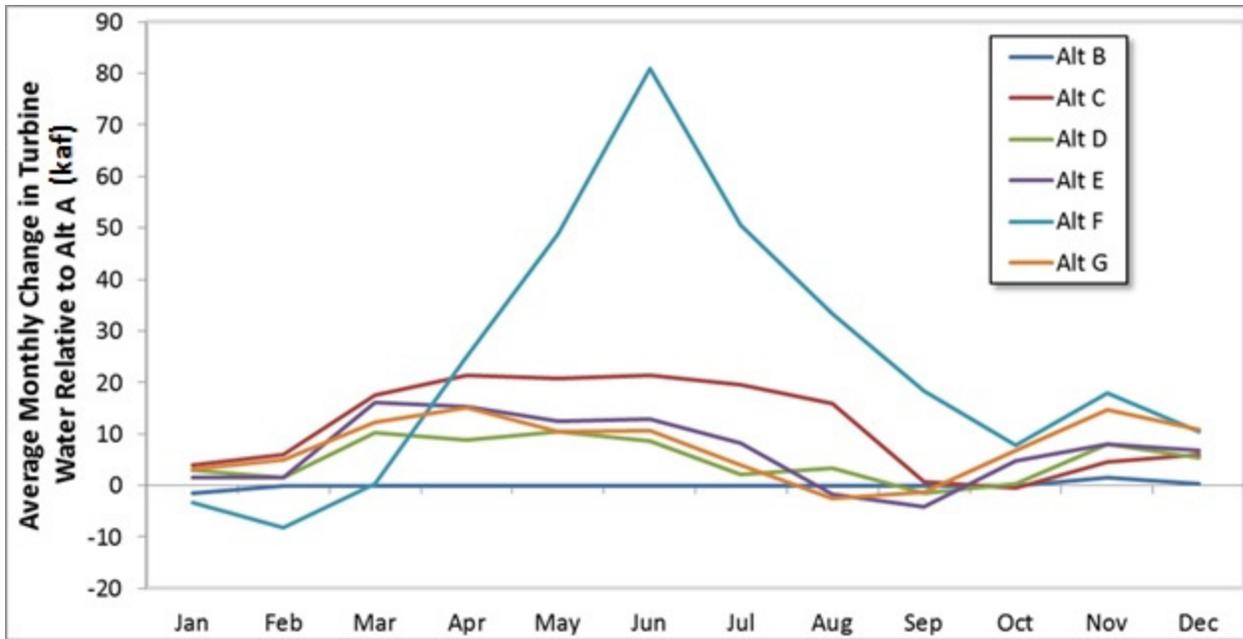


FIGURE K.5-3 Average Monthly Difference in Turbine Water Releases Relative to Alternative A

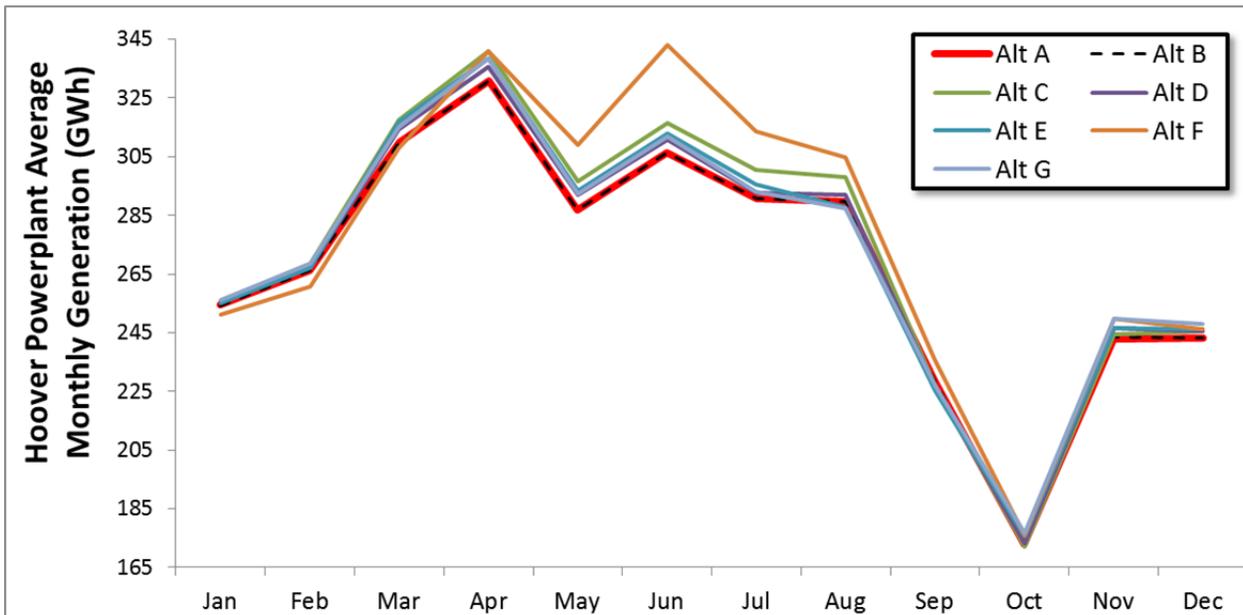


FIGURE K.5-4 Average Monthly Hoover Powerplant Generation for All Power Systems under Primary LTEMP EIS Alternatives

late spring through the end of summer, while the range in autumn and winter tends to be relatively small.

K.5.3 Hoover Maximum Operational Capacity and Firm Capacity

In addition to water-to-power conversion factors discussed in the preceding section, the derated capacity of the Hoover Dam Powerplant is also affected by the pool elevation of Lake Mead. Argonne derived a curve of derated capacity as a function of pool elevation based on information provided by Reclamation. Historically, at pool elevations of 1,205 ft and above, the maximum net output is 2,074 MW. It decreases as the pool elevations drops below the 1,205-ft level. As discussed previously, below the minimum power pool elevation of 1,050 ft, the derated capacity is zero.

This analysis assumed that the firm hydropower capacity of Hoover is based on a 90th percentile exceedance. Results of this analysis, however, show that under all alternatives, Lake Mead's elevation in August is projected to be below the minimum power pool level (where no generation is assumed to be possible) more than 10% of the time. Because the maximum operational capacity is zero under all alternatives, the powerplant is credited with no firm capacity despite projections that indicate that the derated capacity for the Hoover Powerplant is expected to be greater than zero most of the time. It therefore follows that LTEMP alternatives have no impact on Hoover Powerplant's firm capacity and economic value.

K.5.4 Economic Value of Hoover Powerplant Energy

The change in the economic value of Hoover Powerplant energy production under each alternative is computed by multiplying the change in monthly energy production by monthly market prices of energy as projected by the AURORA model. Estimates are made for each month of the 20-year LTEMP period for all 21 hydrology traces. For this analysis, it was assumed that the powerplant generates 95% of its total energy production during hours of the week that have relatively high market prices.³⁶ The remaining 5% is generated during times when prices are lower.

To compare the economic impact of alternatives on a consistent basis, the net present value (NPV) of Hoover Powerplant economic benefits were computed using a 3.375% annual discount rate, the same rate used for computing the NPV elsewhere in this EIS. The result of NPV calculations for the Hoover Powerplant is shown for each alternative in Figure K.5-5. The NPV benefit for Hoover ranges from nearly zero for Alternative B to about \$89 million for Alternative F.

³⁶ The 95% assumption is based on discussions with Reclamation staff.

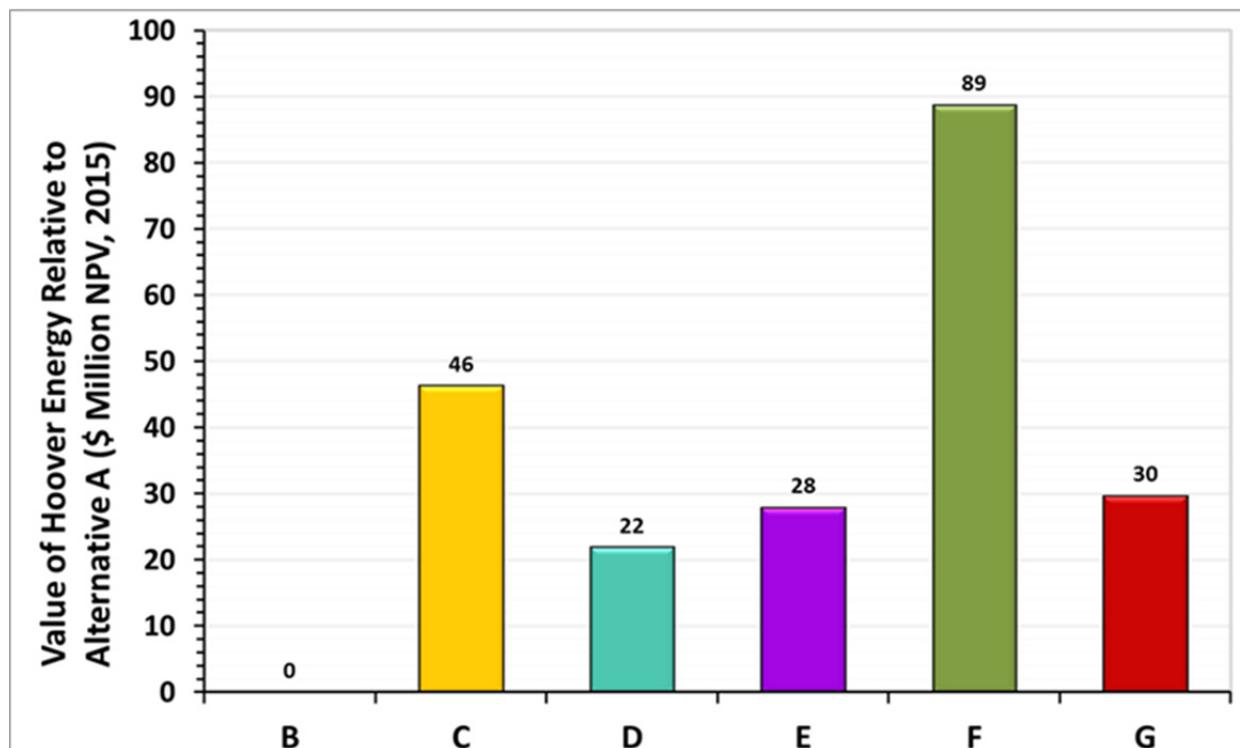


FIGURE K.5-5 NPV of Hoover Powerplant Benefits Relative to Alternative A Resulting from LTEMP Alternatives

K.5.5 Sensitivity of Model Results

Model results are highly sensitive to assumptions, some of which are not yet precisely known. In particular, the assumption regarding minimum power pool elevation has a large bearing on the results discussed above because most of the estimated benefits are due to lower bypass releases under LTEMP alternatives. If a lower minimum pool elevation was assumed, results would be significantly different. For example, at an assumed minimum power pool of 950 ft the Hoover Powerplant Model projects zero bypass releases because SBM pool elevations are always above that level. Energy economics would therefore be significantly different.

On the other hand, the economic impacts of firm capacity discussed above are zero because pool elevations are lower than 1,050 ft more than 10% of the time under all alternatives. If a 950-ft minimum power pool had been assumed. Firm capacity levels and economic values would always be greater than zero and most likely vary among alternatives. This lack of precise information about Hoover should be taken into consideration when interpreting model results.

K.6 REFERENCES

Anderson, K., 2014, personal communication from Anderson (Utah Associated Municipal Power Systems), to L. Poch (Argonne National Laboratory), Feb. 24.

Bloomberg Business, undated, *Markets—United States Government Bonds*. Available at <http://www.bloomberg.com/markets/rates-bonds/government-bonds/us>. Accessed Dec. 3, 2015.

BondsOnline, undated, *Income Investor Tools*. Available at http://www.bondsonline.com/Todays_Market/Composite_Bond_Yields_table.php. Accessed Dec. 3, 2015.

BLS (Bureau of Labor Statistics), undated, *Databases, Tables, & Calculators by Subject*, Series ID code pcu22112-22112. Available at <http://data.bls.gov/cgi-bin/srgate>. Accessed Dec. 3, 2015.

Clayton, R., 2013, personal communication from Clayton (Bureau of Reclamation), to L. Poch (Argonne National Laboratory), Mar. 8.

CRCN (Colorado River Commission of Nevada), 2015, *Colorado River Commission of Nevada—Home*. Available at <http://crc.nv.gov/index.asp>. Accessed July 17, 2015.

CSU (Colorado Springs Utilities), 2012, *2012 Electric Integrated Resource Plan*, Aug. 6.

Deseret (Deseret Power Electric Cooperative), 2012, *Integrated Resource Plan Update*, Oct.

E3 (Energy and Environmental Economics, Inc.), 2014, *Capital Cost Review of Generation Technologies: Recommendations for WECC's 10- and 20-Year Studies*, prepared for Western Electric Coordinating Council, March.

EIA (U.S. Energy Information Administration), 2014, *Assumptions to the Annual Energy Outlook 2014*, Washington D.C., June. Available at [http://www.eia.gov/forecasts/aeo/assumptions/pdf/0554\(2014\).pdf](http://www.eia.gov/forecasts/aeo/assumptions/pdf/0554(2014).pdf). Accessed Mar. 2, 2015

EIA, 2015a, *Electric Power Sales, Revenue, and Energy Efficiency Form EIA-861 Detailed Data Files*. Available at <http://www.eia.gov/electricity/data/eia861>. Accessed July 16, 2015.

EIA, 2015b, “Annual Energy Outlook 2015 Data Tables.” Available at http://www.eia.gov/forecasts/aeo/supplement/sup_t2t3.xlsx. Accessed July 16.

EIA, 2015c, *Annual Energy Outlook 2015 with Projections to 2040*. Available at <http://www.eia.gov/forecasts/aeo/pdf/0383%282015%29.pdf>. Accessed July 16, 2015.

EPRI (Electric Power Research Institute), 2013, *Program on Technology Innovation: Integrated Generation Technology Options 2012 (Technical Update)*, Feb. Available at <http://www.epri.com/abstracts/Pages/ProductAbstract.aspx?productId=00000000001026656>. Accessed Feb. 25, 2015.

FWS (U.S. Fish and Wildlife Service), 1992, *Final Biological Opinion on the Operation of Flaming Gorge Dam*, Mountain-Prairie Region, Denver, Col., Nov. 25.

Graziano, D.J., L.A. Poch, T.D. Veselka, C.S. Palmer, S. Loftin, and B. Osiek, 2015, *Financial Analysis of Experimental Releases Conducted at Glen Canyon Dam during Water Year 2014*, ANL-15/10, Technical Memorandum, Argonne National Laboratory, Sept.

Harpman, D., 2014a, personal communication from Harpman (U.S. Bureau of Reclamation) to T. Veselka (Argonne National Laboratory), Aug. 26.

Harpman, D., 2014b, personal communication from Harpman (U.S. Bureau of Reclamation) to T. Veselka (Argonne National Laboratory), Oct. 7.

Harpman, D.A., and A.S. Rosekrans, 1996, *Modeling Hourly Operations at Glen Canyon Dam, Colorado River Storage Project, Arizona, GCPS09 version 1.0*, EC-96-12, U.S. Department of the Interior, Bureau of Reclamation, Sept.

IAEA (International Atomic Energy Agency), 1980, *Wien Automatic Planning Package (WASP): A Computer Code for Power Generating System Expansion Planning*, ver. 3, Vienna, Austria, Nov.

McManes, C., 2014, "Modern Technology Helps American Icon Generate More Power," *IEEE-USA InSight*, July 1. Available at <http://insight.ieeeusa.org/insight/content/ieeeusa/68196>. Accessed Dec. 3, 2015.

James, L., 2014, personal communication from James (Colorado River Energy Distributors Association) to M. Runge (United States Geological Survey), K. LaGory (Argonne National Laboratory), G. Knowles (Bureau of Reclamation), and R. Billerbeck (National Park Service), Apr. 18.

Loftin, S.D., J. McCoy, R. E. Moulton, T. L. Myers, and B. Sands, 1998, Replacement Resource Process, *Final Methods Report and Executive Summary*, prepared for Western Area Power Administration, March.

NTUA (Navajo Tribal Utility Authority), 2012, *Integrated Resource Plan: Third Five-Year Update*, Oct.

Osiek, B., 2014, "Salt Lake City Area Integrated Projects, Post-2004 Allocations - Effective October 1, 2008 through September 30, 2024," personal communication from Osiek (Western Area Power Administration) to Les Poch (Argonne National Laboratory), May 23.

Platte River Power Authority, 2015, *Platte River Power Authority—Home*. Available at <http://www.prpa.org>. Accessed July 17, 2015.

PRPA (Platte River Power Authority), undated, *2012 Integrated Resource Plan*.

Reclamation (Bureau of Reclamation), undated, *Bureau of Reclamation Construction Cost Trends*, U.S. Department of the Interior. Available at <http://www.usbr.gov/tsc/techreferences/mands/cct-pdfs/cct12-15.pdf>. Accessed May 28, 2015.

Reclamation, 2005, *Operation of Flaming Gorge Dam Final Environmental Impact Statement*, U.S. Department of the Interior, Upper Colorado Region, Salt Lake City, Utah, Sep.

Reclamation, 2006, *Record of Decision: Operation of Flaming Gorge Dam Final Environmental Impact Statement*, U.S. Department of the Interior, Feb. Available at <http://www.usbr.gov/uc/envdocs/rod/fgFEIS/final-ROD-15feb06.pdf>. Accessed April 1, 2015.

Reclamation, 2007a, *Colorado River Interim Guidelines for Lower Basin Shortages and Coordinated Operations for Lake Powell and Lake Mead*, U.S. Department of the Interior, Boulder City, Nev., Oct. Available at <http://www.usbr.gov/lc/region/programs/strategies/FEIS>. Accessed May 27, 2015.

Reclamation, 2007b, *Environmental Impact Statement—Colorado River Interim Guidelines for Lower Basin Shortages and Coordinated Operations for Lake Powell and Lake Mead*, Bureau of Reclamation, Upper and Lower Colorado Region, October. Available at <http://www.usbr.gov/lc/region/programs/strategies.html>. Accessed May 2013.

Reclamation, 2014a, “Change in Discount Rate for Water Resources Planning,” *Federal Register* Vol. 79 No. 248, Dec. 29, p. 78108.

Reclamation, 2014b, “Subject: Interest Rates for Fiscal Year 2015,” Control No. 84-55000, memorandum from R. Gonzales, Director of Policy and Administration, Nov. 25.

Scheid, N., 2015, personal communication from Scheid (Western Area Power Administration), to T. Veselka (Argonne National Laboratory), Mar. 3.

SRP (Salt River Project), 2012, *Integrated Resource Plan FY 2013*, Town of Gilbert, Fort McDowell Yavapai Nation, and Salt River Pima-Maricopa Indian Community, Dec. 19.

Tri-State (Tri-State Generation and Transmission Association, Inc.), 2010, *Integrated Resource Plan/Electric Resource Plan*, Nov.

Tri-State, 2015, *Member Systems*. Available at <http://www.tristategt.org/OurMembers/members-directory.cfm>. Accessed July 17, 2015.

UAMPS (Utah Associated Municipal Power Systems), 2013, *2012 Integrated Resource Plan*.

UMPA (Utah Municipal Power Agency), 2013, *Integrated Resource Plan: Five-Year Plan (FY2013 to FY2017)*, Apr. 24.

UMPA, 2015, *Utah Municipal Power Agency—Home*. Available at <http://www.umpa.cc>. Accessed July 17, 2015.

Veselka, T.D., L.A. Poch, C.S. Palmer, S. Loftin, and B. Osiek, 2010, *Ex Post Power Economic Analysis of Record of Decision Operational Restrictions at Glen Canyon Dam*, ANL/DIS-10-6, Technical Memorandum, Argonne National Laboratory, July.

Veselka, T.D., L.A. Poch, C.S. Palmer, S. Loftin, and B. Osiek, 2011, *Revised Financial Analysis of Experimental Releases Conducted at Glen Canyon Dam during Water Years 1997 through 2005*, Technical Memorandum ANL/DIS-11-1, Argonne National Laboratory, January.

WAPA (Western Area Power Administration), 2015, *Power Marketing—Power Allocations*. Available at <https://www.wapa.gov/regions/CRSP/PowerMarketing/Pages/power-marketing.aspx>. Accessed Nov. 13, 2015.

Wicks, P., 2014, personal communication from Wicks (Western Area Power Administration), to T. Veselka and L. Poch (Argonne National Laboratory), Oct. 1.

WM Financial Strategies, undated, *Rates over Time—Interest Rate Trends*. Available at <http://www.munibondadvisor.com/market.htm>. Accessed Dec. 3, 2015.

WMPA (Wyoming Municipal Power Agency), 2015, *WMPA Membership*. Available at <http://www.wmpa.org/members>. Accessed July 17, 2015.

ATTACHMENT K.1:

GEOGRAPHIC SCOPE OF THE ANALYSIS

The geographic scope of the economic effects of the operations of Glen Canyon Dam has long been a topic of discussion among staff at the Western Area Power Administration (WAPA), Bureau of Reclamation (Reclamation), National Park Service (NPS), Grand Canyon Monitoring and Research Center (GCMRC), and Argonne National Laboratory (Argonne). The method described herein assumes that the effect of changes to the operation of the Glen Canyon Dam is limited to the Salt Lake City Area Integrated Projects (SLCA/IP) system; that is, SLCA/IP federal hydropower resources and WAPA's SLCA/IP long-term firm (LTF) customers. Figure 1 shows the extent of the study area considered in this analysis. This assumption became essential when the scope and timing of the Glen Canyon Dam Long-Term Experimental and Management Plan (LTEMP) power systems analysis were re-evaluated in June 2014 as a result of funding and schedule considerations. Several proposed options for proceeding were developed at that time to offer different levels of analytical detail, costs, and completion dates. The option selected (middle ground relative to detail, funding, and timing) defined the geographic scope as WAPA's SLCA/IP marketing area with ties to the rest of the Western Interconnection for market transaction at the Palo Verde hub. Budget and timing factors have determined the scope of this initial analysis.

This analysis assumes that there is little, if any, economic effect at electricity hubs outside the SLCA/IP system of hydropower plants and WAPA's firm customers in terms of changes in locational marginal prices (LMPs) as a result of alternative operations at Glen Canyon Dam. Argonne undertook a study that verified this limited regional influence. A report documenting this study will be written and peer reviewed. A final, peer-reviewed version of this report will not be available until sometime after the final LTEMP Environmental Impact Statement (EIS) has been published. Therefore, when simulating the operation of Glen Canyon Dam, the region of detailed modeling is restricted to the SLCA/IP system. Spot market transactions conducted at points between this system and the rest of the Western Interconnection will be represented as a static set of market prices for the Palo Verde hub.

Western Interconnection Energy Transactions

The SLCA/IP system is directly connected with other private or invest-owned electric utilities (IOUs) in the geographic area. Among these are Rocky Mountain Power, Excel Energy, and Public Service Company of New Mexico. An electrical market exists such that the SLCA/IP system can exchange with these utilities and others to which they are indirectly connected in order to lower operating costs. To approximate these economic energy exchanges, the AURORA model was run to simulate the dispatch of the entire Western Interconnection. Resulting prices from this run are then input into the more geographically limited, but more detailed, model of the SLCA/IP powerplants and its firm customers. It is assumed that these prices are static and do not change as a result of alternative operating criteria at Glen Canyon Dam. Glen Canyon Dam is a

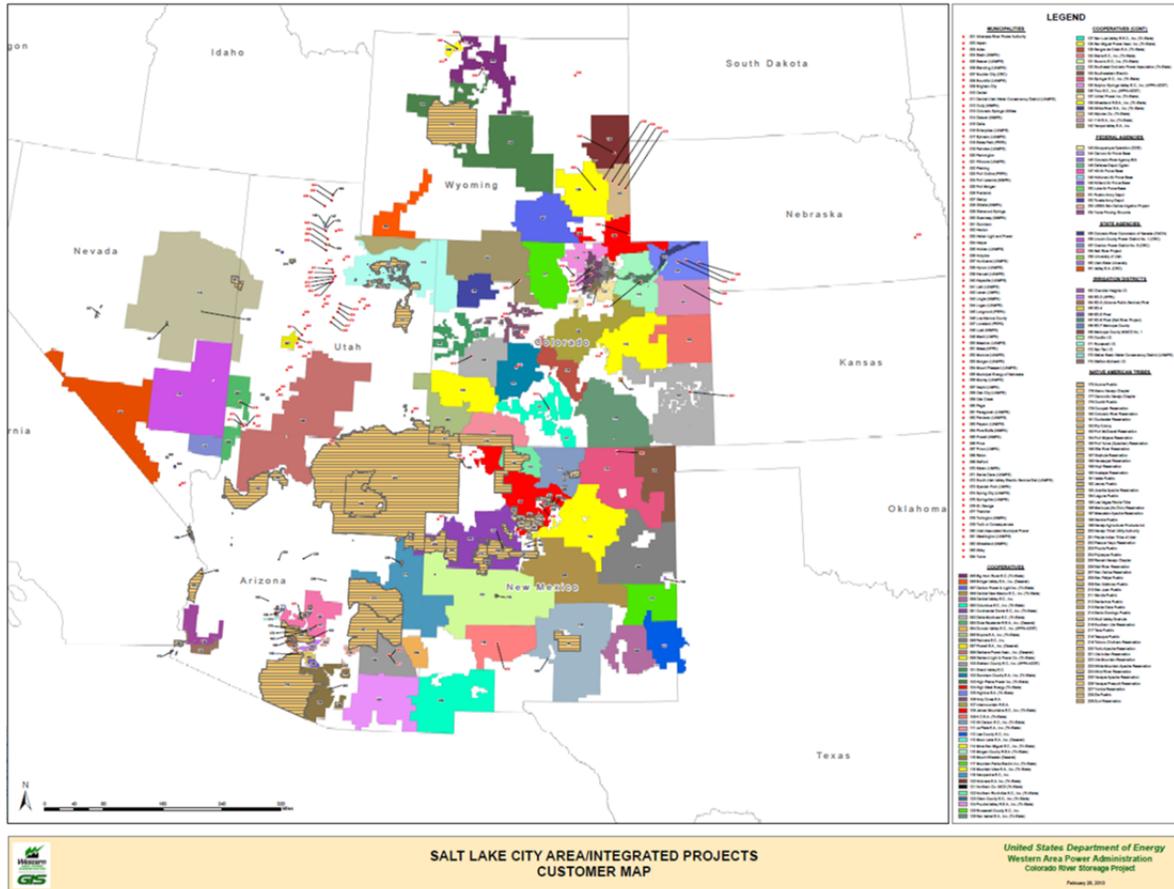


FIGURE 1 Study Area Considered in the LTEMP Power Systems Analysis

very small resource compared to the total Western Interconnection generating capacity and is thought to have only a miniscule impact on Western Interconnection market prices.

Western Interconnection Capacity Transactions

For this analysis, we make the simplifying assumption that no capacity exchange or joint expansion planning occurs—economic impacts of changes in Glen Canyon Dam capacity are limited to WAPA’s eight large SLCA/IP LTF customers. Note that smaller customers do not have significant supply resources. It is therefore assumed that small customers will not build capacity in the future. All lost Glen Canyon Dam capacity as a result of operational changes at Glen Canyon Dam would be replaced by the eight larger utility systems, and any resulting capacity losses for the small customers would be replaced via LTF capacity agreements with the larger utilities.

This assumption that the SLCA/IP system will replace lost capacity through its own initiatives can be justified if there is no accessible excess capacity in the larger region. Therefore,

a capacity loss at Glen Canyon Dam cannot be replaced via the purchase of excess capacity from a surrounding utility; for example, from IOUs with whom they are connected. If this assumption is true, the methodology described here will provide a very good approximation of the true economic impact, since the loss of Glen Canyon Dam capacity will require the construction of new capacity somewhere in the grid.

In order to properly assess the strength of this assumption, an examination of relevant regional data, such as integrated resource plans (IRPs) of WAPA's large customers that own generating facilities and large IOUs in the geographic and "electrical" area was conducted. In general, all IRPs examined revealed that utilities are expanding capacity with both renewable and thermal technologies in the near future. In addition, some utilities are increasing Demand Side Management programs to reduce the need for expanding capacity. It was also discovered that the loss of capacity in one large IOU (namely, NVEnergy) from a mandated shutdown of coal-fired powerplants will be replaced with natural gas-fired generation about a year after the first group of coal-fired units are shut down (see Figure 7 in Attachment K.9). Summaries of key IRPs are provided in Attachment K.9. The conclusion drawn from the review of the IRPs is that there is very little, if any, excess capacity in the Balancing Authorities in which WAPA's customers are located and in the broader power pool areas that are defined in the AURORA "out-of-the-box" model configuration. Therefore, loss in capacity at Glen Canyon Dam would need to be replaced soon after the loss was incurred. This loss could be replaced by new capacity that is either built by WAPA's customers or alternatively by another utility and sold via LTF capacity contracts. In this analysis, it is assumed that the replacement capacity would be directly built by the customers. From a purely economic viewpoint, there is little difference if the pool of eight large customers builds the capacity or if it is built by another utility.

Analysis Fidelity

Although in reality WAPA and its customers operate in the Western Interconnection, the approach used by Argonne power system analysts emphasizes performing high-fidelity analyses on a smaller network topology as opposed to analyzing system response of the entire Western Interconnection to changes in operating criteria dictated by LTEMP EIS alternatives. By accurately modeling a smaller system, it is possible to track and explain with a relatively high level of confidence both system- and component-level reactions to alternative operating criteria and to trout management flow (TMF) and HFE operation schedules. SLCA/IP system interactions with the broader Western Interconnection are also represented, but in far less detail. As described in this attachment, power systems analysts were able to fairly closely match historical 2013 generation levels for the eight large utility systems.

It should also be noted that unit commitments, system dispatch, and capacity expansion decisions are not made by a single entity that makes decisions for the entire interconnect. Instead autonomous decisions under uncertainty are made by many entries in the Western Interconnection using market price signals such as the ones reported by the Intercontinental Exchange (ICE) to take unit commitment, dispatch, and energy market transaction decisions. Therefore, the AURORA model of the Western Interconnection tends to "over optimize" system operations. Low 2012 Palo Verde market prices computed by AURORA may be in part due to

the “single decision maker” approach that is employed. Another difficulty in modeling Western Interconnection operations is that hydropower operating constraints for the multitude of hydropower plants within the interconnection are extremely challenging. The approach used in this analysis represents a middle ground between simulating each utility individually and optimizing Western Interconnection operations. It also allows the modeler to represent hydropower operations at a level of detail that cannot be simulated at an adequate level of fidelity by AURORA.

ATTACHMENT K.2:

AURORA WESTERN INTERCONNECTION SPOT MARKET ENERGY PRICES ADJUSTMENTS

The power systems analysis uses a representation of the spot market at the Palo Verde hub where SLCA/IP market system participants buy and sell energy at a set of given hourly prices. The methodology applied in this study uses this price set to represent the economic value of energy; that is, the marginal cost to produce energy that serves the last megawatt of load. This includes both fuel costs and variable operation and maintenance (O&M) expenses. Historical economic values are extremely difficult to accurately estimate because the Western Interconnection is composed of numerous independent entities that operate in a geographically large and very complex grid. Difficulties associated with modeling the Western Interconnection for long-term analyses consist of but certainly not limited to the following (<http://www.ipd.anl.gov/anlpubs/2012/04/73032.pdf>):

1. The interconnection includes multiple U.S. states and three countries;
2. Part of the system operates in an organized central market (i.e., CAISO) and other portions operate in a bilateral market;
3. A large fraction of Western Interconnection loads are supplied by hydropower plants, many of which are subject to complicated and difficult to model environmental operating criteria (even on a site-specific level);
4. A lack of unit-specific information on fuel prices and heat rate curves ;
5. Insufficient data on bus-level loads;
6. A large and complicated transmission system;
7. Lack of information on resource availability (e.g., unit outage and transmission line outages);
8. Forecast errors associated with loads, hydropower inflows, and variable resource (wind/solar) output; and
9. Complex interactions among entities that make decisions under uncertainty based on limited information about the interconnection.

All power systems models, including AURORA, must therefore make many simplifying assumptions about the grid and the mathematical representation of each grid component. These assumptions lead to an imperfect representation of reality.

In the study, spot market prices modeled for 2013 by the default Western Interconnection AURORA model were significantly different from day-ahead market (DAM) prices published by the ICE and the CAISO. The Palo Verde hub was chosen to represent prices for the spot market in the AURORA network topology for the LTEMP analysis because it is the hub closest to Glen Canyon Dam and is often used as the benchmark price for Western Area Power Administration (WAPA) energy transactions.

The ICE publishes day-ahead weighted average peak, off-peak, and Sunday off-peak electricity price for every day each year. Sunday off-peak hours are the 16 daytime hours that have the highest loads; they correspond to the 16 hr classified as peak in the other 6 days of the week. Hourly prices generated by the AURORA model were subdivided into 7 categories; namely, holiday, Sunday daytime, Sunday nighttime, Saturday peak, Saturday off-peak, weekday peak, and weekday off-peak. The monthly averages were computed for each category and compared against the monthly average of the ICE prices in these categories.

In order to bring AURORA model hourly prices in line with these ICE prices, AURORA model results were scaled to match ICE averages. A scalar (ratio of the ICE to AURORA prices) was generated for each month and each category. In this preliminary investigation, it was discovered that prices generated by the AURORA model were generally lower than the ICE prices. Prices in off-peak hours were lower by about 5 to 15% and prices in peak hours were lower by as much as 20 to 50%. To adjust for this discrepancy in prices, future AURORA model runs for the LTEMP network topology, AURORA prices at the Palo Verde hub were multiplied by the aforementioned scalar. The scalars derived from ICE prices are shown in Table 1.

TABLE 1 Scalars Used to Adjust Spot Market Prices in the AURORA Model

Month	Sunday			Saturday		Weekday	
	Holiday	Daytime	Nighttime	Peak	Off Peak	Peak	Off Peak
January	1.053	1.032	1.110	1.068	1.042	1.058	1.019
February	NA ^a	1.145	1.221	1.123	1.083	1.093	1.140
March	NA ^a	1.133	1.175	1.119	1.126	1.105	1.120
April	NA ^a	1.319	1.297	1.257	1.132	1.163	1.183
May	0.943	1.143	1.126	1.156	1.046	1.165	1.053
June	NA ^a	1.210	1.241	1.241	1.067	1.200	1.066
July	1.100	1.222	1.204	1.343	1.009	1.538	1.094
August	NA ^a	1.175	1.142	1.231	1.004	1.230	1.060
September	1.088	1.133	1.251	1.218	1.051	1.170	1.116
October	NA ^a	1.134	1.235	1.156	1.118	1.094	1.142
November	1.079	1.084	1.208	1.166	1.159	1.098	1.113
December	1.082	1.279	1.470	1.233	1.265	1.228	1.299

^a NA = not applicable.

The scaled AURORA prices were used as a surrogate for the economic value of energy based on the premise that the ICE data adequately reflects actual market prices and those market prices are a good measure of economic costs. In economic theory, a perfect market will produce prices that reflect economic costs. However, no market is perfect, including those in the Western Interconnection. Therefore, due to the complexities associated with modeling actual economic costs at the margin, power system modeler used the aforementioned scaling methodology. This not ideal, but it appears that market mechanisms in the Western Interconnection are working reasonably well and market monitors (such as those in the CAISO) help to ensure that participants do not unduly take advantage of market imperfections.

ATTACHMENT K.3:

SELECTION OF REPRESENTATIVE TRACE

Introduction

This paper briefly describes the process that was used for selecting a representative hydrology trace for use in the Long-Term Experiment and Management Plan (LTEMP) power systems modeling task. A single representative trace was required to balance the complexity and time requirements for power system simulations with task completion timelines. Goals in selecting a trace included considerations for (a) matching the probability distribution of annual water releases as exhibited in the full set of 21 hydrology traces developed by the Bureau of Reclamation, (b) representing the variability in monthly releases, (c) avoiding significant numbers of non-power release events (where monthly volumes and elevations lead to water releases not being fully utilized for power generation), and (d) providing reasonably close matches (across all six alternatives and long-term strategies) for end-of-year elevations and release volumes. The following sections describe several metrics that were developed to characterize these goals and provided the basis for selecting a representative trace.

Six alternatives and long-term strategies,¹ including a no action alternative, were originally proposed for study in the LTEMP Draft Environmental Impact Statement (DEIS). A seventh alternative, Alternative D, was proposed after this analysis for choosing a representative trace was performed, and is not included in this analysis. The alternatives have been assigned a letter designation and will be referenced in this document by that letter: Long-Term Strategies B1, C1, and E1, and Alternatives F and G. Alternative A, the no action alternative, is the current operating regime and is known as modified low fluctuating flow (MLFF) as defined in the 1996 Record of Decision.

Annual Powell Outflows—Exceedance Curves

A priority in selecting a single representative 20-year hydrology trace for power modeling is to capture the range and distribution of water conditions that occur across all 21 of the original 20-year hydrology traces. To address that objective, we constructed time-independent exceedance curves (basically representing probability distributions) for the annual Powell outflows for each of the 21 traces and six alternatives and long-term strategies. As a metric for comparing the closeness of fit for those 21 distribution profiles as compared with the full set of traces, we calculated the least-squares differentials between each trace-specific

¹ It should be noted that at the time the representative trace was chosen, the LTEMP DEIS had only 6 alternatives and long-term strategies. A hybrid or 7th alternative was subsequently added. The hybrid is a combination of the C1 and E1 long-term strategies; however, the choice of the representative trace would not be affected by the addition of the hybrid alternative.

TABLE 1 Powell Outflow Exceedance: Rankings of Traces by Least-Squares Differentials as a Measure for Matching the Distribution of Releases for All Traces^a

Rank	Alternative A (No Action Alternative)		Long-Term Strategy B1		Long-Term Strategy C1		Long-Term Strategy E1		Alternative F		Alternative G	
	Trace	Sq. Diff ^b	Trace	Sq. Diff.	Trace	Sq. Diff.	Trace	Sq. Diff.	Trace	Sq. Diff.	Trace	Sq. Diff.
1	Trace 14	710	Trace 14	710	Trace 13	636	Trace 13	637	Trace 14	533	Trace 13	872
2	Trace 19	836	Trace 19	836	Trace 19	906	Trace 14	1,130	Trace 13	832	Trace 14	940
3	Trace 13	1,024	Trace 13	1,024	Trace 14	1,055	Trace 19	1,401	Trace 19	930	Trace 19	1,133
4	Trace 12	1,208	Trace 12	1,208	Trace 12	1,241	Trace 12	1,448	Trace 12	1,257	Trace 12	1,337
5	Trace 15	2,353	Trace 15	2,353	Trace 15	2,548	Trace 15	2,620	Trace 15	2,639	Trace 15	2,590
6	Trace 3	2,594	Trace 3	2,594	Trace 3	3,811	Trace 3	3,945	Trace 3	3,003	Trace 3	3,746
7	Trace 18	3,509	Trace 18	3,509	Trace 18	4,249	Trace 7	4,661	Trace 7	4,150	Trace 18	3,833
8	Trace 7	3,962	Trace 7	3,962	Trace 7	4,641	Trace 18	4,835	Trace 18	4,394	Trace 7	4,362
9	Trace 4	4,096	Trace 4	4,096	Trace 4	5,110	Trace 4	5,106	Trace 4	4,642	Trace 4	4,676
10	Trace 17	4,541	Trace 17	4,541	Trace 2	5,406	Trace 17	5,392	Trace 17	5,129	Trace 17	5,028
11	Trace 16	5,245	Trace 16	5,246	Trace 17	5,420	Trace 2	5,846	Trace 2	5,440	Trace 2	5,631
12	Trace 2	5,325	Trace 2	5,325	Trace 6	7,051	Trace 16	6,429	Trace 6	6,467	Trace 16	5,919
13	Trace 6	5,648	Trace 6	5,648	Trace 20	7,258	Trace 6	7,047	Trace 16	6,669	Trace 6	6,460
14	Trace 20	7,399	Trace 20	7,399	Trace 16	7,572	Trace 20	7,359	Trace 20	7,511	Trace 20	7,390
15	Trace 8	9,687	Trace 8	9,688	Trace 0	10,979	Trace 8	10,992	Trace 0	10,858	Trace 8	10,202
16	Trace 10	10,446	Trace 10	10,446	Trace 1	11,068	Trace 0	11,008	Trace 10	11,016	Trace 0	10,865
17	Trace 0	10,868	Trace 0	10,868	Trace 8	11,350	Trace 1	11,332	Trace 8	11,255	Trace 10	11,111
18	Trace 1	11,249	Trace 1	11,249	Trace 10	11,557	Trace 10	11,601	Trace 1	11,491	Trace 1	11,408
19	Trace 5	11,262	Trace 5	11,262	Trace 5	12,662	Trace 5	12,816	Trace 5	12,712	Trace 5	12,113
20	Trace 9	13,003	Trace 9	13,003	Trace 9	14,797	Trace 9	14,807	Trace 9	13,982	Trace 9	14,046
21	Trace 11	14,321	Trace 11	14,321	Trace 11	16,284	Trace 11	16,349	Trace 11	15,433	Trace 11	15,501

^a Trace 14, the selected representative trace, is highlighted in green.

^b Note: Sq. Diff. = least squares differential between the trace-specific exceedance curve and the all-traces exceedance curve.

exceedance curve and the all-traces exceedance curve. These differentials were calculated separately for each of the six alternatives and long-term strategies (Table 1).

Table 2 shows that hydrology Trace 14 provides a distribution of annual water releases that closely mimics the full set of releases for all traces. We also observed that differences in the rankings when examining Powell outflows versus estimated power releases were minor and relatively insignificant to the selection of a single representative trace. Thus, the illustrations used in this summary focus primarily on Powell outflows.

Trace 13 also provides a good match with all-trace outflows, especially for Alternative G and Long-Term Strategies C1 and E1, where the least-squares differences are less than those for Trace 14. However, a large portion of the least-squares difference between Traces 13 and 14 is accredited to the closer match to near-peak releases for some alternatives in Trace 13 versus Trace 14, whereas Trace 14 exhibits a closer fit over other portions of the flow distributions (illustrated in figures that follow). Additionally, alternative-to-alternative inconsistencies in end-of-year Powell elevations and annual water releases were significantly greater for Trace 13 than Trace 14.

Trace 19 represents another possible contender with a good match to the all-trace variability. It is not considered further, though, because it includes numerous occurrences of Powell elevations below the top of the penstock within the 20-year modeling period (4 months for each alternative except Alternative F). The below-penstock occurrences across the 21 traces and 20 years are listed below:

- Alternative A—Trace 8: 3 in 2032; Trace 19: 12 in 2016 to 3 in 2017 inclusive.
- Long-Term Strategy B1—Trace 8: 3 in 2032; Trace 19: 12 in 2016 to 3 in 2017 inclusive.
- Long-Term Strategy C1—Trace 8: 3 in 2032; Trace 19: 12 in 2016 to 3 in 2017 inclusive.
- Long-Term Strategy E1—Trace 8: 3 and 4 in 2032; Trace 9: 3 in 2027; trace 19: 12 in 2016 to 3 in 2017 inclusive.
- Alternative F—none; all elevations above 3,490 ft.
- Alternative G—Trace 8: 2 in 2032 to 4 in 2032 inclusive; Trace 19: 12 in 2016 to 3 in 2017 inclusive.

Figures 1 through 5 illustrate the close match between Trace 14 and all-traces exceedance curves for annual Powell outflows. For comparison purposes, we also show: (1) Trace 14 exceedance curve for Long-Term Strategy C1, where Trace 14 ranked third instead of first in the distribution match (this represents the worst-case match for Trace 14); and (2) the Trace 19, 13, and 16 exceedance curves for the No Action Alternative (Alternative A) to illustrate the

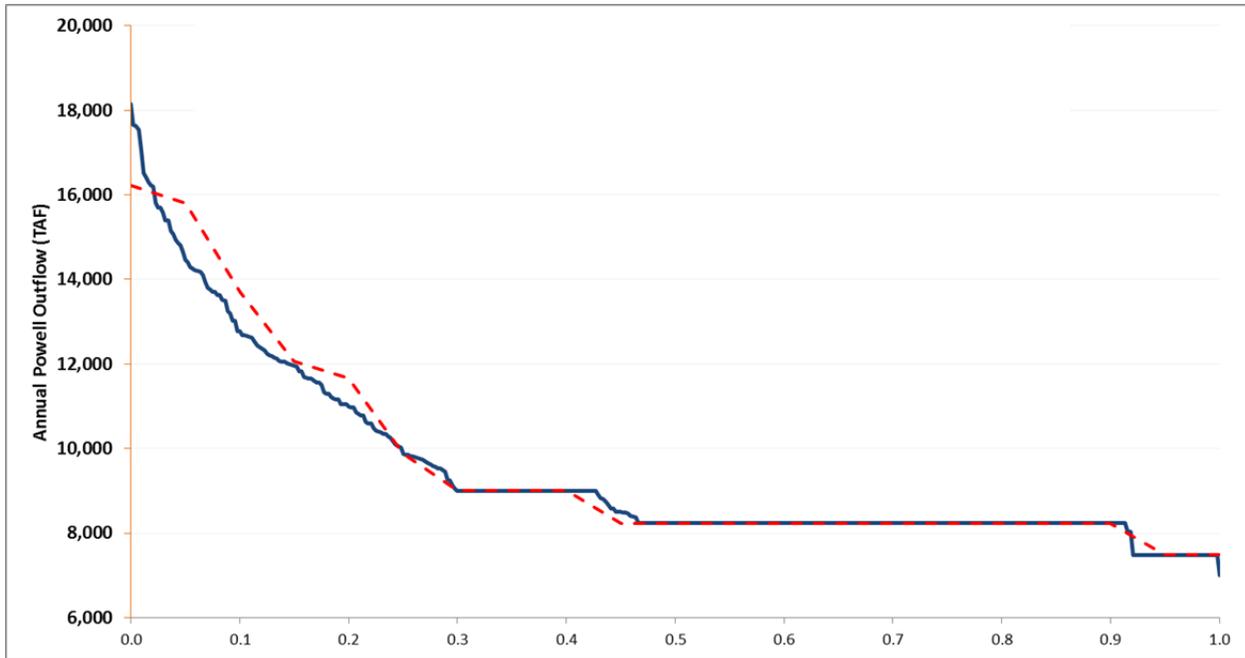


FIGURE 1 Exceedance Curve Comparing Outflows of Trace 14 (red dotted line) and the All-Trace Average (blue line) for the No Action Alternative

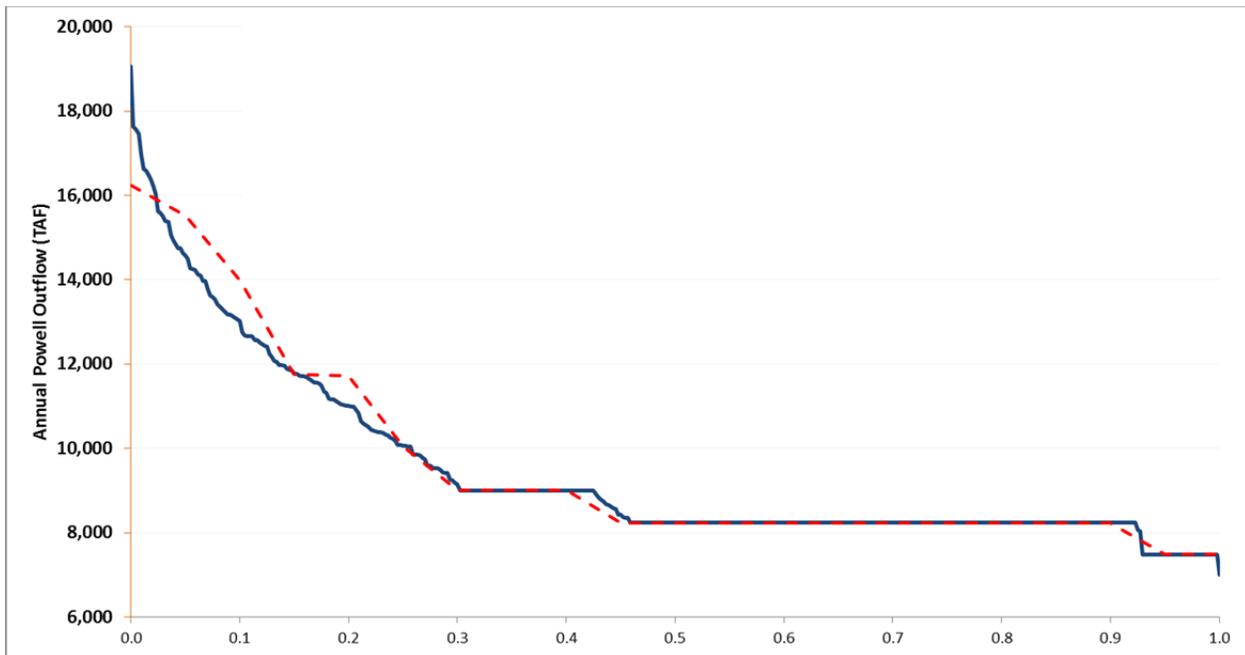


FIGURE 2 Exceedance Curve Comparing Outflows of Trace 14 (red dotted line) and the All-Traces Average (blue line) for Long-Term Strategy C1

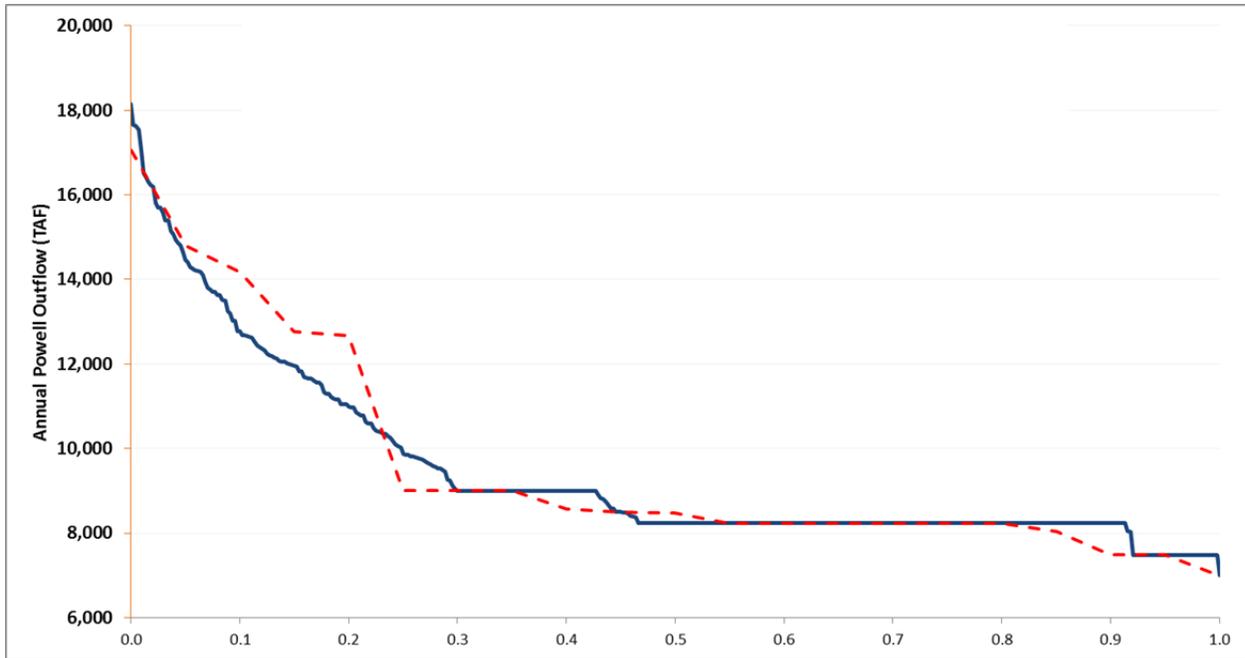


FIGURE 3 Exceedance Curve Comparing Outflows of Trace 19 (red dotted line) and the All-Traces Average (blue line) for the No Action Alternative

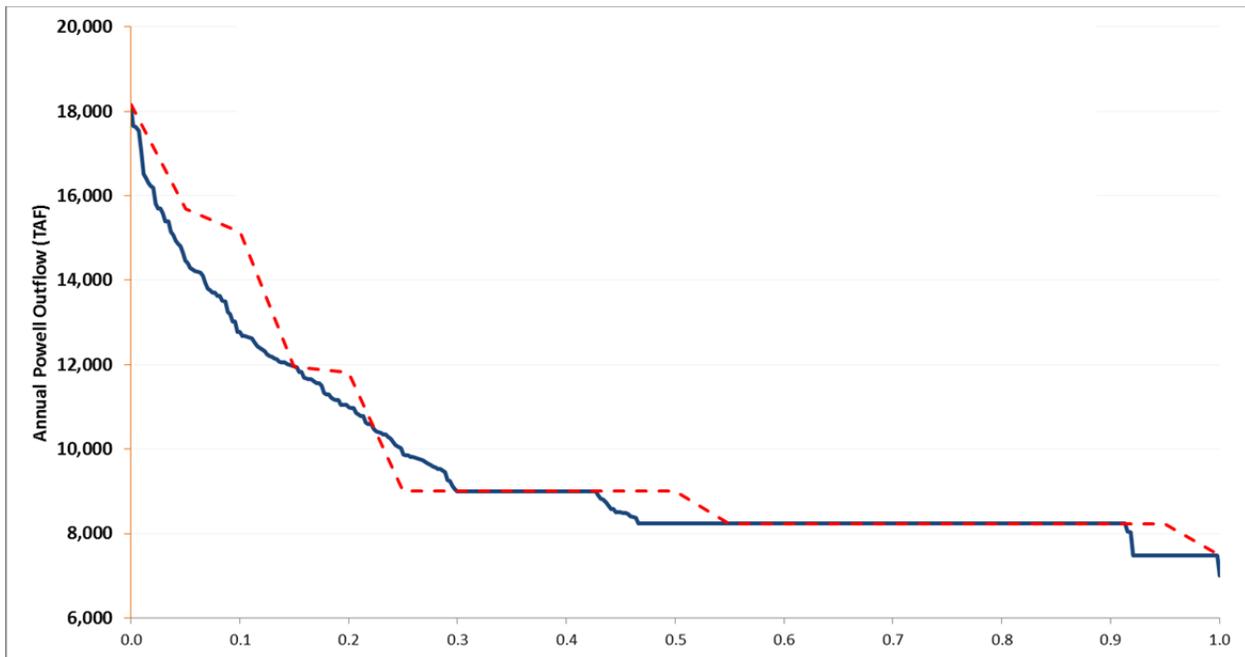


FIGURE 4 Exceedance Curve Comparing Outflows of Trace 13 (red dotted line) and the All-Traces Average (blue line) for the No Action Alternative

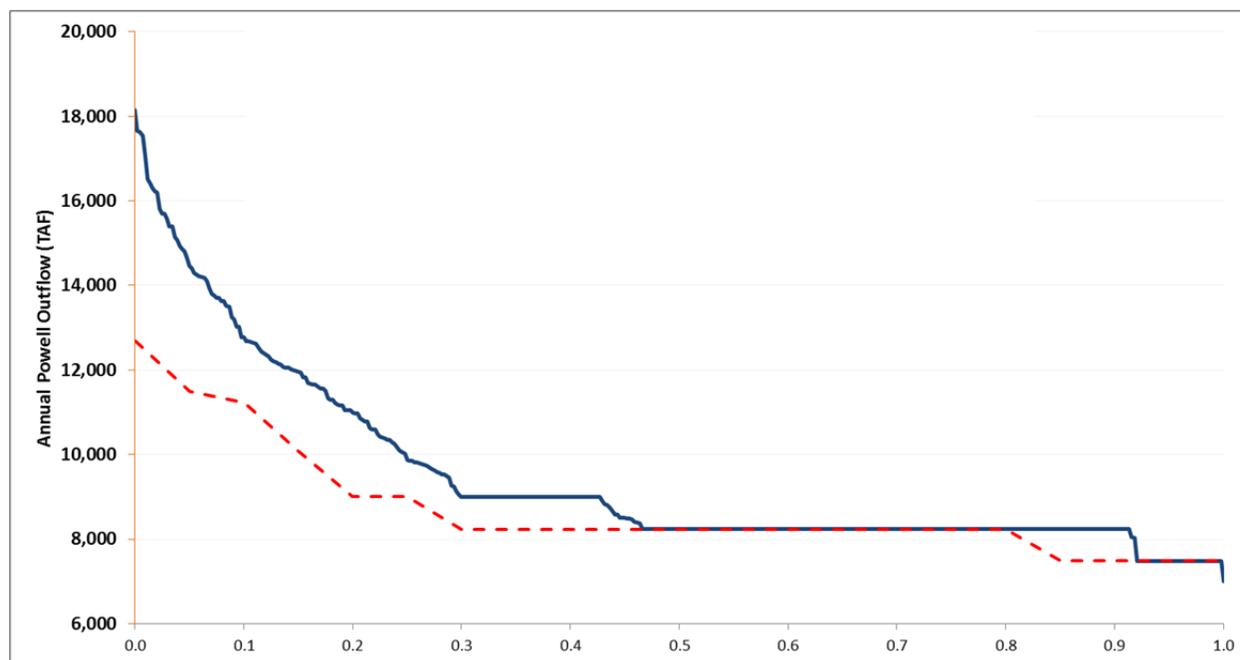


FIGURE 5 Exceedance Curve Comparing Outflows of Trace 16 (red dotted line) and the All-Traces Average (blue line) for the No Action Alternative

difference in fit between the top and middle-ranked traces (rankings for Alternative A are: Trace 19 = 2nd; Trace 13 = 3rd; and Trace 16 = 11th).

Comparison of Monthly Water Releases and Powell Elevations to Averages

Complementing the probability distribution analysis, monthly Powell elevations and water releases for each trace were compared to the associated averages for each month in the 20-year study period for all traces. Again, these comparisons were made separately for each alternative and long-term strategy. The objective in these examinations is to provide “representative variability” over the 20-year spans relative to average outcomes (i.e., the goal is to include conditions that are sometimes “wet,” sometimes “dry,” and sometime “average,” rather than conditions that are uniformly “average” across the entire study period).

Results of monthly outflow and end-of-month elevations for Trace 14 and the all-trace averages are plotted in Figures 6 to 11. Table 3 shows the number of HFES and the amount of water bypassed during all HFES for Trace 14 and the all-trace average. Trace 14 is characterized by lower-than-average water outflow through 2019, higher water outflow through 2026, followed by lower-than-average water outflow through 2033. As seen from these figures, the monthly Powell elevations and water releases averaged over the 21 traces are significantly less variable than observed for a single trace.

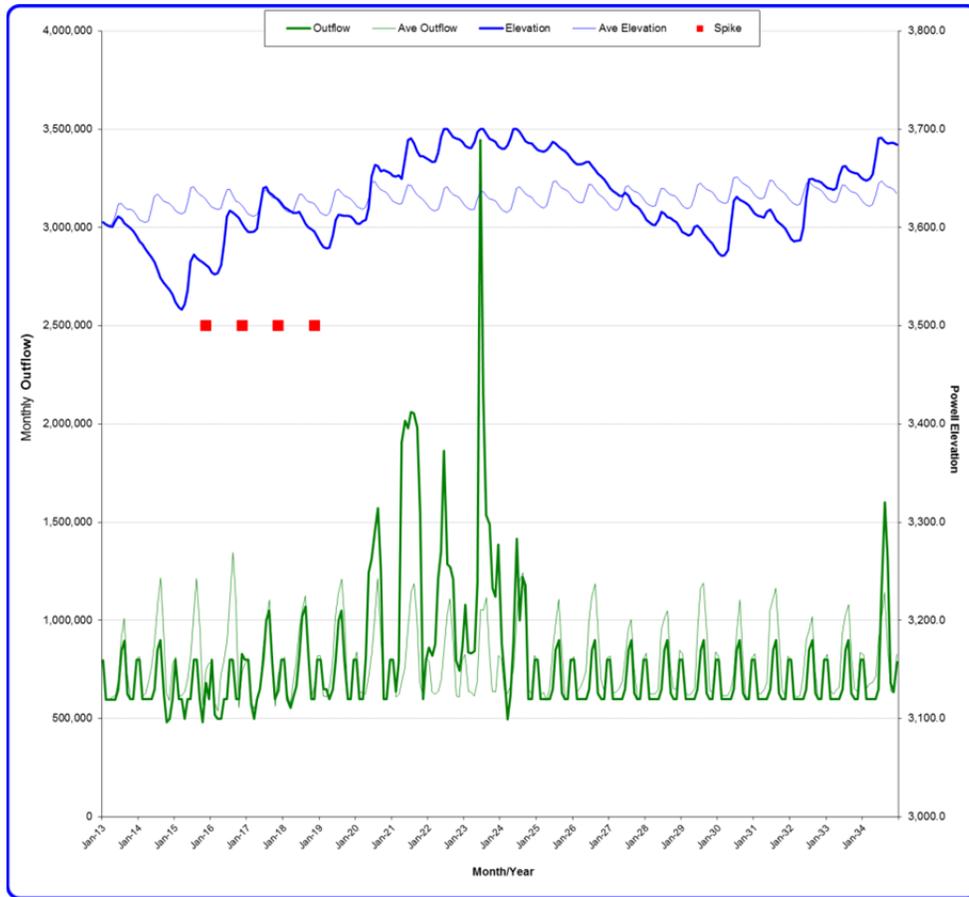


FIGURE 6 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for the No Action Alternative

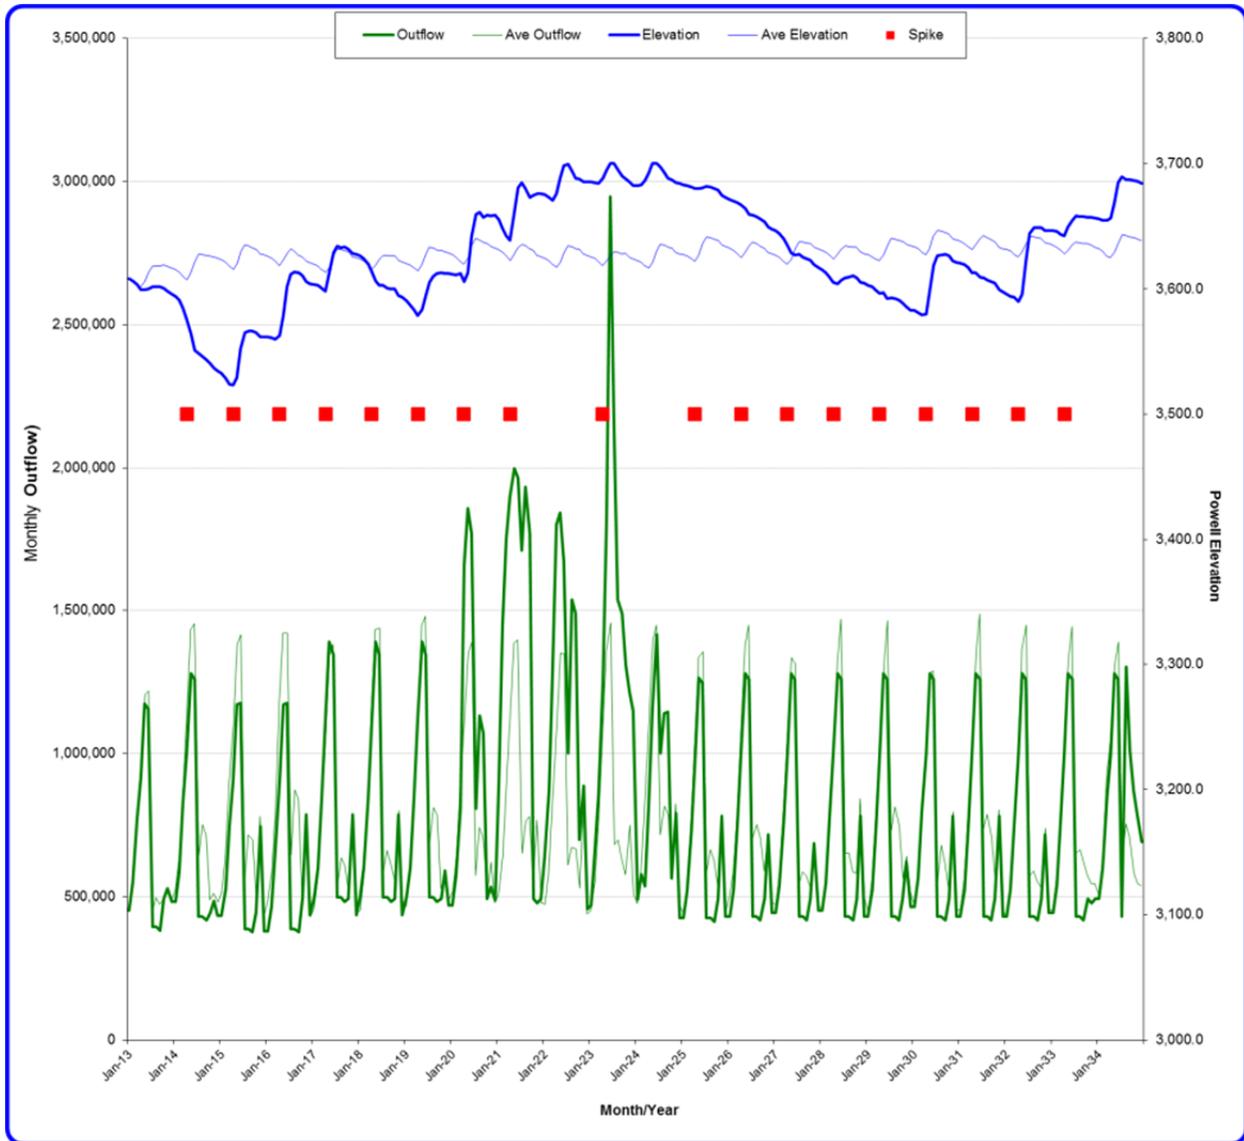


FIGURE 7 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for Alternative F



FIGURE 8 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for Alternative G

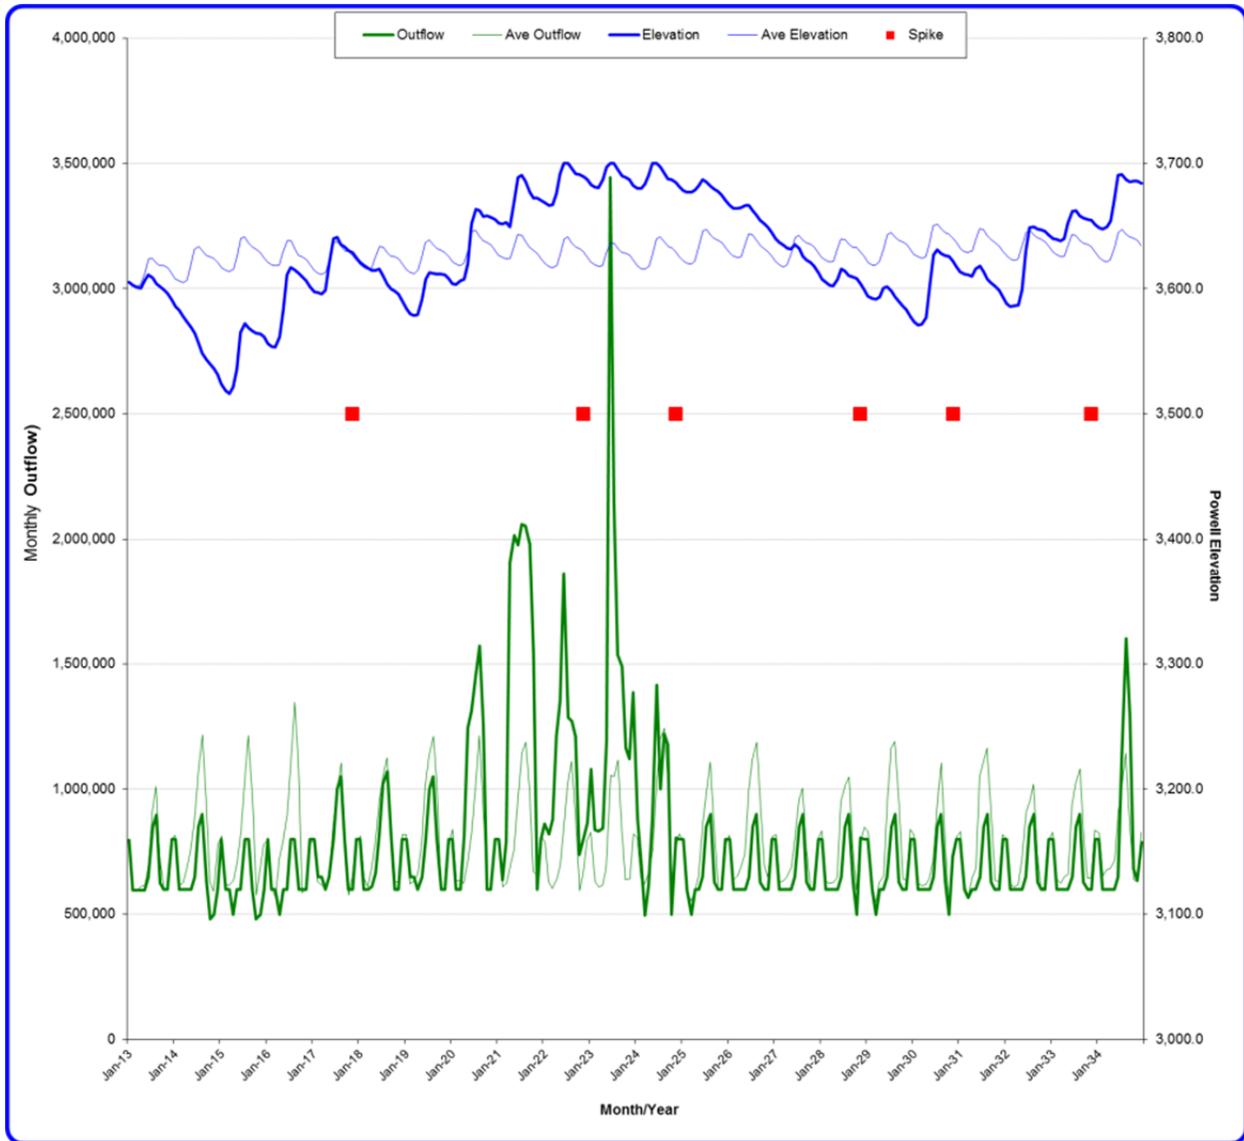


FIGURE 9 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for Long-Term Strategy B1

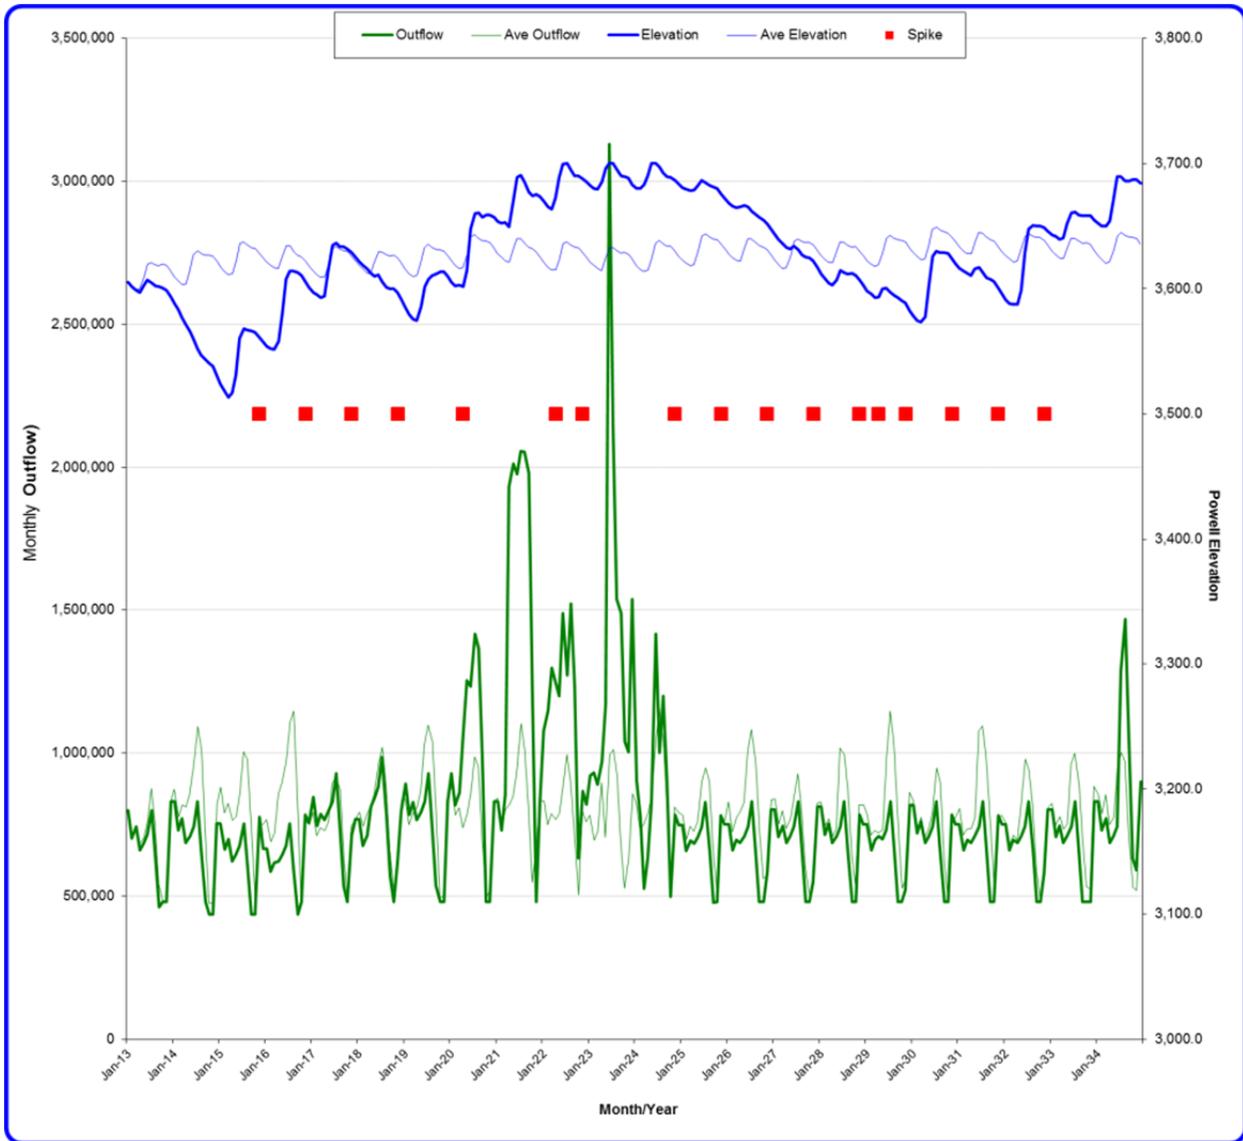


FIGURE 10 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for Long-Term Strategy C1

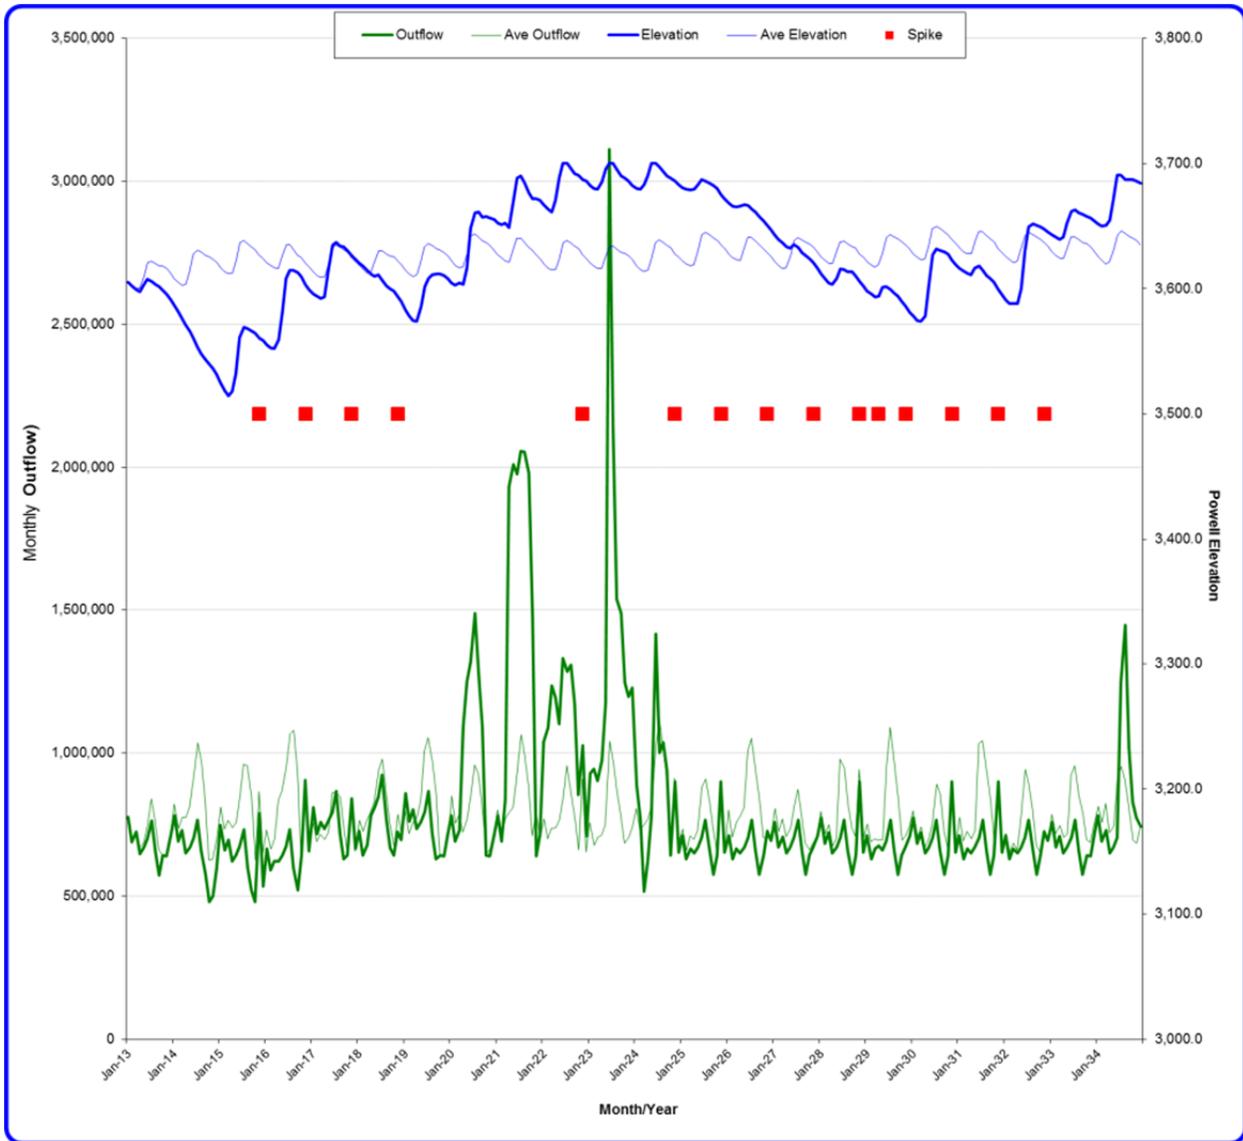


FIGURE 11 Comparison of Monthly Outflow and End-of-Month Elevation of Trace 14 and the All-Trace Average for Long-Term Strategy E1

TABLE 2 Number of HFEs and Amount of Water Spilled Bypassed during HFEs in Trace 14 and the All-Trace Average

Alternative/ Long-Term Strategy	Characteristic	Trace 14	21 Traces Average
A (No Action Alternative)	Number of HFEs	4	4
	Amount of bypassed water spilled during HFEs (kaf)	262	346
B1	Number of HFEs	6	7
	Amount of bypassed water spilled during HFEs (kaf)	472	553
C1	Number of HFEs	17	19
	Amount of bypassed water spilled during HFEs (kaf)	1,329	1,522
E1	Number of HFEs	15	16
	Amount of bypassed water spilled during HFEs (kaf)	1,236	1,211
F	Number of HFEs	18	19
	Amount of bypassed water spilled during HFEs (kaf)	1,734	1,853
G	Number of HFEs	22	22
	Amount of bypassed water spilled during HFEs (kaf)	3,188	2,591

TABLE 3 Rankings of Hydrology Trace 14 in Matching Average Elevations and Outflows Compared to the 21-Trace Average

Alternative/ Long-Term Strategy	Powell Elevation Trace 14 Rank	Powell Outflow Trace 14 Rank
A (No Action Alternative)	11	13
B1	11	13
C1	11	13
E1	10	13
F	12	13
G	10	13

Because capturing variability is an important objective for this study, an exact match to the 21-trace averages is not desirable. Table 4 illustrates how Trace 14 ranks near the middle of variability for all of the 21 traces; it is neither too close to the average during all years, nor the most extreme divergence from the average over all years.

To assess the 21 traces on a common metric, rankings were calculated based on the least-squares differences by rank relative to the monthly average of all 21 traces: Rank = 1 is the closest match to the average (smallest least-squares difference); Rank = 21 represents the largest difference relative to the average. Table 4 demonstrates that Trace 14 is in the mid-range for both elevation and outflow. The point of this comparison is to illustrate that the selected trace contains neither excessive variability, nor insufficient variability relative to all of the traces under consideration.

Evaluation of Differentials in End-of-Year Powell Elevations and Annual Water Releases

For the representative hydrology trace selection, we also examined how closely each trace's end-of-year Powell elevations and annual water releases match when compared across all six alternatives and long-term strategies. In theory, these values should match closely, but we found that this is not the case for a majority of the traces. To generate a common metric for trace-specific comparisons, we first calculated the differences in both end-of-year elevation and annual outflow between Alternatives A and F; A and G; A and Long-Term Strategy B1; A and Long-Term Strategy C1; and A and Long-Term Strategy E1 for each of the 20 years and each hydrology trace (using Alternative A [no action alternative] as a reference point). Since these values should ideally all be zero, we calculated the least-squares differentials and ranked the traces according to the sum of the least-squares differences for the five comparisons listed above. Table 5 shows that for these criteria, Trace 14 ranks near the middle of all traces, indicating that it does not represent an extreme case for deviations in end-of-year elevations or annual water releases. In contrast, Trace 13 exhibits the worst match (21st) in annual outflows and ranks 18th in Powell end-of-year elevations.

Examining this same issue through graphical depictions, Figures 12 and 13 compare the differentials for Traces 14 and 13 side by side, in year-by-year plots of the pairwise end-of-year differentials. Trace 14 is preferred over Trace 13 because of the more consistent end-of-year Powell elevations and annual water releases across the six alternatives and long-term strategies.

Evaluation of HFE Bypasses

As a final comparison, Figure 14 shows quantities of water bypassed during the HFEs for Trace 14 (highlighted as enlarged red diamond) compared to other traces for each of the six alternatives. These comparisons show that Trace 14 exhibits outcomes that span the range of possible rankings relative to other traces. That is, Trace 14 exhibits HFE bypass volumes that are low, medium, and high, for various alternatives, in comparison with other traces. These observations make Trace 14 a favorable candidate for representative bypass characteristics across all alternatives.


TABLE 4 Rankings of Hydrology Traces Compared to All-Trace Average for End-of-Year Elevations and Annual Water Releases

Rank (1 = least differential)	Powell Elevation		Powell Outflow	
	Trace Number	Square Differential	Trace Number	Square Differential
1	Trace 4	6.51	Trace 9	0.000
2	Trace 9	20.05	Trace 4	0.000
3	Trace 11	26.91	Trace 11	0.000
4	Trace 6	32.63	Trace 6	0.001
5	Trace 0	43.05	Trace 8	0.003
6	Trace 20	47.32	Trace 12	0.006
7	Trace 3	47.95	Trace 15	0.006
8	Trace 1	54.64	Trace 14 ^a	0.007
9	Trace 2	59.81	Trace 0	0.008
10	Trace 7	64.72	Trace 20	0.010
11	Trace 12	127.00	Trace 2	0.015
12	Trace 15	192.56	Trace 1	0.015
13	Trace 14 ^a	235.30	Trace 3	0.016
14	Trace 17	326.53	Trace 17	0.018
15	Trace 19	354.81	Trace 7	0.019
16	Trace 16	458.47	Trace 5	0.029
17	Trace 8	583.18	Trace 19	0.060
18	Trace 13 ^a	838.12	Trace 10	0.071
19	Trace 5	914.47	Trace 18	0.086
20	Trace 18	1085.39	Trace 16	0.099
21	Trace 10	2363.07	Trace 13 ^a	0.112

^a Traces 13 and 14 are highlighted to illustrate their relative rank with respect to end-of-year elevations and annual water releases.


Summary

The observations and comparisons described above were used to select hydrology Trace 14 as the representative trace. Characteristics such as annual water release distributions, monthly water release variability, bypass events, and end-of-year elevation/volume consistency were considered and a majority of these factors favor Trace 14. While a few other traces show comparable strengths in certain comparison categories, each of those candidate traces show less favorable rankings in other categories.

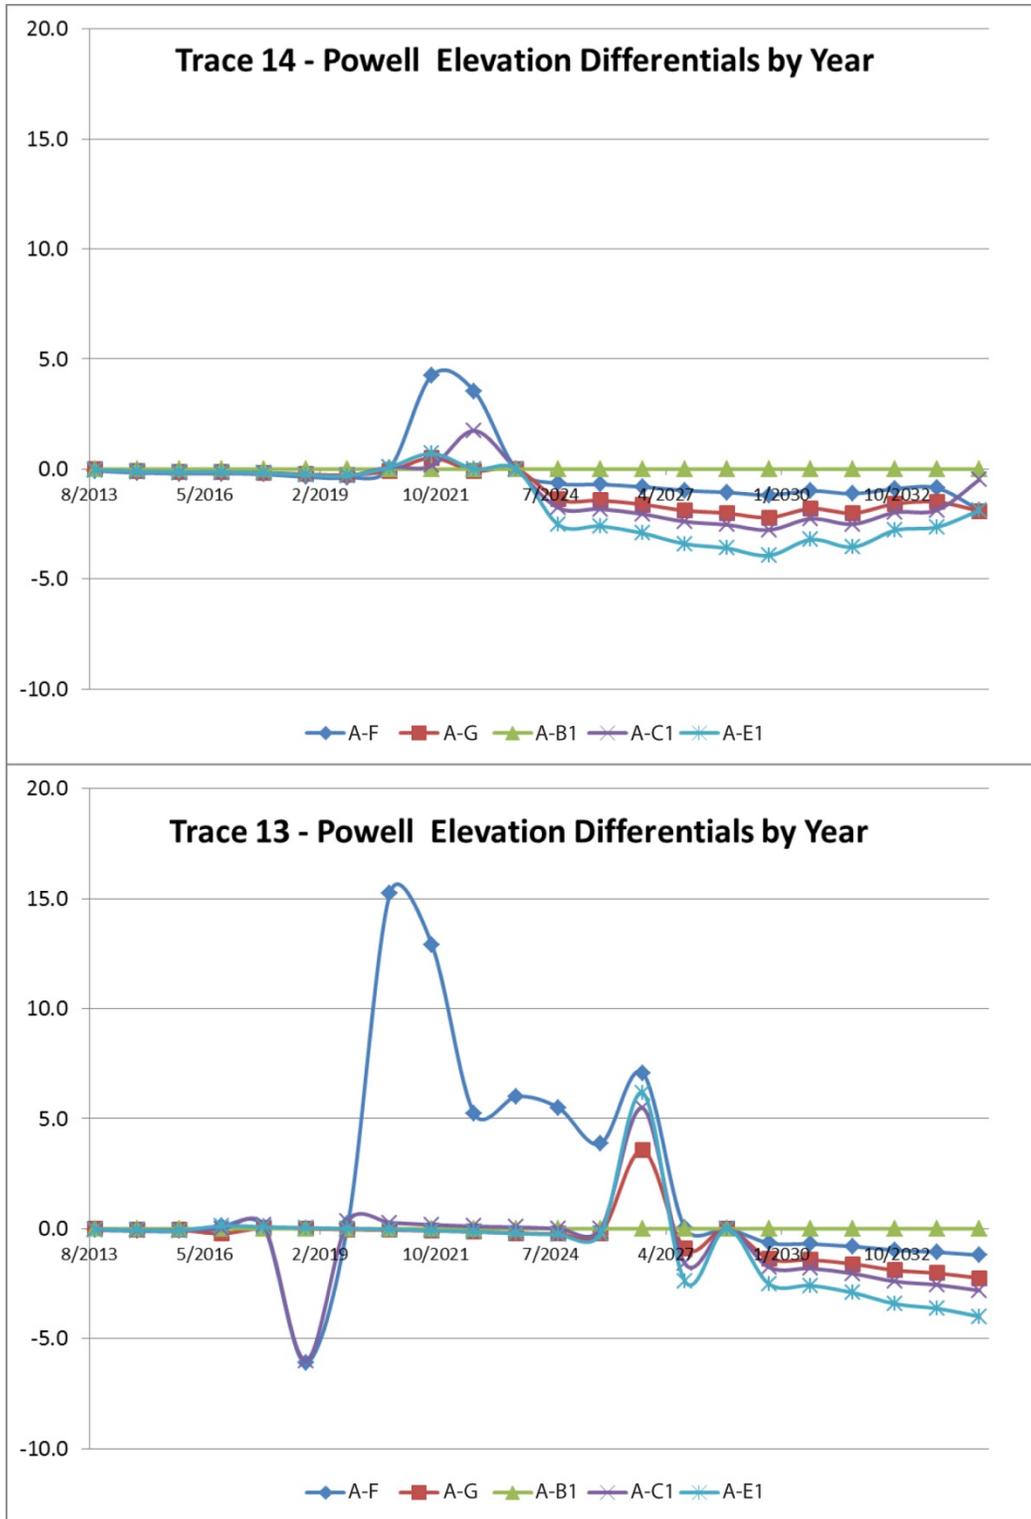


k1071513

FIGURE 12 Pairwise Annual Lake Powell Elevation Differentials for Traces 14 and 13 (Alternative A is the reference case)

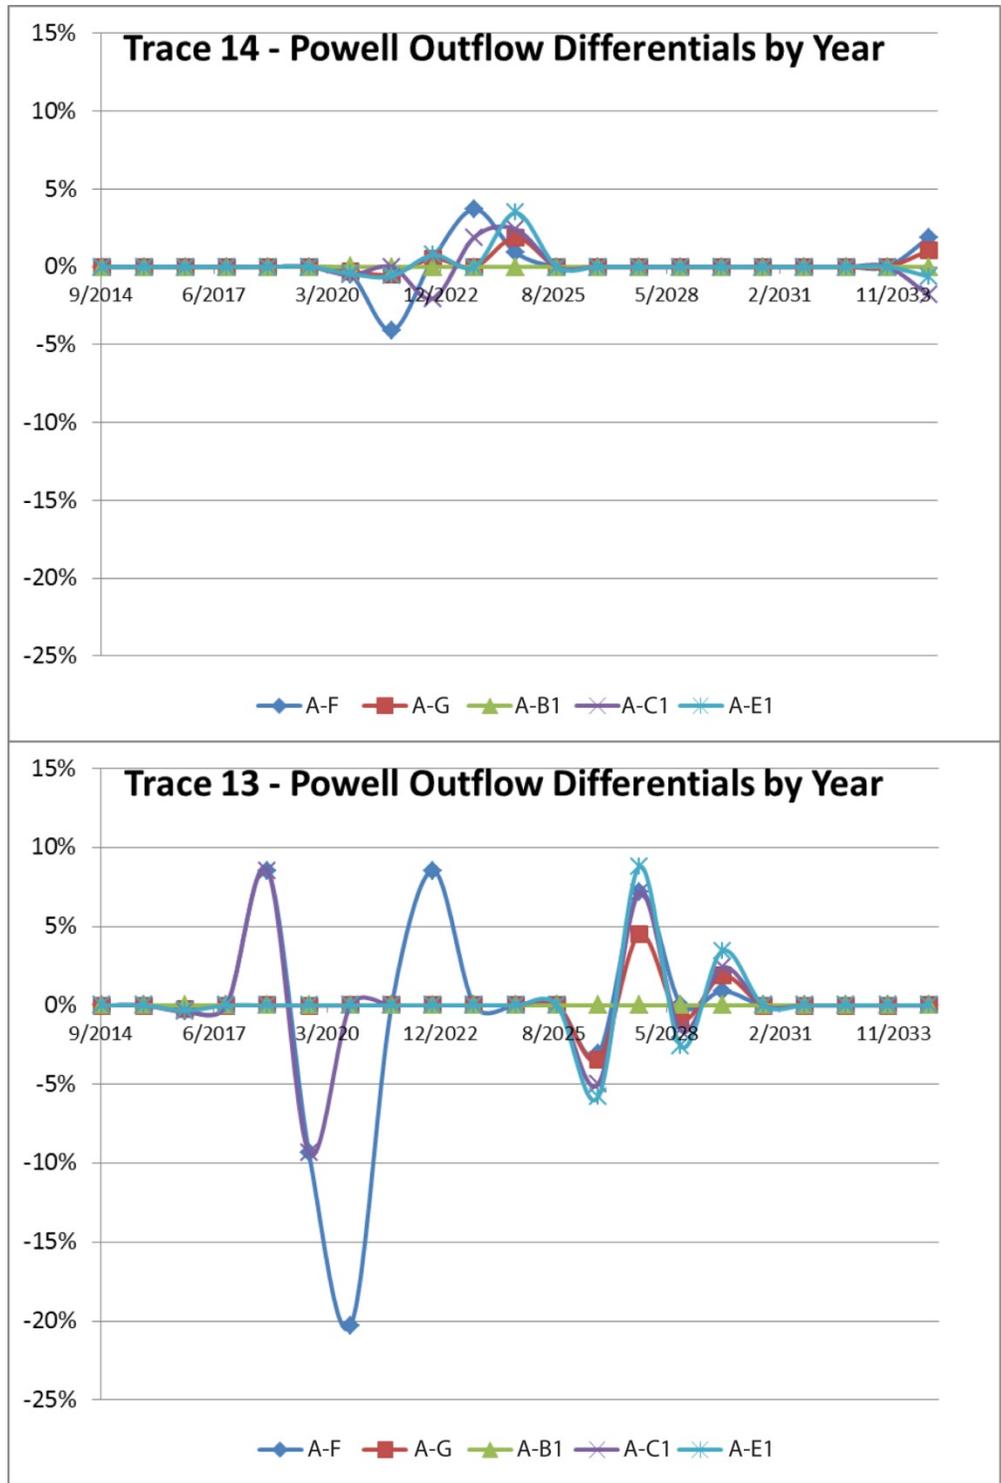

K1071514

FIGURE 13 Pairwise Annual Lake Powell Outflow Differentials for Traces 14 and 13 (Alternative A is the reference case)

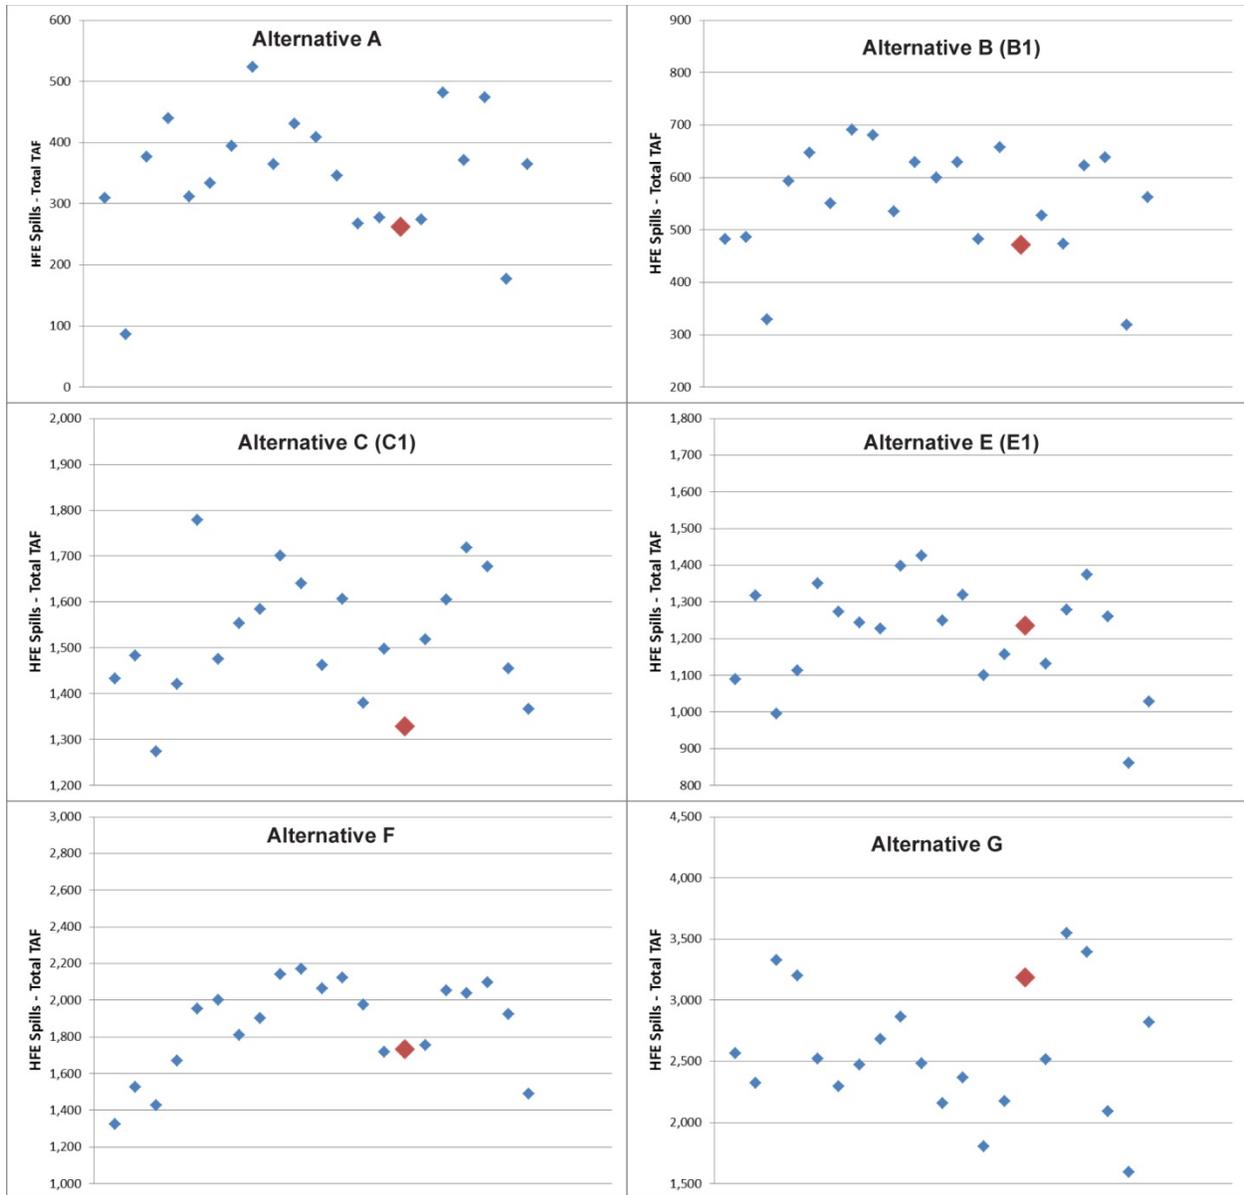

kl071515

FIGURE 14 Quantity of Water Bypassed during HFEs across All Hydrology Traces and All Six Alternatives

ATTACHMENT K.4:

DISCOUNTING PROCEDURES

The costs and benefits of most environmental policies are incurred at different times over what are frequently long time horizons. A fundamental concept in finance and economics is that the timing of benefits and costs makes a difference in the attractiveness of an investment. All other things being equal, one would prefer to receive the benefits of an investment as soon as possible and to pay the costs as far out in the future as possible. Given the choice between receiving \$100 today or \$100 a year from now, most people would prefer \$100 today. Alternatively, if given the choice between paying out \$50 today or one year from now, most of us would prefer the latter.

Because the timing of these costs and benefits differs across alternatives, the responsible policy choice requires the use of appropriate techniques to allow for commensurate comparisons. Typically, the present value of the future stream of costs and benefits for each alternative is computed and the results arrayed for decision-makers.

Discounting is the method used for identifying the present value of a cost or benefit that occurs at some time in the future. The process of “discounting” is used to make costs or benefits that occur at different points in time commensurate with each other.

Although the mechanics of the discounting process are very straightforward, the magnitude of the discount rate greatly influences the degree to which future costs and benefits “count” in the decision. As a result, the choice of discount rate is the subject of much controversy.

The literature on discounting and the choice of a discount rate is vast. Many modern economics texts contain synopses of this literature (e.g., Field 2008; Tietenberg and Lewis 2009). A more lengthy assessment can be found in the Environmental Protection Agency’s, *Guidelines for Preparing Economic Analyses* (EPA 2010) and Burgess and Zerbe (2011).

Federal water resource agencies, including the Bureau of Reclamation (Reclamation), are required to employ an administratively determined discount rate known as the federal plan formulation and evaluation rate when undertaking economic analyses of water resource and related matters (see 42 U.S.C. 1962d–17, Public Law 93-251-March 7, 1974 Sec. 80 (a)). This requirement and more specific analysis procedures are described in the *Economic and Environmental Principles and Guidelines for Water and Related Land Resources Implementation Studies* (U.S. Water Resources Council 1983). This document is often referred to as the “P&Gs.”

A new set of water resource planning guidelines have been announced which will ultimately supersede the P&Gs (Council on Environmental Quality 2014). In March 2013, the *Principles and Requirements for Federal Investments in Water Resources* (referred to as the P&Rs) were released and in December 2014 a set of *Interagency Guidelines* (IGs) were released by the President’s Council on Environmental Quality. Reclamation is now drafting agency-

specific procedures. These ongoing efforts will lead to production of a consolidated document, the *Principles, Requirements and Guidelines* (PR&Gs). Finalization of this effort is slated for calendar year 2016.

Two procedural points are relevant to this analysis. First, the forthcoming PR&Gs do not alter the statutory requirement of the Bureau of Reclamation to employ the federal plan formulation and evaluation rate in their water resource analyses. Second, this environmental impact study was initiated well-prior to completion of these new guidelines, and the PR&Gs are not applicable to the analysis reported here.

As prescribed by law and described in the P&Gs, federal water resource agencies must use an administratively determined discount rate for cost-benefit analysis. This rate is known as the federal discount rate for plan formulation and evaluation. The plan formulation and evaluation rate is calculated annually by the Secretary of the Treasury pursuant to 42 U.S.C. 1962d-1 (see the *Code of Federal Regulations* [CFR] at 18 CFR Part 704 for a description of the methodology) and then is officially transmitted to the water resource agencies. The plan formulation and evaluation rate for fiscal year (FY) 2015 is 3.375% (Reclamation 2014a,b).

Table 1 summarizes the inflation, escalation, and discounting procedures used in this analysis. As illustrated, the base year chosen for this economic analysis is 2015. The period of analysis is 21 calendar-years, spanning the period 2013 to 2033. All economic value estimates reported in this document are measured in 2015 dollars, unless otherwise stated.

The prices and values employed as input data for the economic modeling were reported at various times. To create a common input baseline, these prices and values were inflated from the year in which they were reported to 2014 dollars, using the annual Western Regional Consumer Price Index (CPI) (Bureau of Labor Statistics 2015).

TABLE 1 Discounting Procedures

Parameter	Value
Base year for reported results	2015
Period of analysis 2013 through 2033	21 years
Price escalation rate (2014 through 2015)	2.2126%
Price escalation rate (2015 through 2033)	0.0%
Discount rate ^a	3.375%

^a Federal Water Resource plan formulation and evaluation rate for FY 2015.

Modeling output was inflated from 2014 to 2015 dollars for reporting purposes. The equivalent annual CPI rate during the most recent 10-year (2004 to 2014) period was calculated to be 2.2126 percent (rounded to 4 decimal places). Price inflation from 2014 to 2015 was assumed to be the same as it was during this 10-year period. All 2014 values and prices were escalated from 2014 to the base year of 2015 using an escalation rate of 2.2126 percent.

To summarize, consistent with applicable federal law, the procedures described in the *Economic and Environmental Principles and Guidelines for Water and Related Land Resources Implementation Studies* (U.S. Water Resources Council 1983), all costs and benefits that occur after 2015 are reported in constant 2015 dollars (they are not escalated). Costs and benefits that occur in 2015 are not discounted, given that 2015 is the base year for this analysis. All costs and benefits that occur after 2015 are discounted back to the 2015 base year using the FY 2015 federal discount rate for plan formulation and evaluation (3.375%).

References

Bureau of Labor Statistics, 2015, "Consumer Price Index Overview Table—West." Available at http://www.bls.gov/xg_shells/ro9xg01.htm. Accessed Feb. 4, 2015.

Burgess, D., and R.O. Zerbe, Jr., 2011, "Appropriate Discounting for Benefit-Cost Analysis" *Journal of Benefit-Cost Analysis* 2(2):1–20.

Council on Environmental Quality, 2014, *Principles, Requirements and Guidelines for Federal Investments in Water and Land Related Resources Implementation Studies*, Executive Office of the President, Washington, D.C., updated December 2014. Available at <http://www.whitehouse.gov/administration/eop/ceq/initiatives/PandG>. Accessed Feb. 6, 2015.

EPA (Environmental Protection Agency), 2010, *Guidelines for Preparing Economic Analyses*, EPA 240-R-10-001, Office of the Administrator, Washington, D.C., Dec.

Field, B.C., 2008, *Natural Resource Economics—An Introduction*, 2nd Edition, Waveland Press, Inc., Long Grove, Ill.

Reclamation (Bureau of Reclamation), 2014a, "Change in Discount Rate for Water Resources Planning," *Federal Register* Vol. 79 No. 248, Dec. 29, p. 78108.

Reclamation, 2014b, "Subject: Interest Rates for Fiscal Year 2015," Control No. 84-55000, memorandum from R. Gonzales, Director of Policy and Administration, Nov. 25.

Tietenberg, T., and L. Lewis, 2009, *Environmental and Natural Resource Economics*, 8th Edition, Pearson, Addison-Wesley Inc., Boston, Mass.

U.S. Water Resources Council, 1983, *Economic and Environmental Principles and Guidelines for Water and Related Land Resources Implementation Studies*, U.S. Government Printing Office, Washington, D.C.

ATTACHMENT K.5:

FORCED OUTAGE SCENARIO GENERATION FOR HYDROELECTRIC POWER FACILITIES

The following is a description of the methodology used in creating a forced outage scenario for hydroelectric power facilities.

Requirement

1. Generate a reasonable forced outage scenario consistent with industry average for hydro units.
2. The forced outages should be multiple of 24 hr.
3. The forced outage always starts at the beginning of a day.

Inputs

1. Planned maintenance schedule for the hydroelectric power facility being modeled (from Reclamation)
2. Cause code statistics from the North American Electric Reliability Corporation (NERC)
3. Forced outage rate distribution from NERC

NERC publishes generating availability data system (GADS; <http://www.nerc.com/page.php?cid=4|43|47>). These reports contain aggregate statistics for various unit types. The cause code group statistics provides the number of forced outages and the number of hours under forced outage per unit per year. Tables 1 and 2 contain the relevant data extracted from GADS 2010.

Methodology

1. For each year and for each unit, randomly assign a forced outage rate (FOR) based on the distributions in Table 2.
2. Compute the forced outage hours based on the assigned FOR and service hours. Service hours are the number of hours the unit is not on planned maintenance schedule (i.e., available for generation).
3. Sum forced outage hours across all the units for a given year (TOTSYS)

TABLE 1 Cause Code Statistics for Hydro Plants >30 MW 2006–2010

Unit Type	Index	Cause Code	Description	Avg. No. of Outages per Unit Year	Avg. Hours Out per Unit Year
9	1	3600-3689	Electrical	0.31	25.28
9	2	3810-3899	AuxiliarySystems	0.06	2.71
9	3	3950-3999	Miscellaneous(BalanceOfPlant)	0.04	0.39
9	4	4500-4590	GENERATOR	0.17	45.18
9	5	4600-4609	Exciter	0.16	10.75
9	6	4610-4650	CoolingSystem	0.04	3.03
9	7	4700-4750	Controls	0.19	4.28
9	8	4800-4899	Miscellaneous(Generator)	0.1	9.92
9	9	7000-7099	Turbine	0.36	42.05
9	10	7100-7199	WaterSupplyDischarge	0.29	25.83
9	11	7200-7299	Miscellaneous(HydroTurbinePump)	0.23	11.25
9	12	9000-9040	Catastrophe	0.06	1.57
9	13	9135-9160	Economic	0.01	9.24
9	14	9300-9320	Miscellaneous(External)	0.26	1.4
9	15	9504-9590	Regulatory	0.01	0.01
9	16	9676-9696	OtherOperatingEnvironmentalLim	0.01	0.15
9	17	9700-9720	Safety	0	0
9	18	9900-9920	PERSONNELERRORS	0.05	0.22
9	19	9999-9999	PERFORMANCE	0.01	0.27

TABLE 2 Equivalent Forced Outage Rate Distribution

Unit Type	Index	FOR (Max)	Exceedance Curve
9	1	0	0.069
9	2	0.01	0.5727
9	3	0.02	0.7063
9	4	0.05	0.8238
9	5	0.1	0.8987
9	6	0.2	0.9383
9	7	0.3	0.9574
9	8	0.4	0.9721
9	9	0.5	0.9838
9	10	0.6	0.9883
9	11	0.7	0.9927
9	12	0.8	0.9956
9	13	0.9	0.9971
9	14	1	1

4. Using cause code statistics, calculate average outage length in hours for each cause code (column 6 divide by column 5 in Table 1).
5. Compute the total forced outage hours for each cause code across all units (column 6 * no. of units) and also the total forced outage hours across all units and all cause codes (TOTFOH).
6. Total outage hours based on cause codes are typically much lower than the hours out for units since cause codes outages are based on actual data and reflect only those hours that the unit is in service or called into service. Compute a "SCALE" as the ratio of TOTFH and TOTSYS.
7. Compute the total number of outages for each cause code across units using the "SCALE", column 5 from Table 1 and the total number of units.
8. For each cause code, loop through the number of outages. Randomly select a unit and a random start time that the unit is not on planned maintenance. Assign the forced outage for the duration of average outage length for the given cause code (from step 4 above).
9. Adjust the length of forced outage to be a multiple of 24 hr and move to the beginning of the day, if necessary.

ATTACHMENT K.6:

**FORECAST OF MONTHLY PEAK LOADS AND ENERGY BY SLCA/IP
 LONG-TERM FIRM CUSTOMER**

The development of hourly load projections over the study period is based on the 2006 representative nominal load profile and monthly projections of utility-level peak and total loads. Implementation of this method differs from utility to utility depending upon data availability. The primary source of forecast information was the utility’s integrated resource plan (IRP). If these data are not available in the IRP, then generation and capacity projections from the Energy Information Administration’s (EIA’s) 2014 Annual Energy Outlook (EIA 2014) are used instead. The method for developing the hourly load forecast for each of the eight utilities plus Western Area Power Administration’s (WAPA’s) remaining small customers is described in more detail in Section K.1.6.3 of Appendix K.

Figures 1 and 2 show monthly peak loads and total monthly load projections, respectively, for each of the eight large customers and the two aggregate small customer groups. This data was used to generate the graphs shown in Figures K.1-15 and K.1-16 in Section K.1.6.3 of Appendix K.

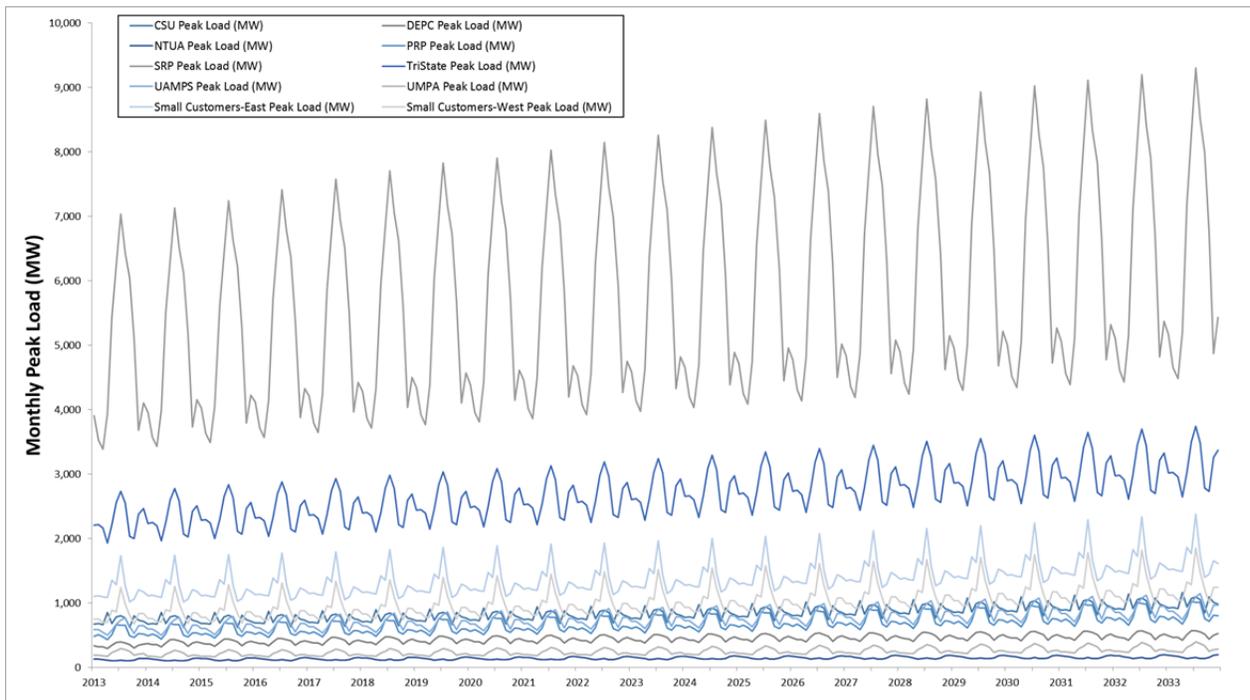


FIGURE 1 Projected Future Peak Loads by Each Large Customer and Small Customer Groups in the SLCA/IP Market System during the LTEMP Period

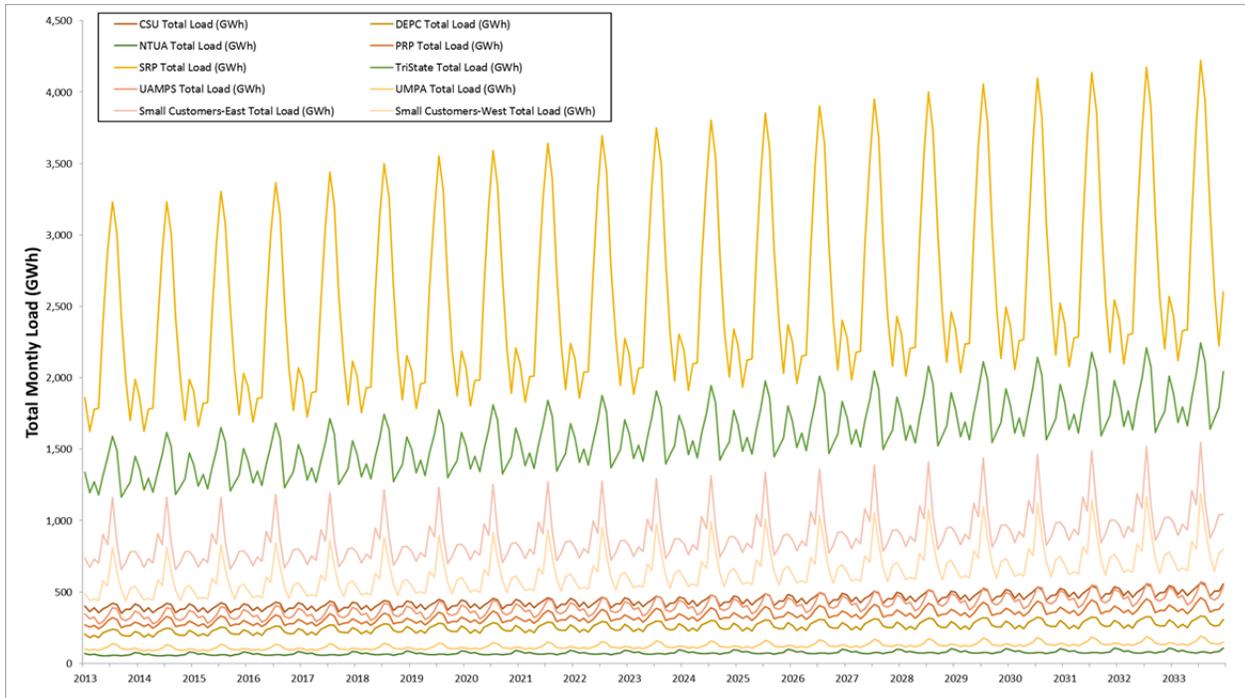


FIGURE 2 Projected Future Monthly Loads by Each Large Customer and Small Customer Groups in the SLCA/IP Market System during the LTEMP Period

Reference

EIA (U.S. Energy Information Administration), 2014, *Assumptions to the Annual Energy Outlook 2014*, Washington D.C., June. Available at [http://www.eia.gov/forecasts/aeo/assumptions/pdf/0554\(2014\).pdf](http://www.eia.gov/forecasts/aeo/assumptions/pdf/0554(2014).pdf). Accessed March 2, 2015.

ATTACHMENT K.7:

ANALYSIS OF THE TIMING OF THE PEAK LOAD

In the recent past, Western Area Power Administration’s (WAPA’s) coincidental peak load has occurred in the summer, but it does not consistently occur in a specific month. A study was performed to determine the month in which the peak occurred in recent history.

Hourly load data was obtained for 2006 to 2012 from Federal Energy Regulatory Commission (FERC) Form 714 for WAPA’s eight largest customers: Salt River Project (SRP), Tri-State Generation and Transmission Association (Tri-State), Colorado Springs Utilities (CSU), Platte River Power Authority (PRPA), Navajo Tribal Utility Authority (NTUA), Utah Associated Municipal Power Systems (UAMPS), Utah Municipal Power Agency (UMPA), and Deseret Generation and Transmission Cooperative (Deseret). These customers account for 75% of WAPA’s energy and capacity, so the aggregate load of these customers would determine when WAPA’s peak occurs.

Table 1 shows the peak load in each month of the year from 2006 to 2012. Data was not available for NTUA and Deseret from 2010 to 2012, so those utilities were not included in those years. However, Figure 1 shows that NTUA and Deseret only account for 1% and 3% of the peak load from 2006 to 2009, respectively, so not having their data in the last 3 years of the study would not alter the occurrence of the coincidental peak.

The peak load occurs in July in 3 of the 7 years and in August in 4 of the 7 years (as indicated by the shaded areas in Table 1). Therefore, the peak occurs in either July or August

TABLE 1 Aggregate Monthly Peak Load of WAPA’s Eight Large Customers for 2006 to 2012^a

Month	2006	2007	2008	2009	2010	2011	2012
1	7,470	8,089	8,411	7,983	7,426	7,836	7,160
2	6,974	7,619	8,293	7,611	7,434	8,626	6,740
3	6,781	7,204	7,308	6,983	7,091	6,964	6,514
4	6,852	7,878	7,934	7,760	7,029	7,214	7,959
5	9,053	9,116	9,969	9,820	8,328	7,884	9,234
6	10,419	10,624	10,744	10,549	10,625	10,624	11,009
7	11,336	11,670	11,188	11,416	11,049	11,069	10,722
8	10,691	11,639	11,656	11,461	10,495	11,301	11,604
9	9,361	10,403	9,382	10,232	9,884	10,840	9,738
10	8,143	8,374	8,738	7,947	8,956	8,191	8,295
11	7,596	7,377	7,535	7,478	7,788	6,665	6,803
12	7,888	8,102	8,326	8,480	8,247	7,623	7,452
Total	11,336	11,670	11,656	11,461	11,049	11,301	11,604

^a Missing NTUA and Deseret. Maximum values are shaded.

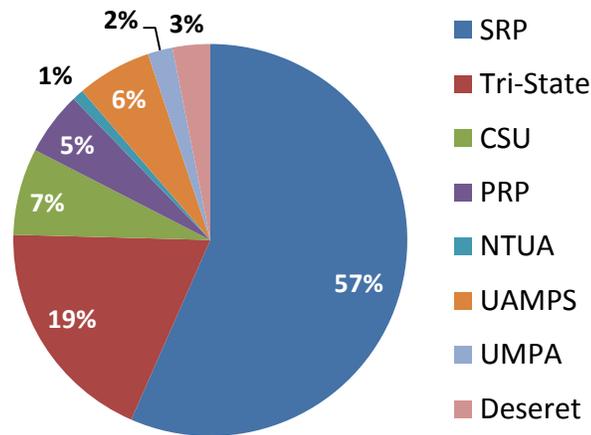


FIGURE 1 Breakdown of Non-coincident Peak by Customer

with nearly equal frequency. For the LTEMP EIS analysis, August was chosen as the peak month.

Figures 2 through 9 show monthly peak loads for the eight large SLCA/IP LTF power customers. All customers except the NTUA peak in the summer months of either July or August. However, in one year, CSU reported an abnormally high peak load in April.

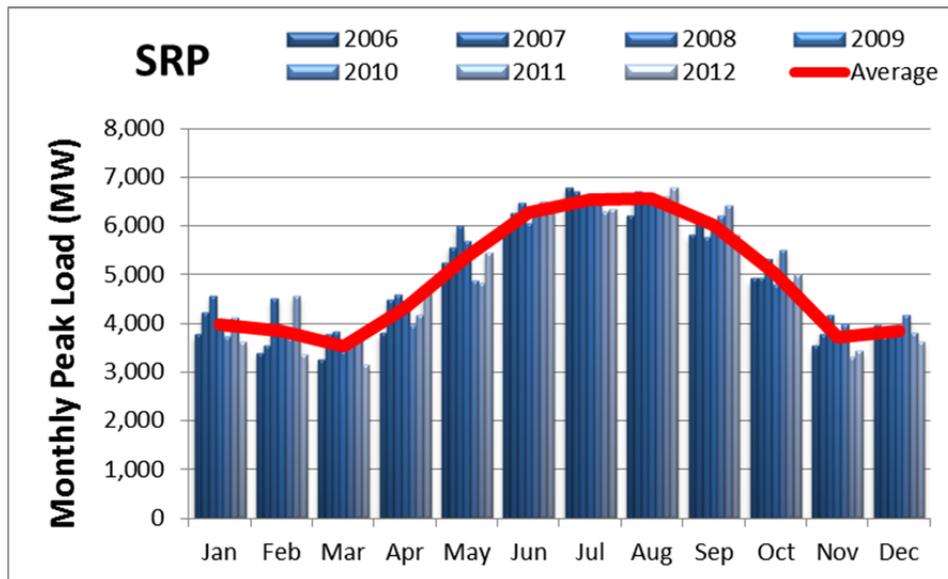


FIGURE 2 SRP Historical Monthly Peak Load

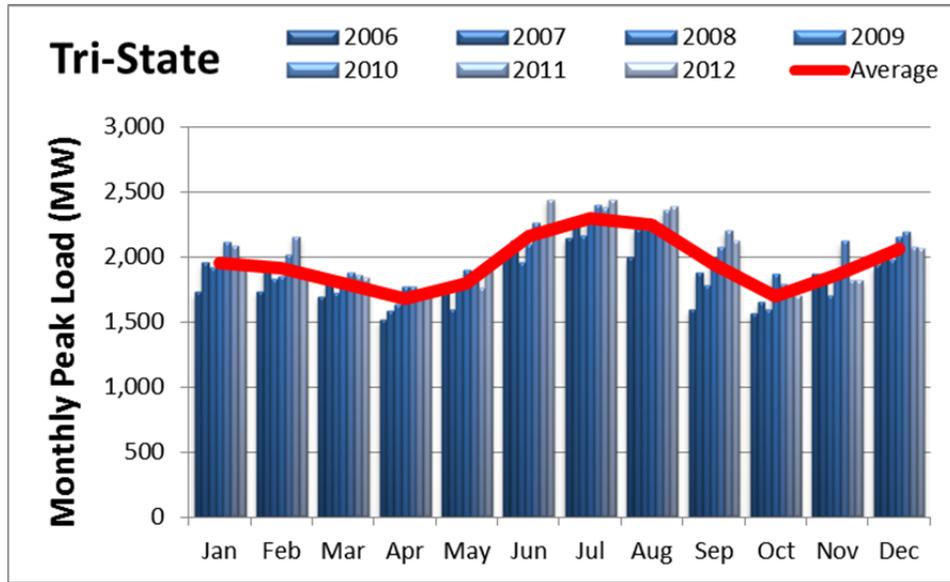


FIGURE 3 Tri-State Historical Monthly Peak Loads

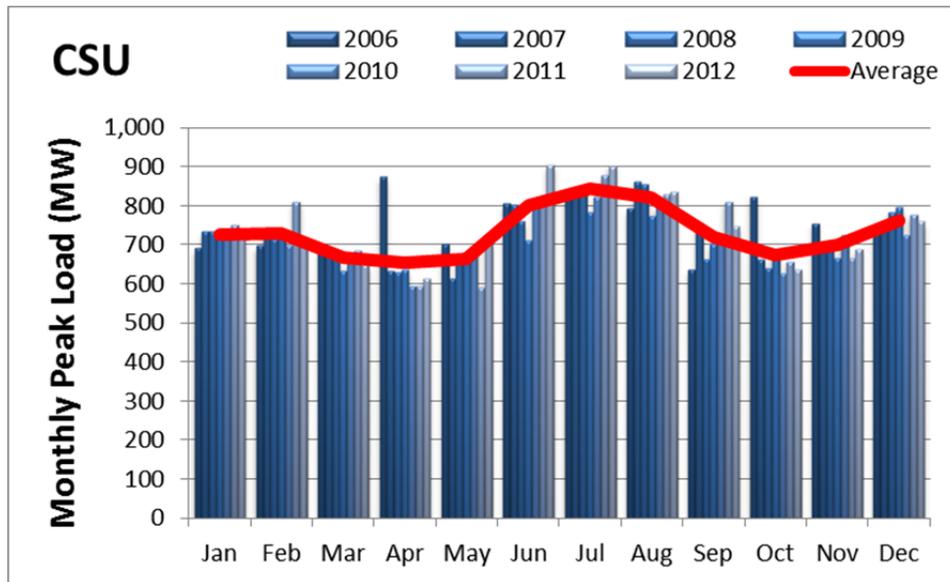


FIGURE 4 CSU Historical Monthly Peak Loads

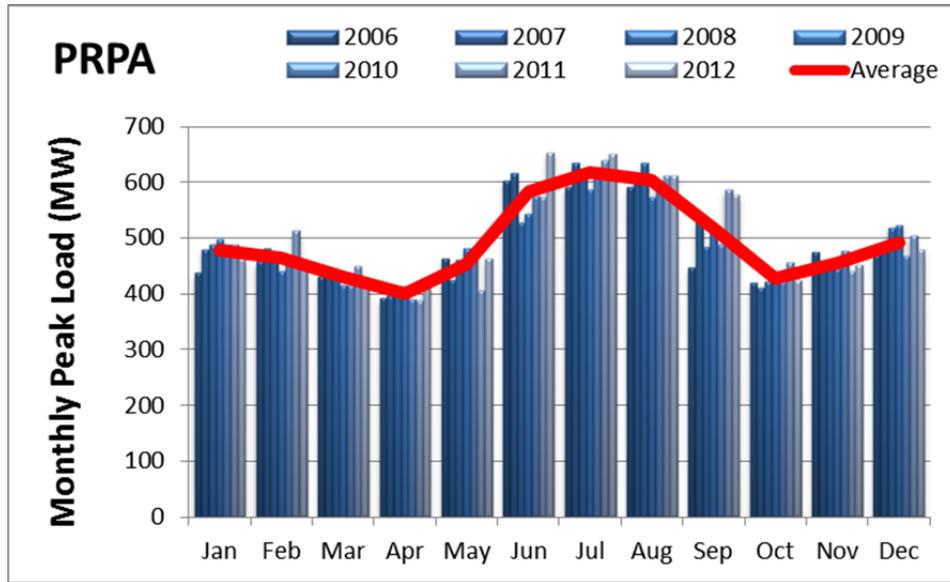


FIGURE 5 PRPA Historical Monthly Peak Loads

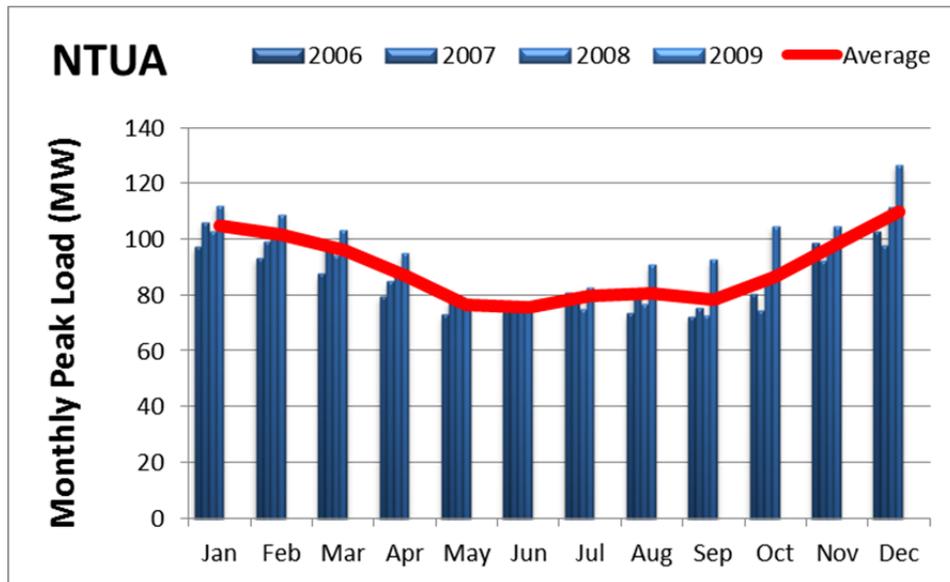


FIGURE 6 NTUA Historical Monthly Peak Loads

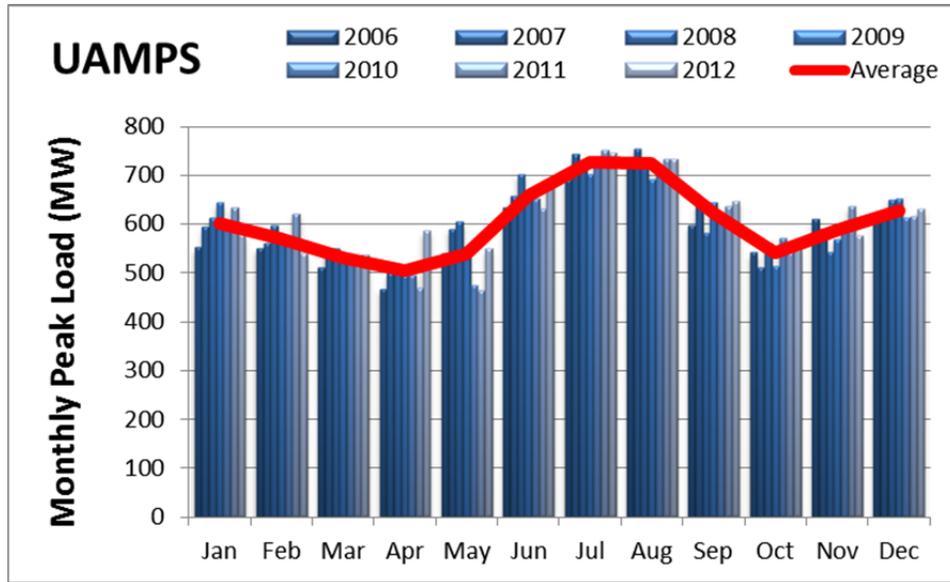


FIGURE 7 UAMPS Historical Monthly Peak Loads

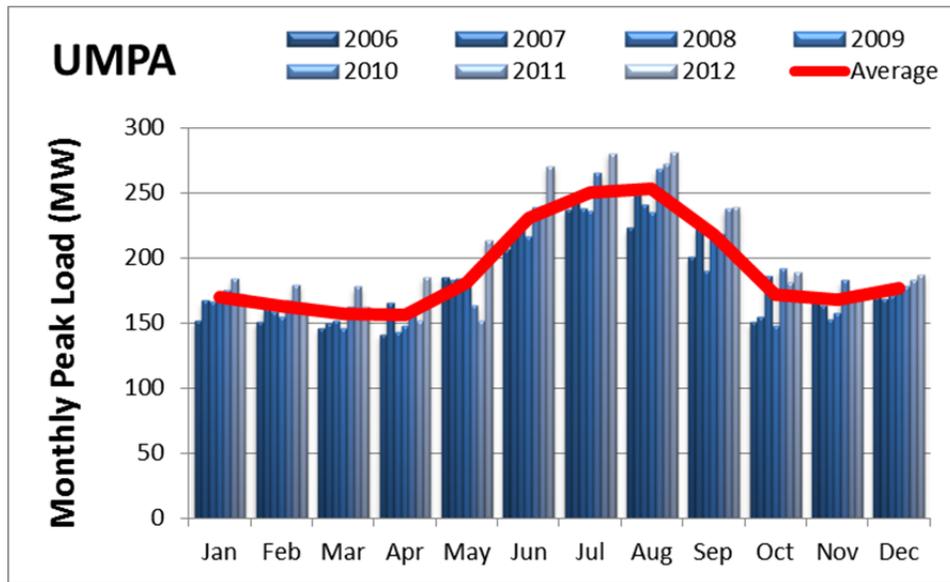


FIGURE 8 UMPA Historical Monthly Peak Loads

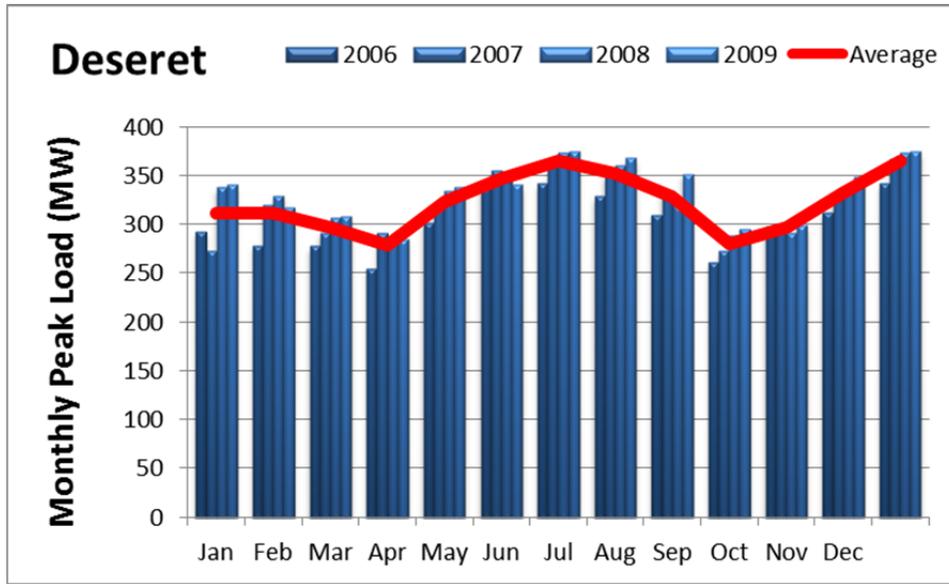


FIGURE 9 Deseret Historical Monthly Peak Loads

ATTACHMENT K.8:

**ANALYSIS OF CAPACITY DETERMINATIONS—
COMPARING RESULTS USING A RANGE OF EXCEEDENCE LEVELS
AND TWO SUMMER PEAK MONTHS**

Marketable capacity is very sensitive to the assumed exceedance level and the timing of the annual peak load. This attachment will describe that sensitivity. In the Western Interconnection annual peak loads almost always occur in either July or August; in fact, the study described in Attachment K.7 shows the peak occurs in either July or August with nearly equal frequency.

The graphs on the left side of Figure 1 show the marketable capacity for the six major alternatives and long-term strategies at exceedance levels from 10% to 99% for the three hydropower resource components combined. Marketable capacity was also shown for three different times when the peak load was assumed to occur, namely, July, August, and July/August combined. All alternatives have less marketable capacity at all exceedance levels than the no action alternative, except for Long-Term Strategy B1, which is expected because it has the least restrictive environmental constraints of any alternative.

The graphs on the right of Figure 1 show the difference in marketable capacity compared to Alternative A, which is the the no action alternative. The graphs show that the greatest difference in capacity occurs at the 50% exceedance level and the smallest at the 99% exceedance level.

There is also a noticeable difference in marketable capacity for some alternatives compared to the no action alternative depending upon the month chosen. Long-Term Strategies C1 and E1 have a much smaller difference in marketable capacity compared to Alternative A in July than in August at all exceedance levels.

The choice of the peak month and exceedance level used for Glen Canyon Dam capacity availability is a policy choice by the Western Area Power Administration (WAPA) and is related to the degree of risk WAPA chooses to take when marketing long-term capacity. There have been variations in level of risk chosen by WAPA when marketing long-term capacity from various projects. For the Long-Term Experimental and Management Plan (LTEMP) Environmental Impact Statement (EIS), an exceedance level of 90% and a peak month of August were selected. The exceedance level was chosen based on an analysis of the current post 2004 WAPA marketing plan that demonstrated that WAPA has sufficient SLCA/IP resources to meet its firm capacity obligations 90% of the time (67 FR 5113). Results were presented in Section K.1.10.4 for exceedance levels of 50% and 99%.

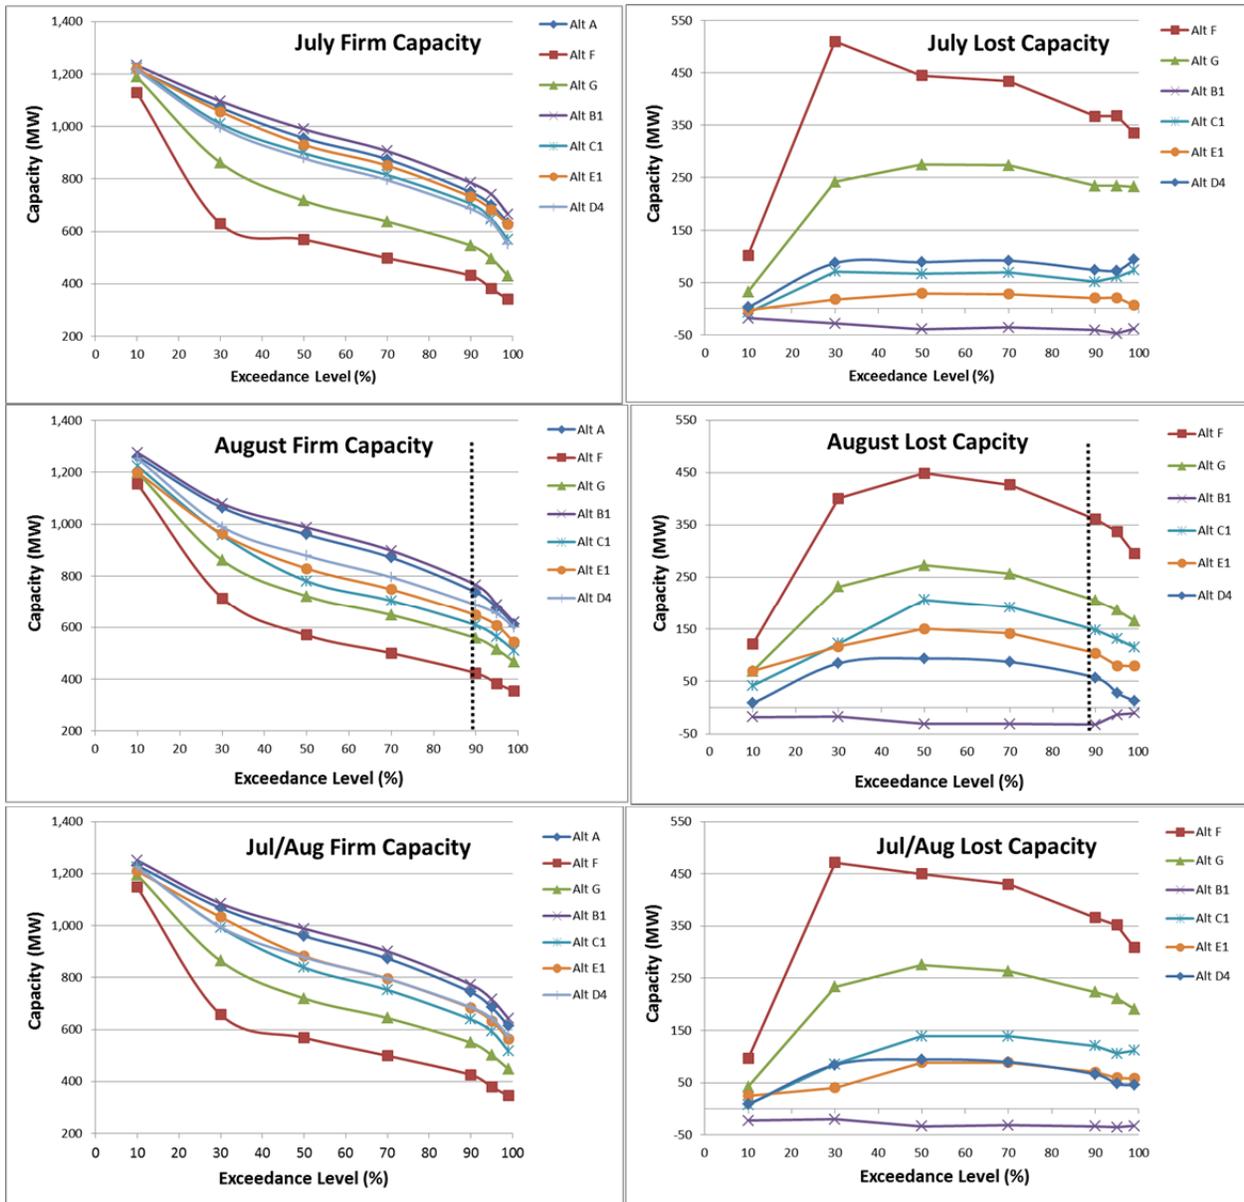


FIGURE 1 Comparison of SLCA/IP Federal Hydropower Firm and Lost Capacity Determinations across Alternatives, Exceedance Levels, and Summer Peak Months

ATTACHMENT K.9:

RESULTS OF A SURVEY OF ELECTRIC UTILITY INTEGRATED RESOURCE PLANS

An integrated resource plan (IRP) is a comprehensive decision support tool and roadmap for meeting an electric utility's objective of providing reliable and least-cost electric service to all of its customers. It is typically developed with considerable involvement from state agencies and regulators, customer and industry advocacy groups, project managers, and other stakeholders. Key elements of an IRP include determining the need for resources over a specific planning period, such as the next 10 to 20 years; the preferred portfolio of supply-side and demand-side resources to meet this need; and an action plan identifying the steps to implement the plan, such as the timing of bringing new resources online.

A survey of IRPs of Western Area Power Administration's (WAPA's) large customers that own generating facilities and large investor-owned utilities (IOUs) in the geographic and "electrical" area was conducted to determine the timing and type of resources these utilities were planning to reliably meet future electric demand. The results of this IRP survey could be compared to the results of the AURORA expansion model to see how well the AURORA prediction matched against the utility's best estimate. WAPA's customers surveyed included Platte River Power Authority (PRP), Colorado Springs Utilities (CSU), Tri-State Generation and Transmission Association (Tri-State), and Salt River Project (SRP).

Large IOUs surveyed included Public Service of Colorado (PSCO; now part of Xcel Energy), Public Service Company of New Mexico (PNM), Rocky Mountain Power (RMP; the eastern business unit of PacifiCorp or PACE), Arizona Public Service Company (AZPS), Tucson Electric Power Company (TEPC), Nevada Power Company (NEVP; the southern subsidiary of NV Energy), and Sierra Pacific Power Company (SPPC; the northern subsidiary of NV Energy). All IRPs were obtained from company websites and were all published between 2011 and 2014. These IOUs were chosen because they have contracts to supply generation to some of WAPA's customers and are also located in the same power pools in the AURORA model as WAPA's customers. Figure 1 shows the approximate service territories of these IOUs in the Western Interconnection.

If the timing and type of new generation predicted by our AURORA expansion model runs are similar to what is planned in the IRPs, then the limited scope in our model is a good surrogate for modeling the larger system.

Figure 2 shows the least-cost baseline expansion plan for PSCO in its most recent IRP, which was published in October 2011. The plan predicts that several combustion turbines will come online between 2018 and 2022 followed by a combined-cycle gas turbine in 2023. Expansion plans from the 2014 PNM IRP shown in Figure 3 forecasts a small 40-MW gas turbine in 2016 followed by a 177-MW gas turbine in 2018. Rocky Mountain Power's expansion plans from its 2013 IRP are shown in Figure 4. A 645-MW combined-cycle unit was just brought

online in 2014 as forecast by the IRP. RMP also plans to bring a combined-cycle combustion turbine and wind turbines online in 2024.

Figure 5 shows a future capacity addition plan from the APS IRP. The capacity it obtains from long-term contracts is steadily decreasing from over 2,800 MW in 2014 to less than 350 MW by 2029. ASP plans to bring over 1,000 MW of natural gas-fired generation online in 2019 followed by 2,000 MW more in 2024 and 1,000 MW in 2029. ASP also plans to rely more heavily on customer energy efficiency beginning in 2019. Additional generation from renewables will begin in 2019.

Figure 6 shows a future capacity addition plan from the TEP IRP. New natural gas generation of over 370 MW is planned for 2015 followed by another 640 MW in 2019. All short-term market resources will be phased out by 2019.

Figure 7 shows capacity addition plans from the NEVP IRP for four scenarios. To comply with a Nevada law phasing out certain coal-fired generation, a combination of new solar photovoltaic and natural gas-fired generation will be brought online between 2016 and 2021. To satisfy future demand, additional combined-cycle generation of 597 MW is planned to come online as early as 2020 and another 273 MW of capacity in 2022.

Figure 8 shows capacity addition plans from the SPP IRP for four scenarios. Depending upon the scenario, combustion turbines with a total capacity of from 273 MW to 536 MW are planned as early as 2022 and 2023. By 2025, an addition of over 570 MW of combined-cycle generation is planned followed by over 300 MW of combustion turbine capacity in 2029.

The IRPs of four of WAPA's large customers that own generation were also surveyed; namely, PRP, CSU, Tri-State, and SRP. The PRP IRP states that new peaking capacity may be needed as early as 2020 because that is when its reserve margin is forecast to drop below 15%. The CSU IRP shows capacity expansion plans for a number of future scenarios. Depending on the scenario, new renewables are expected to begin coming online beginning in 2017 to 2023. New combustion turbines of approximately 40 MW will start coming online from 2029 to 2031. The Tri-State IRP also examines numerous future scenarios. Depending on the scenario, new combined-cycle powerplants with a capacity of 588 MW will start coming online as early as 2019 to 2022; new renewable generation in multiples of 50 MW blocks will come online steadily from 2015 to 2029. Finally, SRP expects to bring new natural gas-fired peaking generation online between 2020 and 2022.

In conclusion, the survey of new capacity additions shown in IRPs for both WAPA's customers and large IOUs show that new capacity, both thermal and renewable generation, is scheduled to be brought online as early as 2017 to 2018. This means that there is very little excess capacity in the power pools in which WAPA's customers are located. Therefore, any capacity lost at Glen Canyon due to changes in operations from the Long-Term Experimental and Management Plan alternatives might cause new generation to be brought online earlier than the current IRPs indicate.

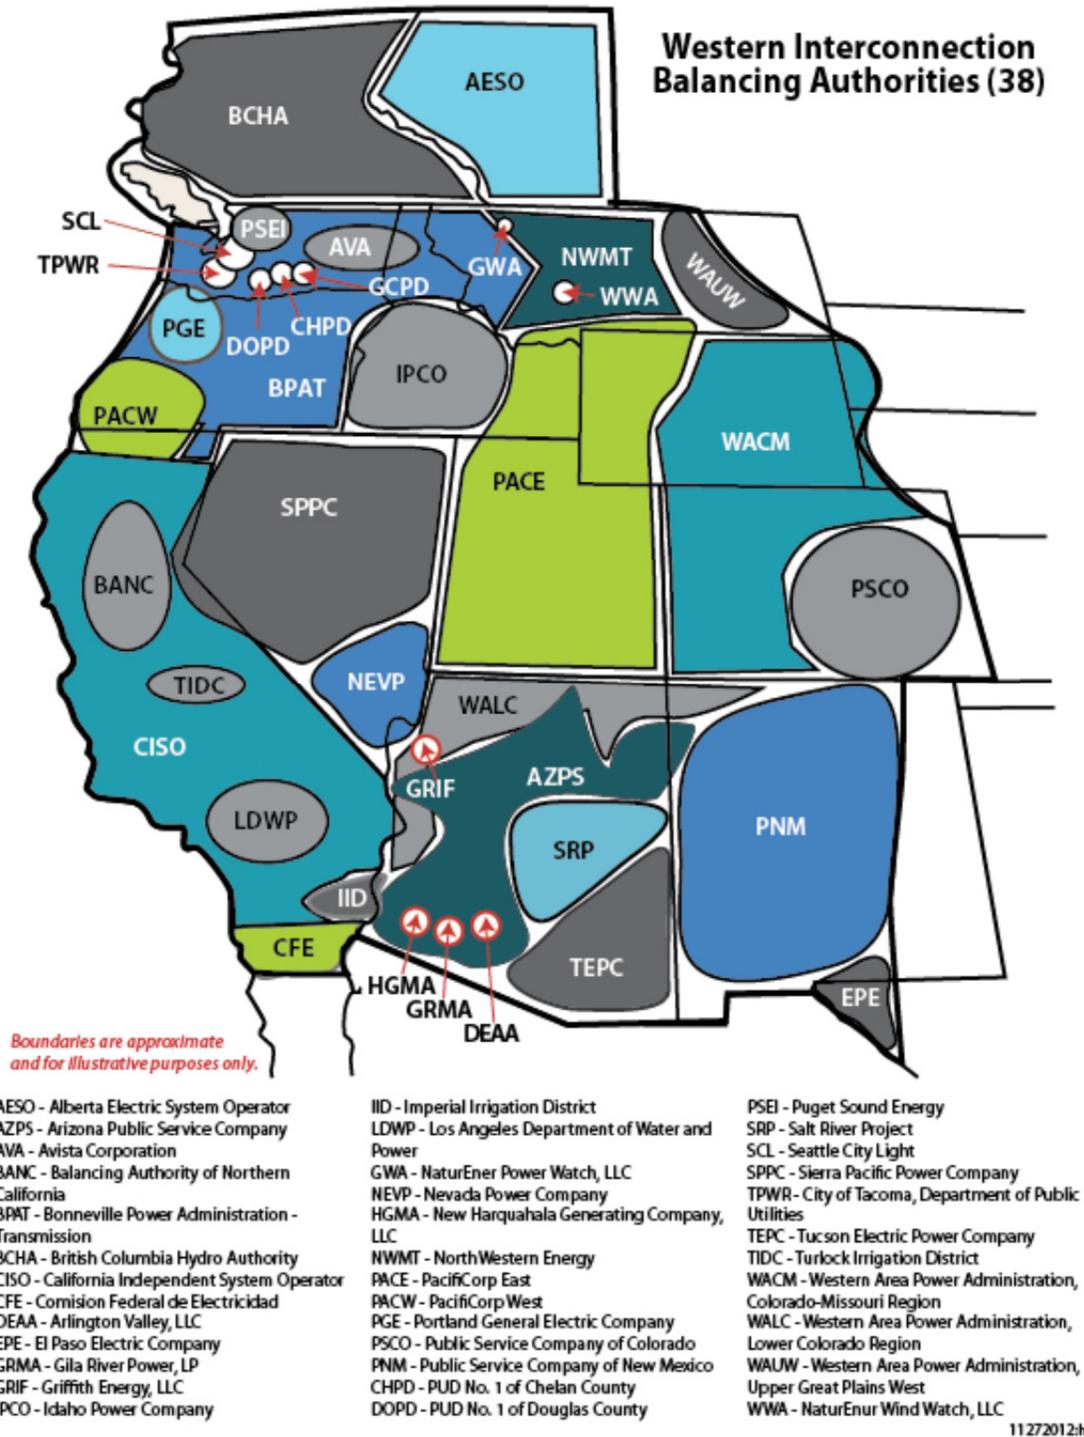


FIGURE 1 Balancing Authorities in the Western Interconnection (Source: WECC website: [https://www.wecc.biz/Reliability/VGS_BalancingAuthorityCooperation Concepts_Intra-HourScheduling.pdf](https://www.wecc.biz/Reliability/VGS_BalancingAuthorityCooperation_Concepts_Intra-HourScheduling.pdf))

Year	Baseload ¹	2x1 ¹ Combined Cycle	1x1 ¹ Combined Cycle	Combustion Turbine ¹	Battery	Wind ²	Solar PV ²	Solar Thermal ²
2011								
2012								
2013								
2014								
2015								
2016								
2017								
2018				346 MW				
2019				173 MW				
2020				173 MW				
2021				173 MW				
2022		643 MW		346 MW				
2023								
2024								
2025								
2026								
2027		643 MW						
2028								
2029				173 MW				
2030						200 MW		
2031				173 MW			100 MW	
2032		643 MW						
2033								
2034		643 MW						
2035								
2036		643 MW						
2037								
2038								
2039								
2040								
2041								
2042	485 MW	643 MW						
2043						200 MW	25 MW	
2044						200 MW	25 MW	
2045						100 MW		
2046						200 MW	25 MW	
2047						100 MW		
2048						100 MW		
2049				346 MW				
2050								

(1) Listed as summer accredited capacity rating
 (2) Listed as nameplate capacity

Source: <http://www.xcelenergy.com/staticfiles/xcel/Regulatory/Regulatory%20PDFs/PSCo-ERP-2011/Exhibit-No-KJH-1-Volume-2.pdf>

FIGURE 2 Least-Cost Baseline Expansion Plan from PSCO’s Current IRP

Scenario Description	Revised SIP with PV3 78 MW Scenario	Revised SIP with PV3 132 MW Scenario
Load Forecast	Current	Current
Gas Pricing	PACE Reference Case	PACE Reference Case
CO2	PACE Reference Case (\$11 in 2020)	PACE Reference Case (\$11 in 2020)
San Juan Investment Recovery	\$16,401,523	\$16,401,523
SJ Retirements/Unit 4 Addition	Units 2 & 3 (Dec 2017) + 78 MW to SJ4	Units 2 & 3 (Dec 2017) + 132 MW to SJ4
2014		
2015	Red Mesa (102 MW) 2015 Solar (23 MW)	Red Mesa (102 MW) 2015 Solar (23 MW)
2016	Aeroderivative (40 MW) Solar PV Tier 1 (40 MW)	Aeroderivative (40 MW) Solar PV Tier 1 (40 MW)
2017	San Juan BART	San Juan BART
2018	Large GT (177 MW) Palo Verde 3 (134 MW)	Large GT (177 MW) Palo Verde 3 (134 MW)
2019	Solar PV Tier 2 (60 MW)	
2020	Solar PV Tier 2 (20 MW) Solar PV Tier 3 (20 MW)	Solar PV Tier 2 (20 MW)
2021	Solar PV Tier 3 (60 MW)	Solar PV Tier 2 (60 MW)
2022	Solar PV Tier 3 (60 MW)	Solar PV Tier 3 (40 MW)
2023	Large GT (177 MW)	Solar PV Tier 3 (60 MW)
2024		Wind (100 MW) Large GT (177 MW)
2025		
2026	Large GT (177 MW) Wind (100 MW)	
2027		2nd Aeroderivative (40 MW)
2028		Large GT (177 MW)
2029		
2030	Reciprocating Engines (93 MW)	
2031	2nd Aeroderivative (40 MW)	Aeroderivative (40 MW) Solar PV Tier 3 (40 MW)
2032	Aeroderivative (40 MW)	Reciprocating Engines (93 MW)
2033	Small GT (85 MW)	

Source: <https://www.pnm.com/documents/396023/396193/PNM+2014+IRP/bdcccdd52-b0bc-480b-b1d6-cf76c408fdcf>

FIGURE 3 Expansion Plan for PNM in Current IRP

Preferred Portfolio (EG-2 Case-07a)		Capacity(MW)												
		2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Ex t	Existing Plant Retirements/Conversion:													
	Hayden1	-	-	-	-	-	-	-	-	-	-	-	-	-
	Hayden2	-	-	-	-	-	-	-	-	-	-	-	-	-
	Carbon1 (Early Retirement Conversion)	-	-	(67)	-	-	-	-	-	-	-	-	-	-
	Carbon2 (Early Retirement Conversion)	-	-	(105)	-	-	-	-	-	-	-	-	-	-
	Johnston1	-	-	-	-	-	-	-	-	-	-	-	-	-
	Johnston2	-	-	-	-	-	-	-	-	-	-	-	-	-
	Johnston3	-	-	-	-	-	-	-	-	-	-	-	-	-
	Johnston4	-	-	-	-	-	-	-	-	-	-	-	-	-
	Naughton1	-	-	-	-	-	-	-	-	-	-	-	-	-
	Naughton2	-	-	-	-	-	-	-	-	-	-	-	-	-
	Naughton3 (Early Retirement Conversion)	-	-	(330)	-	-	-	-	-	-	-	-	-	-
	Coal Ret. WY- Gas RePower	-	-	338	-	-	-	-	-	-	-	-	-	-
	Expansion Resources:													
	COCTFD 2d	-	-	-	-	-	-	-	-	-	-	-	-	-
	COCTJ 1d	-	-	-	-	-	-	-	-	-	-	-	-	423
	Lake Side II	-	645	-	-	-	-	-	-	-	-	-	-	-
	SOCTFrame C1	-	-	-	-	-	-	-	-	-	-	-	-	-
	SOCTFrame ID	-	-	-	-	-	-	-	-	-	-	-	-	-
	Coal Plant Turbine Upgrades	1.8	-	-	-	-	-	-	-	-	-	-	-	-
Wind, Wyoming, 40	-	-	-	-	-	-	-	-	-	-	-	432	218	
Total Wind	-	-	-	-	-	-	-	-	-	-	-	432	218	
CHP - Biomass	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	
CHP - Other	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	0.4	
DSM Class 1, ID-Curtail	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1, ID-Irrigate	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1, UT-Curtail	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1, UT-Irrigate	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1, WY-Curtail	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1, WY-Irrigate	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 1 Total	-	-	-	-	-	-	-	-	-	-	-	-	-	
DSM Class 2, ID	3	3	3	3	3	3	3	4	3	4	4	3	3	
DSM Class 2, UT	63	61	54	52	50	48	48	43	42	40	30	33	30	
DSM Class 2, WY	4	4	5	5	6	6	6	6	7	7	6	7	7	
DSM Class 2 Total	69	67	61	60	59	57	58	52	52	51	39	42	39	
Micro Solar - Pv	7.11	11.0	14.2	16.4	17.0	13.1	13.1	13.1	13.1	13.1	13.1	13.1	13.1	
Micro Solar - Water Heating	-	-	-	-	0.8	0.4	0.5	0.6	2.4	2.4	2.4	2.4	2.4	
FOT/Mona Q8	-	-	-	-	-	37	151	248	19	161	255	-	132	

Source: http://www.pacificorp.com/content/dam/pacificorp/doc/Energy_Sources/Integrated_Resource_Plan/2013IRP/PacificCorp-2013IRP_Vol1-Main_4-30-13.pdf (see page 239)

FIGURE 4 Rocky Mountain Power Expansion Plan from 2013 IRP

2014 IRP (VALUES IN MW AT PEAK)				
	2014	2019	2024	2029
TOTAL PROJECTED LOAD REQUIREMENTS (NEEDS)	8,124	9,543	11,276	12,982
EXISTING RESOURCES AS OF DEC. 31, 2013				
APS-Owned Generation	6,315	6,086	6,063	6,066
Long-Term Contracts	2,872	1,490	389	346
Total Existing Resources as of Dec. 31, 2013	9,187	7,576	6,452	6,412
FUTURE* PROJECTED CUSTOMER RESOURCES				
Energy Efficiency	109	877	1,230	1,447
Distributed Energy	45	109	203	261
Demand Response	0	0	150	275
Total Future* Customer Resources	153	986	1,584	1,983
FUTURE* PROJECTED GENERATION RESOURCES				
Natural Gas	0	1,010	3,030	4,205
Renewable Energy	0	57	295	425
Total Future* Projected Utility Resources	0	1,067	3,325	4,630
Total Future* Projected Resource Additions	153	2,053	4,909	6,613
Total Resources	9,340	9,630	11,361	13,025



*Future resources added after December 31, 2013 Source: http://www.aps.com/library/resource%20alt/2014_IntegratedResourcePlan.pdf

FIGURE 5 Capacity Expansion Plan for Arizona Public Service Company from 2014 IRP

Future Resources (Nameplate Capacity MW)	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028
Natural Gas Resources	-	374	374	374	374	1,016	1,018	1,020	1,022	1,114	1,116	1,118	1,210	1,212	1,214
Utility Scale Renewables	208	258	258	258	258	258	258	258	326	326	475	529	529	529	529
Distributed Generation (DG)	71	78	94	110	125	141	157	173	190	210	229	250	254	259	265
Energy Efficiency (EE)	48	80	110	137	164	191	217	229	233	238	244	249	253	259	262
Demand Response (DR)	15	19	24	29	35	40	45	45	45	45	45	45	45	45	50
Total Nameplate Capacity	342	808	859	908	956	1,646	1,695	1,724	1,817	1,933	2,109	2,191	2,291	2,304	2,320
Short-Term Market Resources	400	250	200	200	570	-	-	-	-	-	-	-	-	-	-
Total System Resources	742	1,058	1,059	1,108	1,526	1,646	1,695	1,724	1,817	1,933	2,109	2,191	2,291	2,304	2,320

Source: <https://www.tep.com/doc/planning/2014-TEP-IRP.pdf>

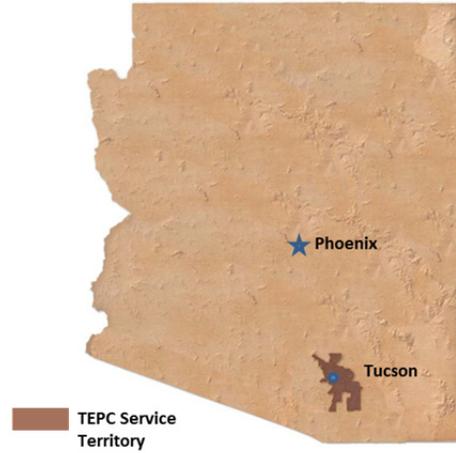


FIGURE 6 Capacity Expansion Plan for Tucson Electric Power Company from 2014 IRP

Nevada Power Company Expansion Plans - Base Load			
Case A	Case B	Case C	Case D
To replace retired coal plants in accordance with Nevada Law (SB 123)			
15 MW PV - 2016	15 MW PV - 2016	496 MW Merchant CC	274 MW Merchant CC
597 MW CC - 2018	568 MW CTs (8) - 2018	15 MW PV - 2016	15 MW PV - 2016
35 MW PV - 2021	35 MW PV - 2021	200 MW PV - 2016	200 MW PV - 2016
		35 MW PV - 2021	500 MW PV - 2018
Future conventional resource additions			
597 MW CC - 2020	597 MW CC - 2020	597 MW CC - 2020	597 MW CC - 2020
273 MW CC - 2022	273 MW CC - 2022	273 MW CC - 2022	273 MW CC - 2022
213 MW CTs (3) - 2023	213 MW CTs (3) - 2023	213 MW CTs (3) - 2023	213 MW CTs (3) - 2023
597 MW CC - 2024	597 MW CC - 2024	597 MW CC - 2024	597 MW CC - 2024
234 MW CTs (3) - 2030	234 MW CTs (3) - 2030	213 MW CTs (3) - 2027	234 MW CTs (3) - 2030
234 MW CTs (3) - 2032	234 MW CTs (3) - 2032	234 MW CTs (3) - 2030	234 MW CTs (3) - 2032
		234 MW CTs (3) - 2032	

Source: https://www.nvenergy.com/company/rates/filings/IRP/NPC_IRP/ERC/NPC/Vol4-Narratives.pdf

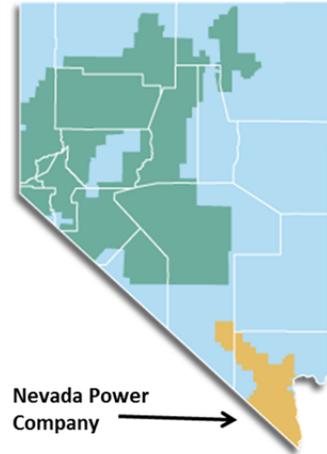


FIGURE 7 Capacity Expansion Plan for Nevada Power Company from 2014 IRP

Sierra Pacific Power Expansion Plans - Base Load			
Case 1 <u>ALL Market</u>	Case 2 <u>Renewable</u>	Case 3 - Alternative Plan <u>CT's</u>	Case 4 - Preferred Plan <u>CC's</u>
	402 MW CTs (6) - 2022	536 MW CTs (6) - 2022	273 MW CC - 2022
237 MW CTs (3) - 2023			
571 MW CC - 2025	571 MW CC - 2025	571 MW CC - 2025	571 MW CC - 2025
316 MW CTs (4) - 2029	316 MW CTs (4) - 2029	316 MW CTs (4) - 2029	316 MW CTs (4) - 2029

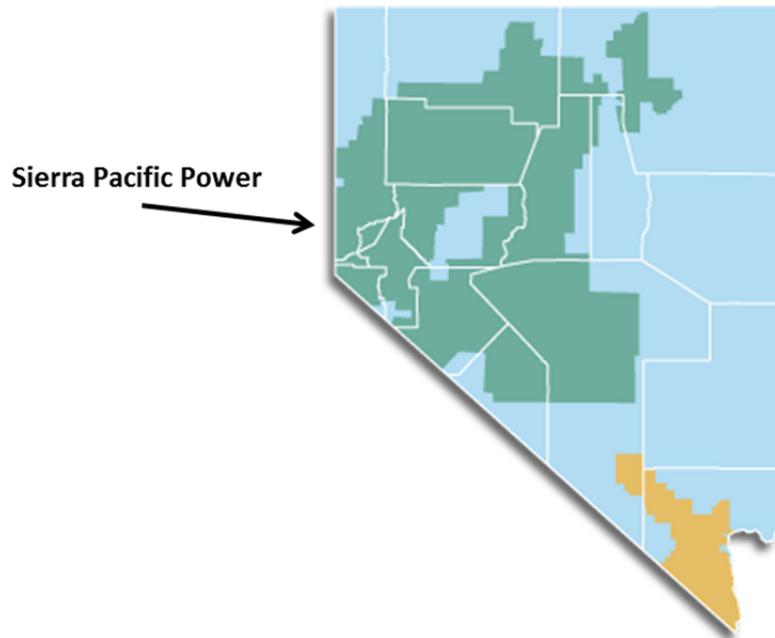


FIGURE 8 Capacity Expansion Plan for Sierra Pacific Power Company from 2014 IRP

ATTACHMENT K.10:

INDICES USED FOR CONVERTING DOLLARS FROM ONE YEAR TO ANOTHER

The Argonne National Laboratory Glen Canyon Dam Long-Term Experimental and Management Plan (LTEMP) Environmental Impact Statement (EIS) power systems team has data that are expressed in terms of various nominal dollars. However, it is important that model runs and analysis be performed on a consistent dollar year basis. The range of nominal dollars that was used ranges from 2010 dollars to 2013 dollars. In addition, the LTEMP EIS co-lead team has also decided that results presented to the public should be expressed in terms of 2015 dollars. For all power systems analyses, the gross national product (GNP) implicit price deflator (IPD) was used for converting nominal dollars from one year to another. Argonne staff used the Federal Reserve Economic Data (FRED) for the IPD with the series ID of the Gross Domestic Product: Implicit Price Deflator (GDPDEF) found on the St. Louis Federal Reserve Bank (Fed) website (<http://research.stlouisfed.org/fred2/data/GDPDEF.txt>).

The IPD is a good measure of the rate of price change in the economy as a whole. However, the last data point available from the St. Louis Fed is for October 2014. Therefore, the index was projected through January 2015. Based on a simple trend analysis using a third-order polynomial to fit the GNP price deflator over the January to October 2014 time period, the projected IPD was approximately 107.7 in January 2015 (January 2010 index = 100); that is a decline of about 0.3% from the October 2014 level. Figure 1 and Table 1 below show results of the trend analysis.

As shown in Figure 2, there is a similar, but somewhat more pronounced, decline when a trend analysis was conducted using monthly data for the seasonally adjusted (SA) consumer price index (CPI) for all U.S. cities/all items (series ID: CUSR0000SA0) (see <http://download.bls.gov/pub/time.series/cu/cu.data.1.AllItems>) and also for producer price index (PPI) data for total final demand (series ID: WPUFD4) from January 2014 through December 2015 (see <http://www.bls.gov/news.release/ppi.nr0.htm>). Both the CPI and PPI are about 1.0% lower in December 2014 relative to September 2014.

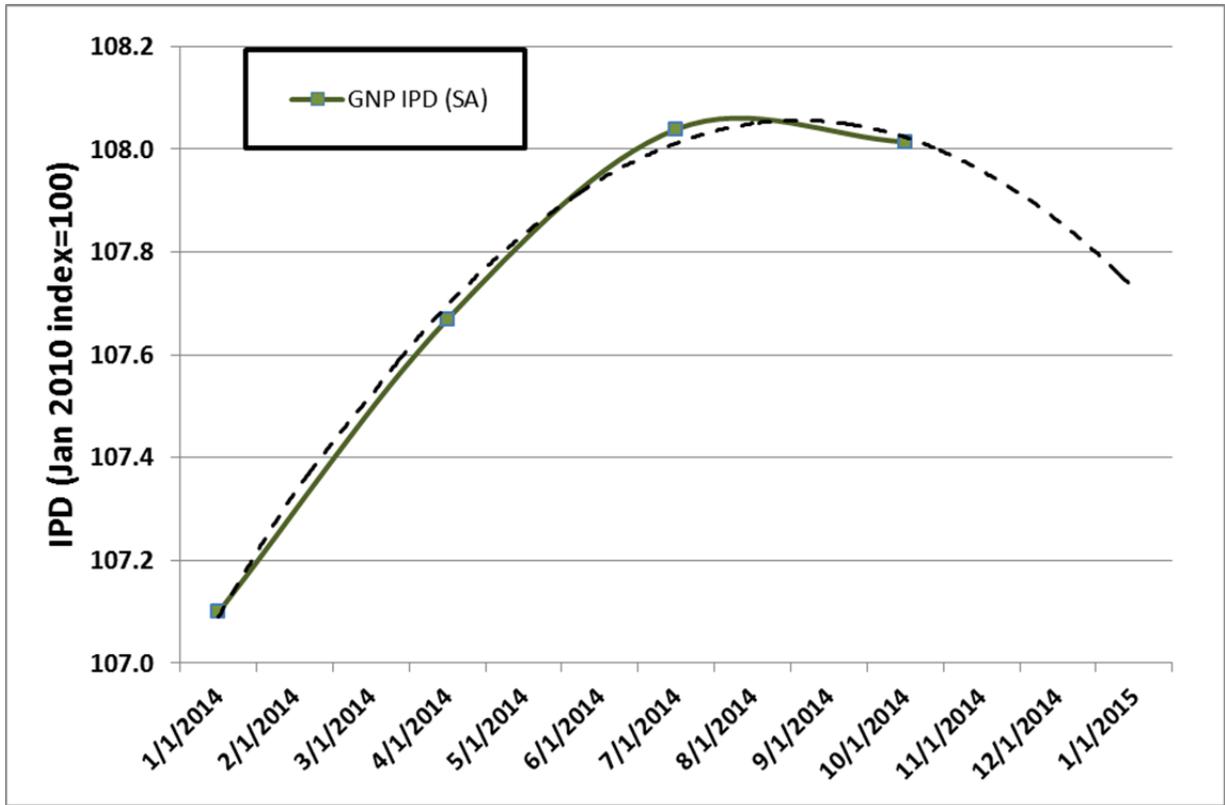


FIGURE 1 Results of Trend Analysis to Project Implicit Price Deflator (IPD) to January 2015 (SA = seasonally adjusted)

A downward trend in future producer prices through January 2015 is also in line with projections made by the Financial Forecast Center, which projects a 1% lower PPI for all commodities in January 2015 compared to December 2014 levels (see <http://www.forecasts.org/ppi.htm>).

The lower, but not as dramatic decrease in the IPD is further supported by Figure 3 below that shows both the CPI and PPI compared to the IPD. Both roughly follow the same trend in the January 2010 and October 2015 time period. However, the IPD tends to follow a smoother, less jagged track, implying that in general it may be somewhat less responsive to short-term economic drivers.

TABLE 1 Historical Quarterly Implicit Price Deflators and Projection for January 2015

Date	IPD
1/1/2010	100.0
4/1/2010	110.4
7/1/2010	100.9
10/1/2010	101.4
1/1/2011	101.9
4/1/2011	102.6
7/1/2011	103.2
10/1/2011	103.4
1/1/2012	103.9
4/1/2012	104.4
7/1/2012	104.9
10/1/2012	105.3
1/1/2013	105.7
4/1/2013	105.9
7/1/2013	106.4
10/1/2013	106.7
1/1/2014	107.1
4/1/2014	107.7
7/1/2014	108.0
10/1/2014	108.0
1/1/2015	107.7 ^a

^a Projected.

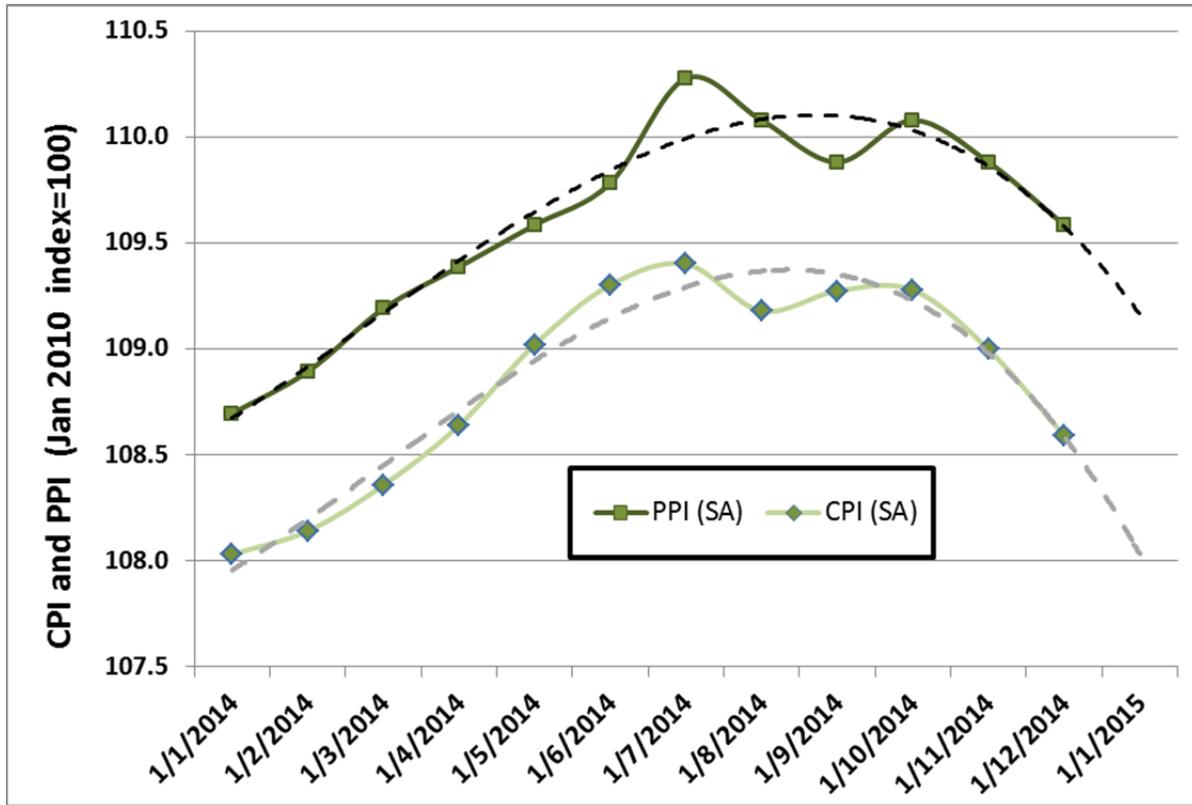


FIGURE 2 Comparison of Trend Analyses Projecting Produce Price Index (PPI) and Consumer Price Index (CPI) to January 2015 (SA = seasonally adjusted)

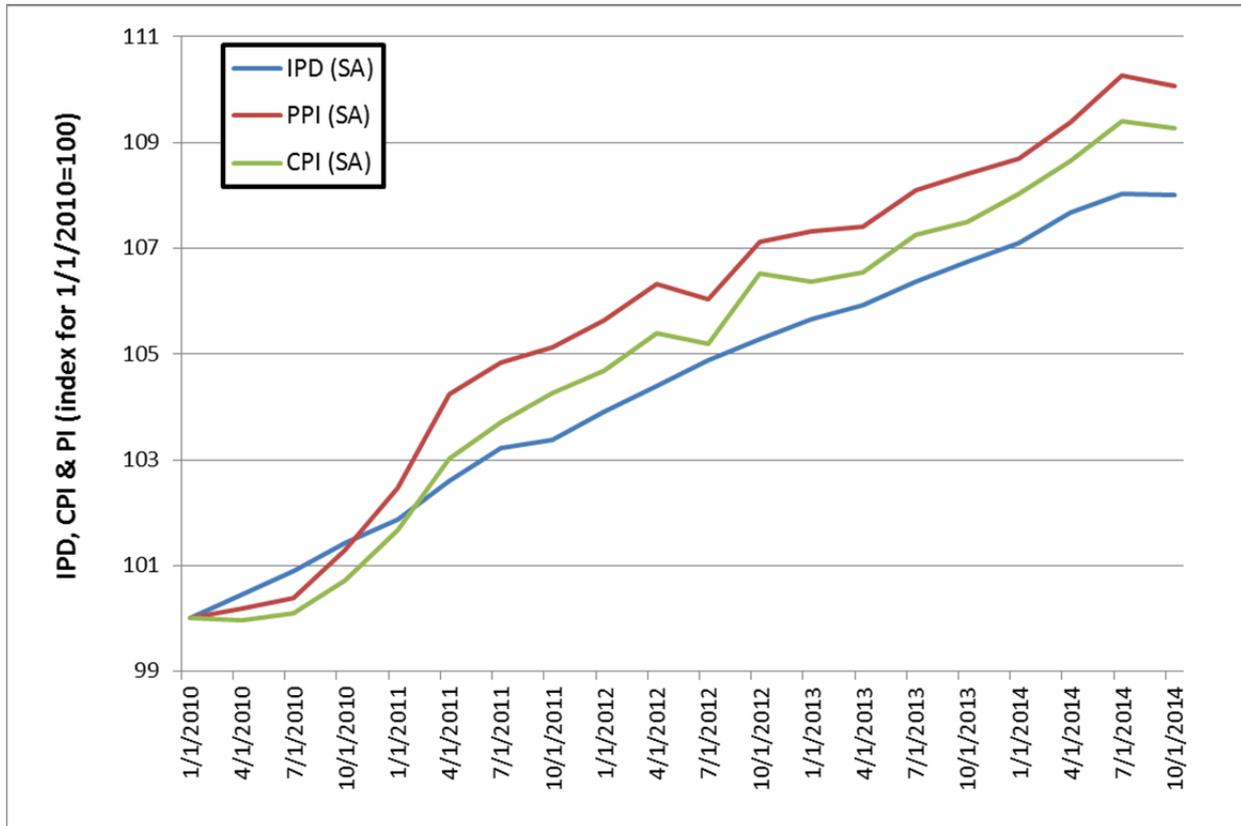


FIGURE 3 Comparison of Historical Trends for Implicit Price Deflator (IPD), Consumer Price Index (CPI), and Producer Price Index (PPI) from January 2010 to January 2014 (SA = seasonally adjusted)

ATTACHMENT K.11:

**SUMMARY IRP OF CAPACITY ADDITIONS (MW) IN THE JOINT SYSTEM AND
SURROUNDING UTILITY SYSTEMS THROUGH THE END OF CY2034**

Utility ^a	CT	Aero- Derivatives CT	NGCC	Natural Gas (Technology Unspecified)	Wind/Solar	Other	Total
PSCO	1,730		1,929		1,500		5,159
PNM(132 MW)	531	120			383	461	1,495
PAC			2,625				2,625
APS				5,229	288		5,517
TEP					270		270
NVE	2,043		2,064		50		4,157
Sierra Pacific	1,264		870				2,134
PRPA					108		108
CSU					250	11	261
TSGT			1,040		700		1,740
SRP					132		132
Total	5,568	120	8,528	5,229	3,681	472	23,598
% without Aero	39.5		60.5				100
% Including Aero	40.0		60.0				100

^a Utilities in the joint system (WAPA LTF customers) are highlighted in light green.

Data Sources

Public Service of Colorado

<https://www.xcelenergy.com/staticfiles/xcel/Regulatory/Regulatory%20PDFs/PSCo-ERP-2011/Exhibit-No-KJH-1-Volume-2.pdf>

Public Service Company of New Mexico

<https://www.pnm.com/documents/396023/396193/PNM+2014+IRP/bdcccdd52-b0bc-480b-b1d6-cf76c408fdcf>

PacifiCorp

https://www.rockymountainpower.net/content/dam/pacificorp/doc/Energy_Sources/Integrated_Resource_Plan/2015%20IRP%20Update/2015%20IRP%20Update_20160426.pdf

Arizona Public Service

https://www.aps.com/library/resource%20alt/APS%20Preliminary%202017%20IRP_Resource%20Planning-15-0094_030116.pdf

Tucson Electric Power

<https://www.tep.com/doc/planning/2016-TEP-IRP.pdf>

Nevada Energy

https://www.nvenergy.com/company/rates/filings/IRP/NPC_IRP/ERCR_NPC/Vol4-Narratives.pdf

Sierra Pacific

https://www.nvenergy.com/company/rates/filings/IRP/SPPC_IRP/images/Vol.11SPPCIRPsuppl ynarrativeta383pgs.pdf

Platte River Power Authority

<http://www.prapa.org/wp-content/uploads/2016/04/2017-Western-IRP.pdf>

Colorado Springs Utilities

<https://www.csu.org/pages/eirp-b.aspx>

Tri-State Generation and Transmission Association, Inc.

<http://www.tristategt.org/resourceplanning/documents/2015%20ERP%20Report%20with%20SEC%20FLS%20and%20all%20Appendices.pdf>

Salt River Project

<http://www.srpnet.com/about/financial/pdfx/ResourceStewardship-2014.pdf>

ATTACHMENT K.12:

**ANNUAL SLCA/IP ALLOCATIONS TO
AMERICAN INDIAN TRIBES AND BENEFIT INFORMATION**

K-278

Customer Name	Winter Season		Summer Season		Supplier Responsible for Benefit Crediting	Utility Serving Tribal Reservation
	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)		
Ak-Chin Indian Community	1,920	3,520,881	4,244	7,722,879	N/A	Operate own utility
Bureau of Indian Affairs Colorado River Agency	881	1,593,277	442	883,290	N/A	Bureau of Indian Affairs operated utility
San Carlos Irrigation Project	1,840	3,373, 246	1,366	2,486,780	N/A	Bureau of Indian Affairs operated utility contracted with Gila River Indian Community Utility Authority (GRICUA)
Alamo Navajo Chapter	196	373,654	184	329,415	Tri-State	Socorro Electric Cooperative—Member of Tri-State
Canoncito Navajo Chapter	145	276,206	135	241,351	Tri-State	Continental Divide Electric Cooperative—Member of Tri-State
Cocopah Indian Tribe	1,058	2,022,535	1,281	2,289,809	NTUA	Arizona Public Service Company
Colorado River Indian Tribes	3,772	7,207,343	5,978	10,685,860	Page Electric Utility	Arizona Public Service Company
Confederated Tribes of the Goshute Reservation	62	118,806	39	69,992	Deseret/Mt. Wheeler	Deseret/Mt. Wheeler
Duckwater Shoshone Tribe	67	128,586	69	122,947	Deseret/Mt. Wheeler	Deseret/Mt. Wheeler
Ely Shoshone Tribe	129	246,599	78	138,741	Deseret/Mt. Wheeler	Deseret/Mt. Wheeler
Fort Mojave Indian Tribe	272	520,611	282	504,931	N/A	Operate own utility
Ft. McDowell Mojave-Apache Indian Community	2,270	4,336,951	2,346	4,192,957	SRP	Salt River Project
Gila River Indian Community	13,330	25,473,606	13,920	24,883,872	N/A	Operate own utility
Havasupai Tribe	237	452,237	199	356,282	NTUA	Provided by BIA—Truxton Canon Agency, but power is from Mohave Electric, Member of AEPSCO, which has a SLCA/IP allocation—see APPA Contract No. 87-BCA-10001

K-279

Customer Name	Winter Season		Summer Season		Supplier Responsible for Benefit Crediting	Utility Serving Tribal Reservation
	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)		
Hopi Tribe	2,810	5,369,665	2,716	4,854,810	NTUA	NTUA and Arizona Public Service Company (depends where on reservation)
Hualapai Tribe	609	1,163,130	625	1,118,127	NTUA	Mojave Electric Cooperative
Jicarilla Apache Tribe	735	1,403,805	580	1,036,264	N/A	Operate own utility/buy wholesale from PNM for supplemental
Las Vegas Paiute Tribe	523	999,427	721	1,288,008	NTUA	NV Energy
Mescalero Apache Tribe	990	1,890,996	976	1,743,837	Tri-State	Otero County Electric Cooperative—Member of Tri-State
Nambe Pueblo	65	124,829	59	104,627	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Navajo Agricultural Products Industries	500	2,212,425	22,900	48,833,990	N/A	All Requirements Met by WAPA
Navajo Tribal Utility Authority	48,052	97,612,554	42,614	84,194,098	N/A	Operate own utility. Tucson Electric Power provides other wholesale power resources
Paiute Indian Tribe of Utah	154	294,452	158	282,873	NTUA	PacifiCorp, City of St. George, and Flowell Electric (Tribe fragmented geographically)
Pascua Yaqui Tribe	1,032	1,972,271	1,320	2,360,127	NTUA	TriCo Electric Cooperative—Member of AEPCO, which has a SLCA/IP allocation—see APPA Contract No. 87-BCA-10001
Picuris Pueblo	22	42,183	76	135,363	Tri-State	Kit Carson Electric Cooperative—Member of Tri-State
Pueblo De Cochiti	224	428,910	185	330,732	PNM-non-WAPA customer	Public Service Company of New Mexico

K-280

Customer Name	Winter Season		Summer Season		Supplier Responsible for Benefit Crediting	Utility Serving Tribal Reservation
	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)		
Pueblo of Acoma	410	783,229	420	750,759	Tri-State	Continental Divide Electric Cooperative—Member of Tri-State
Pueblo of Isleta	1,109	2,119,606	1,098	1,962,172	NTUA	Public Service Company of New Mexico
Pueblo of Jemez	265	505,513	214	382,418	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of Laguna	753	1,438,435	742	1,326,495	Tri-State	Continental Divide Electric Cooperative—Member of Tri-State
Pueblo of Pojoaque	271	517,903	208	371,891	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of San Felipe	422	805,473	328	586,285	PNM-non-WAPA customer	Public Service Company of New Mexico
Pueblo of San Ildefonso	64	122,213	63	112,702	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of San Juan	303	579,114	298	533,433	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of Sandia	817	1,561,033	943	1,684,993	PNM-non-WAPA customer	Public Service Company of New Mexico
Pueblo of Santa Clara	264	505,350	214	382,268	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of Santo Domingo	438	837,643	452	807,426	PNM-non-WAPA customer	Public Service Company of New Mexico
Pueblo of Taos	340	649,082	221	395,819	Tri-State	Kit Carson Electric Cooperative—Member of Tri-State

Customer Name	Winter Season		Summer Season		Supplier Responsible for Benefit Crediting	Utility Serving Tribal Reservation
	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)		
Pueblo of Tesuque	598	1,143,446	628	1,121,780	PNM-non-WAPA customer	Public Service Company of New Mexico
Pueblo of Zia	85	161,712	68	122,326	Tri-State	Jemez Mountains Electric Cooperative—Member of Tri-State
Pueblo of Zuni	1,185	2,264,600	1,020	1,822,622	Tri-State	Continental Divide Electric Cooperative—Member of Tri-State
Quechan Indian Tribe	729	1,393,402	505	902,692	N/A	Arizona Public Service Company
Ramah Navajo Chapter	412	786,592	300	536,096	Tri-State	Continental Divide Electric Cooperative—Member of Tri-State
Salt River Pima-Maricopa Indian Community	13,380	25,569,197	16,144	28,858,050	SRP	Salt River Project
San Carlos Apache Tribe	3,780	7,222,993	4,152	7,421,915	NTUA	Arizona Public Service Company
Santa Ana Pueblo	410	783,525	460	822,045	PNM-non-WAPA customer	Public Service Company of New Mexico
Skull Valley Band of Goshute Indians	15	28,290	15	27,269	N/A	PacifiCorp
Southern Ute Indian Tribe	1,174	2,243,756	1,122	2,006,482	Tri-State	La Plata Electric Association—Member of Tri-State
Tohono O’odham Utility Authority	3,044	5,816,784	1,047	1,871,035	N/A	Operate own utility
Tonto Apache Tribe	349	667,470	382	683,459	NTUA	Arizona Public Service Company
Ute Indian Tribe	688	1,315,260	457	816,884	Page Electric Utility	Deseret/Moon Lake Electric
Ute Mountain Ute Tribe	508	970,293	477	852,108	Tri-State	Empire Electric Association—Member of Tri-State

K-281

Customer Name	Winter Season		Summer Season		Supplier Responsible for Benefit Crediting	Utility Serving Tribal Reservation
	Capacity (kW)	Energy (kWh)	Capacity (kW)	Energy (kWh)		
White Mountain Apache Tribe	5,999	11,463,994	5,822	10,407,621	Ak-Chin	Arizona Public Service Company
Wind River Reservation	491	938,332	484	865,612	Tri-State	High Plains Power—Member of Tri-State
Yavapai Apache Nation	1,465	2,800,451	1,893	3,383,533	NTUA	Arizona Public Service Company
Yavapai Prescott Indian Tribe	805	1,538,623	733	1,309,825	NTUA	Arizona Public Service Company
Yomba Shoshone Tribe	30	58,232	31	56,131	NTUA	NV Energy